


SOIL TEST RESULTS


SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	PL. I.	% BY WEIGHT				% PASSING SIEVES		
							C. SAND	F. SAND	SILT	CLAY	10	40	200
S- 57	15	4+25	1.50-2.00	A-7-6(8)	45	27	20.5	34.8	4.5	40.2	100	87	47
S- 58	15	4+25	3.50-4.50	A-4(0)	32	8	3.8	61.3	6.7	28.1	100	98	38
SS- 53	-14	4+89	2.60-3.05	A-4(1)	34	10	4.8	57.5	5.5	32.2	100	97	41
SS- 54	-14	4+89	4.12-4.57	A-6(1)	34	11	1.2	63.7	6.9	28.1	100	100	40
S- 51	10	5+45	1.00-2.00	A-6(4)	31	16	1.2	55.5	9.1	34.2	94	93	48
S- 52	10	5+45	3.00-4.00	A-6(3)	36	17	13.3	48.0	4.5	34.2	99	89	41
S- 48	0	6+00	6.00-7.00	A-7-6(18)	47	24	1.2	57.3	9.3	32.2	100	99	75

-RAMP B-

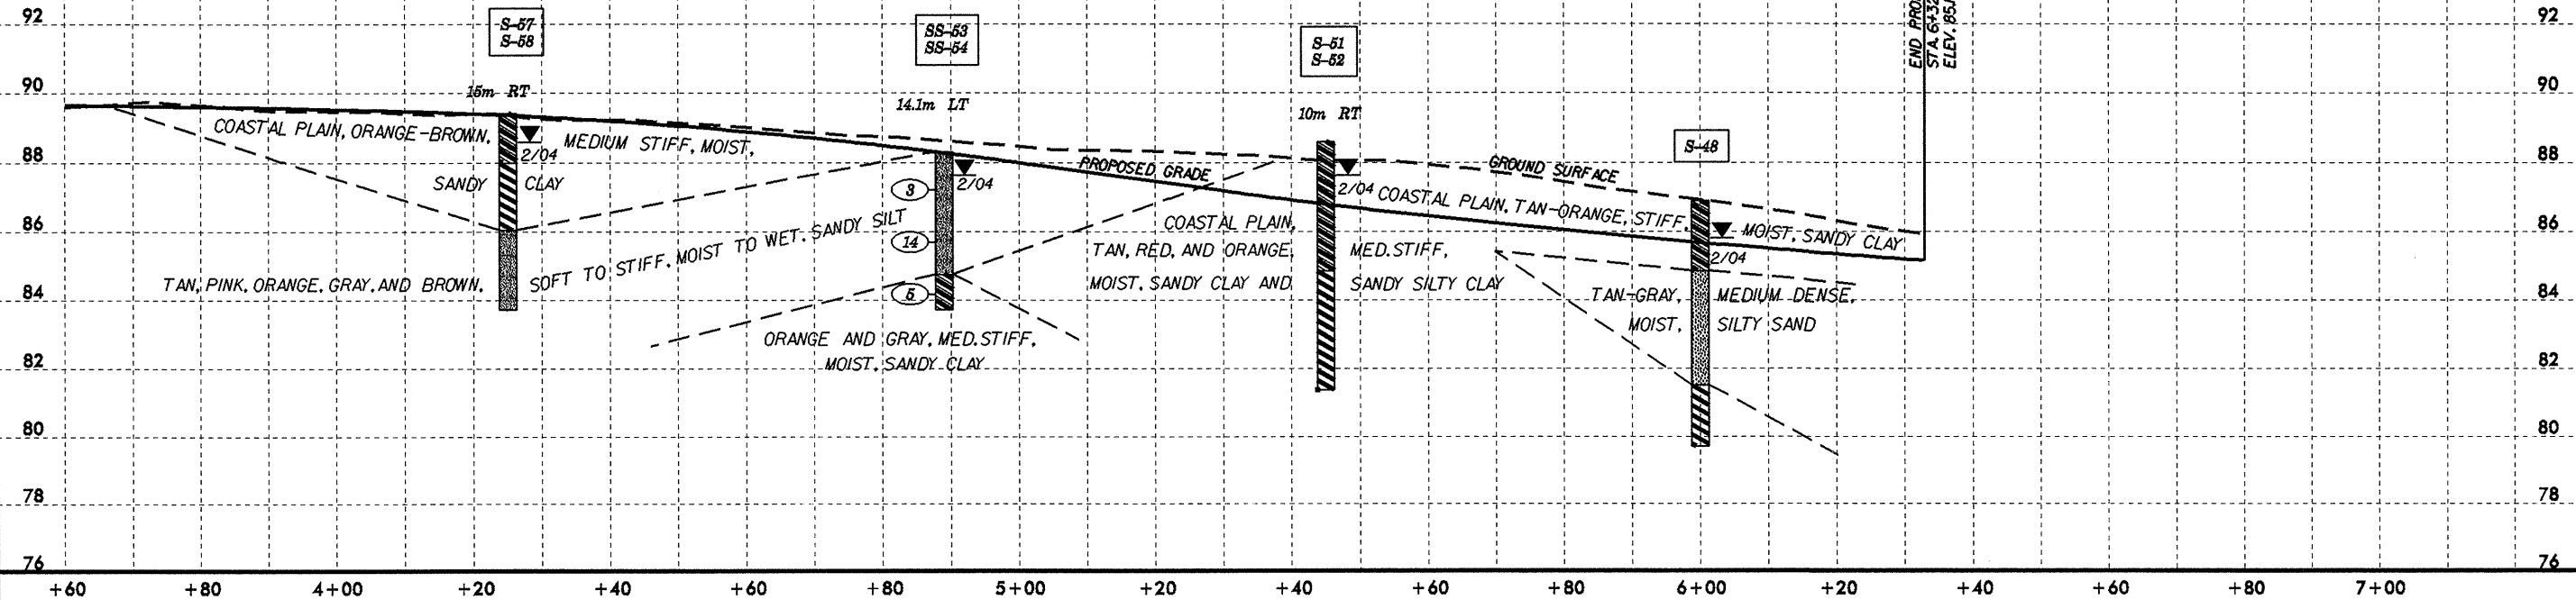

-LOOP B-

- UNSUITABLE UNCLASSIFIED EXCAVATION
- PROPOSED UNDERCUT

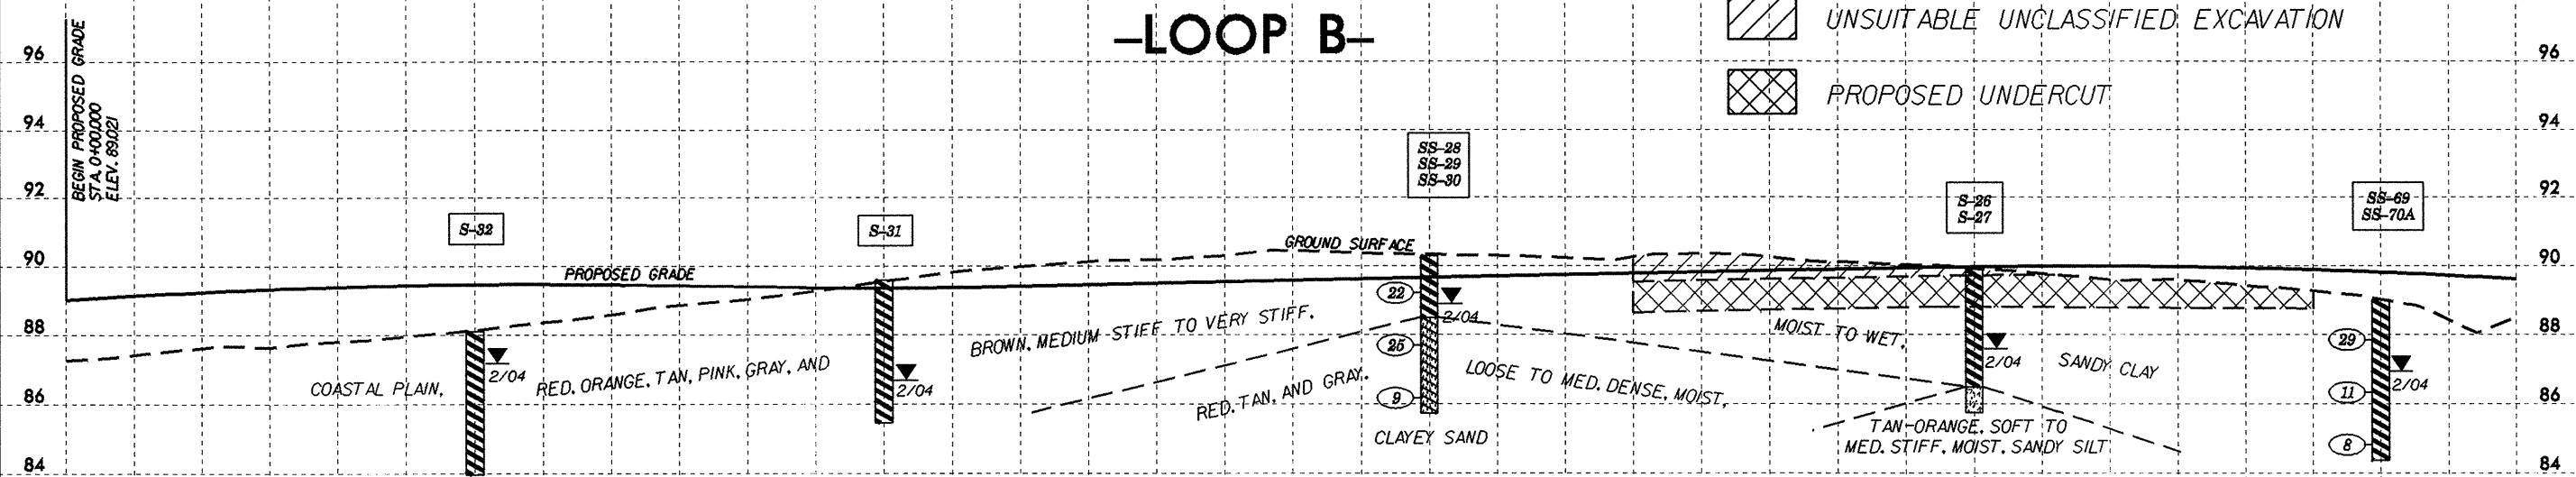

SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	PL. I.	% BY WEIGHT				% PASSING SIEVES		
							C. SAND	F. SAND	SILT	CLAY	10	40	200
S- 32	0	0+60	3.50-4.00	A-7-6(11)	46	19	10.1	44.9	10.8	34.2	100	94	63
S- 31	0	1+20	2.50-3.00	A-7-6(9)	47	25	7.5	45.7	6.5	40.3	100	96	51
SS- 28	0	2+00	1.08-1.53	A-7-6(4)	44	17	30.2	28.0	7.6	34.2	100	83	45
SS- 29	0	2+00	2.60-3.05	A-2-6(1)	37	15	47.7	26.8	5.3	20.1	96	69	27
SS- 30	0	2+00	4.12-4.57	A-2-6(1)	35	13	17.5	49.3	6.9	26.2	100	91	35
S- 26	0	2+80	1.00-1.50	A-7-6(11)	54	29	34.6	16.5	8.6	40.3	98	77	50
S- 27	0	2+80	3.50-4.00	A-5(1)	46	2	5.8	47.3	6.5	40.3	97	94	49
SS- 69	0	3+40	1.16-1.61	A-7-6(3)	42	17	18.9	41.4	7.5	32.2	97	85	41
SS- 70A	0	3+40	2.68-3.13	A-7-6(6)	41	20	1.6	55.7	6.5	36.2	100	99	48