


-Y3-

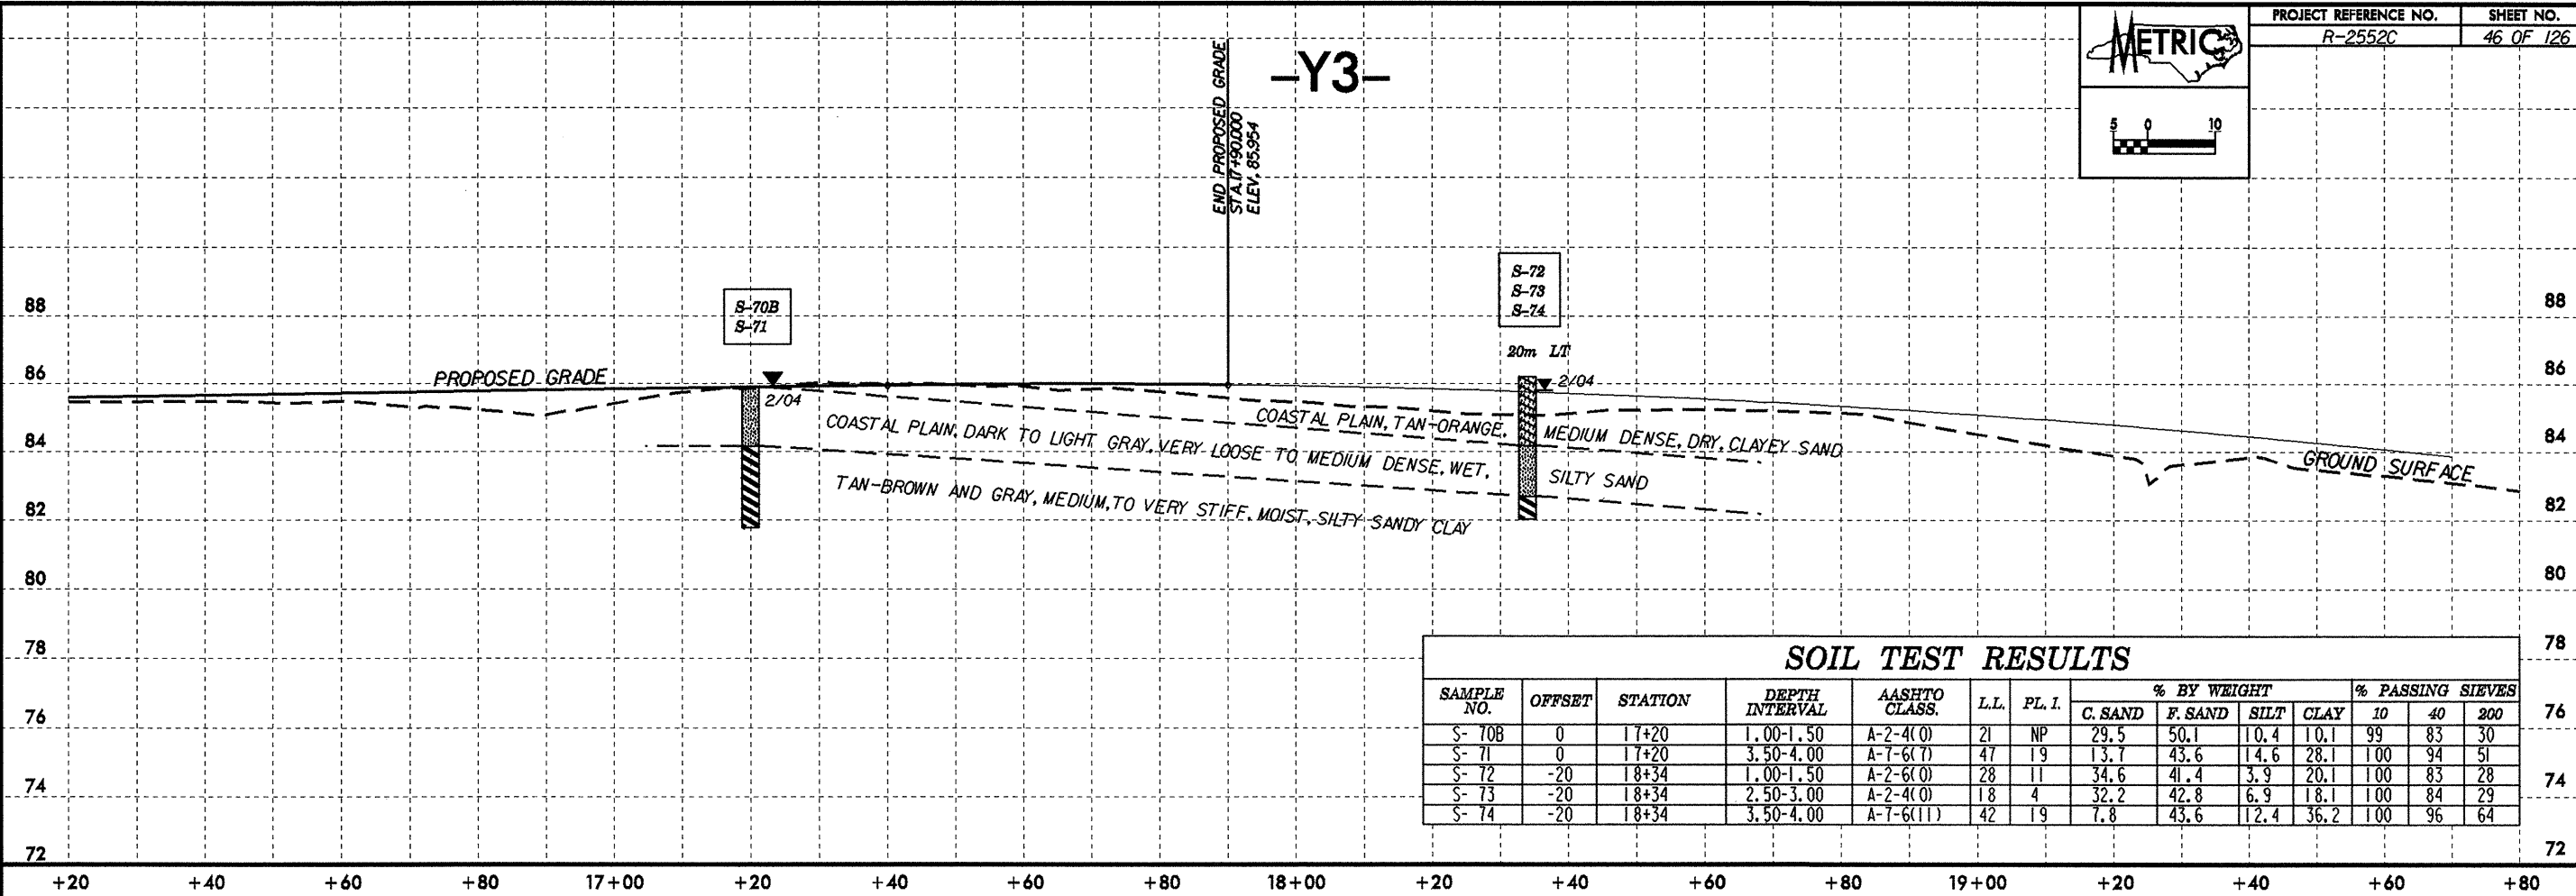

SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.L. I.	% BY WEIGHT				% PASSING SIEVES		
							C. SAND	F. SAND	SILT	CLAY	10	40	200
S-70B	0	17+20	1.00-1.50	A-2-4(0)	21	NP	29.5	50.1	10.4	10.1	99	83	30
S-71	0	17+20	3.50-4.00	A-1-6(7)	47	19	13.7	43.6	14.6	28.1	100	94	51
S-72	-20	18+34	1.00-1.50	A-2-6(0)	28	11	34.6	41.4	3.9	20.1	100	83	28
S-73	-20	18+34	2.50-3.00	A-2-4(0)	18	4	32.2	42.8	6.9	18.1	100	84	29
S-74	-20	18+34	3.50-4.00	A-1-6(11)	42	19	7.8	43.6	12.4	36.2	100	96	64

-Y4-

