
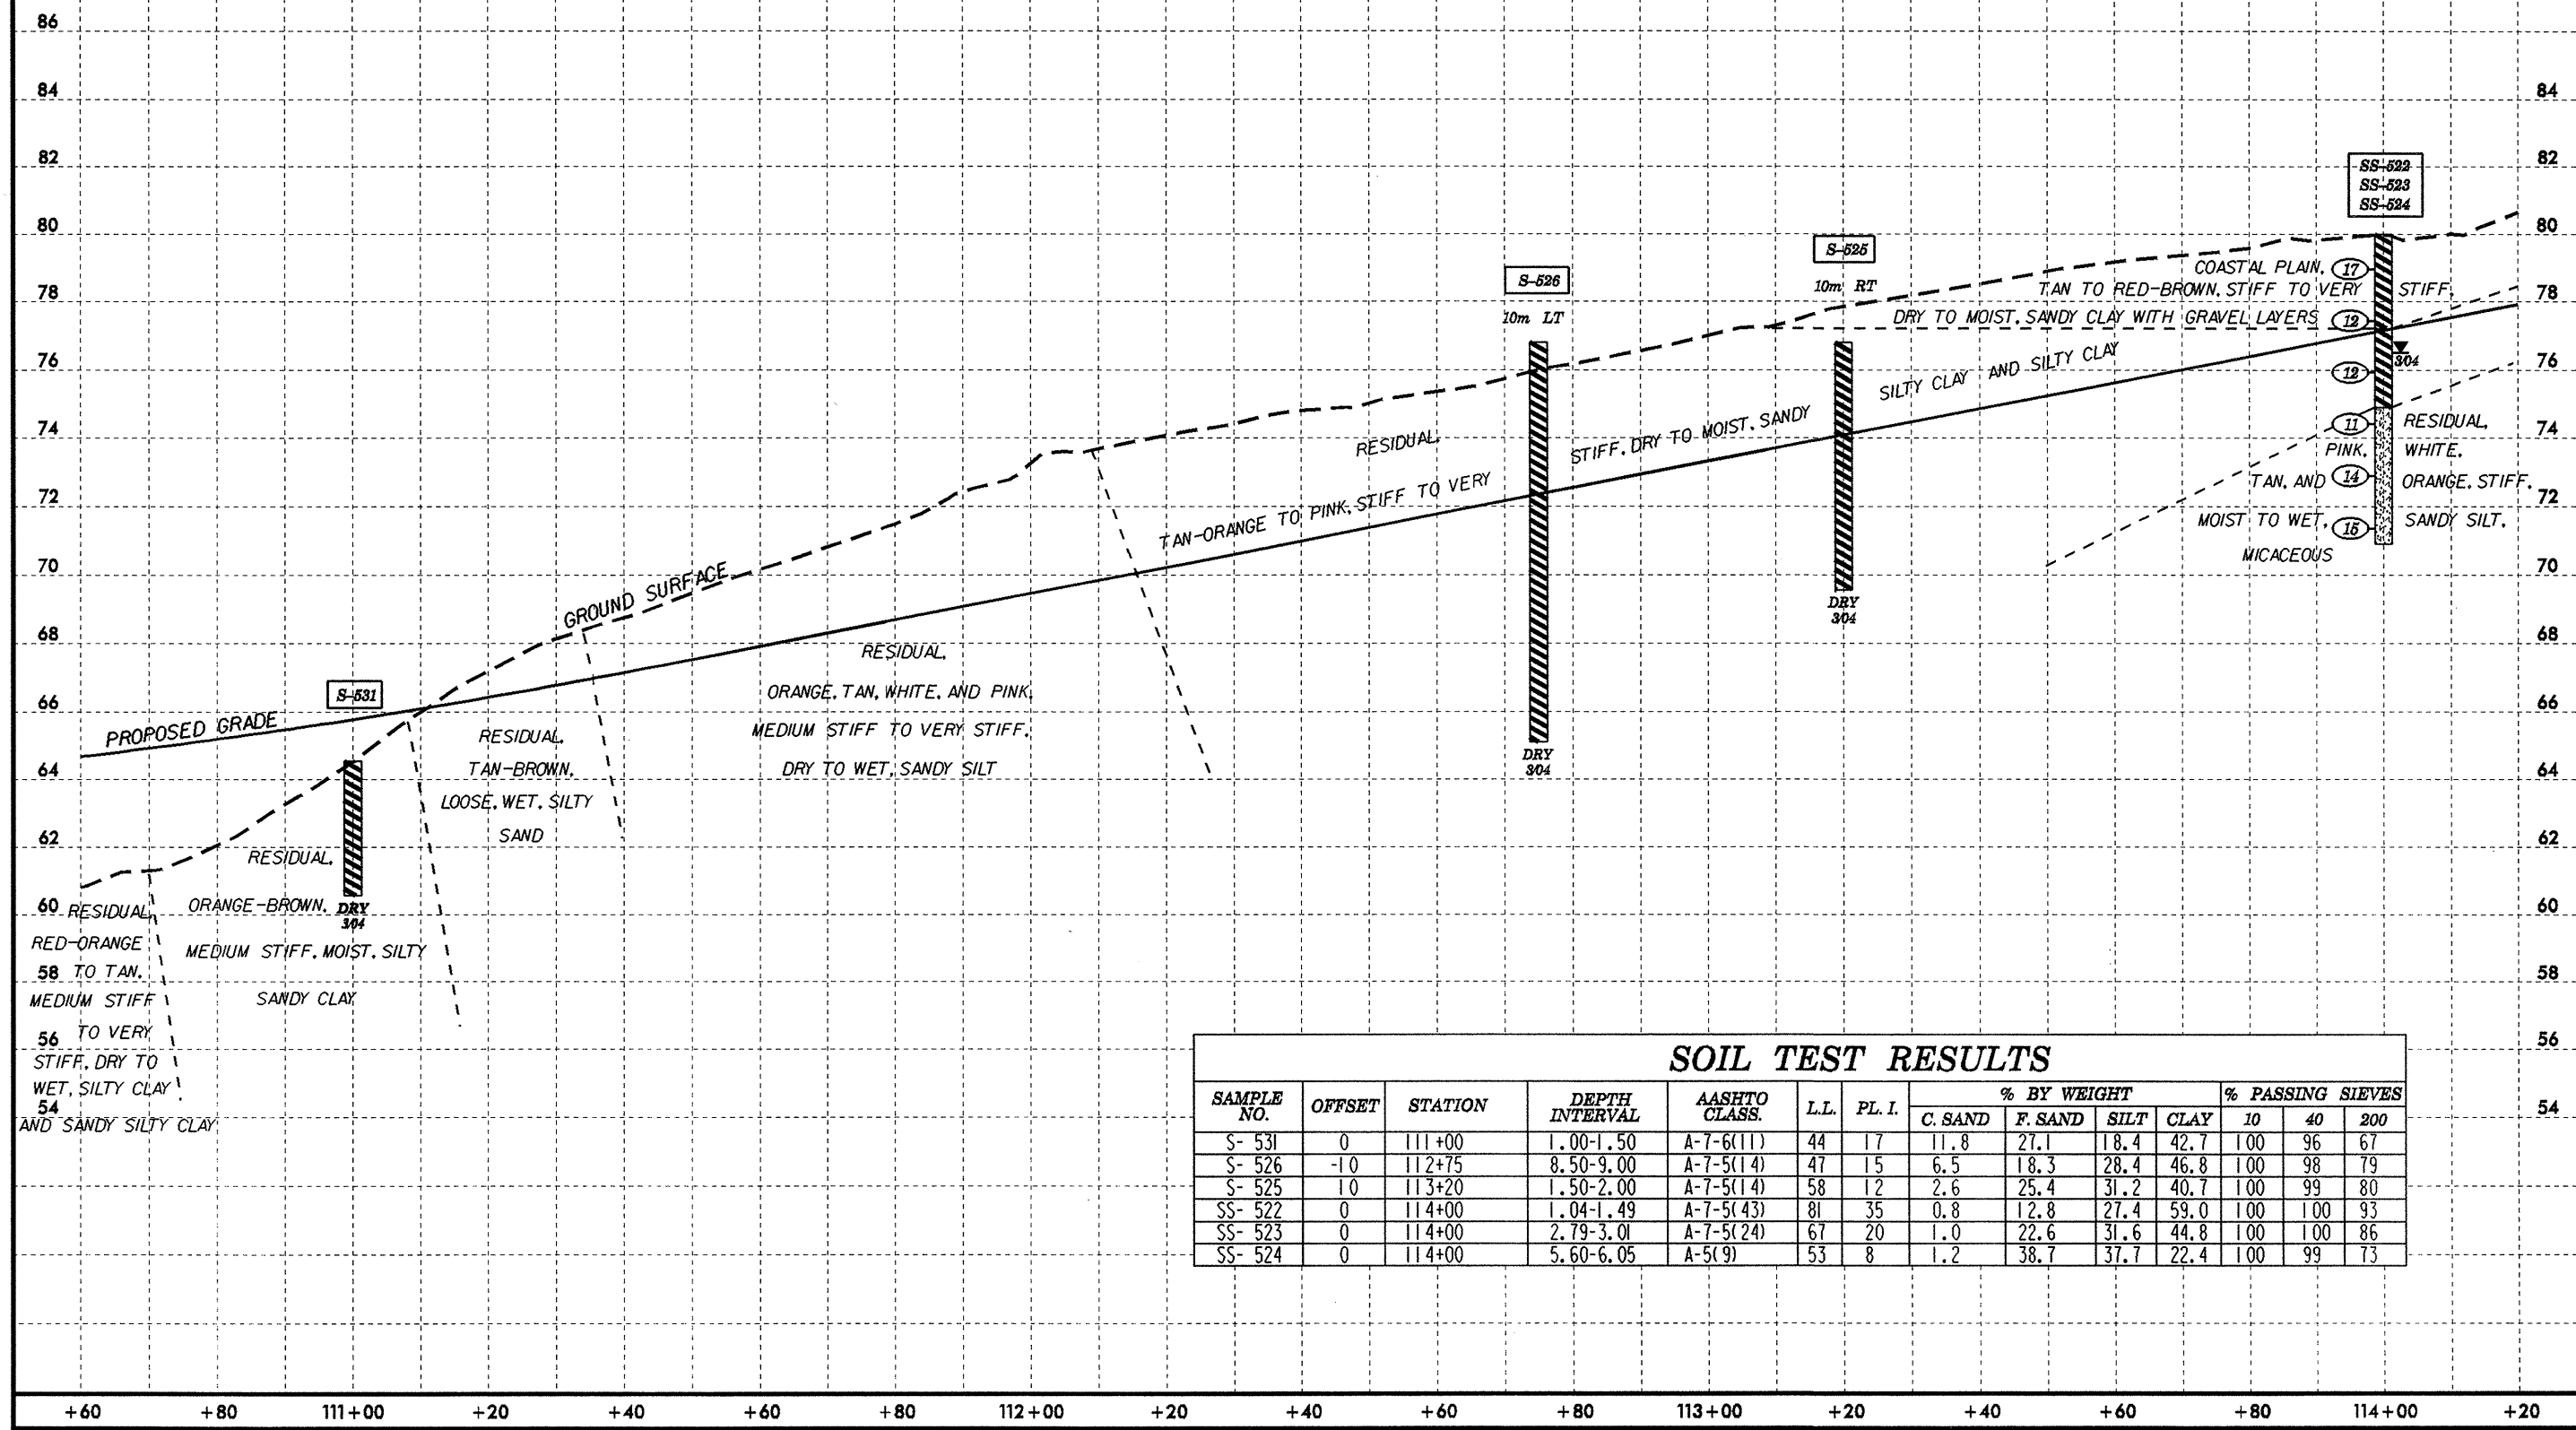


# -L2LT-



### SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	PL. I.	% BY WEIGHT				% PASSING SIEVES		
							C. SAND	F. SAND	SILT	CLAY	10	40	200
S- 531	0	111+00	1.00-1.50	A-7-6(11)	44	17	11.8	27.1	18.4	42.7	100	96	67
S- 526	-10	112+75	8.50-9.00	A-7-5(14)	47	15	6.5	18.3	28.4	46.8	100	98	79
S- 525	10	113+20	1.50-2.00	A-7-5(14)	58	12	2.6	25.4	31.2	40.7	100	99	80
SS- 522	0	114+00	1.04-1.49	A-7-5(43)	81	35	0.8	12.8	27.4	59.0	100	100	93
SS- 523	0	114+00	2.79-3.01	A-7-5(24)	67	20	1.0	22.6	31.6	44.8	100	100	86
SS- 524	0	114+00	5.60-6.05	A-5(9)	53	8	1.2	38.7	37.7	22.4	100	99	73