


### SOIL TEST RESULTS

| SAMPLE NO. | OFFSET | STATION | DEPTH INTERVAL | AASHTO CLASS. | LL | P.I. | % BY WEIGHT |         |      |      | % PASSING (SIEVES) |    |     | % MOISTURE | % ORGANIC |
|------------|--------|---------|----------------|---------------|----|------|-------------|---------|------|------|--------------------|----|-----|------------|-----------|
|            |        |         |                |               |    |      | C. SAND     | F. SAND | SILT | CLAY | 10                 | 40 | 200 |            |           |
| SS-469     | CL     | 19+40   | 0.15-0.60      | A-2-4(0)      | 15 | NP   | 45.0        | 31.3    | 13.7 | 10.0 | 100                | 73 | 27  |            |           |
| SS-470     | CL     | 19+40   | 1.17-1.62      | A-7-6(17)     | 62 | 39   | 32.1        | 17.7    | 14.1 | 36.1 | 99                 | 78 | 53  |            |           |
| SS-471     | CL     | 19+40   | 2.64-3.14      | A-7-5(4)      | 49 | 12   | 30.5        | 28.3    | 31.1 | 10.0 | 100                | 81 | 49  |            |           |
| SS-472     | CL     | 19+40   | 4.21-4.66      | A-4(1)        | 36 | 10   | 37.6        | 27.5    | 24.9 | 10.0 | 98                 | 74 | 41  |            |           |
| SS-473     | CL     | 19+40   | 7.25-7.70      | A-4(0)        | 40 | NP   | 37.8        | 30.7    | 23.5 | 8.0  | 98                 | 72 | 37  |            |           |
| S-492      | CL     | 13+80   | 0.15-1.00      | A-4(0)        | 23 | 10   | 39.5        | 27.8    | 12.5 | 20.3 | 98                 | 75 | 36  |            |           |
| S-468      | CL     | 13+80   | 2.00-3.00      | A-7-6(9)      | 45 | 26   | 31.3        | 24.1    | 16.5 | 28.1 | 100                | 81 | 50  |            |           |
| S-464      | CL     | 19+60   | 0.15-1.00      | A-7-5(21)     | 65 | 34   | 23.7        | 16.3    | 15.9 | 44.2 | 100                | 84 | 63  |            |           |
| S-252      | CL     | 20+05   | 0.40-1.05      | A-7-5(42)     | 77 | 46   | 7.4         | 12.9    | 17.3 | 62.4 | 100                | 97 | 82  | -          | -         |
| S-253      | CL     | 20+05   | 2.90-3.10      | A-7-6(6)      | 42 | 17   | 26.4        | 24.9    | 20.5 | 28.2 | 100                | 84 | 53  | -          | -         |
| S-254      | CL     | 20+05   | 3.50-3.90      | A-5(2)        | 41 | 9    | 31.6        | 27.2    | 21.1 | 20.1 | 100                | 80 | 47  | -          | -         |

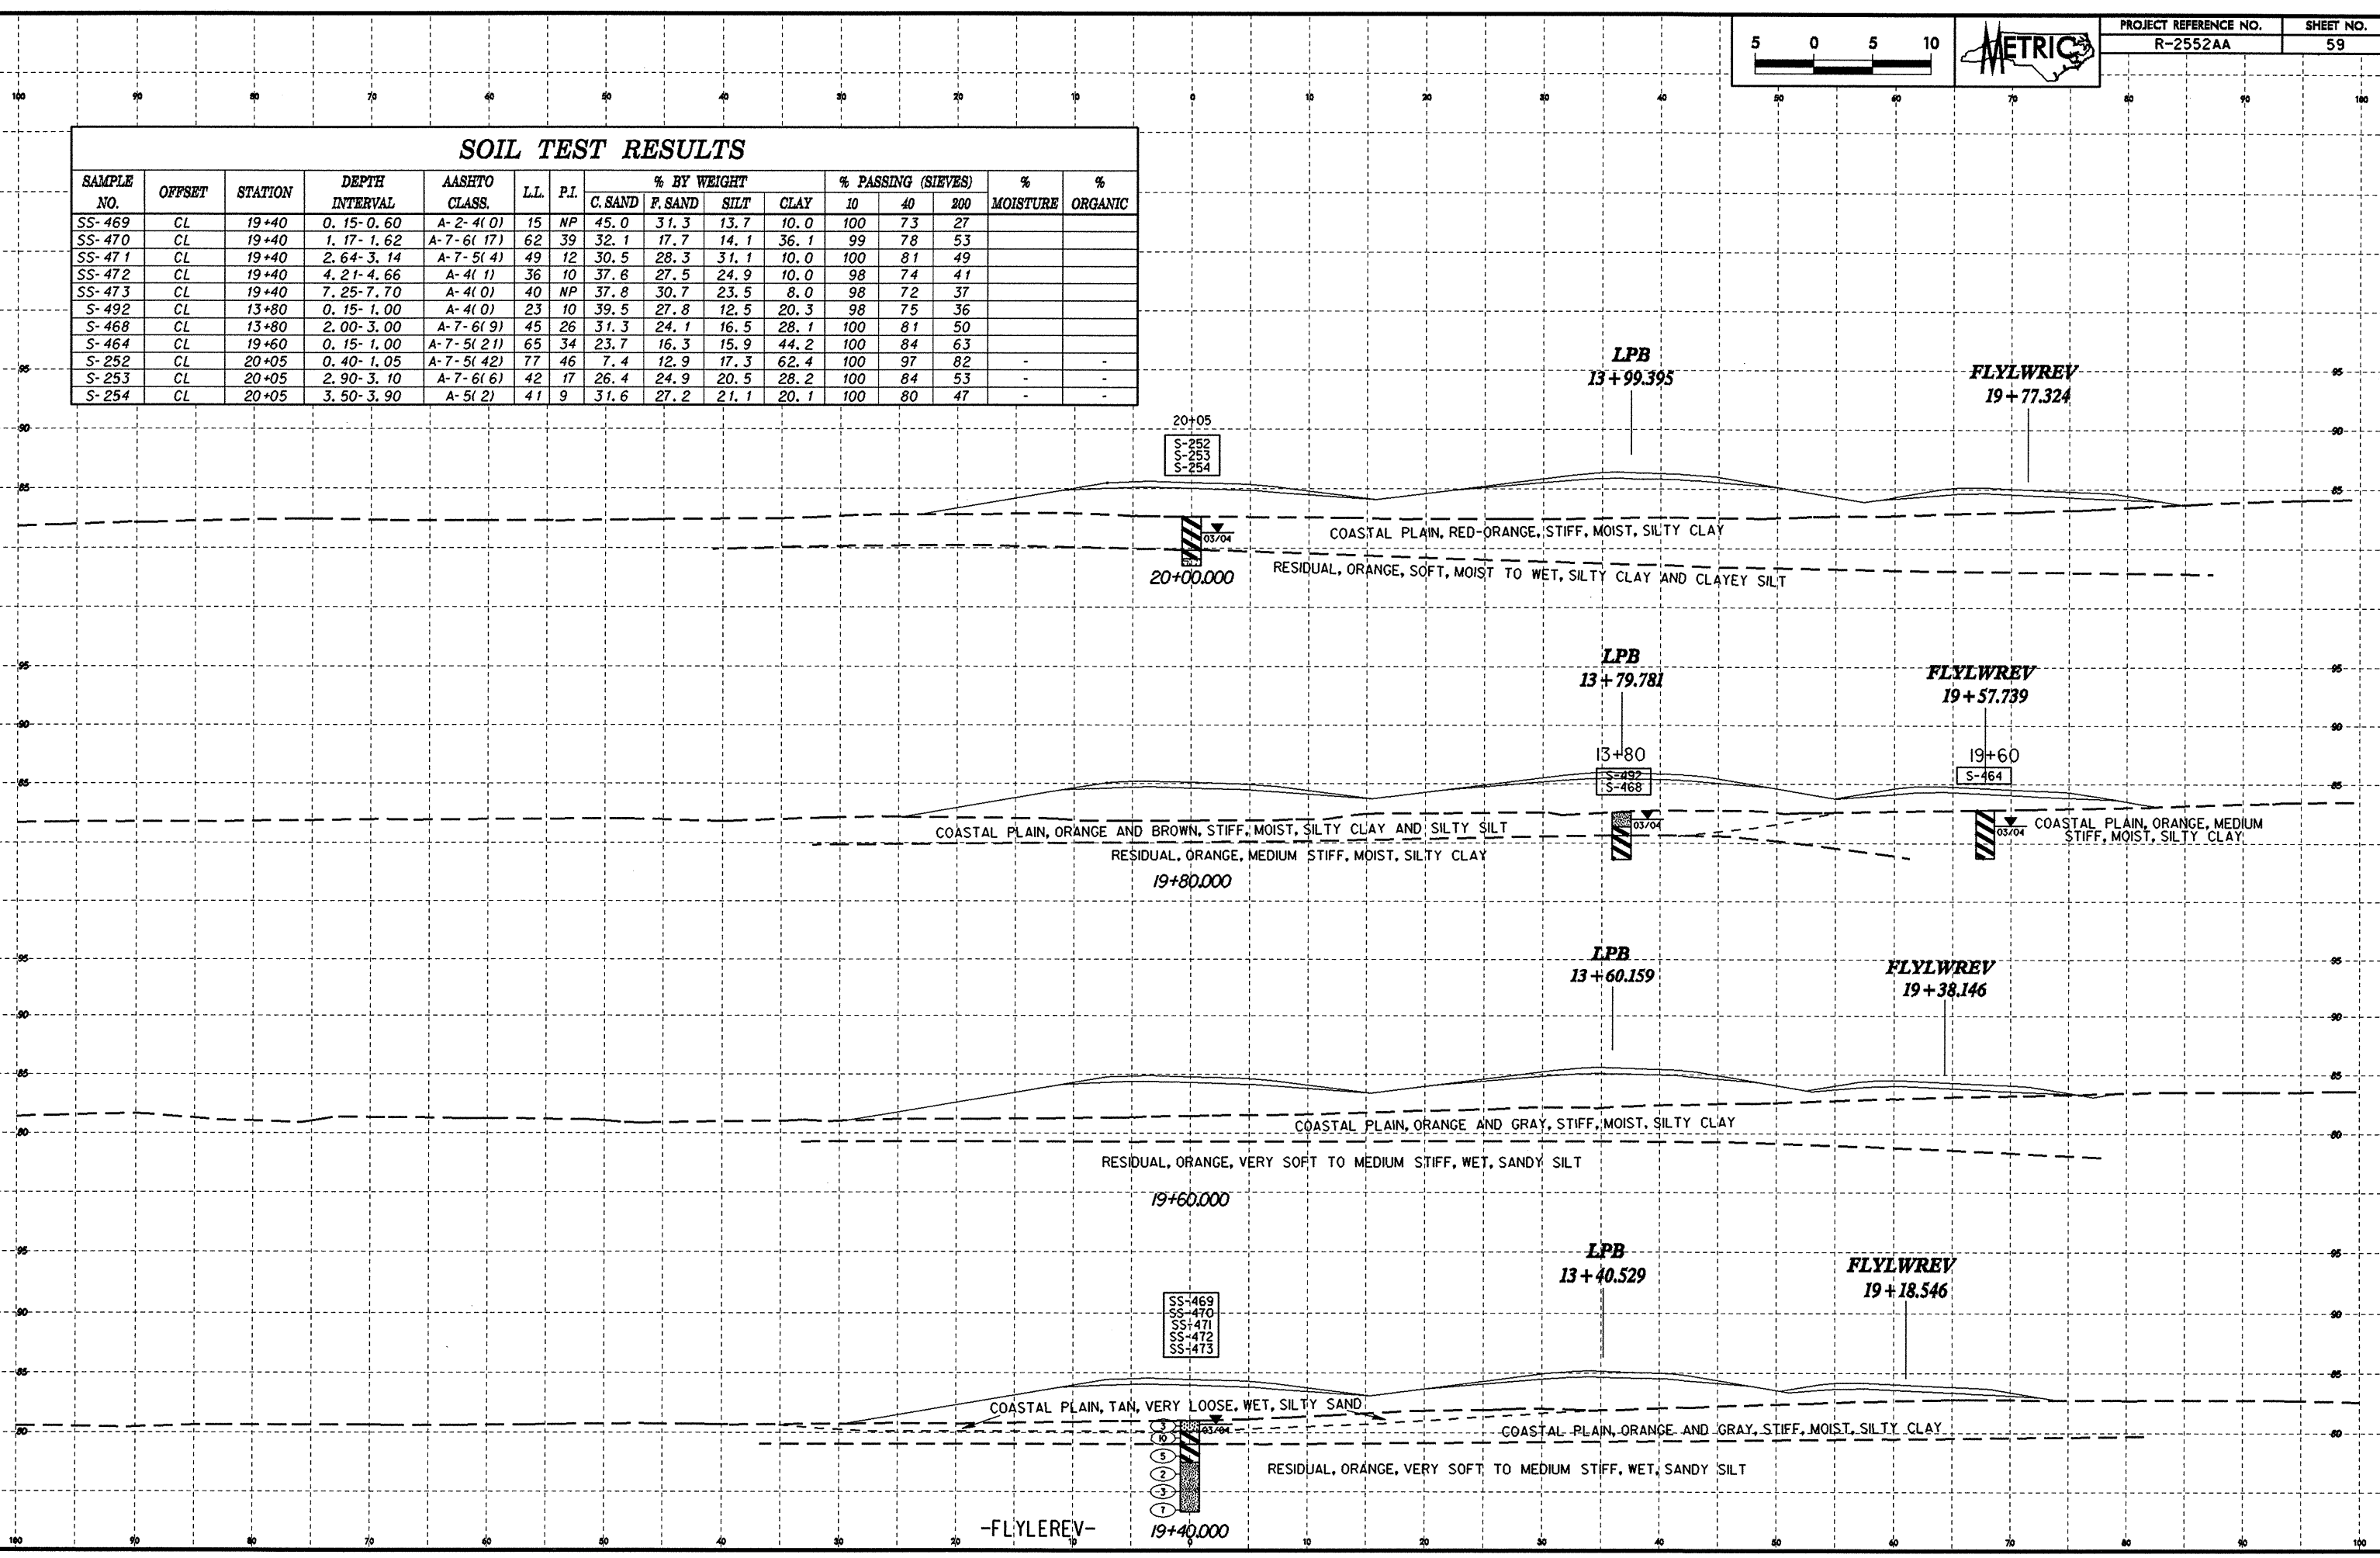

20+05  
S-252  
S-253  
S-254

LPB  
13+99.395

FLYLWREV  
19+77.324

20+00.000

LPB  
13+79.781

FLYLWREV  
19+57.739

13+80  
S-492  
S-468

19+60  
S-464

19+80.000

LPB  
13+60.159

FLYLWREV  
19+38.146

19+60.000

LPB  
13+40.529

FLYLWREV  
19+18.546

SS-469  
SS-470  
SS-471  
SS-472  
SS-473

19+40.000

-FLYLREV-