




50 40 30 20 10 0 10 20 30 40 50

SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.I.	% BY WEIGHT				% PASSING (SIEVES)			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
SS-113	CL	14+20	1.00-1.45	A-7-5(31)	81	31	11.3	11.9	10.6	66.3	100	94	79	54.7	-
SS-114	CL	14+20	2.52-2.97	A-7-5(16)	61	22	10.5	28.3	21.0	40.2	100	96	67	-	-
SS-115	CL	14+20	4.04-4.49	A-7-5(10)	59	17	17.7	30.4	19.8	32.2	100	93	58	42.9	-
SS-116	CL	14+20	5.56-6.01	A-7-5(16)	69	19	10.5	29.5	27.8	32.2	100	95	67	-	-
SS-117	CL	14+80	0.00-3.97	A-6(2)	35	16	27.5	38.8	1.5	32.2	100	90	38	-	-

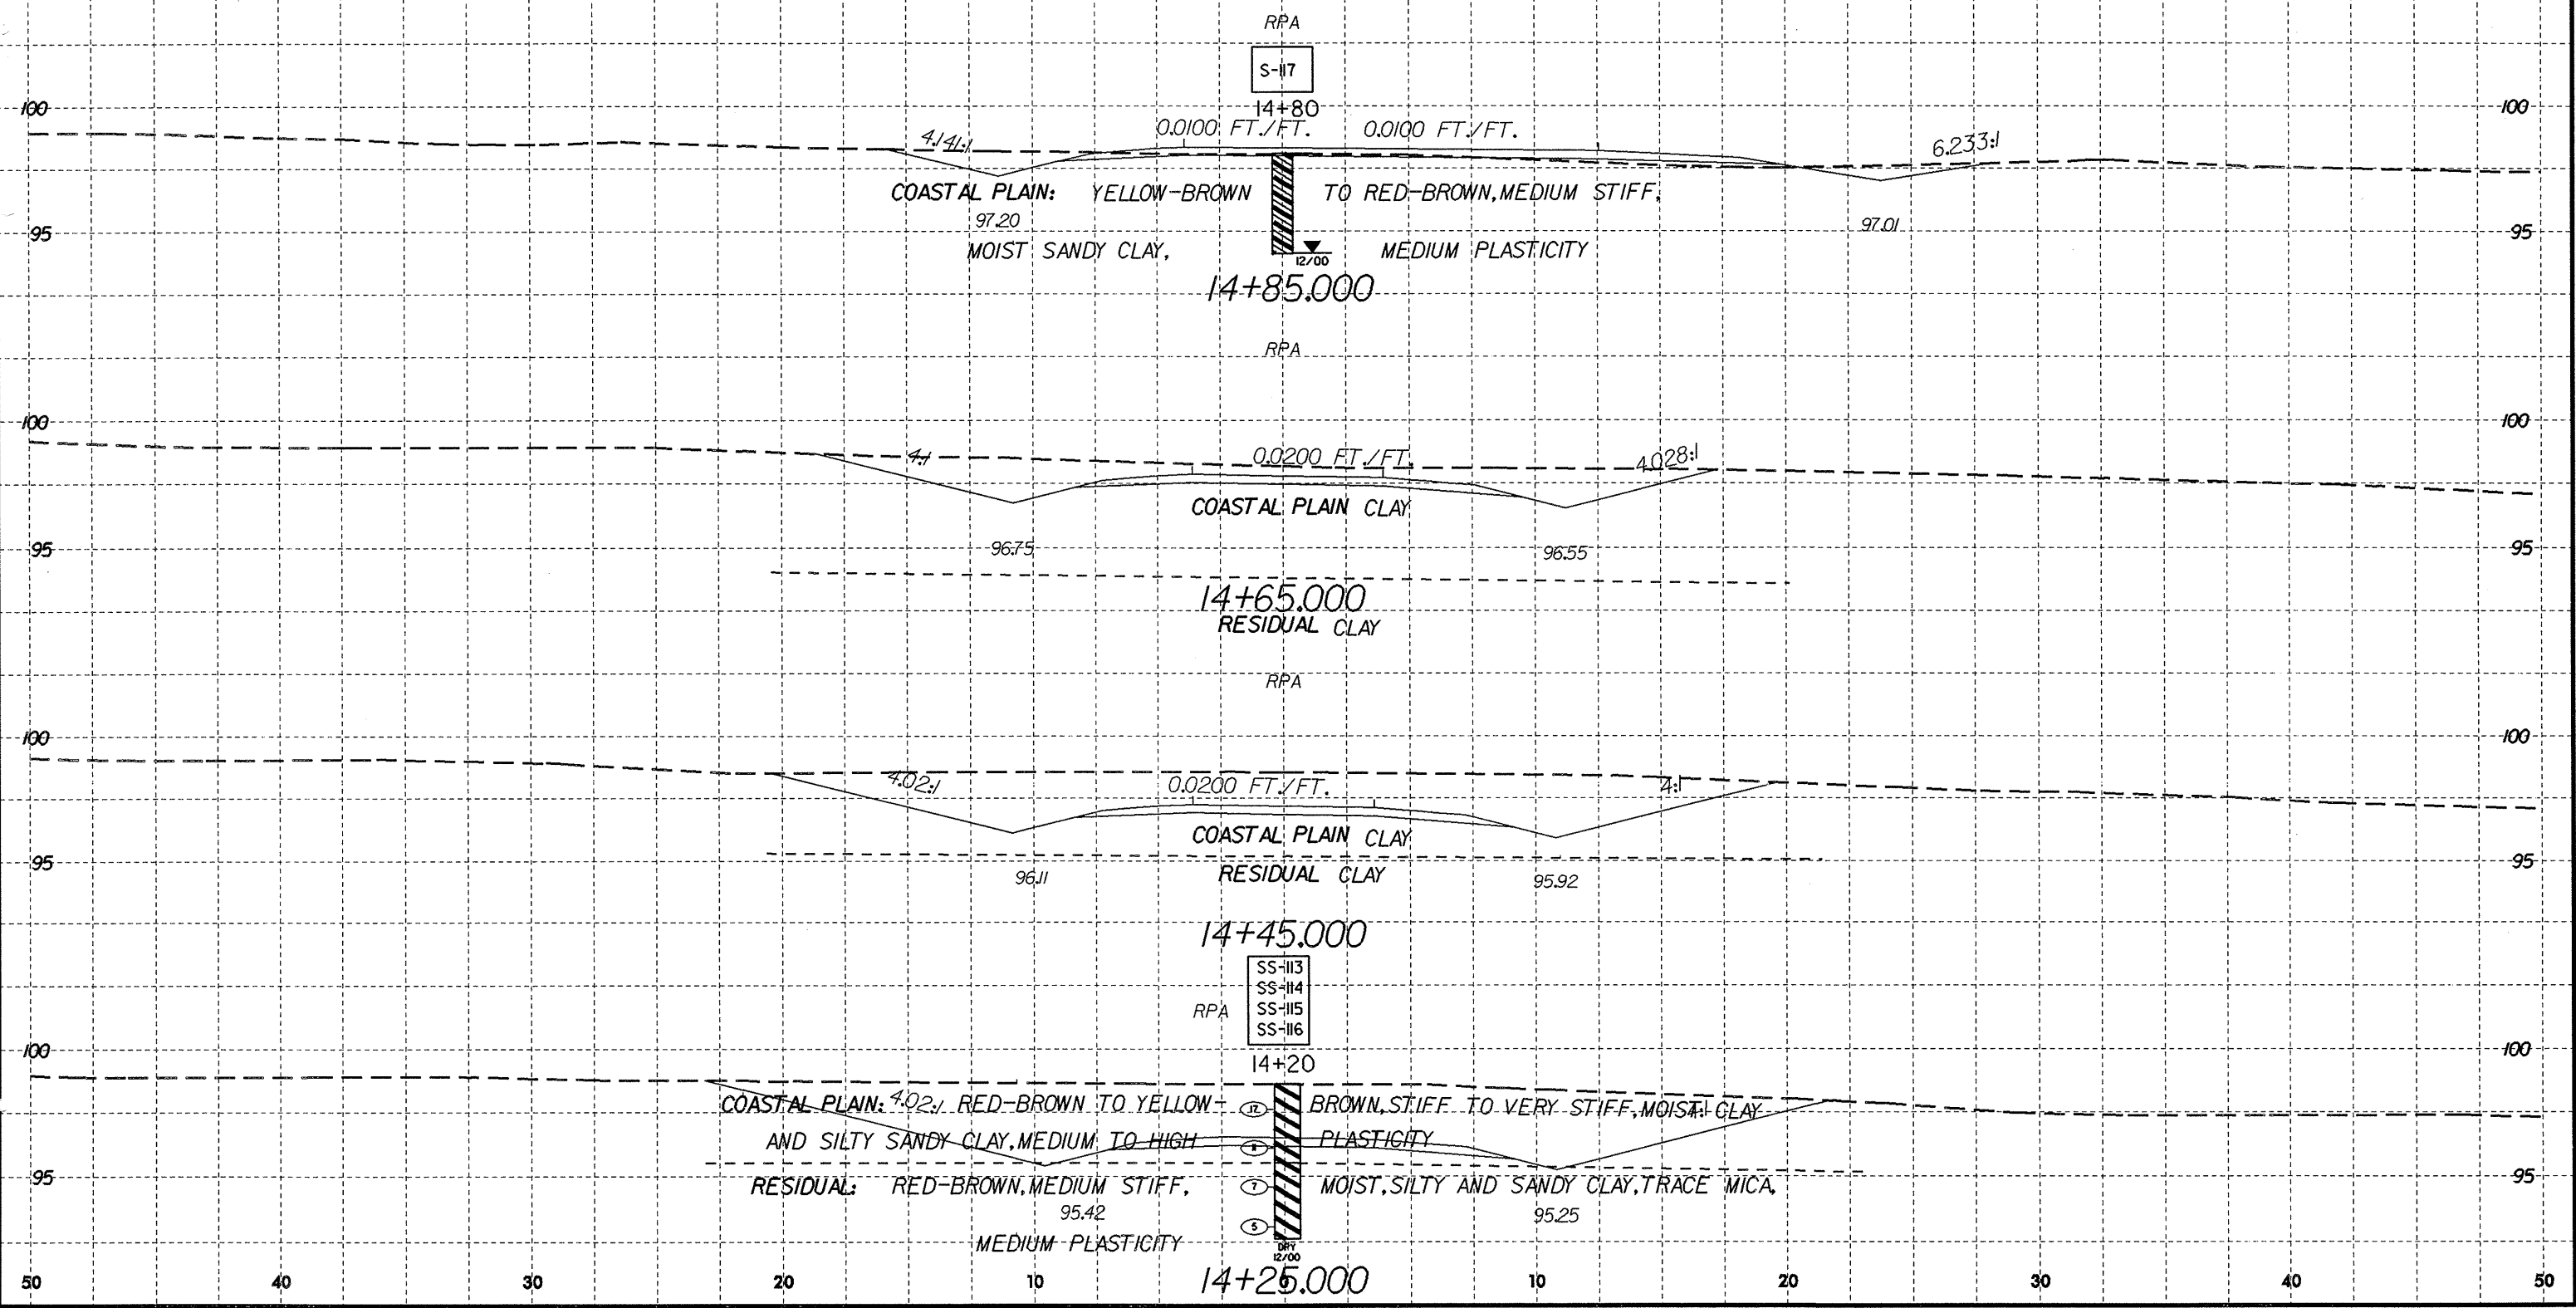

 SYSTEMS
