


SOIL TEST RESULTS															
SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	LL	P.I.	% BY WEIGHT				% PASSING (SIEVES)			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
S-105	CL	12+60	2.00-4.02	A-7-5(8)	56	12	15.7	29.9	20.2	34.2	100	94	59	-	-

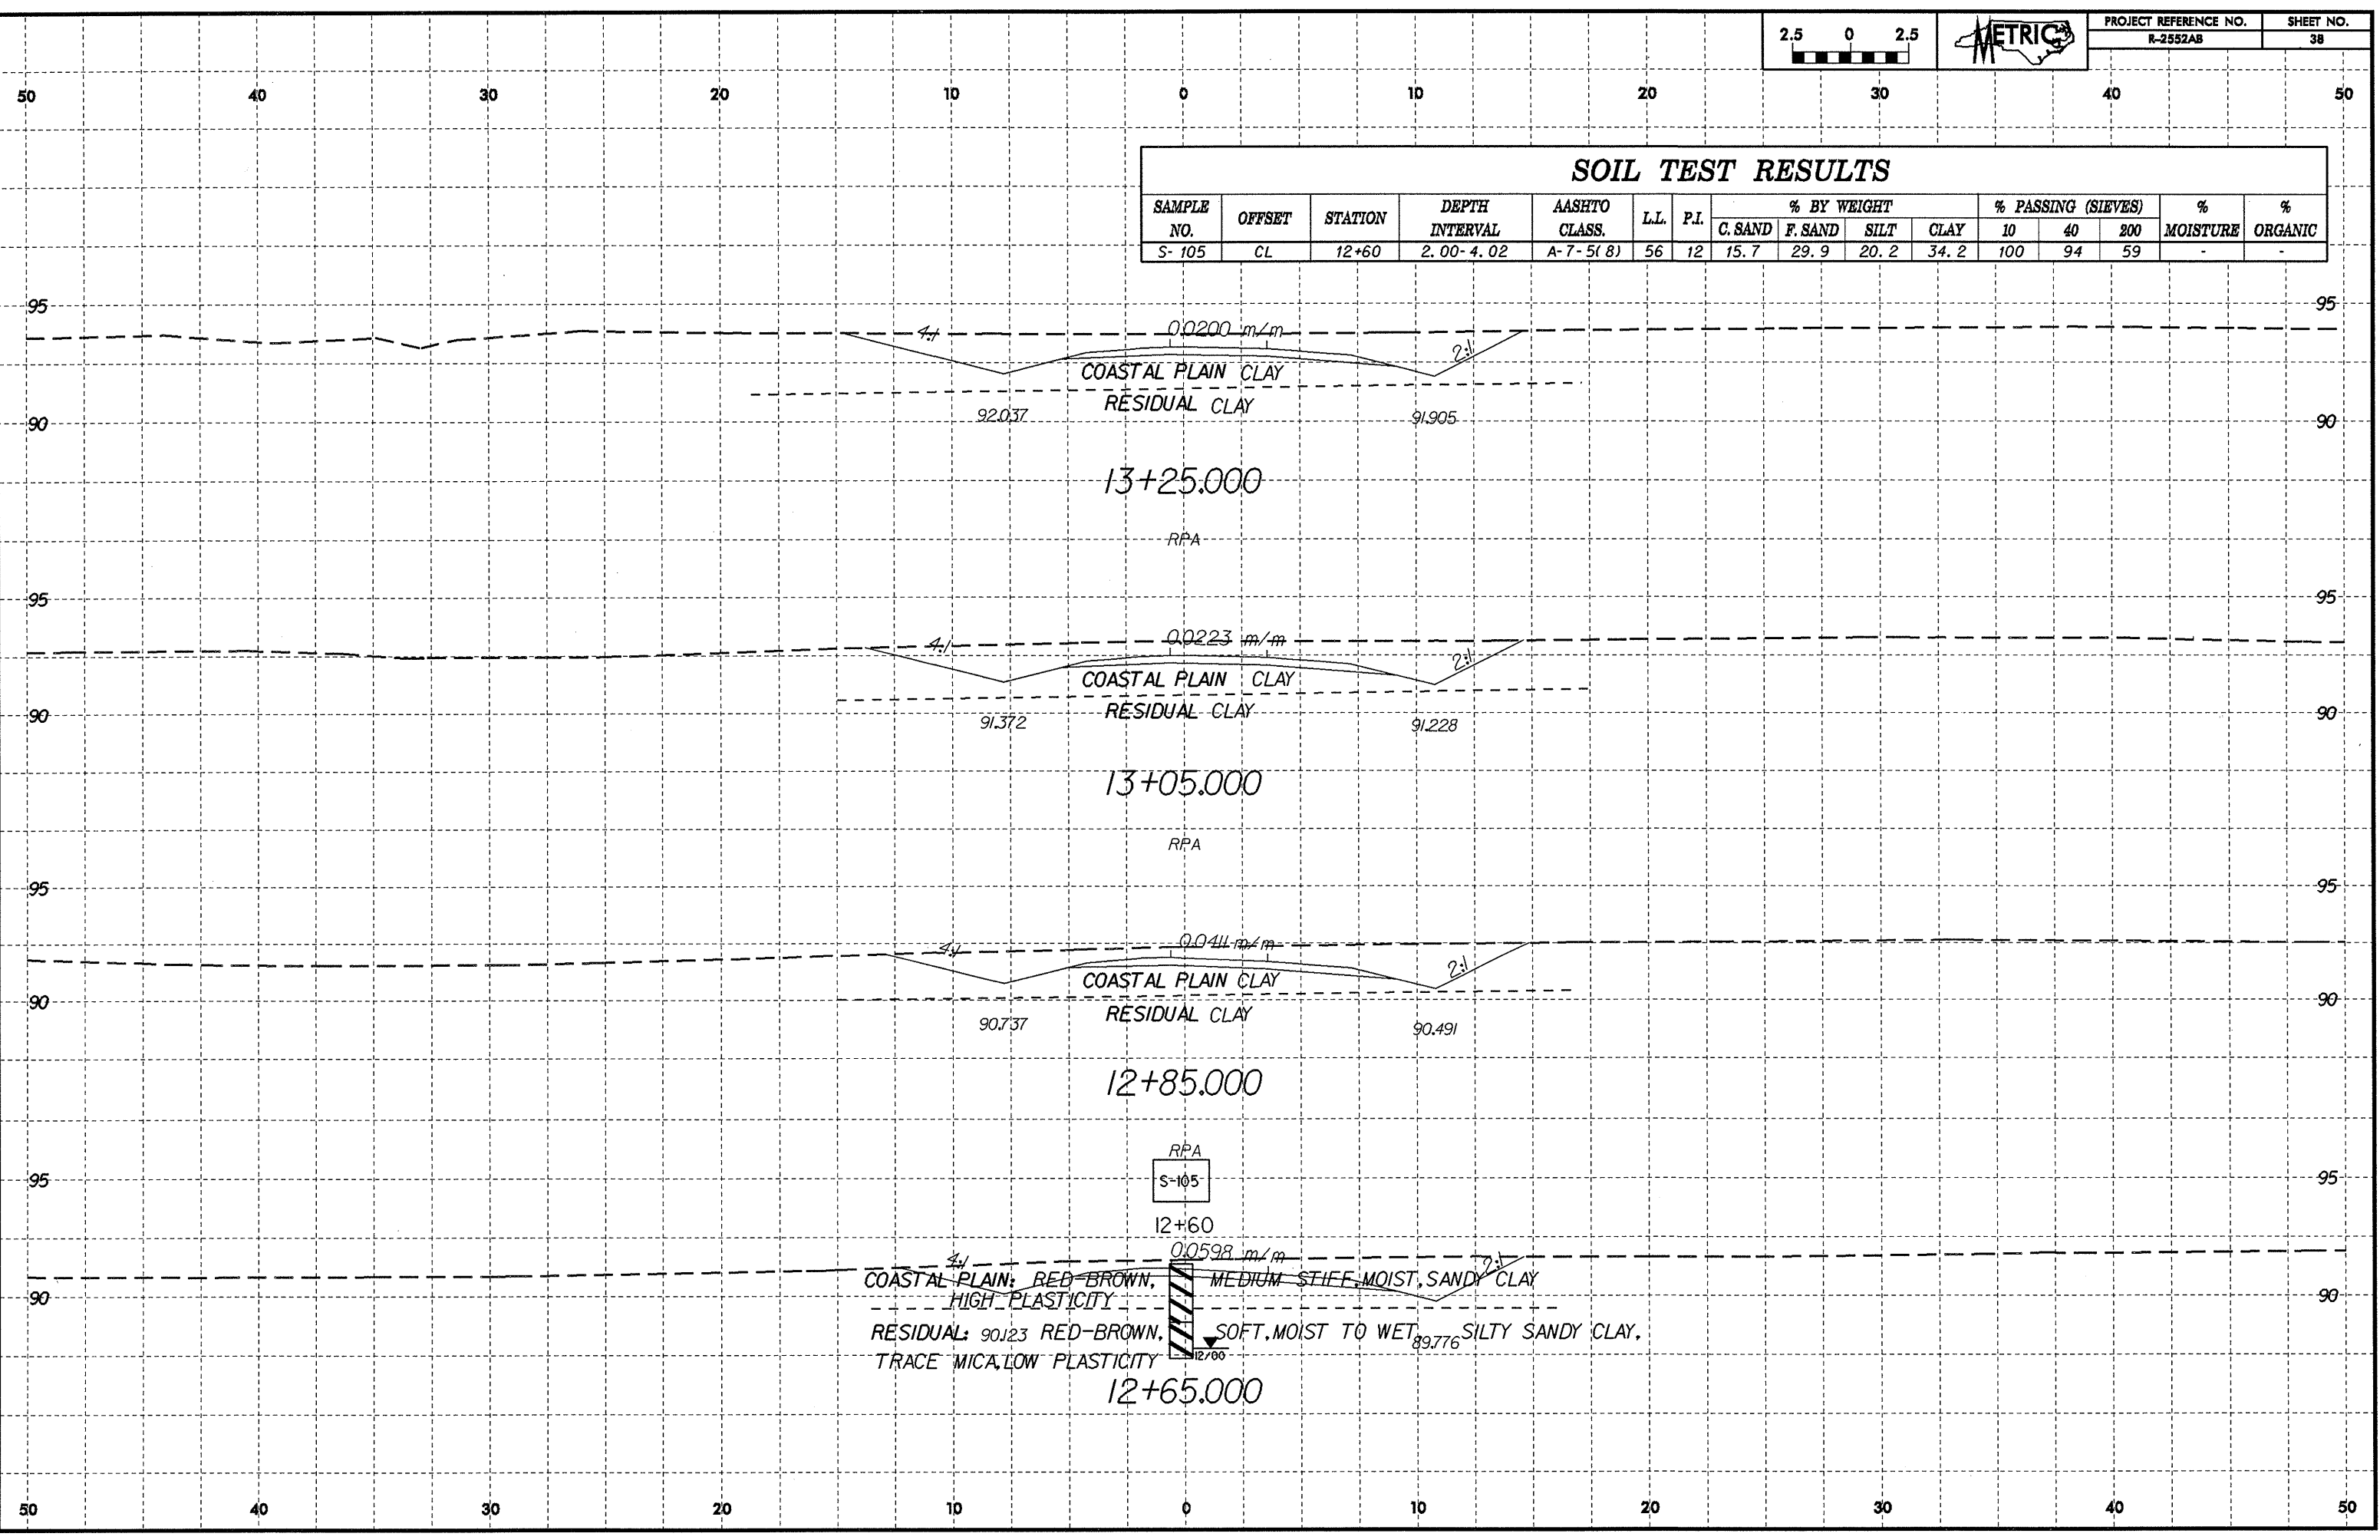

SYSTEMS
 12/10/00