


SOIL TEST RESULTS															
SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	LL	P.I.	% BY WEIGHT				% PASSING (SIEVES)			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
ST-2	30M LT	36+96	0.50-1.11	A-4(0)	19	3	30.7	33.1	20.2	16.0	97	82	39	12.0	-
SS-68	30M LT	36+96	1.07-1.52	A-4(0)	23	4	25.6	27.8	24.1	22.5	100	86	50	33.0	-
SS-69	30M LT	36+96	1.83-2.28	A-2-4(0)	20	2	52.4	31.1	4.2	12.3	82	56	16	-	-
SS-70	30M LT	36+96	2.59-3.04	A-5(1)	41	10	52.8	9.4	25.5	12.3	100	60	39	29.4	-
SS-71	CL	37+20	1.08-1.53	A-2-4(0)	24	7	44.8	23.1	19.8	12.3	96	64	35	25.1	-
SS-72	CL	37+20	2.58-3.03	A-6(4)	30	12	17.0	33.6	26.9	22.5	100	92	55	-	-
SS-73	CL	37+20	4.10-4.55	A-4(3)	35	5	13.9	27.0	26.3	32.8	100	94	63	-	-
SS-74	CL	37+20	7.14-7.59	A-4(0)	31	NP	36.0	34.6	21.2	8.2	99	78	36	-	-

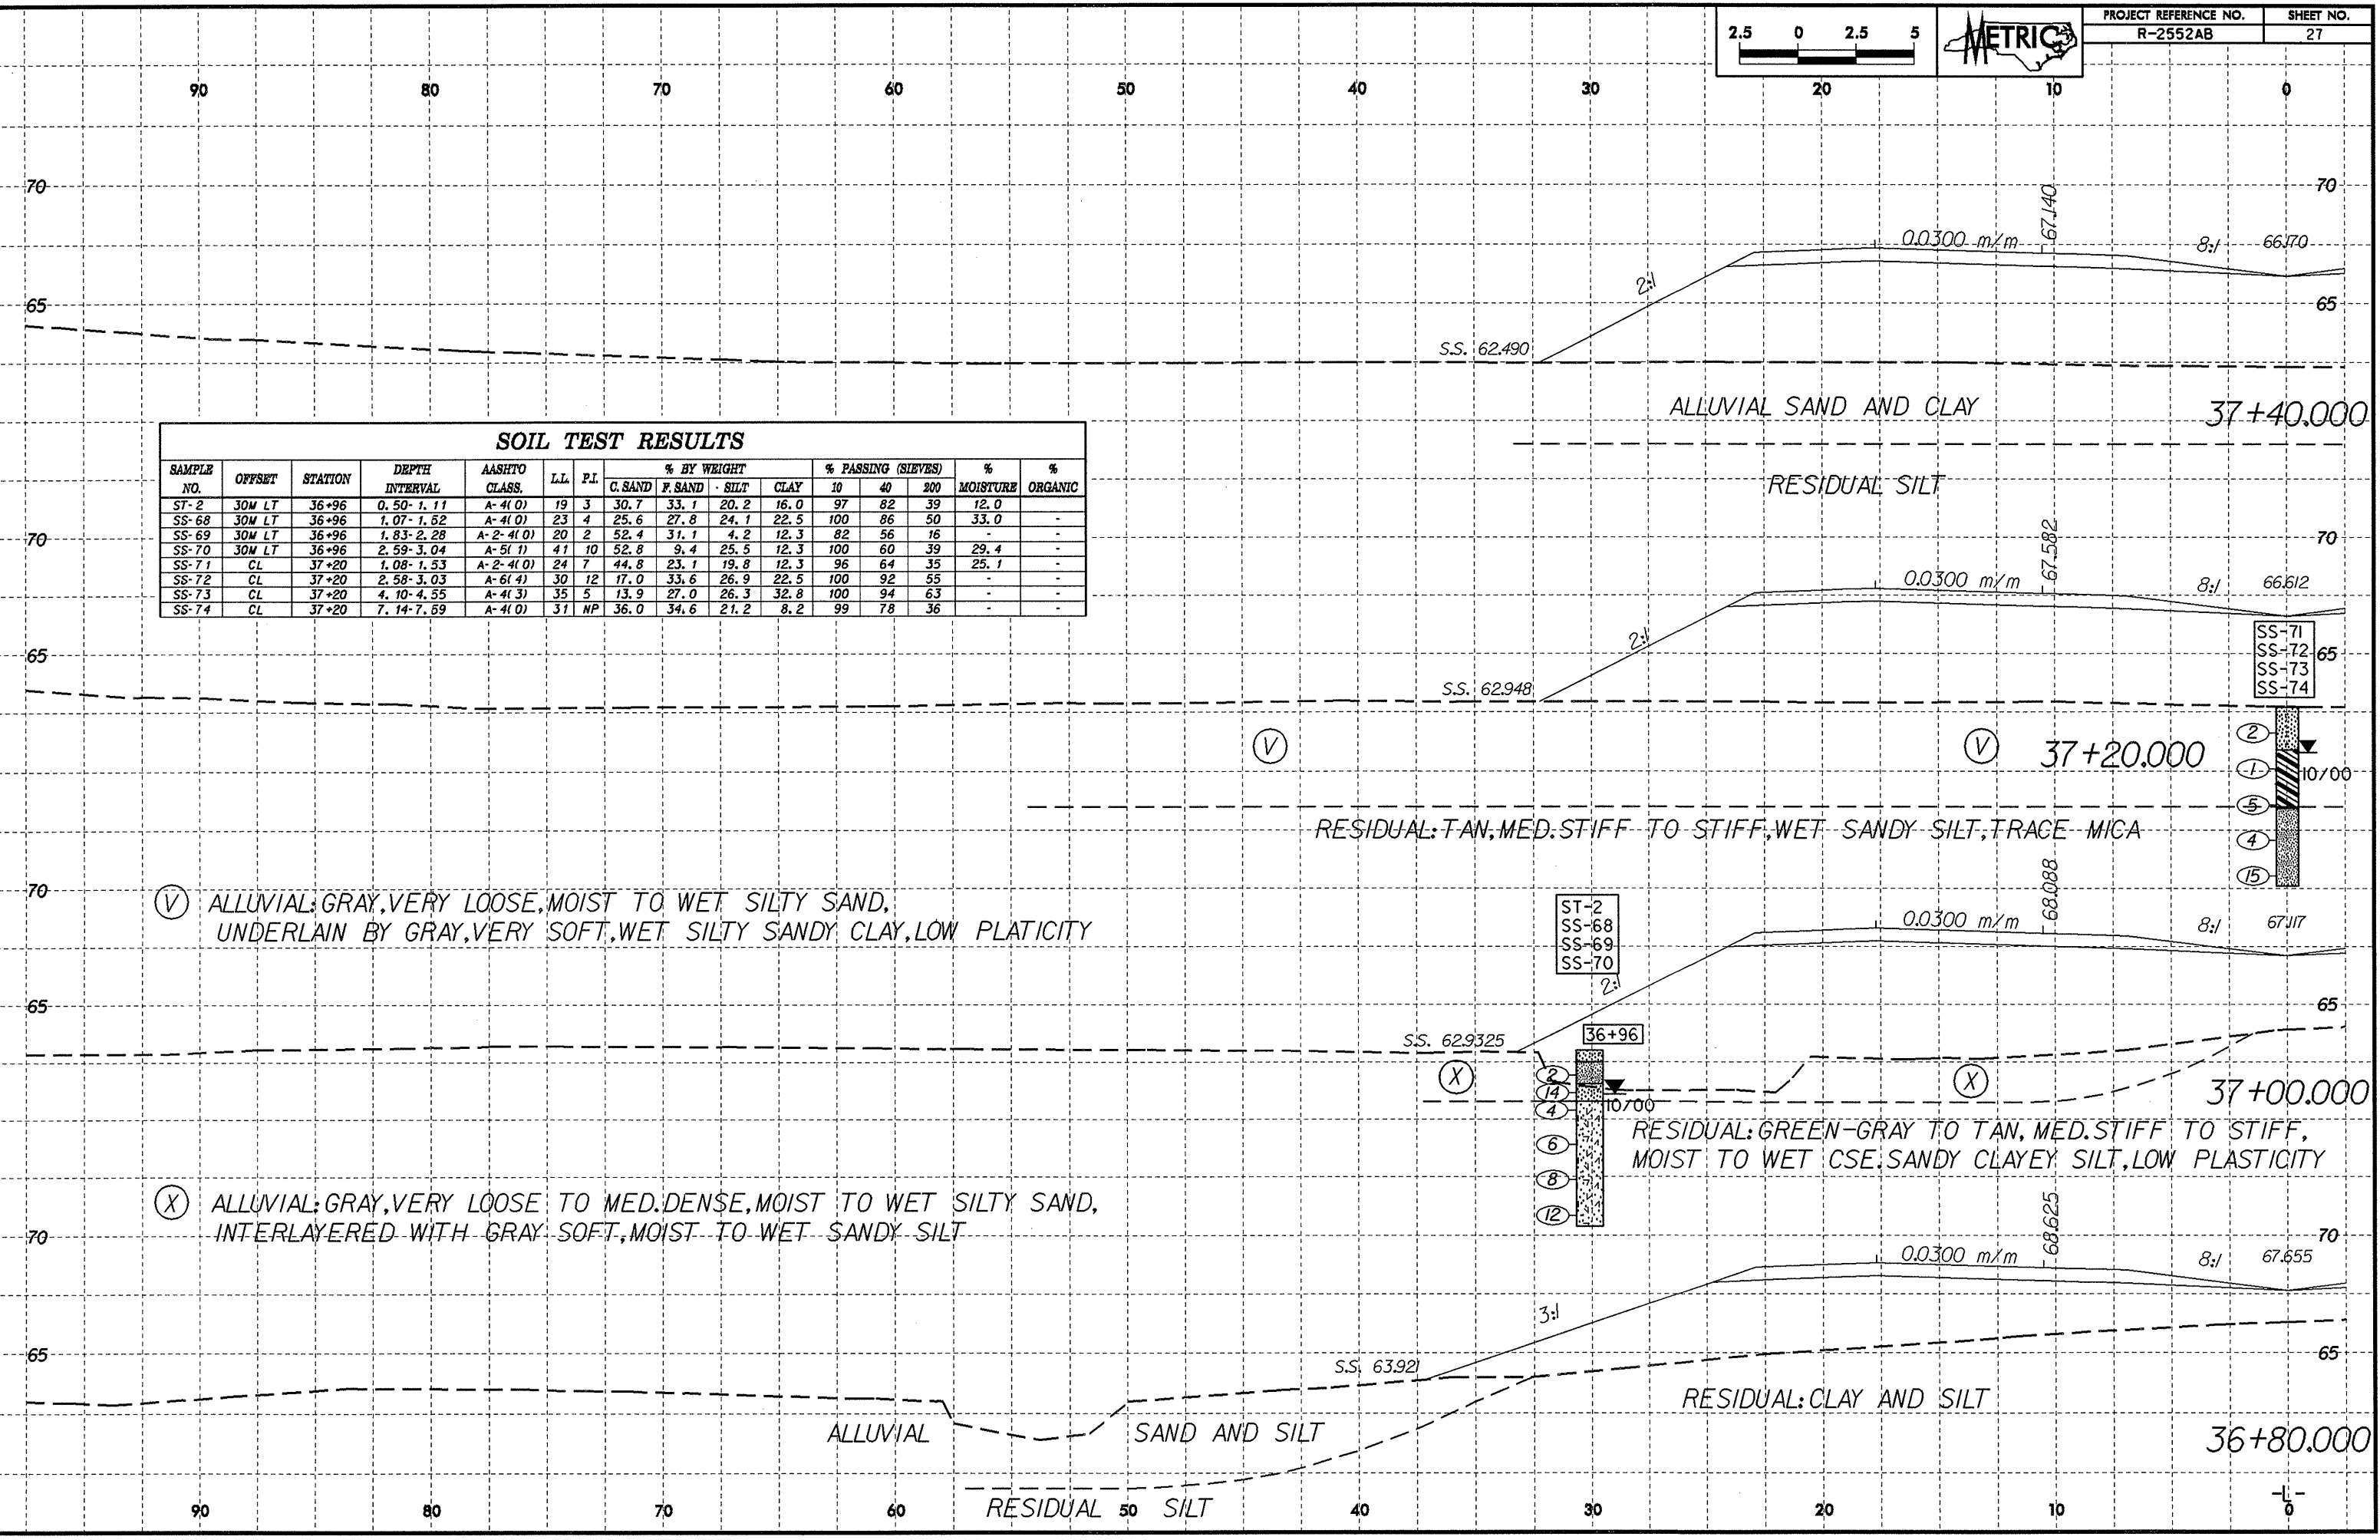

(V) ALLUVIAL: GRAY, VERY LOOSE, MOIST TO WET SILTY SAND, UNDERLAIN BY GRAY, VERY SOFT, WET SILTY SANDY CLAY, LOW PLASTICITY

(X) ALLUVIAL: GRAY, VERY LOOSE TO MED. DENSE, MOIST TO WET SILTY SAND, INTERLAYERED WITH GRAY SOFT, MOIST TO WET SANDY SILT

ST-2  
SS-68  
SS-69  
SS-70

SS-71  
SS-72  
SS-73  
SS-74

36+96  
2  
4  
6  
8  
12

37+20.000  
2  
4  
5  
15

RESIDUAL: TAN, MED. STIFF TO STIFF, WET SANDY SILT, TRACE MICA

RESIDUAL: GREEN-GRAY TO TAN, MED. STIFF TO STIFF, MOIST TO WET CSE. SANDY CLAYEY SILT, LOW PLASTICITY

ALLUVIAL SAND AND SILT

RESIDUAL: CLAY AND SILT

ALLUVIAL SAND AND CLAY

RESIDUAL SILT

37+40.000

37+00.000

36+80.000