
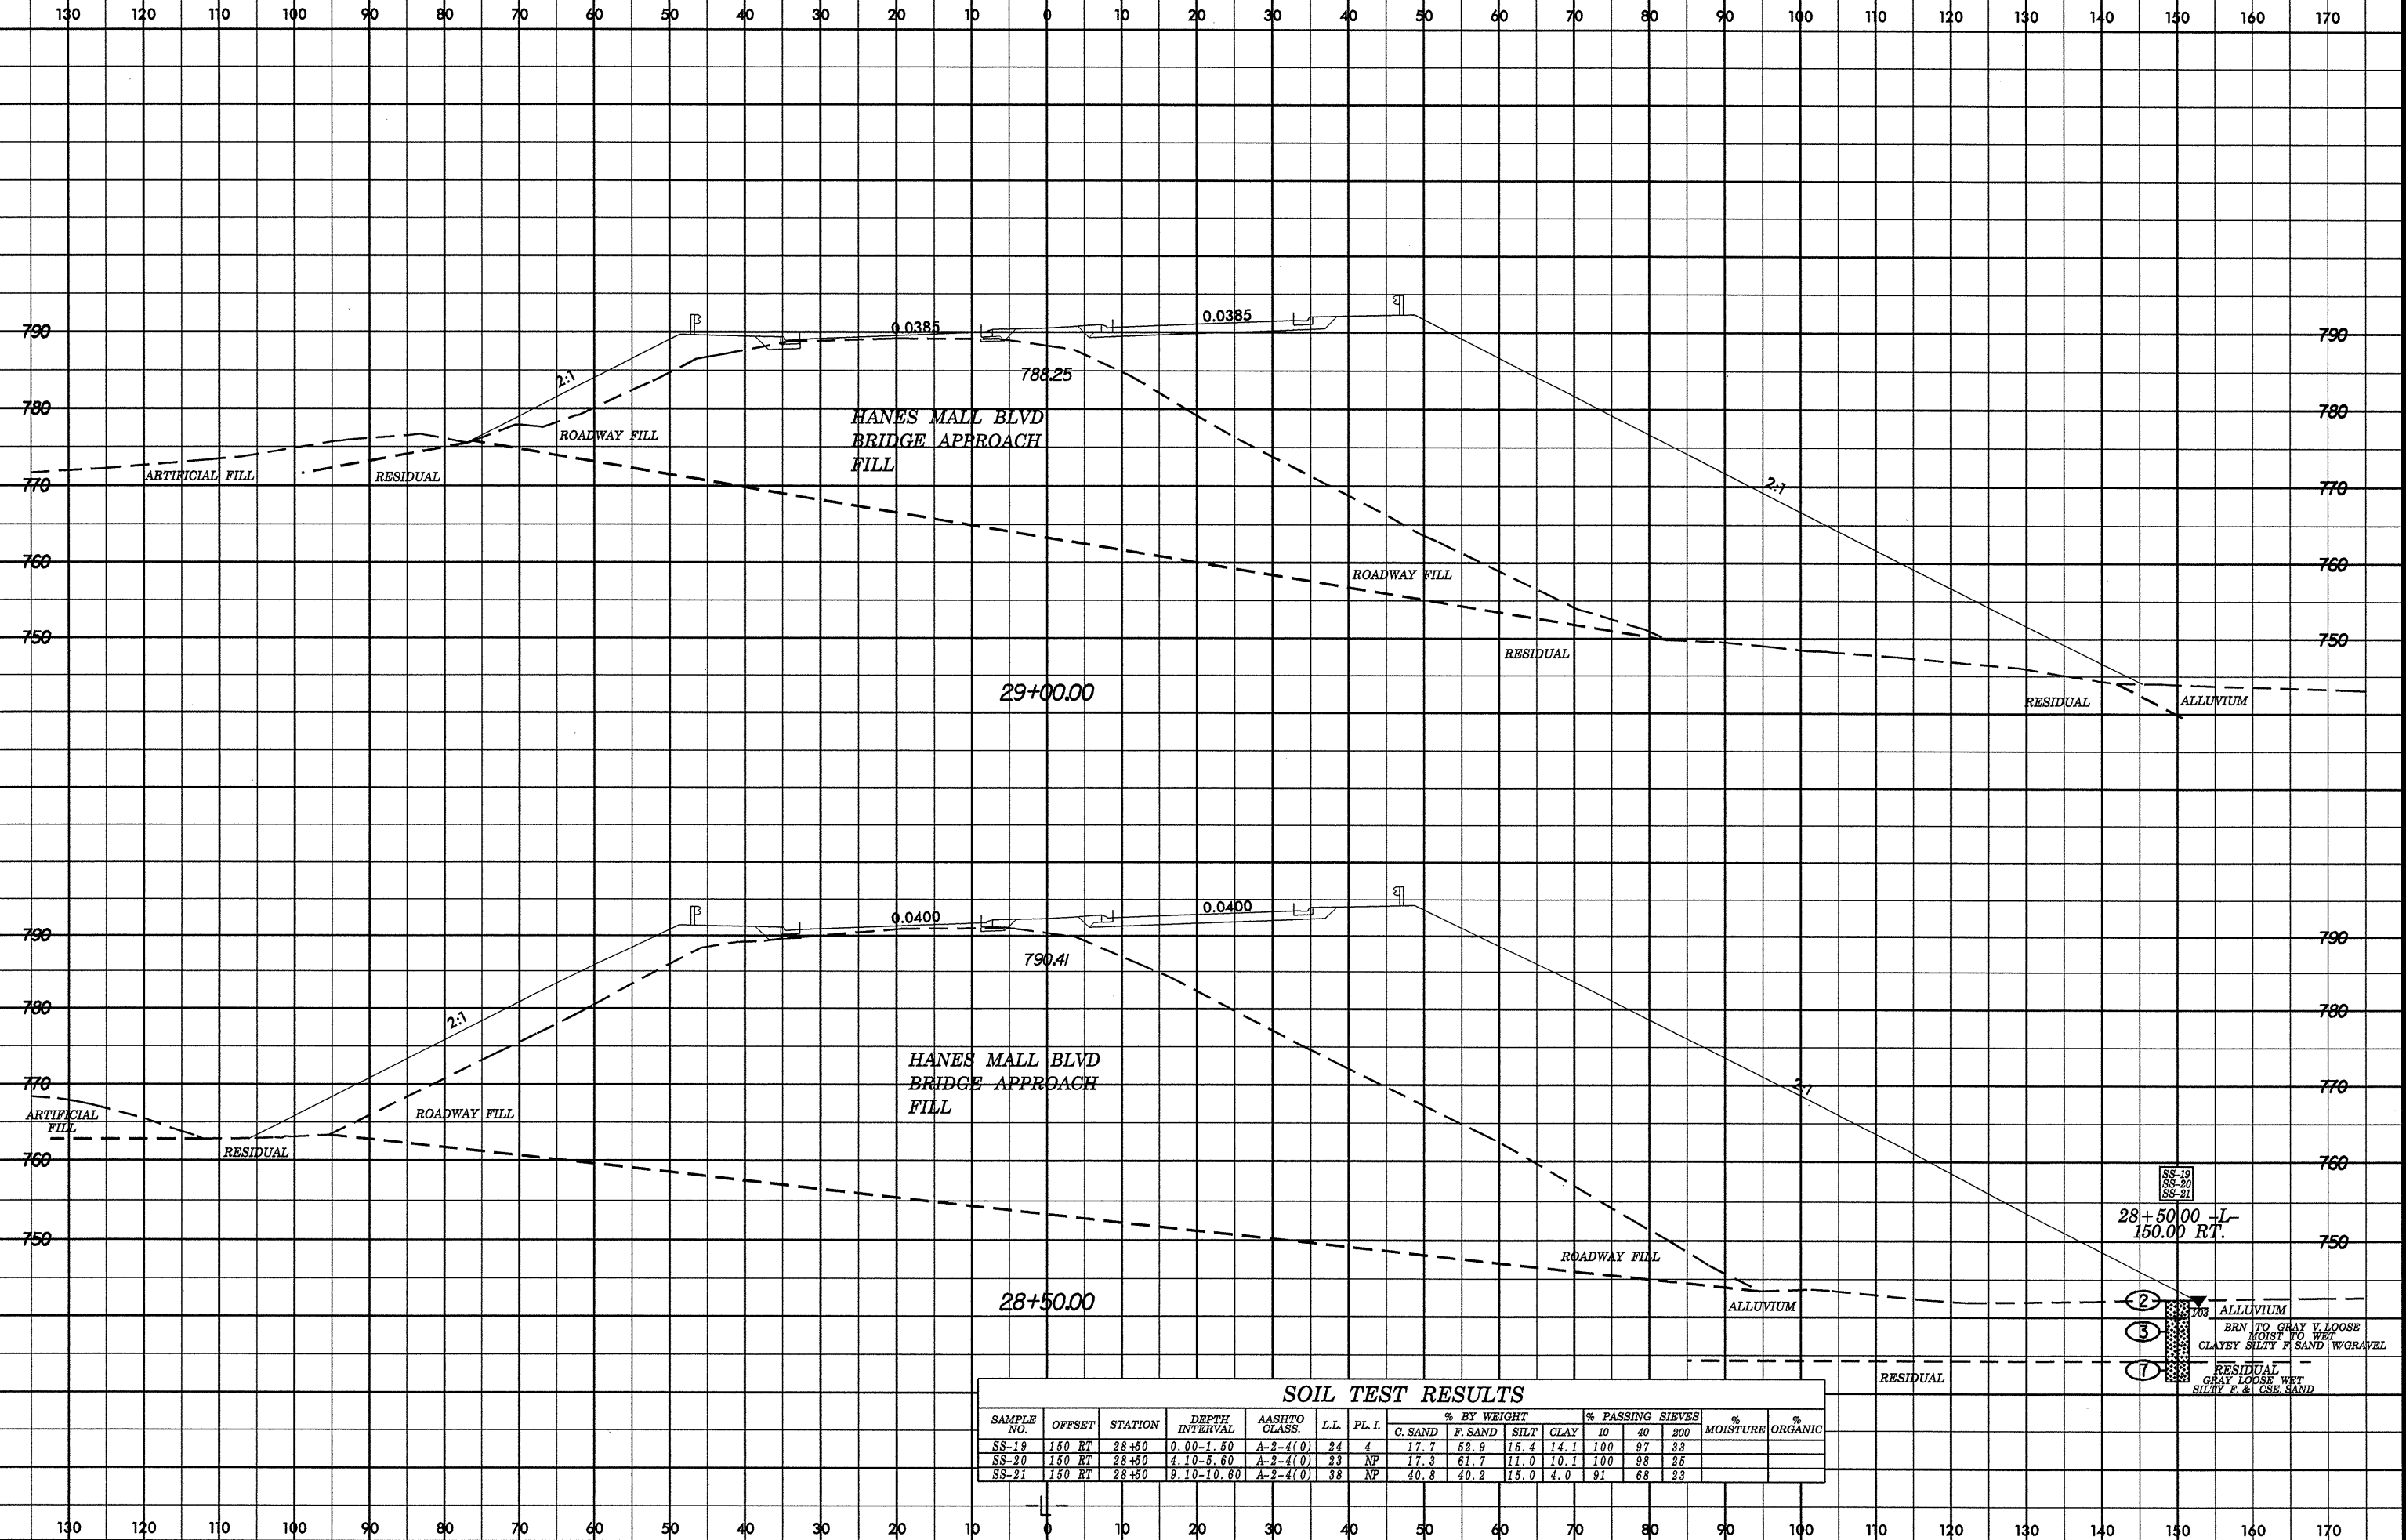


8/23/99



**SOIL TEST RESULTS**

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	LL	PL. I.	% BY WEIGHT				% PASSING SIEVES			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
SS-19	150 RT	28+50	0.00-1.50	A-2-4(0)	24	4	17.7	52.9	15.4	14.1	100	97	33		
SS-20	150 RT	28+50	4.10-5.60	A-2-4(0)	23	NP	17.3	61.7	11.0	10.1	100	98	25		
SS-21	150 RT	28+50	9.10-10.60	A-2-4(0)	38	NP	40.8	40.2	15.0	4.0	91	68	23		

28+50.00 -L- 150.00 RT.

SS-19  
SS-20  
SS-21

(2) ALLUVIUM

(3) BRN TO GRAY V. LOOSE MOIST TO WET CLAYEY SILTY F SAND W/GRAVEL

(7) RESIDUAL GRAY LOOSE WET SILTY F. & CSE. SAND

C:\TEMP\SS-19.DWG