5/28/99

NOTES:

1) DEPTHS SHOWN FOR EX. RAW WATER MAINS, ERW 100 AND ERW 200, ARE APPROXIMATE. CONTRACTOR SHALL VERIFY DEPTH OF EX. RAW WATER MAINS PRIOR TO INSTALLATION OF PROPOSED WATER MAINS.

2) 18" MIN. SEPARATION IS REQUIRED BETWEEN THE EXISTING RAW WATER MAINS AND THE PROP. 12" WATER MAIN.

3) 4' MIN. COVER IS REQUIRED OVER THE PROP. 12" WATER MAIN.

4) TYPE 3 BEDDING REQ'D UNLESS OTHERWISE NOTED.

25 0 50

PROJECT REFERENCE NO.	SHEET NO.
B-3652	UC-3
DESIGNED BY: DMP	
DRAWN BY: DMP	
CHECKED BY: DMP	
APPROVED BY:	
REVISED:	

NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

PROJECT SERVICES UNIT
PHONE: (919) 250-4128
FAX: (919) 250-4119

NORTH CAROLINA PROFESSIONAL SEAL 26457 ENGINEER ANDREW P. LARRICK 1-25-05

UTILITY CONSTRUCTION PLANS ONLY

UTILITY CONSTRUCTION

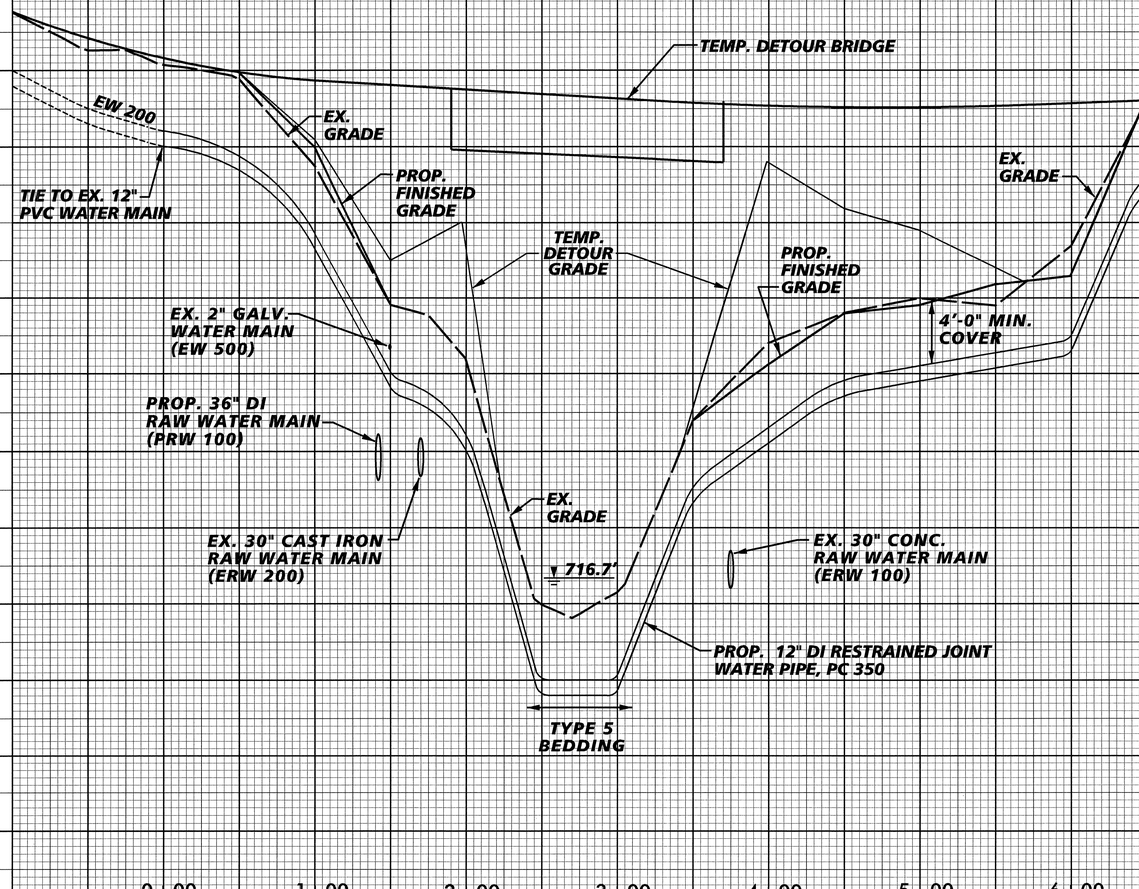

PW 100 (SEE SHEET UC-2)

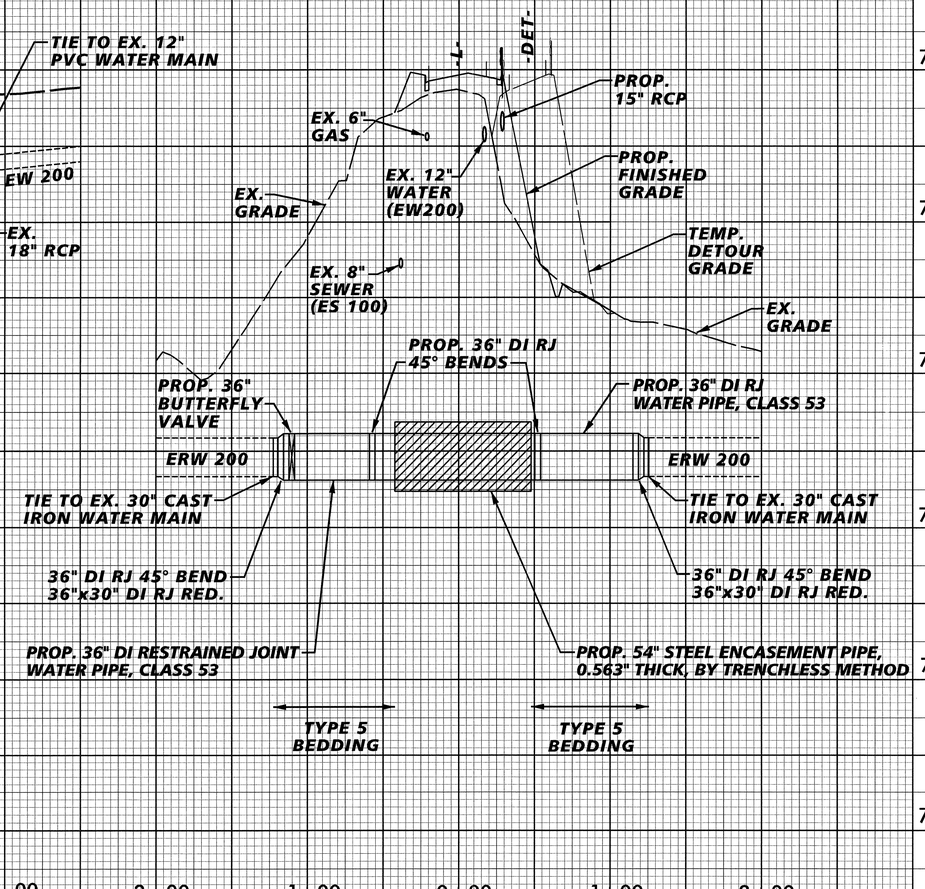

PRW 100 (SEE SHEET UC-2)

UTILITY CONSTRUCTION PLANS DESIGNED BY:
DAVIS-MARTIN-POWELL & ASSOC., INC.
ENGINEERING-LAND PLANNING-SURVEYING
HIGH POINT, NORTH CAROLINA