


CROSS SECTION -L-

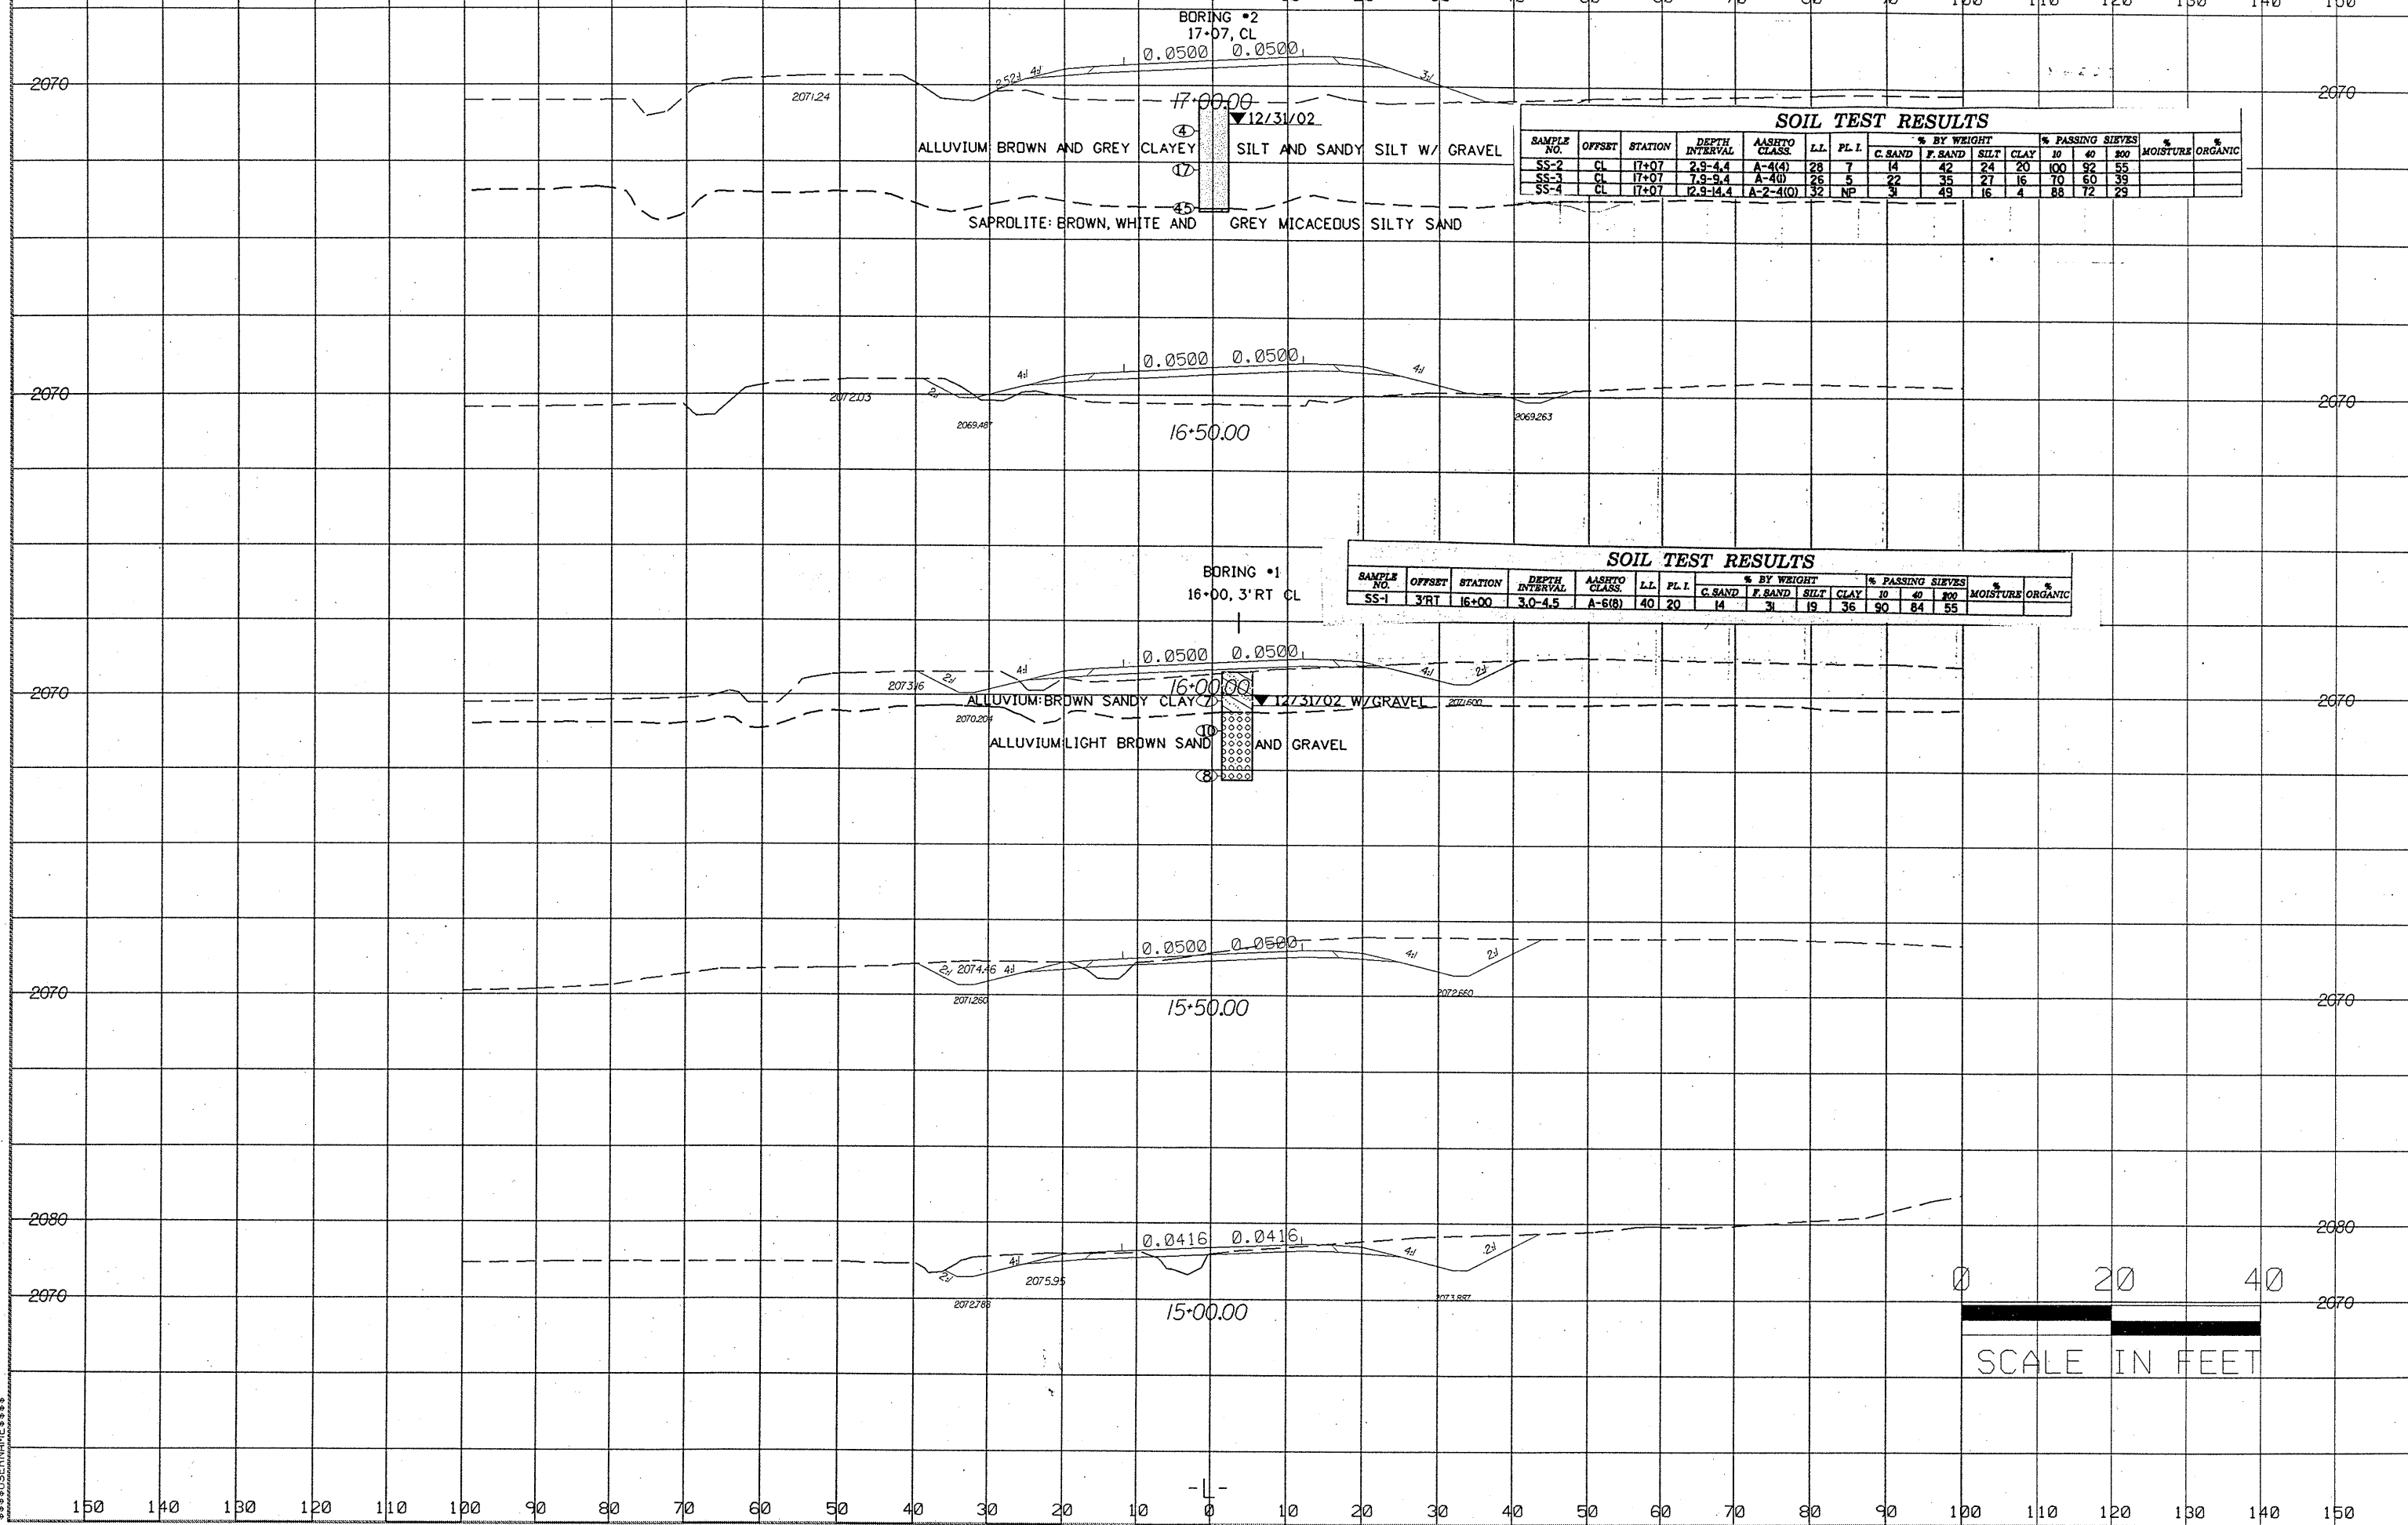


SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	ASTM CLASS.	L.L.	P.L.I.	% BY WEIGHT				% PASSING SIEVES			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
SS-2	CL	17+07	2.9-4.4	A-4(4)	28	7	14	42	24	20	100	92	55		
SS-3	CL	17+07	1.9-3.4	A-4(0)	26	5	22	35	27	16	70	60	39		
SS-4	CL	17+07	12.9-14.4	A-2-4(0)	32	NP	3	49	16	4	88	72	29		

SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	ASTM CLASS.	L.L.	P.L.I.	% BY WEIGHT				% PASSING SIEVES			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
SS-1	3' RT	16+00	3.0-4.5	A-6(8)	40	20	14	31	19	36	90	84	55		

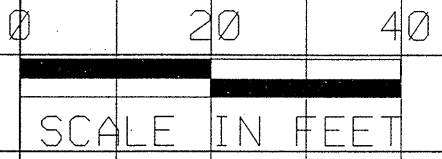

 SYSTEM *****
 DESIGN *****
 USER *****
