



336S CABINET
FRONT VIEW

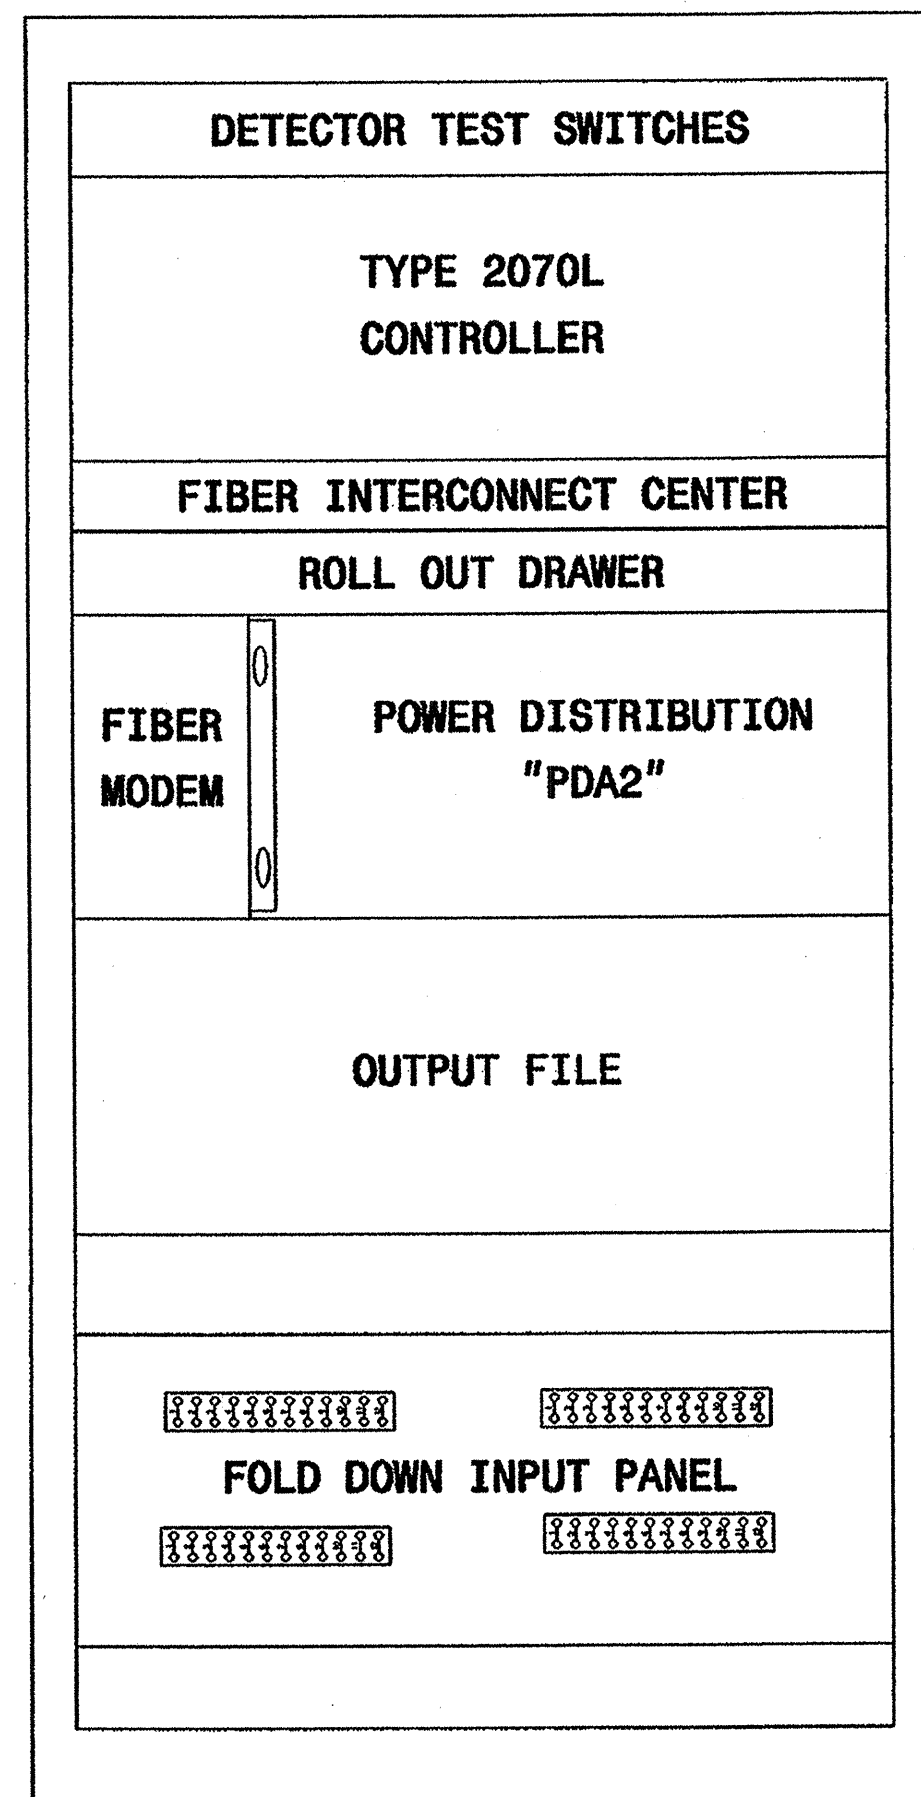

336S CABINET
REAR VIEW

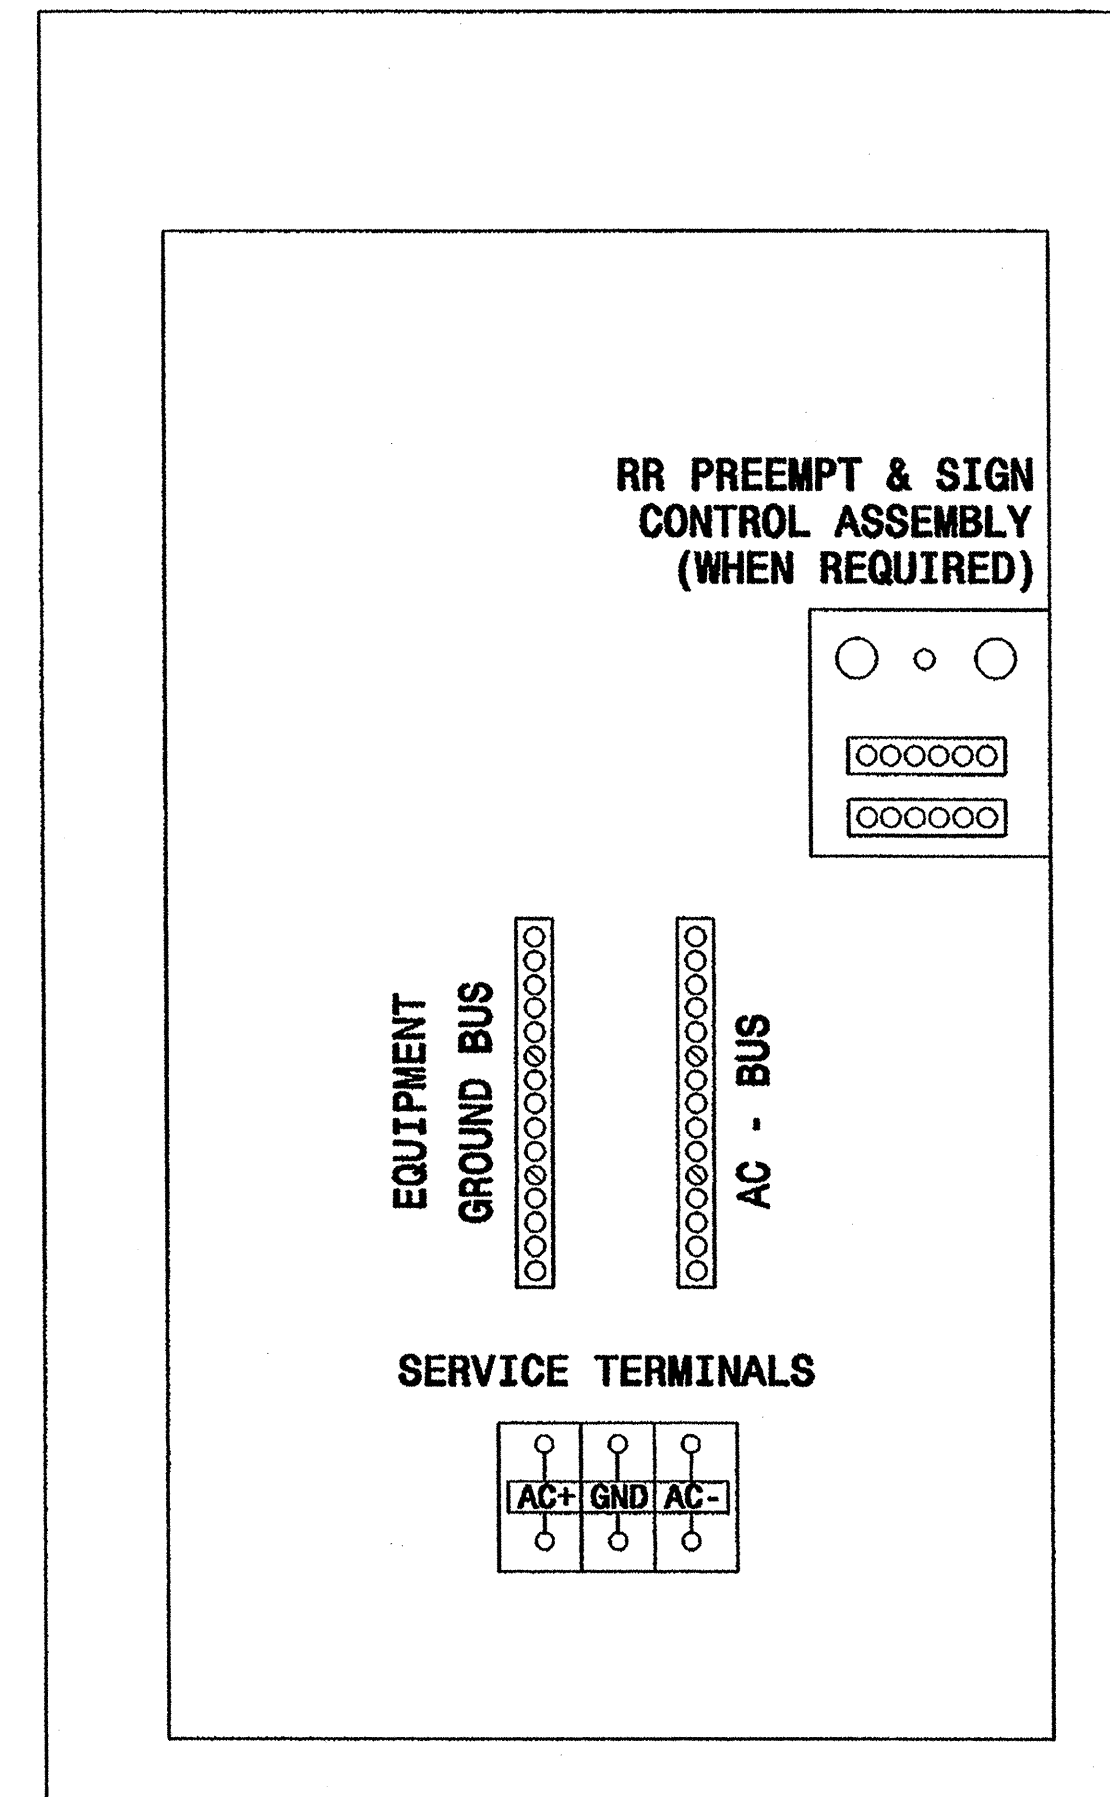

336S CABINET
REAR VIEW
RIGHT SIDE

NOTES

- PROVIDE A 2 " SPACE BETWEEN THE CONTROLLER AND THE ROLL OUT DRAWER TO ACCOMMODATE A FIBER INTERCONNECT CENTER.
- INSTALL POWER LINE SURGE PROTECTION INSIDE POWER DISTRIBUTION ASSEMBLY.

Typical Drawing

	Cabinet Component Layout 170 Cabinet Model 336S with 2070L Controller		SEAL NORTH CAROLINA PROFESSIONAL ENGINEER MILTON I. DEAN SEAL 16286
	PLAN DATE: October 2002 PREPARED BY: P I Alexander	REVIEWED BY: REVIEWED BY:	REVISIONS INIT. DATE