



**Project Special Provisions
Structures and Culverts
Table of Contents**

	Page
1 Maintenance & Protection of Traffic Beneath Proposed Structure at Stations 66+01.153 -L- (LT & RT), and 66+11.952 -L- (8-13-04)	1
2 Maintenance & Protection of Traffic Beneath Proposed Structure at Station at Station 146+39.081 -L- (8-13-04)	2
3 Pot Bearings (6-7-05)	2
4 Sound Barrier Wall (1-27-10)	6
5 Thermal Sprayed Coatings (Metallization) (6-7-05)	9
6 Evazote Joint Seals (11-5-10)	13
7 Elastomeric Concrete (1-27-10)	18
8 Falsework and Formwork (8-4-09)	20
9 Submittal of Working Drawings (1-27-10)	25
10 Construction, Maintenance & Removal of Temporary Access at Station 118+17.500 -L- (11-17-06)	32
11 Construction, Maintenance & Removal of Temporary Access at Station 77+44.000 -L- (11-17-06)	32
12 Optional Disc Bearings (6-7-05)	33
13 Crane Safety (8-15-05)	37
14 Shipping Steel Structural Members (7-18-06)	38
15 Grout for Structures (7-12-07)	40
16 High Strength Bolts (5-25-10)	42
17 Prestressed Concrete Members (10-12-10)	43
18 Adhesively Anchored Anchor Bolts or Dowels (6-11-07)	49
19 Direct Tension Indicators (6-12-09)	50
20 Curing Concrete (6-12-09)	51
21 Placing Load on Structure Members (8-4-09)	52
22 Metric Structural Steel (SPECIAL)	52
23 Structural Steel for Bridge at Station 146+39.081 -L- (EB & WB) (SPECIAL)	53
24 Charpy V-Notch Tests (SPECIAL)	58
25 Cap for Prestressed Concrete Piles (SPECIAL)	58
26 Pile Restrikes for LRFD (SPECIAL)	59
27 Visual Barrier Wall on Structure (SPECIAL)	59
28 Chain Link fence (SPECIAL)	60
29 Continuous Flight Auger Piles for Sound Barrier Walls (SPECIAL)	60
30 Pile Driving Analyzer (11-17-06)	65
31 Piles (8-4-09)	70

	173	
32 Mechanically Stabilized Earth Retaining Walls		70
at Sta. 30+50.000 -Y1- & 10+40.000 -Y4-	(SPECIAL)	
33 MSE Retaining Walls at 146+39.081 -L-	(SPECIAL)	80
34 Load Transfer Platform (LTP)	(SPECIAL)	89
35 Electrical Conduit System	(SPECIAL)	94
36 Railroad Provisions		97

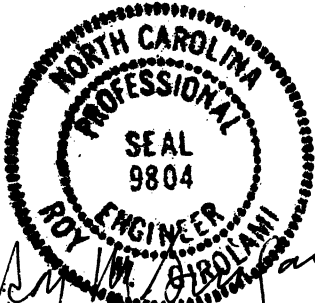

Roy M. Al-Jamali
 11-3-10
 except for items 2, 10,
 23, 25, 29, 33, 34, 35 & 36

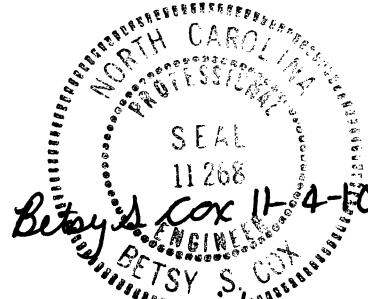

Betsy S. Cox 11-4-10
 ENGINEER
 BETSY S. COX
 except for items
 1, 11, 25, 27, 28, 29, 33, 34, 35, 36

PROJECT SPECIAL PROVISIONS
STRUCTURES AND CULVERTS

PROJECT X-0002BC/X-0002CA/X-0002CB

CUMBERLAND COUNTY

MAINTENANCE AND PROTECTION OF TRAFFIC BENEATH
PROPOSED STRUCTURE AT STATIONS 66+01.153 -L- (LT. LN.),
66+01.153 -L- (RT. LN.), AND 66+11.952 -L-

(8-13-04)

1.0 GENERAL

Maintain traffic on NC 210 (-Y1-) as shown in Traffic Control Plans and as directed by the Engineer.

Provide a minimum temporary vertical clearance of 5.0 meters at all times during construction.

Submit plans and calculations for review and approval for protecting traffic and bracing girders, as described herein, at the above station before beginning work at this location. Have the drawings and design calculations prepared, signed, and sealed by a North Carolina Registered Professional Engineer. The approval of the Engineer will not relieve the Contractor of the responsibility for the safety of the method or equipment.

2.0 PROTECTION OF TRAFFIC

Protect traffic from any operation that affords the opportunity for construction materials, equipment, tools, etc. to be dropped into the path of traffic beneath the structure. Based on Contractor means and methods determine and clearly define all dead and live loads for this system, which, at a minimum, shall be installed between beams or girders over any travelway or shoulder area where traffic is maintained. Install the protective system before beginning any construction operations over traffic. In addition, for these same areas, keep the overhang falsework in place until after the rails have been poured.

3.0 BRACING GIRDERS

Brace girders to resist wind forces, weight of forms and other temporary loads, especially those eccentric to the vertical axis of the member during all stages of erection and construction. Before casting of intermediate diaphragms, decks, or connecting steel diaphragms do not allow the horizontal movement of girders to exceed ½ inch (13mm).

4.0 BASIS OF PAYMENT

Payment at the contract unit prices for the various pay items will be full compensation for the above work.

**MAINTENANCE AND PROTECTION OF TRAFFIC BENEATH
PROPOSED STRUCTURE AT STATIONS 146+39.081-L-**

(8-13-04)

1.0 GENERAL

Maintain traffic on NC 210 (-Y1-) as shown in Traffic Control Plans and as directed by the Engineer.

Provide a minimum temporary vertical clearance of 5.0 meters at all times during construction.

Submit plans and calculations for review and approval for protecting traffic and bracing girders, as described herein, at the above station before beginning work at this location. Have the drawings and design calculations prepared, signed, and sealed by a North Carolina Registered Professional Engineer. The approval of the Engineer will not relieve the Contractor of the responsibility for the safety of the method or equipment.

2.0 PROTECTION OF TRAFFIC

Protect traffic from any operation that affords the opportunity for construction materials, equipment, tools, etc. to be dropped into the path of traffic beneath the structure. Based on Contractor means and methods determine and clearly define all dead and live loads for this system, which, at a minimum, shall be installed between beams or girders over any travelway or shoulder area where traffic is maintained. Install the protective system before beginning any construction operations over traffic. In addition, for these same areas, keep the overhang falsework in place until after the rails have been poured.

3.0 BRACING GIRDERS

Brace girders to resist wind forces, weight of forms and other temporary loads, especially those eccentric to the vertical axis of the member during all stages of erection and construction. Before casting of intermediate diaphragms, decks, or connecting steel diaphragms do not allow the horizontal movement of girders to exceed 1/2 inch (13mm).

4.0 BASIS OF PAYMENT

Payment at the contract unit prices for the various pay items will be full compensation for the above work.

POT BEARINGS

(6-07-05)

1.0 GENERAL

This item consists of furnishing, fabrication and installation of pot bearings in accordance with AASHTO Standard Specifications, the Standard Specifications, the recommendations of the manufacturer and the details shown on the plans and as specified herein.

Fixed pot bearings consist of a sole plate, a disc of elastomer in a steel cylinder with a snug fitting steel piston, masonry plate, anchor bolts, nuts and washers. Expansion pot bearings consist of a sole plate, a top steel plate with a polished stainless steel sheet facing bearing on a fixed pot bearing with a layer of virgin polytetrafluoroethylene (PTFE) material on its top, masonry plate, anchor bolt assembly which includes anchor bolts, nuts, washers, pipe sleeves, a closure plate, grout and various sizes of standard pipe and any other necessary material as detailed on the plans.

2.0 MATERIALS

Use pot bearings produced by the same manufacturer.

Use AASHTO M270 Grade 50W (345W) for all steel in the pot bearings. Clean, coat, and seal the plates in the pot bearing assemblies except for the areas with special facings and the internal surfaces of pot, in accordance with the Special Provision for "Thermal Sprayed Coatings (Metallization)". Metallization of the internal surfaces of the pot is permitted provided these surfaces are then polished to a surface smoother than 63 micro inches (0.0016 mm) root mean square. Coat surfaces to a thickness of 8 mils (0.200 mm) minimum on all external parts. Repair surfaces that are abraded or damaged after the application of metallizing in accordance with the Special Provision for "Thermal Sprayed Coatings (Metallization)".

Galvanize all fill plates specified on the plans. Provide anchor bolts and nuts in accordance with the Standard Specifications.

When the maximum plan dimension of the sheet is 12" (300 mm) or less, provide a stainless steel sheet in expansion pot bearings that is at least 16 gage or 1/16" (1.6 mm). When the maximum plan dimension is greater than 12" (300 mm), provide a stainless steel sheet that is at least 11 gage or 1/8" (3 mm). Ensure that all stainless steel sheets are in conformance with ASTM A240/A167 Type 304 and polished to a minimum #8 mirror surface finish.

Blast clean the surface of the plate that will be attached to the stainless sheet to a near white condition in accordance with the Standard Specifications. Position and clamp the back of the stainless sheet that is to be in contact with the steel plate on the steel plate. Apply the stainless steel to the blast cleaned surface of the steel plate as soon as possible after blasting and before any visible oxidation of the blast cleaned surface occurs. Weld the stainless sheet continuously around its perimeter using a tungsten inert gas, wire-fed welder.

For the PTFE sheet, used as a mating surface for the stainless sheet, provide an unfilled virgin PTFE Sheet (Recessed) or a glass-fiber filled PTFE sheet, resulting from skiving billets formed under hydraulic pressure and heat. Provide resin that conforms to the requirements of ASTM D4894 or D4895.

To bond the PTFE and the piston, use heat cured high temperature epoxy capable of withstanding temperature of -320°F to 500°F (-195°C to 260°C).

Provide a neoprene or natural rubber elastomer with a durometer hardness of 50 that allows for a minimum rotation of 0.02 radians. Place a 1/64" (0.4 mm) thick unfilled PTFE disc on either side of the elastomer inside the bearing. Use a brass sealing ring with the neoprene or natural rubber elastomer.

3.0 DESIGN

Have the manufacturer design the pot bearings for the loads and movements shown on the contract plans. However, use the anchor bolt size, length, spacing and masonry plate thickness as shown on the contract plans and provide an overall height of the bearing assembly that is at least the height shown on the contract plans, but no more than 1/2 inch (13 mm) greater than this height. Either combine, cast as a single piece, or weld together the sole plate and top plate/piston and the cylinder with the masonry plate.

When designing the bearings, use the following allowable bearing stresses:

- On confined elastomer: 3500 psi (24.1 MPa)
- On PTFE Sliding Surface, filled or unfilled PTFE (recessed): 3500 psi (24.1 MPa)

Submit eight sets of shop drawings and one set of design calculations for review, comments and acceptance. Have a North Carolina Registered Professional Engineer check and seal the shop drawings and design calculations.

After the Engineer reviews the drawings and, if necessary, corrections are made, submit one 22" x 34" reproducible set of the working drawings.

4.0 SAMPLING AND TESTING

A. Sampling

The manufacturer is responsible for randomly selecting and testing sample bearings from completed lots of bearings. The manufacturer is also responsible for certifying that the completed bearings and their components have been tested and are in compliance with the requirements of this Special Provision. Have the manufacturer furnish the results of the tests to the Materials and Tests Engineer.

B. Testing

1. Proof Load Test

Load a test bearing to 150% of the bearing's rated design capacity and simultaneously subject it to a rotational range of 0.02 radians (1.146°) for a period of 1 hour.

Have the bearing visually examined both during the test and upon disassembly after the test. Any resultant visual defects, such as extruded or deformed elastomer or PTFE, damaged seals or rings, or cracked steel is cause for rejection.

Keep the steel bearing plate and steel piston in continuous and uniform contact for the duration of the test. Any observed lift-off is cause for rejection.

2. Sliding Coefficient of Friction

For all guided and non-guided expansion type bearings, measure the sliding coefficient of friction at the bearing’s design capacity in accordance with the test method described below, and on the fifth and fiftieth cycles, at a sliding speed of 1 in/min (25 mm/min).

Calculate the sliding coefficient of friction as the horizontal load required to maintain continuous sliding of one bearing, divided by the bearing’s vertical design capacity.

The test results are evaluated as follows:

- A maximum measured sliding coefficients of friction of 3%.
- A visual examination both during and after the test. Any resultant visual defects, such as bond failure, physical destruction, cold flow of PTFE to the point of debonding, or damaged components is cause for rejection of the lot.

Using undamaged test bearings in the work is permitted.

3. Test Method

For the test method and equipment, meet the following requirements:

- a. Arrange the test to determine the coefficient of friction on the first movement of the manufactured bearing.
- b. Clean the bearing surface prior to testing.
- c. Conduct the test at maximum working stress for the PTFE surface with the test load applied continuously for 12 hours prior to measuring friction.
- d. Determine the first movement static and dynamic coefficient of friction of the test bearing at a sliding speed of less than 1 in/min (25 mm/min), not to exceed:

0.04	unfilled PTFE
0.08	filled PTFE

- e. Subject the bearing specimen to 100 movements of at least 1 inch (25 mm) of relative movement and, if the test facility permits, the full design movement at a speed of less than 1 ft/min (300 mm/min). Following this test determine the static and kinetic coefficient of friction again. The specimen is considered a failure if it exceeds the values measured in (d) above or if it shows any signs of bond failure or other defects.

Bearings represented by test specimens passing the above requirements are approved for use in the structure subject to on-site inspection for visible defects.

5.0 INSTALLATION

Prior to shipment, seal the joint between the steel piston and the steel cylinder with a bead of caulk. Store pot bearings delivered to the bridge site under cover on a platform above the ground surface. Protect the bearings from injury at all times and, before placing the bearings, dry and clean all dirt, oil, grease or other foreign substances from the bearing. Do not disassemble the bearings during installation, except at the manufacturer's direction. Place the bearings in accordance with the recommendations of the manufacturer, Contract Drawings, and as directed by the Engineer. If there is any discrepancy between the recommendations of the manufacturer, Special Provisions, and Contract Drawings, the Engineer is the sole judge in reconciling any such discrepancy.

Provide preformed bearing pads under the masonry plates in accordance with Article 1079-1 of the Standard Specifications.

Do not install any bearing before the Engineer approves it.

6.0 BASIS OF PAYMENT

Payment will be at the lump sum contract price bid for "Pot Bearings" which price will be full compensation for furnishing all labor, materials, tools, equipment and incidentals required to complete the work in accordance with the Standard Specifications, this Special Provision, the manufacturer's requirements and as directed by the Engineer.

SOUND BARRIER WALL

(1-27-10)

1.0 DESCRIPTION

This work consists of furnishing precast panels, structural steel, concrete, and all other materials; handling, transporting, fabricating, galvanizing, and storing materials; furnishing erection drawings, pile excavation, backfilling, erecting and installing the sound barrier wall members and all other materials as required by the plans, Standard Specifications and this Special Provision.

The plans allow for a choice of 10 ft (3.1 m) or 15 ft (4.6 m) pile spacing. Pile spacings greater than 15 ft (4.6 m) will not be permitted. Provide consistent pile spacing the entire length of the wall. Use odd pile spacing, if necessary, only at the ends of the wall and at turning points as approved by the Engineer.

A maximum one foot drop or rise in elevation between wall sections is permitted. Elevation changes greater than one foot, if necessary, will be allowed only at the end of the wall. Top of wall elevation changes that result in a jagged appearance will not be allowed.

2.0 ALTERNATE PILE SPACING

As an alternate, the Contractor may submit plans for pile spacing greater than 10' and less than 15' for review, comments and approval. The excavated hole diameter, excavation depth and reinforcing steel shall be equal to the amount shown on the existing plans for the 15' pile spacing. A variance in the reinforcing steel will be allowed for the length of horizontal and number of vertical reinforcement bars in the precast panel for the alternate pile spacing.

Submit two sets of detailed plans for review. Include all details in the plans, including the size and spacing of required reinforcement necessary to fabricate the precast panels. Have a North Carolina Registered Professional Engineer check, seal and date the plans. After the plans are reviewed and, if necessary, the corrections made, submit one set of reproducible tracings on 22" x 34" sheets to become part of the contract plans.

3.0 MATERIALS AND FABRICATION

Provide materials and fabricate members in accordance with the requirements of Division 10 of the Standard Specifications for Roads and Structures.

Provide precast panels that are 4 inches \pm 1/4 inch (102 \pm 6 mm) thick with an exposed aggregate finish on one face. The panel face with the aggregate finish shall be installed facing the roadway. The depth of the exposure is required to range from 0 to 1/4 inch (0 mm to 6 mm). Furnish three 12" x 12" (300 mm x 300 mm) samples for approval which establish the acceptable variations in color, texture, and uniformity. After the color, texture, and uniformity of the furnished samples are approved, produce a full scale panel unit meeting design requirements. This mock-up and the furnished samples establish the base or standard quality for acceptance of the panels. When producing the final installed panels, use fine and coarse aggregate, retarder, and cement from the same source as those used in the approved sample panels.

4.0 CONSTRUCTION METHODS

Complete the final survey of existing ground profile after clearing the wall area but prior to submitting any working drawings. Submit the final groundline survey with the working drawings.

If the Department is responsible for the survey, the Engineer field verifies the existing ground profile along the sound barrier wall. Contact the Engineer to obtain the survey information. Otherwise, complete the existing ground survey prior to submittal of working drawings.

Excavate holes with the diameters shown on the plans. Perform pile excavation to the depths shown on the plans and install piles as shown on the plans or in the accepted submittals with a tolerance of 1/2 inch per foot (42 mm per meter) from vertical. Backfill excavations with concrete after placing piles.

C. Pile Excavation

Use equipment of adequate capacity and capable of drilling through soil and non-soil including rock, boulders, debris, man-made objects and any other materials encountered. Blasting is not permitted to advance the excavation. Blasting for core removal is only permitted when approved by the Engineer. Dispose of drilling spoils in accordance with Section 802 of the Standard Specifications and as directed by the Engineer. Drilling spoils consist of all excavated material including water removed from the excavation either by pumping or drilling tools.

If unstable, caving or sloughing soils are anticipated or encountered, stabilize excavations with either slurry or steel casing. When using slurry, submit slurry details including product information, manufacturer's recommendations for use, slurry equipment information and written approval from the slurry supplier that the mixing water is acceptable before beginning drilling. When using steel casing, use either the sectional type or one continuous corrugated or non-corrugated piece. Steel casings should consist of clean watertight steel of ample strength to withstand handling and driving stresses and the pressures imposed by concrete, earth or backfill. Use steel casings with an outside diameter equal to the hole size and a minimum wall thickness of 1/4 inch (6 mm).

D. Concrete Placement

Before placing concrete, center and support the pile in the excavation and check the water inflow rate in the excavation after any pumps have been removed. If the inflow rate is less than 6" (150 mm) per half hour, remove any water and free fall the concrete into the excavation. Ensure that concrete flows completely around the pile. If the water inflow rate is greater than 6" (150 mm) per half hour, propose a concrete placement procedure to the Engineer. The Engineer shall approve the concrete placement procedure before placing concrete.

Fill the excavation with Class A concrete in accordance with Section 1000 of the Standard Specifications except as modified herein. Provide concrete with a slump of 6" to 8" (150 to 200 mm). Use an approved high-range water reducer to achieve this slump. Place concrete in a continuous manner and remove all casings.

5.0 WORKING DRAWINGS

Submit casting drawings for the precast face panels for approval in accordance with Article 1077-2 of the Standard Specifications prior to casting. Show the inserts, method of handling, and support details used for transportation on casting drawings. Submit metalwork fabrication drawings for approval prior to fabrication of steel wall components. Submit an erection plan and concrete face panel placing plan, including location of various heights of panels, for review and acceptance prior to fabrication of metalwork. Submit five sets of detail drawings.

6.0 METHOD OF MEASUREMENT

The quantity of sound barrier wall to be paid for will be the actual square feet (square meters) of precast panels used in the completed and accepted wall. Measurement will be made of the total area of precast panels used in the wall.

7.0 BASIS OF PAYMENT

The quantity of sound barrier wall, measured as provided above, will be paid for at the contract unit price bid per square foot (square meter) for "Sound Barrier Wall".

The unit price bid per square foot (square meter) will be full compensation for all work covered by this Special Provision including, but not limited to, furnishing precast panels, structural steel, concrete, and all other materials; handling, transporting, fabricating, galvanizing, and storing materials; furnishing erection drawings, backfilling, pile excavation including any casing or slurry, and erecting and installing the sound barrier wall members.

Payment will be made under:

Sound Barrier Wall.....Square Foot (Square Meter)

THERMAL SPRAYED COATINGS (METALLIZATION)

(6-07-05)

1.0 DESCRIPTION

Apply a thermal sprayed coating (TSC) and sealer to metal surfaces as specified herein when called for on the plans or by other Special Provisions, or when otherwise approved by the Engineer in accordance with the SSPC-CS 23.00/AWS C2.23/NACE No. 12 Specification. Only Arc Sprayed application methods are used to apply TSC coatings, the Engineer must approve other methods of application.

2.0 QUALIFICATIONS

Only use NCDOT approved TSC Contractors meeting the following requirements:

1. Who have the capability of blast cleaning steel surfaces to SSPC SP-5 and SP-10 Finishes.
2. Who employ a Spray Operator(s) qualified in accordance with AWS C.16/C2.16M2002 and a Quality Control Inspector(s) who have documented training in the applicable test procedures of ASTM D-3276 and SSPC-CS 23.00.

A summary of the contractor's related work experience and the documents verifying each Spray Operator's and Quality Control Inspector's qualifications are submitted to the Engineer before any work is performed.

3.0 MATERIALS

Provide wire in accordance with the metallizing equipment manufacturer’s recommendations. Use the wire alloy specified on the plans which meets the requirements in Annex C of the SSPC-CS 23.00 Specification. Have the contractor provide a certified analysis (NCDOT Type 2 Certification) for each lot of wire material.

Apply an approved sealer to all metallized surfaces in accordance with Section 9 of SSPC-CS 23. The sealer must either meet SSPC Paint 27 or is an alternate approved by the Engineer.

4.0 SURFACE PREPARATION AND TSC APPLICATION

Grind flame cut edges to remove the carbonized surface prior to blasting. Bevel all flame cut edges in accordance with Article 442-10(D) regardless of included angle. Blast clean surfaces to be metallized with grit or mineral abrasive in accordance with Steel Structures Painting Council SSPC SP-5/10(as specified) to impart an angular surface profile of 2.5 - 4.0 mils (0.063 – 0.100 mm). Surface preparation hold times are in accordance with Section 7.32 of SSPC-CS 23. If flash rusting occurs prior to metallizing, blast clean the metal surface again. Apply the thermal sprayed coating only when the surface temperature of the steel is at least 5°F (3°C) above the dew point.

At the beginning of each work period or shift, conduct bend tests in accordance with Section 6.5 of SSPC-CS 23.00. Any disbonding or delamination of the coating that exposes the substrate requires corrective action, additional testing, and the Engineer’s approval before resuming the metallizing process.

Apply TSC with the alloy to the thickness specified on the plans or as provided in the table below. All spot results (the average of 3 to 5 readings) must meet the minimum requirement. No additional tolerance (as allowed by SSPC PA-2) is permitted. (For Steel Beams: For pieces with less than 200 ft² (18.6m²) measure 2 spots/surface per piece and for pieces greater than 200 ft² (18.6m²) add 1 additional spots/surface for each 500 ft² (46.5m²)).

Application	Thickness	Alloy	Seal Coat
Pot Bearings	8 mil	85/15 Zinc (W-Zn-Al-2)	0.5 mil
Armored Joint Angles	8 mil	85/15 Zinc (W-Zn-Al-2)	0.5 mil
Modular Joints	8 mil	99.99% Zn (W-Zn-1)	0.5 mil
Expansion Joint Seals	8 mil	99.99% Zn (W-Zn-1)	0.5 mil
Optional Disc Bearings	8 mil	85/15 Zinc (W-Zn-Al-2)	0.5 mil

When noted on the plans or as specified in the above chart, apply the sealer to all metallized surfaces in accordance with the manufacturer’s recommendations and these provisions. Apply the seal coat only when the air temperature is above 40°F (4°C) and the surface temperature of the steel is at least 5°F (3°C) above the dew point. If the

sealer is not applied within eight hours after the final application of TSC, the applicator verifies acceptable TSC surfaces and obtains approval from the Engineer before applying the sealer.

5.0 INSPECTION FREQUENCY

The TSC Contractor must conduct the following tests at the specified frequency and the results documented in a format approved by the Engineer.

Test/Standard	Location	Frequency	Specification
Ambient Conditions	Site	Each Process	5°F (3°C) above the dew point
Abrasive Properties	Site	Each Day	Size, angularity, cleanliness
Surface Cleanliness SSPC Vis 1	All Surfaces	Visual All Surfaces	SSPC-SP-10 Atmospheric Service SSPC-SP - 5 Immersion Service
Surface Profile ASTM D-4417 Method C	Random Surfaces	3 per 500 ft ²	2.5 - 4.0 mils
Bend Test SSPC-CS 23.00	Site	5 per shift	Pass Visual
Thickness SSPC PA-2R SSPC-CS 23.00	Each Surface	Use the method in PA-2 Appendix 3 for Girders and Appendix 4 for frames and miscellaneous steel. See Note 1.	Zn - 8 mils minimum Al - 8 mils minimum Zn Al - 8 mils minimum Areas with more than twice the minimum thickness are inspected for compliance to the adhesion and cut testing requirements of this specification.
Adhesion ASTM 4541	Random Surfaces Splice Areas	1 set of 3 per 500 ft ²	Zn > 500 psi Al > 1000 psi Zn Al > 750 psi
Cut Test - SSPC-CS 23.00	Random Surfaces	3 sets of 3 per 500 ft ²	No peeling or delamination
Job Reference Std. SSPC-CS 23.00	Site	1 per job	Meets all the above requirements

6.0 REPAIRS

All Repairs are to be performed in accordance with the procedures below, depending on whether the repair surface is hidden or exposed. As an exception to the following, field welded splices on joint angles and field welding bearing plates to girders may be repaired in accordance with the procedures for hidden surfaces.

For hidden surfaces (including but not limited to interior girders, interior faces of exterior girders, and below-grade sections of piles):

1. Welding of metallized surfaces may be performed only if specifically permitted by the Engineer. Remove metallizing at the location of field welds by blast cleaning (SSPC SP-6 finish), or hand (SSPC SP-2 finish) or power tool cleaning (SSPC SP-3 finish) just prior to welding. Clean sufficiently to prevent contamination of the weld. All repairs to welded connections are metallized in accordance with SSPC CS 23.00.
2. Minor areas less than or equal to 0.1 ft^2 (9300mm^2) exposing the substrate are metallized in accordance with SSPC CS 23.00 or painted in accordance with ASTM A780, "Repair of Damaged and Uncoated Areas of Hot Dip Galvanized Coatings."
3. Large areas greater than 0.1 ft^2 (9300mm^2) exposing the substrate are metallized in accordance with SSPC CS 23.00.
4. Damaged (burnished) areas not exposing the substrate with less than the specified coating thickness are metallized in accordance with SSPC CS 23.00 or painted in accordance with ASTM A780, "Repair of Damaged and Uncoated Areas of Hot Dip Galvanized Coatings."
5. Damaged (burnished) areas not exposing the substrate with more than the specified coating thickness are not repaired.
6. Defective coating is repaired by either method 2 or 3 depending on the area of the defect.

For Exposed Surfaces (including but not limited to exterior faces of exterior girders and above-grade sections of piles):

1. Welding of metallized surfaces may be performed only if specifically permitted by the Engineer. Remove metallization at the location of field welds by blast cleaning (SSPC SP-6 finish), or hand (SSPC SP-2 finish) or power tool cleaning (SSPC SP-3 finish) just prior to welding. Clean sufficiently to prevent contamination of the weld. All repairs to welded connections are metallized in accordance with SSPC CS 23.00.
2. All areas exposing the substrate are metallized in accordance with SSPC CS 23.00
3. Defective coating is repaired by either method 2 or 3 depending on the area of the defect.

7.0 TWELVE MONTH OBSERVATION PERIOD

The contractor maintains responsibility for the coating system for a twelve (12) month observation period beginning upon the satisfactory completion of all the work required in the plans or as directed by the engineer. The contractor must guarantee the coating system under the payment and performance bond (refer to article 109-10). To successfully complete the observation period, the coating system must meet the following requirements after twelve(12) months service:

- No visible rust, contamination or application defect is observed in any coated area.
- Painted surfaces have a uniform color and gloss.
- Surfaces have an adhesion of no less than 500 psi (3.45 MPa) when tested in accordance with ASTM D-4541.

8.0 BASIS OF PAYMENT

The contract price bid for the bridge component to which the coating is applied will be full compensation for the thermal sprayed coating.

EVAZOTE JOINT SEALS

(11-5-10)

1.0 SEALS

Use preformed seals compatible with concrete and resistant to abrasion, oxidation, oils, gasoline, salt and other materials that are spilled on or applied to the surface. Use a resilient, UV stable, preformed, impermeable, flexible, expansion joint seal. The joint seal shall consist of low-density, closed cell, cross-linked polyethylene non-extrudable, foam. The joint seal shall contain no EVA (Ethylene Vinyl Acetate). Cell generation shall be achieved by being physically blown using nitrogen. No chemical blowing agents shall be used in the cell generation process.

Use seals manufactured with grooves 1/8" (3 mm) ± wide by 1/8" (3 mm) ± deep and spaced between 1/4" (6 mm) and 1/2" (13 mm) apart along the bond surface running the length of the joint. Use seals with a depth that meets the manufacturer's recommendation, but is not less than 70% of the uncompressed width. Provide a seal designed so that, when compressed, the center portion of the top does not extend upward above the original height

of the seal by more than 1/4" (6 mm). Provide a seal that has a working range of 30% tension and 60% compression and meets the requirements given below.

TEST	TEST METHOD	REQUIREMENT
Tensile strength	ASTM D3575-08, Suffix T	110 – 130 psi (758 – 896 kpa)
Compression Set	ASTM D1056 Suffix B, 2 hr recovery	10% - 16%
Water Absorption	ASTM D3575	< 0.03 lb/ft ² (< 0.001 kpa)
Elongation at Break	ASTM D3575	180% - 210%
Tear Strength	ASTM D624 (D3575-08, Suffix G)	14 – 20 pli
Density	ASTM D3575-08, Suffix W, Method A	1.8 – 2.2 lb/ft ³ (28.8 – 35.2 kg/m ³)
Toxicity	ISO-10993.5	Pass (not cytotoxic)

Have the top of the evazote seal clearly shop marked. Inspect the evazote seals upon receipt to ensure that the marks are clearly visible before installation.

2.0 BONDING ADHESIVE

Use a two component, 100% solid, modified epoxy adhesive supplied by the joint seal manufacturer that meets the requirements given below.

TEST	TEST METHOD	REQUIREMENT
Tensile strength	ASTM D638	3000 psi (20.7 MPa) min.
Compressive strength	ASTM D695	7000 psi (48.3 MPa) min.
Hardness	Shore D Scale	75-85 psi (0.51-0.58 MPa)
Water Absorption	ASTM D570	0.25% by weight max.
Elongation to Break	ASTM D638	5% max.
Bond Strength	ASTM C882	2000 psi (13.8 MPa) min.

Use an adhesive that is workable to 40°F (4°C). When installing in ambient air or surface temperatures below 40°F (4°C) or for application on moist, difficult to dry concrete surfaces, use an adhesive specified by the manufacturer of the joint seal.

3.0 ELASTOMERIC CONCRETE

The elastomeric concrete shall not be placed until the reinforced concrete deck slab has cured for seven full days and reached a minimum strength of 3000 psi (20.7 Mpa).

Prepare the concrete surface within 48 hours prior to placing the elastomeric concrete. Before placing the elastomeric concrete, all concrete surfaces shall be thoroughly cleaned and dry. Sandblast the concrete surface in the blockout and clear the surface of all loose debris. Do not place the elastomeric concrete until the surface preparation is completed and approved.

A manufacturer's representative shall be present when placing elastomeric concrete. Do not place elastomeric concrete if the ambient air or surface temperature is below 45°F (7°C).

Prepare and apply a primer, as per manufacturer's recommendations, to all vertical concrete faces to be in contact with elastomeric concrete, and to areas specified by the manufacturer.

Prepare, batch, and place the elastomeric concrete in accordance with the manufacturer's instructions. Place the elastomeric concrete in the areas specified on the plans while the primer is still tacky and within 2 hours after applying the primer. Trowel the elastomeric concrete to a smooth finish.

4.0 SAWING THE JOINT

The joint opening shall be initially formed to the width shown on the plans including the blockout for the elastomeric concrete.

The elastomeric concrete shall cure a minimum of 2 days prior to sawing the elastomeric concrete to the final width and depth as specified in the plans.

When sawing the joint to receive the evazote seal, always use a rigid guide to control the saw in the desired direction. To control the saw and to produce a straight line as indicated on the plans, anchor and positively connect a template or a track to the bridge deck. Do not saw the joint by visual means such as a chalk line. Fill the holes used for holding the template or track to the deck with an approved, flowable non-shrink, non-metallic grout.

Saw cut to the desired width and depth in one or two passes of the saw by placing and spacing two metal blades on the saw shaft to the desired width for the joint opening.

The desired depth is the depth of the seal plus 1/4" (6 mm) above the top of the seal plus approximately 1" (25 mm) below the bottom of the seal. An irregular bottom of sawed joint is permitted as indicated on the plans. Grind exposed corners on saw cut edges to a 1/4" (6 mm) chamfer.

Saw cut a straight joint, centered over the formed opening and to the desired width specified in the plans. Prevent any chipping or damage to the sawed edges of the joint.

Remove any staining or deposited material resulting from sawing with a wet blade to the satisfaction of the Engineer.

5.0 PREPARATION OF SAWED JOINT FOR SEAL INSTALLATION

After sawing the joint, the Engineer will thoroughly inspect the sawed joint opening for spalls, popouts, cracks, etc. All necessary repairs will be made by the Contractor prior to blast cleaning and installing the seal.

Clean the joints by sandblasting with clean dry sand immediately before placing the bonding agent. Sandblast the joint opening to provide a firm, clean joint surface free of curing compound, loose material and any foreign matter. Sandblast the joint opening without causing pitting or uneven surfaces. The aggregate in the elastomeric concrete may be exposed after sandblasting.

After blasting, either brush the surface with clean brushes made of hair, bristle or fiber, blow the surface with compressed air, or vacuum the surface until all traces of blast products and abrasives are removed from the surface, pockets, and corners.

If nozzle blasting is used to clean the joint opening, use compressed air that does not contain detrimental amounts of water or oil.

Examine the blast cleaned surface and remove any traces of oil, grease or smudge deposited in the cleaning operations.

Bond the seal to the blast cleaned surface on the same day the surface is blast cleaned.

6.0 SEAL INSTALLATION

Install the joint seal according to the manufacturer's procedures and recommendations and as recommended below. Do not install the joint seal if the ambient air or surface temperature is below 45°F (7°C). Have a manufacturer's certified trained factory representative present during the installation of the first seal of the project.

Before installing the joint seal, check the uninstalled seal length to insure the seal is the same length as the deck opening. When the joint seal requires splicing, use the heat welding method by placing the joint material ends against a teflon heating iron of 425-475°F (218-246°C) for 7 - 10 seconds, then pressing the ends together tightly. Do not test the welding until the material has completely cooled.

Begin installation by protecting the top edges of the concrete deck adjacent to the vertical walls of the joint as a means to minimize clean up. After opening both cans of the bonding agent, stir each can using separate stirring rods for each component to prevent premature curing of the bonding agent. Pour the two components, at the specified mixing ratio, into a clean mixing bucket. Mix the components with a low speed drill (400 rpm max.) until a

uniform gray color is achieved without visible marbling. Apply bonding agent to both sides of the elastomeric concrete as well as both sides of the joint seal, making certain to completely fill the grooves with epoxy. With gloved hands, compress the joint seal and with the help of a blunt probe, push the seal into the joint opening until the seal is recessed approximately 1/4" (6 mm) below the surface. When pushing down on the joint seal, apply pressure only in a downward direction. Do not push the joint seal into the joint opening at an angle that would stretch the material. Seals that are stretched during installation shall be removed and rejected. Once work on placing a seal begins, do not stop until it is completed. Clean the excess epoxy from the top of the joint seal immediately with a trowel. Do not use solvents or any cleaners to remove the excess epoxy from the top of the seal. Remove the protective cover at the joint edges and check for any excess epoxy on the surface. Remove excess epoxy with a trowel, the use of solvents or any cleaners will not be allowed.

The installed system shall be watertight and will be monitored until final inspection and approval.

7.0 BASIS OF PAYMENT

Payment for all evazote joint seals will be at the lump sum contract price bid for "Evazote Joint Seals". Prices and payment will be full compensation for furnishing all material, including elastomeric concrete, labor, tools and equipment necessary for installing these units in place and accepted.

ELASTOMERIC CONCRETE

(1-27-10)

1.0 DESCRIPTION

Elastomeric concrete is a mixture of a two-part polymer consisting of polyurethane and/or epoxy and kiln-dried aggregate. Provide an elastomeric concrete and binder system that is preapproved. Use the concrete in the blocked out areas on both sides of the bridge deck joints as indicated on the plans.

2.0 MATERIALS

Provide materials that comply with the following minimum requirements at 14 days (or at the end of the specified curing time).

ELASTOMERIC CONCRETE PROPERTIES	TEST METHOD	MINIMUM REQUIREMENT
Compressive Strength, psi (MPa)	(a) STM D695	2000 (13.8)
5% Deflection Resilience	ASTM D695	95
Splitting Tensile Strength	ASTM D3967	625 (4.31)
Bond Strength to Concrete, psi (MPa)	ASTM D882 (D882M)	450 (3.10)
Durometer Hardness	ASTM D2240	50

BINDER PROPERTIES (without aggregate)	TEST METHOD	MINIMUM REQUIREMENT
Tensile Strength, psi (MPa)	ASTM D638	1000 (6.89)
Ultimate Elongation	ASTM D638	150%
Tear Resistance, lb/in (kN/m)	ASTM D624	200 (34.9)

In addition to the requirements above, the elastomeric concrete must be resistant to water, chemical, UV and ozone exposure and withstand temperature extremes. Elastomeric concrete systems requiring preheated aggregates are not allowed.

3.0 PREQUALIFICATION

Manufacturers of elastomeric concrete materials shall submit samples (including aggregate, primer and binder materials) and a Type 4 certification in accordance with article 106-3 (F) of the Standard Specifications for prequalification to:

North Carolina Department of Transportation
Materials and Tests Unit
1801 Blue Ridge Road
Raleigh, NC 27607

Prequalification will be determined for the system. Individual components will not be evaluated, nor will individual components of previously evaluated systems be deemed prequalified for use.

The submitted binder (a minimum volume of 1 gallon) and corresponding aggregate samples will be evaluated for compliance with the Materials requirements specified above. Systems satisfying all of the Materials requirements will be prequalified for a one year period. Before the end of this period new product samples shall be resubmitted for prequalification evaluation.

If, at any time, any formulation or component modifications are made to a prequalified system that system will no longer be approved for use.

4.0 MATERIAL CERTIFICATION AND INSTALLATION

Provide a Type 5 certification in accordance with article 106-3 (F) of the Standard Specifications, verifying that the materials satisfy the above requirements and proof of NCDOT prequalification.

Prior to placing the elastomeric concrete, thoroughly clean and dry all concrete surfaces. Sandblast the concrete surface in the blockout and clear the surface of all loose debris.

Provide a manufacturer's representative at the bridge site during the installation of the elastomeric concrete to ensure that all steps being performed comply with all manufacturer installation requirements including, but not limited to weather conditions (ambient temperature, relative humidity, precipitation, wind, etc), concrete deck surface preparation, binder and aggregate mixing, primer application, elastomeric concrete placement, curing conditions and minimum curing time before joint exposure to traffic.

5.0 FIELD SAMPLING

Provide additional production material to allow freshly mixed elastomeric concrete to be sampled for acceptance. A minimum of six 2 inch cube molds and three 3x6 inch cylinders will be taken by the Department for each day's production. Compression, splitting tensile, and durometer hardness testing will be performed by the Department to determine

acceptance. Materials failing to meet the requirements listed above are subject to removal and replacement at no cost to the Department.

6.0 BASIS OF PAYMENT

No separate payment will be made for elastomeric concrete. The lump sum contract price bid for “Evazote Joint Seals” will be full compensation for furnishing and placing the Elastomeric Concrete.

FALSEWORK AND FORMWORK

(8-4-09)

1.0 DESCRIPTION

Use this Special Provision as a guide to develop temporary works submittals required by the Standard Specifications or other provisions; no additional submittals are required herein. Such temporary works include, but are not limited to, falsework and formwork.

Falsework is any temporary construction used to support the permanent structure until it becomes self-supporting. Formwork is the temporary structure or mold used to retain plastic or fluid concrete in its designated shape until it hardens. Access scaffolding is a temporary structure that functions as a work platform that supports construction personnel, materials, and tools, but is not intended to support the structure. Scaffolding systems that are used to temporarily support permanent structures (as opposed to functioning as work platforms) are considered to be falsework under the definitions given. Shoring is a component of falsework such as horizontal, vertical, or inclined support members. Where the term “temporary works” is used, it includes all of the temporary facilities used in bridge construction that do not become part of the permanent structure.

Design and construct safe and adequate temporary works that will support all loads imposed and provide the necessary rigidity to achieve the lines and grades shown on the plans in the final structure.

2.0 MATERIALS

Select materials suitable for temporary works; however, select materials that also ensure the safety and quality required by the design assumptions. The Engineer has authority to reject material on the basis of its condition, inappropriate use, safety, or nonconformance with the plans. Clearly identify allowable loads or stresses for all materials or manufactured devices on the plans. Revise the plan and notify the Engineer if any change to materials or material strengths is required.

3.0 DESIGN REQUIREMENTS

A. Working Drawings

Provide working drawings for items as specified in the contract, or as required by the Engineer, with design calculations and supporting data in sufficient detail to permit a structural and safety review of the proposed design of the temporary work.

When concrete placement is involved, include data such as the drawings of proposed sequence, rate of placement, direction of placement, and location of all construction joints. Submit the number of copies as called for by the contract.

When required, have the drawings and calculations prepared under the guidance of, and sealed by, a North Carolina Registered Professional Engineer who is knowledgeable in temporary works design.

Design falsework and formwork requiring submittals in accordance with the 1995 AASHTO *Guide Design Specifications for Bridge Temporary Works* except as noted herein.

1. Wind Loads

Table 2.2 of Article 2.2.5.1 is modified to include wind velocities up to 110 mph (177 km/hr). In addition, Table 2.2A is included to provide the maximum wind speeds by county in North Carolina.

Table 2.2 - Wind Pressure Values

Height Zone feet (m) above ground	Pressure, lb/ft ² (kPa) for Indicated Wind Velocity, mph (km/hr)				
	70 (112.7)	80 (128.7)	90 (144.8)	100 (160.9)	110 (177.0)
0 to 30 (0 to 9.1)	15 (0.72)	20 (0.96)	25 (1.20)	30 (1.44)	35 (1.68)
30 to 50 (9.1 to 15.2)	20 (0.96)	25 (1.20)	30 (1.44)	35 (1.68)	40 (1.92)
50 to 100 (15.2 to 30.5)	25 (1.20)	30 (1.44)	35 (1.68)	40 (1.92)	45 (2.15)
over 100 (30.5)	30 (1.44)	35 (1.68)	40 (1.92)	45 (2.15)	50 (2.39)

2. Time of Removal

The following requirements replace those of Article 3.4.8.2.

Do not remove forms until the concrete has attained strengths required in Article 420-16 of the Standard Specifications and these Special Provisions.

Do not remove forms until the concrete has sufficient strength to prevent damage to the surface.

Table 2.2A - Steady State Maximum Wind Speeds by Counties in North Carolina

COUNTY	25 YR (mph) (km/hr)	COUNTY	25 YR (mph) (km/hr)	COUNTY	25 YR (mph) (km/hr)
Alamance	70 (112.7)	Franklin	70 (112.7)	Pamlico	100 (160.9)
Alexander	70 (112.7)	Gaston	70 (112.7)	Pasquotank	100 (160.9)
Alleghany	70 (112.7)	Gates	90 (144.8)	Pender	100 (160.9)
Anson	70 (112.7)	Graham	80 (128.7)	Perquimans	100 (160.9)
Ashe	70 (112.7)	Granville	70 (112.7)	Person	70 (112.7)
Avery	70 (112.7)	Greene	80 (128.7)	Pitt	90 (144.8)
Beaufort	100 (160.9)	Guilford	70 (112.7)	Polk	80 (128.7)
Bertie	90 (144.8)	Halifax	80 (128.7)	Randolph	70 (112.7)
Bladen	90 (144.8)	Harnett	70 (112.7)	Richmond	70 (112.7)
Brunswick	100 (160.9)	Haywood	80 (128.7)	Robeson	80 (128.7)
Buncombe	80 (128.7)	Henderson	80 (128.7)	Rockingham	70 (112.7)
Burke	70 (112.7)	Hertford	90 (144.8)	Rowan	70 (112.7)
Cabarrus	70 (112.7)	Hoke	70 (112.7)	Rutherford	70 (112.7)
Caldwell	70 (112.7)	Hyde	110 (177.0)	Sampson	90 (144.8)
Camden	100 (160.9)	Iredell	70 (112.7)	Scotland	70 (112.7)
Carteret	110 (177.0)	Jackson	80 (128.7)	Stanley	70 (112.7)
Caswell	70 (112.7)	Johnston	80 (128.7)	Stokes	70 (112.7)
Catawba	70 (112.7)	Jones	100 (160.9)	Surry	70 (112.7)
Cherokee	80 (128.7)	Lee	70 (112.7)	Swain	80 (128.7)
Chatham	70 (112.7)	Lenoir	90 (144.8)	Transylvania	80 (128.7)
Chowan	90 (144.8)	Lincoln	70 (112.7)	Tyrell	100 (160.9)
Clay	80 (128.7)	Macon	80 (128.7)	Union	70 (112.7)
Cleveland	70 (112.7)	Madison	80 (128.7)	Vance	70 (112.7)
Columbus	90 (144.8)	Martin	90 (144.8)	Wake	70 (112.7)
Craven	100 (160.9)	McDowell	70 (112.7)	Warren	70 (112.7)
Cumberland	80 (128.7)	Mecklenburg	70 (112.7)	Washington	100 (160.9)
Currituck	100 (160.9)	Mitchell	70 (112.7)	Watauga	70 (112.7)
Dare	110 (177.0)	Montgomery	70(112.7)	Wayne	80 (128.7)
Davidson	70 (112.7)	Moore	70 (112.7)	Wilkes	70 (112.7)
Davie	70 (112.7)	Nash	80 (128.7)	Wilson	80 (128.7)
Duplin	90 (144.8)	New Hanover	100 (160.9)	Yadkin	70 (112.7)
Durham	70 (112.7)	Northampton	80 (128.7)	Yancey	70 (112.7)
Edgecombe	80 (128.7)	Onslow	100 (160.9)		
Forsyth	70 (112.7)	Orange	70 (112.7)		

Note on the working drawings any anchorages, connectors, inserts, steel sleeves or other such devices used as part of the falsework or formwork that remains in the permanent structure. If the plan notes indicate that the structure contains the necessary corrosion protection required for a Corrosive Site, epoxy coat, galvanize or metalize these devices. Electroplating will not be allowed. Any coating required by the Engineer will be considered incidental to the various pay items requiring temporary works.

B. Review and Approval

The Engineer is responsible for the review and approval of temporary works' drawings.

Submit the working drawings sufficiently in advance of proposed use to allow for their review, revision (if needed), and approval without delay to the work.

Do not start construction of any temporary work for which working drawings are required until the drawings have been approved. Such approval does not relieve the Contractor of the responsibility for the accuracy and adequacy of the working drawings.

The time period for review of the working drawings does not begin until complete drawings and design calculations, when required, are received by the Engineer.

On the drawings, show all information necessary to allow the design of any component to be checked independently as determined by the Engineer.

If requested by the Engineer, submit with the working drawings manufacturer's catalog data listing the weight of all construction equipment that will be supported on the temporary work. Show anticipated total settlements and/or deflections of falsework and forms on the working drawings. Include falsework footing settlements, joint take-up, and deflection of beams or girders. Falsework hangers that support concentrated loads and are installed at the edge of thin top flange concrete girders (such as bulb tee girders) shall be spaced so as not to exceed 75% of the manufacturer's stated safe working load. Use of dual leg hangers (such as Meadow Burke HF-42 and HF-43) are not allowed. Design the falsework and forms supporting deck slabs and overhangs on girder bridges so that there will be no differential settlement between the girders and the deck forms during placement of deck concrete.

4.0 CONSTRUCTION REQUIREMENTS

All requirements of Section 420 of the Standard Specifications apply.

Construct temporary works in conformance with the approved working drawings. Ensure that the quality of materials and workmanship employed is consistent with that assumed in the design of the temporary works. Do not weld falsework members to any portion of the permanent structure unless approved. Show any welding to the permanent structure on the approved construction drawings.

Provide tell-tales attached to the forms and extending to the ground, or other means, for accurate measurement of falsework settlement. Make sure that the anticipated compressive settlement and/or deflection of falsework does not exceed 1 inch (25 mm). For cast-in-place concrete structures, make sure that the calculated deflection of falsework flexural members does not exceed 1/240 of their span regardless of whether or not the deflection is compensated by camber strips.

A. Maintenance and Inspection

Inspect and maintain the temporary work in an acceptable condition throughout the period of its use. Certify that the manufactured devices have been maintained in a condition to allow them to safely carry their rated loads. Clearly mark each piece so that its capacity can be readily determined at the job site.

Perform an in-depth inspection of an applicable portion(s) of the temporary works, in the presence of the Engineer, not more than 24 hours prior to the beginning of each concrete placement. Inspect other temporary works at least once a month to ensure that they are functioning properly. Have a North Carolina Registered Professional Engineer inspect the cofferdams, shoring, sheathing, support of excavation structures, and support systems for load tests prior to loading.

B. Foundations

Determine the safe bearing capacity of the foundation material on which the supports for temporary works rest. If required by the Engineer, conduct load tests to verify proposed bearing capacity values that are marginal or in other high-risk situations.

The use of the foundation support values shown on the contract plans of the permanent structure is permitted if the foundations are on the same level and on the same soil as those of the permanent structure.

Allow for adequate site drainage or soil protection to prevent soil saturation and washout of the soil supporting the temporary works supports.

If piles are used, the estimation of capacities and later confirmation during construction using standard procedures based on the driving characteristics of the pile is permitted. If preferred, use load tests to confirm the estimated capacities; or, if required by the Engineer conduct load tests to verify bearing capacity values that are marginal or in other high risk situations.

The Engineer reviews and approves the proposed pile and soil bearing capacities.

5.0 REMOVAL

Unless otherwise permitted, remove and keep all temporary works upon completion of the work. Do not disturb or otherwise damage the finished work.

Remove temporary works in conformance with the contract documents. Remove them in such a manner as to permit the structure to uniformly and gradually take the stresses due to its own weight.

6.0 METHOD OF MEASUREMENT

Unless otherwise specified, temporary works will not be directly measured.

7.0 BASIS OF PAYMENT

Payment at the contract unit prices for the various pay items requiring temporary works will be full compensation for the above falsework and formwork.

SUBMITTAL OF WORKING DRAWINGS

(1-27-10)

1.0 GENERAL

Submit working drawings in accordance with Article 105-2 of the *Standard Specifications* and this provision. For this provision, "submittals" refers to only those listed in this provision. The list of submittals contained herein does not represent a list of required submittals for the project. Submittals are only necessary for those items as required by the contract. Make submittals that are not specifically noted in this provision directly to the Resident Engineer. Either the Structure Design Unit or the Geotechnical Engineering Unit or both units will jointly review submittals.

If a submittal contains variations from plan details or specifications or significantly affects project cost, field construction or operations, discuss the submittal with and submit all copies to the Resident Engineer. State the reason for the proposed variation in the submittal. To minimize review time, make sure all submittals are complete when initially submitted. Provide a contact name and information with each submittal. Direct any questions regarding submittal requirements to the Resident Engineer, Structure Design Unit contacts or the Geotechnical Engineering Unit contacts noted below.

In order to facilitate in-plant inspection by NCDOT and approval of working drawings, provide the name, address and telephone number of the facility where fabrication will actually be done if different than shown on the title block of the submitted working drawings. This includes, but is not limited to, precast concrete items, prestressed concrete items and fabricated steel or aluminum items.

2.0 ADDRESSES AND CONTACTS

For submittals to the Structure Design Unit, use the following addresses:

Via US mail:

Mr. G. R. Perfetti, P. E.
State Bridge Design Engineer
North Carolina Department
of Transportation
Structure Design Unit
1581 Mail Service Center
Raleigh, NC 27699-1581
Attention: Mr. P. D. Lambert, P. E.

Via other delivery service:

Mr. G. R. Perfetti, P. E.
State Bridge Design Engineer
North Carolina Department
of Transportation
Structure Design Unit
1000 Birch Ridge Drive
Raleigh, NC 27610
Attention: Mr. P. D. Lambert, P. E.

Submittals may also be made via email.

Send submittals to:

plambert@ncdot.gov (Paul Lambert)

Send an additional e-copy of the submittal to the following address:

jgaither@ncdot.gov (James Gaither)

For submittals to the Geotechnical Engineering Unit, use the following addresses:

For projects in Divisions 1-7, use the following Eastern Regional Office address:

Via US mail:

Mr. K. J. Kim, Ph. D., P. E.
Eastern Regional Geotechnical
Manager
North Carolina Department
of Transportation
Geotechnical Engineering Unit
Eastern Regional Office
1570 Mail Service Center
Raleigh, NC 27699-1570

Via other delivery service:

Mr. K. J. Kim, Ph. D., P. E.
Eastern Regional Geotechnical
Manager
North Carolina Department
of Transportation
Geotechnical Engineering Unit
Eastern Regional Office
3301 Jones Sausage Road, Suite 100
Garner, NC 27529

For projects in Divisions 8-14, use the following Western Regional Office address:

Via US mail:

Mr. John Pilipchuk, L. G., P. E.
Western Regional Geotechnical
Manager
North Carolina Department
of Transportation
Geotechnical Engineering Unit
Western Regional Office
5253 Z Max Boulevard
Harrisburg, NC 28075

Via other delivery service:

Mr. John Pilipchuk, L. G., P. E.
Western Region Geotechnical
Manager
North Carolina Department
of Transportation
Geotechnical Engineering Unit
Western Regional Office
5253 Z Max Boulevard
Harrisburg, NC 28075

The status of the review of structure-related submittals sent to the Structure Design Unit can be viewed from the Unit's web site, via the "Contractor Submittal" link.

Direct any questions concerning submittal review status, review comments or drawing markups to the following contacts:

Primary Structures Contact:	Paul Lambert (919) 250 – 4041 (919) 250 – 4082 facsimile plambert@ncdot.gov
Secondary Structures Contacts:	James Gaither (919) 250 – 4042 David Stark (919) 250 – 4044
Eastern Regional Geotechnical Contact (Divisions 1-7):	K. J. Kim (919) 662 – 4710 (919) 662 – 3095 facsimile kkim@ncdot.gov
Western Regional Geotechnical Contact (Divisions 8-14):	John Pilipchuk (704) 455 – 8902 (704) 455 – 8912 facsimile jpilipchuk@ncdot.gov

3.0 SUBMITTAL COPIES

Furnish one complete copy of each submittal, including all attachments, to the Resident Engineer. At the same time, submit the number of hard copies shown below of the same complete submittal directly to the Structure Design Unit and/or the Geotechnical Engineering Unit.

The first table below covers "Structure Submittals". The Resident Engineer will receive review comments and drawing markups for these submittals from the Structure Design Unit. The second table in this section covers "Geotechnical Submittals". The Resident Engineer will receive review comments and drawing markups for these submittals from the Geotechnical Engineering Unit.

Unless otherwise required, submit one set of supporting calculations to either the Structure Design Unit or the Geotechnical Engineering Unit unless both units require submittal copies in which case submit a set of supporting calculations to each unit. Provide additional copies of any submittal as directed by the Engineer.

STRUCTURE SUBMITTALS

Submittal	Copies Required by Structure Design Unit	Copies Required by Geotechnical Engineering Unit	Contract Reference Requiring Submittal ¹
Arch Culvert Falsework	5	0	Plan Note, SN Sheet & "Falsework and Formwork"
Box Culvert Falsework ⁷	5	0	Plan Note, SN Sheet & "Falsework and Formwork"
Cofferdams	6	2	Article 410-4
Evazote Joint Seals ⁶	9	0	"Evazote Joint Seals"
Expansion Joint Seals (hold down plate type with base angle)	9	0	"Expansion Joint Seals"
Expansion Joint Seals (modular)	2, then 9	0	"Modular Expansion Joint Seals"
Expansion Joint Seals (strip seals)	9	0	"Strip Seals"
Falsework & Forms ² (substructure)	8	0	Article 420-3 & "Falsework and Formwork"
Falsework & Forms (superstructure)	8	0	Article 420-3 & "Falsework and Formwork"
Girder Erection over Railroad	5	0	Railroad Provisions
Maintenance and Protection of Traffic Beneath Proposed Structure	8	0	"Maintenance and Protection of Traffic Beneath Proposed Structure at Station ____"
Metal Bridge Railing	8	0	Plan Note
Metal Stay-in-Place Forms	8	0	Article 420-3
Metalwork for Elastomeric Bearings ^{4,5}	7	0	Article 1072-10

Miscellaneous Metalwork ^{4,5}	7	0	Article 1072-10
Optional Disc Bearings ⁴	8	0	“Optional Disc Bearings”
Overhead Signs	13	0	Article 903-3(C) & Applicable Provisions
Pile Splicers	7	2	Subarticle 450-7(C) & “Piles”
Pile Points	7	2	Subarticle 450-7(D) & “Piles”
Placement of Equipment on Structures (cranes, etc.)	7	0	Article 420-20
Pot Bearings ⁴	8	0	“Pot Bearings”
Precast Concrete Box Culverts	2, then 1 reproducible	0	“Optional Precast Reinforced Concrete Box Culvert at Station ____”
Precast Retaining Wall Panels	10	1	Article 1077-2
Prestressed Concrete Cored Slab (detensioning sequences) ³	6	0	Article 1078-11
Prestressed Concrete Deck Panels	6 and 1 reproducible	0	Article 420-3
Prestressed Concrete Girder (strand elongation and detensioning sequences)	6	0	Articles 1078-8 and 1078- 11
Removal of Existing Structure over Railroad	5	0	Railroad Provisions
Revised Bridge Deck Plans (adaptation to prestressed deck panels)	2, then 1 reproducible	0	Article 420-3
Revised Bridge Deck Plans (adaptation to modular expansion joint seals)	2, then 1 reproducible	0	“Modular Expansion Joint Seals”
Sound Barrier Wall Casting Plans	10	0	Article 1077-2 & “Sound Barrier Wall”
Sound Barrier Wall Steel Fabrication Plans ⁵	7	0	Article 1072-10 & “Sound Barrier Wall”
Structural Steel ⁴	2, then 7	0	Article 1072-10

Temporary Detour Structures	10	2	Article 400-3 & “Construction, Maintenance and Removal of Temporary Structure at Station _____”
TFE Expansion Bearings ⁴	8	0	Article 1072-10

FOOTNOTES

1. References are provided to help locate the part of the contract where the submittals are required. References in quotes refer to the provision by that name. Articles and subarticles refer to the *Standard Specifications*.
2. Submittals for these items are necessary only when required by a note on plans.
3. Submittals for these items may not be required. A list of pre-approved sequences is available from the producer or the Materials & Tests Unit.
4. The fabricator may submit these items directly to the Structure Design Unit.
5. The two sets of preliminary submittals required by Article 1072-10 of the *Standard Specifications* are not required for these items.
6. Submittals for Fabrication Drawings are not required. Submittals for Catalogue Cuts of Proposed Material are required. See Section 5.A of the referenced provision.
7. Submittals are necessary only when the top slab thickness is 18” or greater.

GEOTECHNICAL SUBMITTALS

Submittal ¹	Copies Required by Geotechnical Engineering Unit	Copies Required by Structure Design Unit	Contract Reference Requiring Submittal ²
Crosshole Sonic Logging (CSL) Reports	1	0	“Crosshole Sonic Logging”
Drilled Pier Construction Sequence Plans	1	0	“Drilled Piers”
Pile Driving Analyzer (PDA) Reports	2	0	“Pile Driving Analyzer”
Pile Driving Equipment Data ³	1	0	Article 450-5 & “Piles”
Retaining Walls	8	2	Applicable Provisions
Contractor Designed Shoring	7	2	“Temporary Shoring”, “Anchored Temporary Shoring” & “Temporary Soil Nail Walls”

FOOTNOTES

1. With the exception of “Pile Driving Equipment Data”, electronic copies of geotechnical submittals are required. See referenced provision.
2. References are provided to help locate the part of the contract where the submittals are required. References in quotes refer to the provision by that name. Articles refer to the *Standard Specifications*.
3. Download Pile Driving Equipment Data Form from following link:
<http://www.ncdot.org/doh/preconstruct/highway/geotech/formdet/>
 Submit one hard copy of the completed form to the Resident Engineer. Submit a second copy of the completed form electronically, by facsimile or via US Mail or other delivery service to the Geotechnical Engineering Unit. Electronic submission is preferred. See second page of form for submittal instructions.

**CONSTRUCTION, MAINTENANCE AND REMOVAL OF
TEMPORARY ACCESS AT STATION 118+17.500-L-**

(11-17-06)

1.0 GENERAL

Construct, maintain, and remove the temporary access required to provide the working area necessary for construction of the new bridge, construction of the temporary detour structure, or for the removal of an existing bridge, as applicable. Temporary access may include other methods than those outlined in this Special Provision; however, all types of temporary access are required to meet the requirements of all permits, the Standard Specifications, and this Special Provision.

2.0 TEMPORARY WORK BRIDGE

Construction of a temporary work bridge is permitted as shown on the plans. The temporary work bridge shall have a minimum span length of 20 feet. Submit details of the temporary work bridge to the Engineer prior to constructing the work bridge to ensure conformance with the plans and all permits. Completely remove the temporary bridge prior to final acceptance or as otherwise required by the permits.

3.0 BASIS OF PAYMENT

The lump sum price bid for “Construction, Maintenance and Removal of Temporary Access at Station _____” will be full compensation for the above work, or other methods of access, including all material, work bridge components, equipment, tools, labor, disposal, and incidentals necessary to complete the work.

**CONSTRUCTION, MAINTENANCE AND REMOVAL OF
TEMPORARY ACCESS AT STATION 77+44.000 -L- (LT. LN.)**

(11-17-06)

1.0 GENERAL

Construct, maintain, and remove the temporary access required to provide the working area necessary for construction of the new bridge, construction of the temporary detour structure, or for the removal of an existing bridge, as applicable. Temporary access may include other methods than those outlined in this Special Provision; however, all types of temporary access are required to meet the requirements of all permits, the Standard Specifications, and this Special Provision.

2.0 TEMPORARY WORK BRIDGE

Construction of a temporary work bridge is permitted as shown on the plans. The temporary work bridge shall have a minimum span length of 20 feet. Submit details of the temporary work bridge to the Engineer prior to constructing the work bridge to ensure conformance with the plans and all permits. Completely remove the temporary bridge prior to final acceptance or as otherwise required by the permits.

3.0 BASIS OF PAYMENT

The lump sum price bid for “Construction, Maintenance and Removal of Temporary Access at Station _____” will be full compensation for the above work, or other methods of access, including all material, work bridge components, equipment, tools, labor, disposal, and incidentals necessary to complete the work.

OPTIONAL DISC BEARINGS

(6-07-05)

1.0 GENERAL

This item consists of furnishing, fabrication and installation of disc bearings in accordance with AASHTO Standard Specifications, the Standard Specifications, the recommendations of the manufacturer and as specified herein. In addition, all plan notes pertaining to furnishing and installing pot bearing assemblies shall also apply to disc bearing assemblies, except as noted herein.

Disc Bearings consist of a polyether urethane structural element (disc) confined by upper and lower steel bearing plates. Equip disc bearings with a shear restriction mechanism to prevent movement of the disc. Supply disc bearings as fixed bearings and guided expansion bearings as designated by the Contract Documents.

Fixed disc bearings allow rotation but no longitudinal or transverse movement in the bearing plane. Fixed bearings consist of a sole plate, an elastomer disc, upper bearing plate, lower bearing plate, masonry plate, anchor bolts, nuts and washers.

Guided expansion disc bearings allow rotation and only longitudinal movement in the bearing plane. Guided expansion disc bearings consist of a sole plate, a top steel plate with a polished stainless steel sheet facing bearing on a fixed disc bearing with a layer of virgin polytetrafluoroethylene (PTFE) material on its top, masonry plate, anchor bolt assembly which includes anchor bolts, nuts, washers, pipe sleeves, a closure plate, grout and various sizes of standard pipe and any other necessary material as detailed on the plans. To allow longitudinal movement, bond a polytetrafluoroethylene (PTFE) sheet to the upper steel bearing plate. Support a sliding steel top bearing plate with the upper steel bearing plate. Face the mating surface of the sliding steel top bearing plate with polished stainless steel. Use either a guide bar or keyway system to restrict transverse movement. Face the sliding surfaces of the guide bar or keyway systems with either PTFE sheets or stainless steel.

2.0 MATERIALS

Use disc bearings produced by the same manufacturer.

Use AASHTO M270 Grade 50W (345W) for all steel in the disc bearings. Clean, coat, and seal the plates in the disc bearing assemblies except for the areas with special facings and the areas that come in contact with the elastomer disc, in accordance with the Special Provision for “Thermal Sprayed Coatings (Metallization)”. Coat surfaces to a thickness of 8 mils (0.200 mm) minimum on all external parts. Repair surfaces that are abraded or damaged after the application of metallizing in accordance with the Special Provision for “Thermal Sprayed Coatings (Metallization)”.

Provide anchor bolts and nuts in accordance with the Standard Specifications.

When the maximum plan dimension of the sheet is 12" (300 mm) or less, provide a stainless steel sheet in expansion disc bearings that is at least 16 gage or 1/16" (1.6 mm). When the maximum plan dimension is greater than 12" (300 mm), provide a stainless steel sheet that is at least 11 gage or 1/8" (3 mm). Ensure that all stainless steel sheets are in conformance with ASTM A167/A240 Type 304 and polished to a minimum #8 mirror surface finish.

Blast clean the surface of the plate that will be attached to the stainless sheet to a near white condition in accordance with the Standard Specifications. Position and clamp the back of the stainless sheet that is to be in contact with the steel plate on the steel plate. Apply the stainless steel to the blast cleaned surface of the steel plate as soon as possible after blasting and before any visible oxidation of the blast cleaned surface occurs. Weld the stainless sheet continuously around its perimeter using a tungsten inert gas, wire-fed welder.

For the PTFE sheet, used as a mating surface for the stainless sheet, provide an unfilled virgin PTFE Sheet (Recessed) or a glass-fiber filled PTFE sheet, resulting from skiving billets formed under hydraulic pressure and heat. Provide resin that conforms to the requirements of ASTM D4894 or D4895.

To bond the PTFE and the bearing plate, use heat cured high temperature epoxy capable of withstanding temperature of -320°F to 500°F (-195 °C to 260 °C).

Mold the polyether urethane structural element from a polyether urethane compound. Conform the physical properties of the polyether urethane to the following requirements:

Physical Property	ASTM Test Method	Requirements	
		Min.	Max.
Hardness, Type D Durometer	D2240	60	64
Tensile Stress psi (Mpa) At 100% elongation At 200% elongation	D412	2000 (13.8) 3700 (25.5)	-----
Tensile Strength psi (Mpa)	D412	5000 (34.5)	-----
Ultimate Elongation %	D412	220	-----
Compression Set % 22 hrs. at 158°F (70°C)	D395	-----	40

3.0 DESIGN

Design the disc bearings for the loads and movements shown on the contract plans. However, use the anchor bolt size, length, spacing and masonry plate thickness as shown on the contract plans and provide an overall height of the bearing assembly that is at least the height shown on the contract plans, but no more than 1/2 inch (13 mm) greater than this height. Either combine and cast the sole plate and top plate/upper bearing plate and the lower bearing plate and masonry plate as a single unit or weld together prior to the installation of the disc.

When designing the bearings, use the following allowable bearing stresses:

- On polyether urethane structural element: 5000 psi (34.5 MPa)
- On PTFE Sliding Surface, filled or unfilled PTFE (recessed): 3500 psi (24.1 MPa)

Submit eight sets of shop drawings and one set of design calculations for review, comments and acceptance. Have a North Carolina Registered Professional Engineer check and seal the shop drawings and design calculations.

After the Engineer reviews the drawings and, if necessary, corrections are made, submit one 22" x 34" reproducible set of the working drawings.

4.0 SAMPLING AND TESTING

A. Sampling

The manufacturer is responsible for randomly selecting and testing sample bearings from completed lots of bearings. The manufacturer is also responsible for certifying that the completed bearings and their components have been tested and are in compliance with the requirements of this Special Provision. Have the manufacturer furnish the results of the tests to the Materials and Tests Engineer.

B. Testing

1. Proof Load Test

Load a test bearing to 150% of the bearing's rated design capacity and simultaneously subject it to a rotational range of 0.02 radians (1.146°) for a period of 1 hour.

Have the bearing visually examined both during the test and upon disassembly after the test. Any resultant visual defects, such as extruded or deformed elastomer or PTFE, damaged seals or rings, or cracked steel is cause for rejection.

Keep continuous and uniform contact between the polyether urethane element and the bearing plates and between the sliding steel top plate and the upper bearing plate for the duration of the test. Any observed lift-off is cause for rejection.

2. Sliding Coefficient of Friction

For all guided and non-guided expansion type bearings, measure the sliding coefficient of friction at the bearing's design capacity in accordance with the test method described below, and on the fifth and fiftieth cycles, at a sliding speed of 1 in/min (25 mm/min).

Calculate the sliding coefficient of friction as the horizontal load required to maintain continuous sliding of one bearing, divided by the bearing's vertical design capacity.

The test results are evaluated as follows:

- A maximum measured sliding coefficient of friction of 3%.
- A visual examination both during and after the test. Any resultant visual defects, such as bond failure, physical destruction, cold flow of PTFE to the point of debonding, or damaged components is cause for rejection of the lot.

Using undamaged test bearings in the work is permitted.

3. Test Method

The test method and equipment shall meet the following requirements:

- f. Arrange the test to determine the coefficient of friction on the first movement of the manufactured bearing.
- g. Clean the bearing surface prior to testing.
- h. Conduct the test at maximum working stress for the PTFE surface with the test load applied continuously for 12 hours prior to measuring friction.
- i. Determine the first movement static and dynamic coefficient of friction of the test bearing at a sliding speed of less than 1 in/min (25 mm/min), not to exceed:

0.04	unfilled PTFE
0.08	filled PTFE
- j. Subject the bearing specimen to 100 movements of at least 1 inch (25 mm) of relative movement and, if the test facility permits, the full design movement at a speed of less than 1 ft/min (300 mm/min). Following this test determine the static and kinetic coefficient of friction again. The specimen is considered a failure if it exceeds the values measured in (d) above or if it shows any signs of bond failure or other defects.

Bearings represented by test specimens passing the above requirements are approved for use in the structure subject to on-site inspection for visible defects.

5.0 INSTALLATION

Store disc bearings delivered to the bridge site under cover on a platform above the ground surface. Protect the bearings from injury at all times and, before placing the bearings, dry and clean all dirt, oil, grease or other foreign substances from the bearing. Do not disassemble the bearings during installation, except at the manufacturer's direction. Place the bearings in accordance with the recommendations of the manufacturer, Contract Drawings, and as directed by the Engineer. If there is any discrepancy between the recommendations of the manufacturer, Special Provisions, and Contract Drawings, the Engineer is the sole judge in reconciling any such discrepancy.

Provide preformed bearing pads under the masonry plates in accordance with Article 1079-1 of the Standard Specifications.

Do not install any bearing before the Engineer approves it.

6.0 BASIS OF PAYMENT

Payment for all optional disc bearings will be at the lump sum contract price bid for "Pot Bearings" which includes full compensation for furnishing all disc bearings, labor, materials, tools, equipment, testing and incidentals required to complete the work in accordance with the Standard Specifications, this Special Provision, the manufacturer's requirements and as directed by the Engineer.

CRANE SAFETY

(8-15-05)

Comply with the manufacturer specifications and limitations applicable to the operation of any and all cranes and derricks. Prime contractors, sub-contractors, and fully operated rental companies shall comply with the current Occupational Safety and Health Administration regulations (OSHA).

Submit all items listed below to the Engineer prior to beginning crane operations involving critical lifts. A critical lift is defined as any lift that exceeds 75 percent of the manufacturer's crane chart capacity for the radius at which the load will be lifted or requires the use of more than one crane. Changes in personnel or equipment must be reported to the Engineer and all applicable items listed below must be updated and submitted prior to continuing with crane operations.

CRANE SAFETY SUBMITTAL LIST

- A. **Competent Person:** Provide the name and qualifications of the “Competent Person” responsible for crane safety and lifting operations. The named competent person will have the responsibility and authority to stop any work activity due to safety concerns.

- B. **Riggers:** Provide the qualifications and experience of the persons responsible for rigging operations. Qualifications and experience should include, but not be limited to, weight calculations, center of gravity determinations, selection and inspection of sling and rigging equipment, and safe rigging practices.

- C. **Crane Inspections:** Inspection records for all cranes shall be current and readily accessible for review upon request.

- D. **Certifications:** By July 1, 2006, crane operators performing critical lifts shall be certified by NC CCO (National Commission for the Certification of Crane Operators), or satisfactorily complete the Carolinas AGC’s Professional Crane Operator’s Proficiency Program. Other approved nationally accredited programs will be considered upon request. All crane operators shall also have a current CDL medical card. Submit a list of anticipated critical lifts and corresponding crane operator(s). Include current certification for the type of crane operated (small hydraulic, large hydraulic, small lattice, large lattice) and medical evaluations for each operator.

SHIPPING STEEL STRUCTURAL MEMBERS

(7-18-06)


Section 1072-23 Marking and Shipping

Add the following paragraphs after the third paragraph of the Section.


Load and ship steel beams and girders in accordance with the Figure below for all types of transportation.

Below is the sketches provided to Materials and Tests Unit on May 8, 1991. When the contractor wishes to place members on trucks not in accordance with these limits, to ship by rail, to attach shipping restraints to the members, to ship horizontally curved steel members, or to invert members, he shall submit a shipping plan prior to shipping. See also Article 1072-11.

LIMITS FOR PLACEMENT OF BEAMS AND GIRDERS DURING SHIPMENT

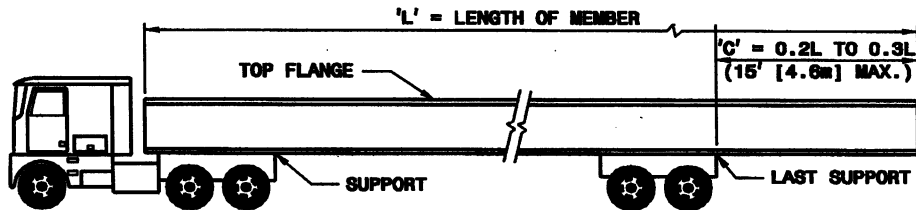

WHEN 'C' = 15' (4.6m) OR LESS

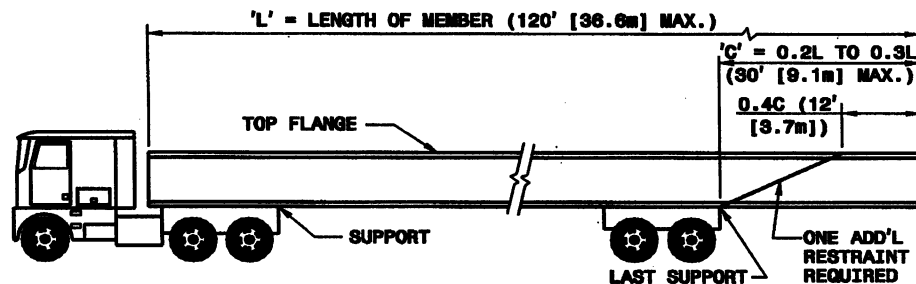

WHEN 'C' = OVER 15' (4.6m) THRU 30' (9.1m)

L	MIN. 'C'	MAX 'C'
75 (22.9m)	15 (4.6m)	22½ (6.9m)
80 (24.4m)	16 (4.9m)	24 (7.3m)
85 (25.9m)	17 (5.2m)	25½ (7.8m)
90 (27.4m)	18 (5.5m)	27 (8.2m)
95 (29.0m)	19 (5.8m)	28½ (8.7m)
100 (30.5m)	20 (6.1m)	30 (9.1m)
105 (32.0m)	21 (6.4m)	30 (9.1m)
110 (33.5m)	22 (6.7m)	30 (9.1m)
115 (35.1m)	23 (7.0m)	30 (9.1m)
120 (36.6m)	24 (7.3m)	30 (9.1m)

NOTES: ALL DIMENSIONS ARE IN FEET (METERS).
 TRUCK LOADING SHOWN FOR SIMPLICITY
 DIMENSIONS APPLY TO ALL TYPES OF SHIPMENTS.

GROUT FOR STRUCTURES

(7-12-07)

1.0 DESCRIPTION

This special provision addresses grout for use in structures, including continuous flight auger (CFA) piles, micropiles, soil nail and anchored retaining walls and backfilling crosshole sonic logging (CSL) tubes or grout pockets, shear keys, dowel holes and recesses for cored slabs and box beams. This provision does not apply to grout placed in post-tensioning ducts for bridge beams, girders, or decks. Provide grout composed of portland cement, water and at the Contractor’s option, fine aggregate and/or pozzolan. If necessary, use set controlling admixtures. Proportion, mix and place grout in accordance with the plans, the applicable section of the *Standard Specifications* or special provision for the application and this provision.

2.0 MATERIALS

Refer to Division 10 of the *Standard Specifications*:

Item	Article
Portland Cement	1024-1
Water	1024-4
Fine Aggregate	1014-1
Fly Ash	1024-5
Ground Granulated Blast Furnace Slag	1024-6
Admixtures	1024-3

At the Contractor’s option, use an approved packaged grout in lieu of the materials above with the exception of the water. Contact the Materials and Tests (M&T) Unit for a list of approved packaged grouts. Consult the manufacturer to determine if the packaged grout selected is suitable for the application and meets the compressive strength and shrinkage requirements.

3.0 REQUIREMENTS

Unless required elsewhere in the Contract, provide non-metallic grout with minimum compressive strengths as follows:

Property	Requirement
Compressive Strength @ 3 days	2500 psi (17.2 MPa)
Compressive Strength @ 28 days	4500 psi (31.0 MPa)

For applications other than micropiles, soil nails and ground anchors, use non-shrink grout with shrinkage of less than 0.15%.

When using approved packaged grout, a grout mix design submittal is not required. Submit grout mix designs in terms of saturated surface dry weights on M&T Form 312U in accordance with the applicable section of the *Standard Specifications* or special provision

for the structure. Use an approved testing laboratory to determine the grout mix proportions. Adjust proportions to compensate for surface moisture contained in the aggregates at the time of mixing. Changes in the saturated surface dry mix proportions will not be permitted unless a revised grout mix design submittal is accepted.

For each grout mix design, provide laboratory test results for compressive strength, density, flow and if applicable, aggregate gradation and shrinkage. Submit compressive strength for at least 3 cube and 2 cylinder specimens at the age of 3, 7, 14 and 28 days for a total of at least 20 specimens tested. Perform laboratory tests in accordance with the following:

Property	Test Method
Compressive Strength	AASHTO T106 and T22
Density	AASHTO T133
Flow for Sand Cement Grout	ASTM C939 (as modified below)
Flow for Neat Cement Grout (no fine aggregate)	Marsh Funnel and Cup API RP 13B-1, Section 2.2
Aggregate Gradation for Sand Cement Grout	AASHTO T27
Shrinkage for Non-shrink Grout	ASTM C1090

When testing grout for flow in accordance with ASTM C939, modify the flow cone outlet diameter from 1/2 to 3/4 inch (13 to 19 mm).

When grout mix designs are submitted, the Engineer will review the mix designs and notify the Contractor as to their acceptability. Do not use grout mix designs until written acceptance has been received. Acceptance of grout mix designs or use of approved packaged grouts does not relieve the Contractor of responsibility to furnish a product that meets the Contract requirements.

Upon written request from the Contractor, a grout mix design accepted and used satisfactorily on a Department project may be accepted for use on other projects.

4.0 SAMPLING AND PLACEMENT

The Engineer will determine the locations to sample grout and the number and type of samples collected for field and laboratory testing. Use API RP 13B-1 for field testing grout flow and density of neat cement grout. The compressive strength of the grout will be considered the average compressive strength test results of 3 cube or 2 cylinder specimens at 28 days.

Do not place grout if the grout temperature is less than 50°F (10°C) or more than 90°F (32°C) or if the air temperature measured at the location of the grouting operation in the shade away from artificial heat is below 40°F (4°C).

Provide grout at a rate that permits proper handling, placing and finishing in accordance with the manufacturer’s recommendations unless directed otherwise by the Engineer. Use grout free of any lumps and undispersed cement. Agitate grout continuously before placement.

Control grout delivery so the interval between placing batches in the same component does not exceed 20 minutes. Place grout before the time between adding the mixing water and placing the grout exceeds that in the table below.

ELAPSED TIME FOR PLACING GROUT		
(with continuous agitation)		
Air or Grout Temperature Whichever is Higher	Maximum Elapsed Time	
	No Set Retarding Admixture Used	Set Retarding Admixture Used
90°F (32°C) or above	30 min.	1 hr. 15 min.
80°F (27°C) through 89°F (31°C)	45 min.	1 hr. 30 min.
79°F (26°C) or below	60 min.	1 hr. 45 min.

5.0 MISCELLANEOUS

Comply with Articles 1000-9 through 1000-12 of the *Standard Specifications* to the extent applicable for grout in lieu of concrete.

HIGH STRENGTH BOLTS

(5-25-10)

The 2006 Standard Specifications shall be revised as follows:

In Section 440-8(A) - **General**, revise the third paragraph and insert a new paragraph four, respectively, as follows:

Make sure that plain bolts and washers have a thin coat of lubricant at the time of installation.

Use nuts that are pre-waxed by the producer/supplier prior to shipping to the project.

In Section 440-8(D) – **Inspection** replace the first sub-paragraph under the third paragraph with the following:

At least once each working day, place 3 calibration sample bolts of the same grade, size, representative length, and conditions as those under inspection in a tension indicating calibration device. Furnish a tension indicating calibration

device certified by an approved independent testing lab within 12 calendar months prior to testing the bolts under inspection. The calibration device should be in good working order and provide accuracy within plus or minus 10 percent for the range of loads between 25,000 and 40,000 pounds. Place a washer under the part turned in tightening for each bolt if washers are so used in the structure. If no washer is used make sure that the material abutting the part turned is the same as that used in the structure.

PRESTRESSED CONCRETE MEMBERS

(10-12-10)

The 2006 Standard Specifications shall be revised as follows:

Section 1078-1 - General, add the following after the second paragraph:

The intent of this section is to require the producer to provide prestressed concrete members that meet the Specifications and exhibit characteristics that are not objectionable to the Department.

(A) Producer Qualification

Producers of precast, prestressed concrete members are required to establish proof of their competency and responsibility in accordance with the Precast/Prestressed Concrete Institute's (PCI) Plant Certification Program in order to perform work for the project. Certification of the manufacturing plant under the PCI program and submission of proof of certification to the State Materials Engineer is required prior to beginning fabrication. Maintain certification at all times while work is being performed for the Department. Submit proof of certification following each PCI audit to the State Materials Engineer for continued qualification. These same requirements apply to producers subcontracting work from the producer directly employed by the Contractor.

Employ producers PCI certified in Product Group B, Bridge Products, and in one of the appropriate categories as listed below:

- B2 Prestressed Miscellaneous Bridge Products: Includes solid piles, sheet piles and bent caps.
- B3 Prestressed Straight-Strand Bridge Members: Includes all box beams, cored slabs, straight-strand girders and bulb-tees, bridge deck panels, hollow piles, prestressed culverts and straight strand segmental components.
- B4 Prestressed Deflected-Strand Bridge Members: Includes deflected strand girders and bulb-tees, haunched girders, deflected strand segmental superstructure components and other post-tensioned elements.

Categories for elements not listed above will be as required by the project special provision or plans.

(B) Working Drawing Submittals

Prior to casting the members, submit complete working drawings to the Engineer for approval. The drawings shall detail the exact location and description of all casting holes, attachments and inserts cast in the member for both temporary and permanent applications. The casting holes, attachments and inserts are in association with, but not limited to: fall protection, overhang falsework, metal stay-in-place forms, solar platforms, temporary girder bracing, transit, erection, lifting and handling. If the plan notes indicate that the structure contains the necessary corrosion protection required for a Corrosive Site, epoxy coat, galvanize or metalize all metallic components except stainless steel and malleable iron components. Electroplating will not be allowed.

Section 1078-7 – Placing Strands, Ties, and Reinforcing Steel, replace the first paragraph with the following:

Position strands, ties, supports, reinforcing bars of the sizes shown on the plans and bearing plates in accordance with the detailed dimensions shown on the plans and effectively secure against displacement from their correct positions. The use of previously tensioned strands is not permitted. For prestressing strands, do not allow deflections or displacements of any kind between the end anchorages unless shown on the plans. Place the steel reinforcing in final position after tensioning of the strands. Bend all tie wires to the inside of the member so that the ends are farther from the edge than the material tied. Support bottom strands spacings not to exceed 20 feet by supports meeting the requirements of Article 1070-4 or by other approved means. Plastic supports may be used when approved.

Section 1078-7 – Placing Strands, Ties, and Reinforcing Steel, replace the third paragraph with the following:

Strand splices are only permitted at the end of a reel and when using a single strand jack. Ensure that the strand lengths to be spliced together have the same lay of wire to avoid unraveling and position the splice so that it does not fall within a member. Do not torch cut the ends of the spliced strand lengths. Cut by shears, abrasive grinders, or other means approved by the Engineer. No more than one strand splice per bed is allowed on an individual strand and the use of previously tensioned strands for splicing is not permitted.

Section 1078-8 – Tensioning Procedure, add the following to the beginning of the Section:

A producer quality control representative shall be present during strand tensioning.

Section 1078-9 – Placing Concrete, replace the entire Section with the following:

Place concrete in accordance with Article 1077-8 and the additional requirements of this article.

Upon completion of stressing strand, place concrete within a reasonable time to prevent contamination of the strands and reinforcing steel.

Place concrete for girders 54" or less in height, and concrete for all cored slabs and box beams, in 2 or more equal horizontal layers. Place concrete for girders over 54" in height in 3 horizontal layers. When placing concrete in 3 layers locate the top of the first layer approximately at the top of the bottom flange and locate the top of the second layer approximately at the top of the web. To prevent separation of surfaces between layers, do not allow the time between successive placements onto previously placed concrete to exceed 20 minutes, unless the previously placed concrete has not yet stiffened, as evidenced by the continuous effective use of vibration. Should shrinkage or settlement cracks occur, the Engineer reserves the right to require additional layers and/or vibration.

The requirement of the above paragraph may be waived with the permission of the Engineer if self consolidating concrete is used.

Internal or a combination of internal and external vibration is required as is necessary to produce uniformly dense concrete without honeycomb.

Place concrete in cold weather in accordance with the requirements of Article 420-9.

Place concrete in daylight unless an adequate lighting system meeting the approval of the Engineer is provided.

Do not exceed a temperature of 95°F in the freshly mixed concrete when placed in the forms.

Place the concrete in the bed in one continuous operation, finishing each member before proceeding to the next one. If the pour stops before the concrete in all the members in the bed is placed, start curing immediately. Do not place concrete in any remaining members in that bed setup once curing at elevated temperatures has begun.

When cored slabs and box beams are cast, employ an internal hold-down system to prevent the voids from moving. At least six weeks prior to casting cored slabs or box beams, submit to the Engineer for review and comment, detailed drawings of the proposed void material and hold-down system. In addition to structural details, indicate the location and spacing of the holds-downs. Submit the proposed method of concrete placement and of consolidating the concrete under the void.

Section 1078-11 – Transfer of Load, replace the first paragraph with the following:

A producer quality control representative or equivalent qualified personnel shall be present during removal of forms and during transfer of load.

Transfer load from the anchorages to the members when the concrete reaches the required compressive strength shown on the plans. Loosen and remove all formwork in one continuous operation as quickly as possible as soon as release strength is obtained. As soon as the forms are removed, and after the NCDOT Inspector has had a reasonable opportunity to inspect the member, transfer the load from the anchorages to the members as quickly as possible in one continuous operation using the approved detensioning sequence.

Section 1078-12 – Vertical Cracks in Prestressed Concrete Girders Prior to Detensioning, replac

This Section addresses prestressed concrete members that have vertical casting cracks prior to strand detensioning. Certain types of these cracks have been determined by the Department to render the girders unacceptable.

Unacceptable cracked members are those with two or more vertical cracks spaced at a distance less than the member depth which extend into the bottom flange. Such members are not considered serviceable and will be rejected. Members with two or more vertical cracks spaced at a distance less than the member depth but do not extend into the bottom flange are subject to an engineering assessment. Such members may not be considered serviceable and may be rejected.

Members with one or more vertical cracks that extend into the bottom flange and are spaced at a distance greater than the member depth are subject to an engineering assessment to determine their acceptability. If this engineering assessment is required, submit, at no additional cost to the Department, a proposal for repairing the member and a structural evaluation of the member prepared by a North Carolina Licensed Professional Engineer. In the structural evaluation, consider the stresses under full service loads had the member not cracked and the effects of localized loss of prestress at the crack as determined by methods acceptable to the Department.

All members, except those defined as unacceptable, which exhibit vertical cracks prior to detensioning, shall receive a 7 day water cure as directed by the Engineer. The water cure shall begin within 4 hours after detensioning the prestressing strands and shall be a minimum of 3'-0" beyond the region exhibiting vertical cracks.

The Department has the final determination regarding acceptability of any members in question.

Section 1078-13 – Prestressed Concrete Girder Web Splitting, replace the entire Section with the following:

After detensioning of certain girders with draped strands, cracks occasionally occur in the webs at the ends of the girders. If such cracks occur, employ a method to remedy this condition

on all subsequent girders of the same type and strand pattern. If debonding of strands is used, satisfy the following criteria:

- (A) Do not debond the two straight strands in the top of the girder. Debond one half of the straight strands, as nearly as possible, in the bottom flange. As nearly as possible, debond one quarter of the straight strands in the bottom of girder 4 feet from each end of the girder and debond one quarter of the straight strands 2 feet from each end of the girder.
- (B) Use a debonding pattern that is symmetrical about the vertical axis of the girder.
- (C) Debond strands so that the center of gravity of the strands in the bottom of the girder remain within 1" of their original location at the end of the girder.
- (D) Debond strands by encasing the strand in a conduit meeting the approval of the Engineer. Conduit may be rigid one-piece or rigid two-piece split sheathing. Do not use flexible conduit or sheathing.

No separate payment is made for debonding strands as payment is included in the contract unit price bid for prestressed concrete girders.

Section 1078-14 – Handling, Transporting and Storing, replace the second paragraph with the following:

Store all prestressed members on solid, unyielding, storage blocks in a manner to prevent torsion or objectionable bending. In handling prestressed concrete girders 54" or less in height, including cored slabs and box beams, maintain them in an upright position at all times and pick them up within 5 feet of the points of bearing and transport and store supported only within 3 feet of points of bearing. In handling prestressed concrete girders greater than 54" in height, maintain them in an upright position at all times and submit for approval the proposed method of lifting, transporting, and storing the girders. As necessary, provide calculations to confirm girders are not overstressed by such operations.

Section 1078-15 – Final Finish, replace the entire Section with the following:

Finish prestressed concrete members that are intended for composite action with subsequently placed concrete or asphalt with a roughened surface for bonding. Make sure that no laitance remains on the surfaces to be bonded.

Rough float the tops of girders. Broom finish the top surface of the cored slab and box beam sections receiving an asphalt overlay. Rake the top surface of cored slab and box beam sections receiving a concrete overlay to a depth of 3/8". No surface finish is required for sides and bottom of the slab and beam sections except the exposed side of the exterior unit as noted below. Provide a resulting surface finish essentially the same color and surface finish as the surrounding concrete.

Provide a 3/4" chamfer along the bottom edges on ends and sides of all box beam and cored slab sections, top outside edges of exterior sections and acute corners of sections. Round

the top edges on ends of all sections with a 1/4" finishing tool. Provide square corners along top edges on all sections along shear keys. Do not chamfer vertical edges at ends of sections.

Fill all voids in the diagonal face of the bottom flange of prestressed concrete girders and the outside face of exterior cored slabs and box beams with a sand-cement or other approved grout. Fill all voids in piles greater than 1/2" in diameter or depth as above. Provide a resulting surface finish essentially the same color and surface finish as the surrounding concrete. Repair voids greater than 1/4" in diameter or depth in other faces of these and other members except piles in a like manner. Where an excessive number of smaller voids exist in any member, the Engineer requires a similar repair.

Repair honeycomb, excessively large fins, and other projections as directed. Submit, at no additional cost to the Department, a proposal for repairing members with honeycomb, cracks, or spalls. Do not repair members containing honeycomb, cracks, or spalls until a repair procedure is approved and the member is inspected by the Engineer. Any appreciable impairment of structural adequacy that cannot be repaired to the satisfaction of the Engineer is cause for rejection.

Clean and fill holes caused by strand hold downs upon removal from the casting bed. Use patches of materials approved by the Engineer that develop strength at least equal to the minimum 28 day strength requirement for the concrete prior to approval of the member. Ensure that members are clean and surfaces have a uniform appearance.

Give the top surface of prestressed concrete panels a raked finish or other approved finish to provide an adequate bond with the cast-in-place concrete. As soon as the condition of the concrete permits, rake the top surface of the concrete making depressions of approximately 1/4". Take care when raking not to catch and pull the coarse aggregate.

Clean reinforcing bars exposed on the tops of girders and exterior cored slabs or box beams of mortar build up and excessive rust.

Apply epoxy protective coating to the ends of prestressed members as noted on the plans.

Section 1078-16 (A) – Alignment and Dimensional Tolerances, revise Table 1078-3 “Tolerances for Prestressed Cored Slabs” as follows:

Width - Differential of adjacent spans in the same structure	1/2"
--	------

Section 1078-16 (B) – Alignment and Dimensional Tolerances, revise Table 1078-4 “Tolerances for Prestressed Girders” as follows:

Position of holes for diaphragm bolts (K)	±1/4"
---	-------

Section 1078-16 (F) – Alignment and Dimensional Tolerances, revise Table 1078-8 “Tolerances for Box Beams” to be consistent with cored slab tolerances as follows:

Width - Any one span	Plan width + 1/8” per joint
Width – Differential of adjacent spans in the same structure	1/2”

Section 1078-16 – Identification of Members, revise Section number to the following:

Section 1078-17

Section 1078-17 – Quality Control, revise Section number to the following:

Section 1078-18

ADHESIVELY ANCHORED ANCHOR BOLTS OR DOWELS

(6-11-07)

1.0 GENERAL

Installation and Testing of Adhesively anchored anchor bolts and dowels shall be in accordance with Section 420-13, 420-21 and 1081-1 of the Standard Specifications except as modified in this provision.

2.0 INSTALLATION

Installation of the adhesive anchors shall be in accordance with manufacturer’s recommendations and shall occur when the concrete is above 40 degrees Fahrenheit and has reached its 28 day strength.

The anchors shall be installed before the adhesive’s initial set (‘gel time’).

3.0 FIELD TESTING

Replace the third paragraph of Section 420-13 (C) with the following:

“In the presence of the Engineer, field test the anchor bolt or dowel in accordance with the test level shown on the plans and the following:

Level One Field testing: Test a minimum of 1 anchor but not less than 10% of all anchors to 50% of the yield load shown on the plans. If less than 60 anchors are to be installed, install and test the required number of anchors prior to installing the remaining anchors. If more than 60 anchors are to be installed, test the first 6 anchors prior to installing the remaining anchors, then test 10% of the number in excess of 60 anchors.

Level Two Field testing: Test a minimum of 2 anchors but not less than 10% of the all anchors to 80% of the yield load shown on the plans. If less than 60 anchors are to be installed, install and test the required number of anchors prior to installing the remaining anchors. If more than 60 anchors are to be installed, test the first 6 anchors prior to installing the remaining anchors, then test 10% of the number in excess of 60 anchors.

Testing should begin only after the Manufacturer's recommended cure time has been reached. For testing, apply and hold the test load for three minutes. If the jack experiences any drop in gage reading, the test must be restarted. For the anchor to be deemed satisfactory, the test load must be held for three minutes with no movement or drop in gage reading."

4.0 REMOVAL AND REPLACEMENT OF FAILED TEST SPECIMENS:

Remove all anchors and dowels that fail the field test without damage to the surrounding concrete. Redrill holes to remove adhesive bonding material residue and clean the hole in accordance with specifications. For reinstalling replacement anchors or dowels, follow the same procedures as new installations. Do not reuse failed anchors or dowels unless approved by the Engineer.

5.0 USAGE

The use of adhesive anchors for overhead installments is not permitted without written permission from the Engineer.

6.0 BASIS OF PAYMENT

No separate measurement or payment will be made for furnishing, installing, and testing anchor bolts/dowels. Payment at the contract unit prices for the various pay items will be full compensation for all materials, equipment, tools, labor, and incidentals necessary to complete the work.

DIRECT TENSION INDICATORS

(6-12-09)

The 2006 Standard Specifications shall be revised as follows:

Replace Section 440-8(C)(6) – **Direct Tension Indicators** with the following:

Supply direct tension indicators in accordance with the requirements of ASTM F959 and Article 1072-7.

Furnish the Engineer with at least one metal feeler gage for each container of direct tension indicators shipped before beginning installation.

Make sure that the lot number on the containers of direct tension indicators is for the same lot number tested as indicated on the test documents.

Furnish to the Engineer three samples of load indicating washers from each lot number, each size and type for tests and two each of the metal feeler gages required for performing the tests.

Install the direct tension indicator under the bolt head. If it is necessary to install the direct tension indicator under the nut, or if the bolt head shall be turned, install additional hardened washers between the nut or bolt head and the direct tension indicator.

Provide a tension indicating device on the project for determining the tension imposed on a fastener when the protrusions on direct tension indicator are properly compressed.

Test 3 samples from each lot of direct tension indicators in the presence of the Engineer. Achieve a minimum bolt tension of 5% greater than that required by Table 440-1 of Article 440-8.

Do not substitute direct tension indicators for hardened steel washers required with short slotted or oversized holes. If desired, use direct tension indicators in conjunction with hardened steel washers.

Install direct tension indicators initially to a snug tight condition as specified in Subarticle 440-8(C)(3). After initial tightening, fully tighten beginning at the most rigid part of the joint and continuing toward its free edges.

For tightening fasteners containing direct tension indicators, use a clean and lubricated wrench. Maintain air supply and hoses in good condition and provide air pressure of at least 100 psi at the wrench.

When tightening the fasteners, ensure that the part of the fastener being restrained from turning does not rotate during the tightening process. Ensure that no portion of the direct tension indicator protrusions is accidentally partially flattened before installing in the structural steel joints.

Do not reuse direct tension indicators. If it is necessary to loosen a bolt previously tensioned, discard and replace the direct tension indicator.

CURING CONCRETE

(6-12-09)

The 2006 Standard Specifications shall be revised as follows:

Replace the first paragraph of Section 420-15(A) – Curing Concrete – General with the following:

Unless otherwise specified in the contract, use any of the following methods except for membrane curing compounds on bridge deck and approach slab, or on concrete which is to receive epoxy protective coating in accordance with 420-18. Advise the Engineer in advance of the proposed method. Have all material, equipment, and labor necessary to promptly apply the

curing on the site before placing any concrete. Cure all patches in accordance with this article. Improperly cured concrete is considered defective.

Replace the third paragraph of Section **420-15(C) – Curing Concrete – Membrane Curing Compound Method** with the following:

Seal the surface with a single uniform coating of the specified type of curing compound applied at the rate of coverage recommended by the manufacturer or as directed, but not less than 1 gallon per 150 square feet of surface area.

PLACING LOAD ON STRUCTURE MEMBERS

(8-4-09)

The 2006 Standard Specifications shall be revised as follows:

Replace the fifth paragraph of Section **420-20 – Placing Load on Structure Members** with the following:

Do not place vehicles or construction equipment on a bridge deck until the deck concrete develops the minimum specified 28 day compressive strength and attains an age of at least 14 curing days. The screed may be rolled across a previously cast bridge deck if the entire pour has not achieved initial set. If any portion of the deck concrete has achieved initial set, the screed can not be rolled across the bridge deck until the concrete develops a compressive strength of at least 1,500 psi. Construction equipment is allowed on bridge approach slabs after the slab concrete develops a compressive strength of at least 3,000 psi and attains an age of at least 7 curing days. A curing day is defined in Subarticle 420-15(A).

METRIC STRUCTURAL STEEL

(SPECIAL)

The structural steel for this project is specified in SI (Metric) units with plate thickness designated in millimeters in accordance with AASHTO M160M.

The substitution of structural steel in US Customary nominal thickness is permitted for primary and secondary members defined as follows:

- Primary members - members such as webs and flanges of plate girders, transverse and bearing stiffeners, girder field splice plates, and connector plates for curved girders.
- Secondary members - members such as connector plates for straight girders, bearing plates and miscellaneous hardware.

Such substitution is limited to the values shown in the following table.

Material Specified Metric (mm)	Primary Members US Customary (in)	Secondary Members US Customary (in)
8	3/8	*
9	3/8	*
10	7/16	3/8
11	7/16	*
12	1/2	*
14	9/16	*
16	11/16	5/8
18	3/4	11/16
20	13/16	3/4
22	7/8	*
25	1	*
28	1-1/8	*
30	1-3/16	*
32	1-5/16	1-1/4
35	1-7/16	1-3/8
38	1-1/2	*
40	1-5/8	*
45	1-13/16	*
50	2	*
55	2-1/4	*
60	2-3/8	*
70	2-13/16	2-3/4
* These values are the same as those for Primary members.		

There will be no additional payment for any extra weight incurred as a result of any substitution.

**STRUCTURAL STEEL FOR BRIDGE AT
STATION 146+39.081 -L- (EB & WB)**

(SPECIAL)

Structural Steel in flanges designated in the plans shall be AASHTO M270 Grade HPS 485W and shall be in accordance with the plans and this special provision. All other structural steel shall be AASHTO M270 Grade 345W and shall be in accordance with the plans and Standard Specifications.

1.0 GENERAL

High performance steel shall be produced and fabricated in accordance with ANSI/AASHTO/AWS Bridge Welding Code D1.5-02, applicable portions of the Standard Specifications, and these Special Provisions.

2.0 MATERIAL PROPERTIES

Structural steel designated on the plans as Grade HPS 485W shall conform to the requirements of ASTM A709-04a.

3.0 WELDING

A. General

All welding procedures for HPS 485W Steel shall be qualified in accordance with AWS D1.5 unless otherwise modified within this Special Provision.

Butt welds of flanges and webs and fillet welds of web to flanges of plate girders shall be made using the Submerged Arc Welding process. Only Submerged Arc Welding (SAW) or Shielded Metal Arc Welding (SMAW) may be used for all other connections involving HPS 485W steel.

The maximum level of diffusible hydrogen in deposited weld metal shall be 4 mL/100g. The level of diffusible hydrogen may be raised to 8mL/100g for SMAW only, provided that the higher preheat temperatures of Table 1 are attained.

B. Filler Metal Requirements

1. Filler metals for use in connecting Grade HPS 485W plates using the SAW process shall be as follows:
 - a. LA85 electrode with Mil800HPNi flux, by Lincoln Electric Company, 22801 St. Clair Avenue, Cleveland, Ohio 44117-1199; (216) 481-8100
 - b. ENi4 electrode, by ESAB, 801 Wilson Avenue, Hanover, PA 17331-1058; (800) 933-7070, combined with Mil800H flux by Lincoln Electric Company
 - c. In lieu of the above consumable combinations, the contractor may request approval of alternate consumables from the Engineer. Alternate manufacturer specific filler metals, both electrode and flux, shall meet the AWS Electrode/Flux Classification F9A4 EXXX-X, with supplementary moisture resistance designators H4 or H2, as per AWS A5.23, with 1% Nickel minimum in the weld deposit.

When using alternate consumables, the fabricator is required to perform the full range of weld tests as required by AWS D1.5 Section 12.6.

When using alternate consumables, diffusible hydrogen (H_d) tests shall be performed on the weld metal. Minimum preheat and interpass temperatures to be used with alternate consumables shall be in accordance with AWS D1.5, Table 4.4. The deposited weld metal shall have a diffusible hydrogen level equivalent to 4 mL/100g or less. H_d test

specimens are to be prepared at the fabrication plant. Specimens are to be tested in accordance with AWS A4.3. Test results in excess of 4 mL/100g are unacceptable, and a retest is required, with or without revised welding procedures. AWS D1.5 Section 5.7.6 is applicable, but WPS or H_d results are not transferable from fabricator to fabricator. Fabricators with multiple plants under a common umbrella of welding equipment, welding training, and supervision are required to perform the H_d testing only once per combination of consumables for each location. Plants audited as a single facility by the American Institute of Steel Construction (AISC) as a part of their Quality Certification Program, or other owner approved equal Quality Assurance Program, are considered one location. Multiple plants not falling under the AISC, or other 'single facility' audit definition, are considered separate facilities and additional WPS and H_d tests are required.

SAW consumables shall meet the hydrogen control level of H4 as per AWS D1.5, Section VIII6.2.2.1(1).

2. Filler metals for all welds connecting a Grade HPS 485W plate to a Grade 345W plate shall conform to the requirements for Grade 345W base metal as listed in AWS D1.5, Table 4.1 (H8 maximum). At the fabricator's option, the consumable combinations of Section 3.0(B)(1)(a) or 3.0(B)(1)(b) may be used provided the hydrogen control level of H4 is met as per AWS D1.5, Section VIII6.2.2.1(1). Electrodes for use in connecting Grade HPS 485W plates to Grade 345W plates using the SMAW process shall have the designator 'R' for moisture resistant coating. The designator 'HZ' shall be either H4 or H8, depending upon the level of preheat used.
3. SAW consumables and SMAW electrodes shall produce weld deposits that meet the requirements of AWS D1.5 Table 4.3.
4. Filler Metal Qualification Test Requirements for welding of HPS 485W plates together are as listed in AWS D1.5, Table 4.1, for Grade 485W base metal. Qualification, Pretest and Verification Test Requirements for welding HPS 485W plates as determined using WPS Test Plates shall provide properties equal to or greater than the base metal requirements as specified in ASTM A709-04a.

C. Preheat and Interpass Temperature

The maximum interpass temperature for welding HPS 485W steel is 232°C.

The minimum preheat and interpass temperatures for welding of HPS 485W steel plates using the electrodes of Section 3.0(B)(1)(a) or 3.0(B)(1)(b) shall be in accordance with Table 1.

Table 1

Minimum Preheat and Interpass Temperature, °C, for HPS 485W

Welding Process	H _d maximum	Thickness, t, (mm) of Thickest Part at Point of Welding			
		t ≤ 19	19 < t ≤ 38	38 < t ≤ 64	t > 64
SAW/SMAW*	4 mL/100g	10	22	22	52
SMAW	8 mL/100g	10	52	80	108

If satisfactory results are not achieved with the above minimum preheat and interpass temperatures during development of the Welding Procedure Specifications (WPS), and an increased preheat temperature is used to provide a satisfactory Procedure Qualification Record (PQR), the higher preheat temperature shall be used during bridge fabrication as the required minimum.

The minimum preheat or interpass temperature required for a joint composed of different base metals and/or thicknesses, shall be based on the highest of the minimum preheat from AWS D1.5, Table 4.4 or the table above.

- * Diffusible hydrogen or filler metal tested by manufacturer shall not exceed a H4 classification. Heat input shall be limited as indicated below.

For all other consumable combinations:

The preheat and interpass temperature requirements shall be in accordance with AWS D1.5, Table 4.4. When welding two pieces of Grade HPS 485W steel, the temperature requirements of Table 4.4, Group IV shall be used. When welding Grade HPS 485W steel to Grade 345W steel, the temperature requirements of Table 4.4, Group I/II shall be used.

D. Heat Input

The minimum amount of heat input shall be 1.57 kilojoules per millimeter (kJ/mm) and the maximum shall be 3.54 kJ/mm determined using AWS D1.5, Section 5.12.

E. Backing

Steel backing material for Welding Procedure Specification test plates may be composed of Grade 345W (Sulfur = 0.025 maximum) or HPS 485W material.

4.0 AISC CERTIFICATION

Only fabricators meeting the requirements of the AISC Quality Certification Program for "Major Steel Bridges" may be used to fabricate HPS 485W steel.

5.0 BASIS OF PAYMENT

Structural steel will be paid for at the contract lump sum price for "Approximately _____ Kilograms Structural Steel". No separate payment will be made for HPS 485W Steel. The approximate quantity shown in the contract pay item is an estimate based on the computed weight of the structural steel necessary to complete the work. No measurement for payment will be made for this pay item, and no adjustment in the contract lump sum price will be made for any variation from the approximate quantity shown except for revisions in the plans which affect the quantity of structural steel necessary to complete the work.

When revisions in the plans have been made which affect the quantities of structural steel, adjustments in compensation will be made by supplemental agreement.

Payment at the contract lump sum price for "Approximately _____ Kilograms Structural Steel" will be full compensation for shop painting.

The above prices and payments will be full compensation for all work covered by this section including but not limited to furnishing, fabricating, delivering, placing, erecting, cleaning, and shop painting; furnishing, erecting, and removing falsework; setting bearings and anchorages; welding; and assembling all structural joints.

Payment will be made under:

Approximately _____ Kilograms Structural Steel.....Lump Sum

CHARPY V-NOTCH TESTS

(SPECIAL)

All structural steel furnished for main beam and girder members (for girder members see plans) shall meet the longitudinal Charpy V-Notch Tests specified in the supplementary requirements in ASTM A709-04a for zone 1. Unless otherwise noted on the plans, the material shall be marked and tested as non-fracture critical. Sampling and testing procedures shall be in accordance with AASHTO T243M (ASTM A673M). The (P) frequency of heat testing shall be used. For grade or grades of structural steel required, see Structure plans.

Obtain and submit certified mill test reports to the Materials and Tests Unit to show the results of each test required by this specification.

Material failing to meet the qualification requirements outlined above is unacceptable for use on this project.

CAP FOR PRESTRESSED CONCRETE PILES

(SPECIAL)

The Contractor shall install reinforced concrete caps on top of the prestressed concrete piles for pile supported MSE wall and embankment as shown in the plans and as directed by the Engineer. The concrete shall be Class AA and the reinforcing bars shall be Grade 420 as specified in the Standard Specifications for Roads and Structures. The concrete and reinforcing bars shall meet all applicable requirements of the Standard Specifications. The cap shall be cast in place with the dimensions shown in the plans. The Contractor may propose precast caps for the Engineer’s review and approval.

The quantity of caps for prestressed concrete piles to be paid for shall be the actual number of each of the caps for either 305 mm piles or 406 mm piles, which have been incorporated into the completed and accepted work. Any form work, excavation or backfill necessary to place the caps will be considered incidental and will not be measured for payment.

The quantity of caps for prestressed concrete piles, measured as provided above, will be paid for at the contract unit price each for “Cap for 305 mm Prestressed Concrete Piles” or “Cap for 406 mm Prestressed Concrete Piles”. Such price and payment will be full compensation for all materials, labor, equipment, form work, excavation, backfill, and other incidentals necessary to complete the work satisfactorily.

- Pay Items: Cap for 305 mm Prestressed Concrete Piles.....Each
- Cap for 406 mm Prestressed Concrete Piles.....Each

PILE RESTRIKES FOR LRFD

(SPECIAL)

After testing piles with the pile driving analyzer (PDA) during initial drive and any pile restrikes or redrives in accordance with the Contract, restrike piles with the PDA attached for the purpose of load resistance factor design (LRFD) calibration. Wait 96 hours to a maximum of 7 days to restrike piles. In some subsurface conditions, the Engineer may require greater than 96 hours before restriking piles.

Test piles with the PDA in accordance with Section 5.0 of the Pile Driving Analyzer Special Provision. The NCDOT Geotechnical Engineering Unit will perform the PDA testing for pile restrikes for LRFD. Notify the Engineer of the pile driving schedule in accordance with the Contract.

No payment will be made for any PDA pay items for pile restrikes for LRFD. The cost of restriking piles will be paid for at the unit bid price for "Pile Redrives" in accordance with Section 450 of the *Standard Specifications*.

VISUAL BARRIER WALL ON STRUCTURE

(SPECIAL)

Description

This work consists of furnishing planks, structural steel and all other materials; handling, transporting, fabricating, galvanizing and storing materials; and erecting and installing the visual barrier wall members and all other materials as required by the plans, Standard Specifications and this Special Provision.

Materials and Fabrication

The structural planks for the visual barrier wall are to have the following properties:

Flexural Strength	57,000 psi (393.3 MPa)	ASTM D-790
Tensile Strength	60,000 psi (414.0 MPa)	ASTM D-638
Compressive Strength	65,000 psi (448.5 MPa)	ASTM D-695
Tensile Modulus	3,500,000 psi (24,150 MPa)	ASTM D-638
Specific Gravity	1.8 (typ)	ASTM D-792

The structural planks are to be color matched to the visual barrier walls adjacent to the structure. The Contractor will submit three color samples to the Engineer for approval before the planks are delivered to the jobsite.

The structural planks shall exhibit good workmanship and shall be free of burrs, cracks or other objectionable marks which would adversely affect the barrier's performance or serviceability. All cracked, discolored, burned and damaged structural panels will be rejected either at the fabrication shop or the construction site even after installation, but prior to acceptance of the project.

The structural steel is to meet the requirements of the Standard Specifications. The posts, backing angles, bolts, nuts and washers are to be galvanized.

Method of Measurement

The quantity of Visual Barrier Wall on Structure to be paid for will be the completed and accepted wall, according to the limits shown on the plans.

Basis of Payment

The quantity of Visual Barrier Wall on Structure, measured as provided above, will be paid for at the contract unit price for "Visual Barrier Wall on Structure."

Payment will be made under:

Visual Barrier Wall on Structure.....Square Meter

CHAIN LINK FENCE

(SPECIAL)

The 1829 mm Chain Link Fence will be constructed according to methods described in the Standard Specifications. The materials making up the 1829 mm Chain Link Fence will be as specified in the Standard Specifications.

The quantity of 1829 mm Chain Link Fence will be the actual number of linear meters of fence, measured in place from end post to end post, which has been completed and accepted. All posts used for the chain link fence are included in the price of the fence and will not be paid for separately. There will be no measurement made for installing adhesive anchors in concrete barrier rail as such work is considered incidental.

The quantity of fence, measured as described above, will be paid for at the contract unit price per linear meter for "1829 mm Chain Link Fence".

Payment will be made under:

1829 mm Chain Link Fence _____ Linear Meters

CONTINUOUS FLIGHT AUGER PILES FOR SOUND BARRIER WALLS (SPECIAL)

1.0 GENERAL

This special provision governs the construction of continuous flight auger (CFA) piles. CFA piles are constructed by drilling a borehole with a continuous flight hollow stem auger and filling the borehole by pumping grout through the auger as it is withdrawn. After completing grout placement, reinforcement is inserted into the column of fluid grout. At the Contractor's option, construct CFA piles for sound barrier walls in lieu of pile excavation. Install CFA piles with the required depth in accordance with the Contract. Use a CFA Pile Subcontractor prequalified by the Contractual Services Unit of the

Department for CFA pile work (work code 3110). For this provision, “pile” refers to a CFA pile and “reinforcement” refers to steel piles.

2.0 CFA PILE INSTALLATION PLAN SUBMITTAL

Provide 4 hard copies and an electronic copy (pdf or jpg format on CD or DVD) of the CFA pile installation plan submittal. Submit the installation plan at least 20 working days before starting CFA pile construction. Do not begin pile construction until the CFA pile installation plan is accepted.

Submit detailed project specific information including the following.

1. List and sizes of proposed equipment including CFA drilling rigs, augers and other drilling tools and grouting equipment.
2. Step-by-step description of CFA pile installation and sequence of pile construction.
3. Methods for placing reinforcement with procedures for supporting and positioning the reinforcement.
4. Minimum grout volume factor. The grout volume factor is equal to the grout volume placed divided by the theoretical grout volume for each depth increment. A grout volume factor of at least 1.15 is required.
5. Equipment and procedures for monitoring and recording grout volume.
6. Examples of construction records to be provided in accordance with Section 6.0.
7. Procedures for containment and disposal of drilling spoils in accordance with Section 802 of the *Standard Specifications*.
8. Grout mix design including laboratory test results in accordance with the Grout for Structures Special Provision.
9. Other information shown on the plans or requested by the Engineer.

If alternate installation procedures are proposed or necessary, a revised CFA pile installation plan submittal may be required. If the work deviates from the accepted submittal without prior approval, the Engineer may suspend CFA pile construction until a revised plan is submitted and accepted.

3.0 MATERIALS

Use steel piles meeting the requirements of Section 1084 of the *Standard Specifications*.

Use grout in accordance with the Contract.

4.0 CFA PILE PRECONSTRUCTION MEETING

Before starting CFA pile construction, conduct a preconstruction meeting to discuss the installation and monitoring of the CFA piles. Schedule this meeting after all CFA pile submittals have been accepted and the CFA Pile Subcontractor has mobilized to the site. The Resident or Bridge Maintenance Engineer, Bridge Construction Engineer, Geotechnical Operations Engineer, General Contractor and the CFA Pile Subcontractor Superintendent, Drill Rig Operators and Project Manager will attend this preconstruction meeting.

5.0 CONSTRUCTION METHODS

Use equipment and methods reviewed and accepted in the CFA pile installation plan or approved by the Engineer. Inform the Engineer of any deviations from the accepted plan.

Dispose of drilling spoils and excess waste grout in accordance with Section 802 of the *Standard Specifications* and as directed by the Engineer. Drilling spoils consist of all excavated material including water removed from boreholes.

A. Drilling

Use CFA piling rigs capable of drilling through whatever materials are encountered to the dimensions and depths shown on the plans or otherwise required by the Engineer.

Use single helix hollow stem augers with uniform diameters and continuous flights from the top of the auger to the bottom tip of the cutting face. Provide augers with flights and teeth that cut the bottom of the borehole flat. Augers with outside diameters at least 97% of the pile design diameter are required. Augers capable of installing piles to a depth 20% greater than plan depth are also required.

Unless piles are installed with a hydraulic fixed mast installation platform and the stem to which the auger is fixed has an outside diameter 10" (250 mm) or greater, at least one guide connected to the leads of the CFA piling rig is required. Prevent the leads from rotating during drilling and grouting.

Seal the grout injection port to prevent entry during drilling. Keep the hollow stem of augers clean when drilling. Clearly mark augers or leads every foot (0.3 m) along their length with markings visible to the unaided eye from the ground. Check for correct pile location and alignment before beginning drilling. Do not begin drilling until enough grout to complete the pile is on the project site.

Advance the auger into the ground at a continuous rate. Do not raise the auger until beginning grout placement. Control the auger rotation speed to prevent excess spoil from being transported to the ground surface and surrounding soil being drawn laterally into the borehole.

If muck, organics, soft soil or other unsuitable materials are encountered within 5 ft (1.5 m) of the ground surface, contact the Engineer as these materials can cause problems with top of pile construction. If auger refusal is encountered before reaching plan depth, stop the auger rotation and inform the Engineer. Unless it is determined otherwise, refusal is defined as less than 1 ft (0.3 m) of auger penetration per minute.

B. Grouting

Remove all oil, rust inhibitors, residual drilling slurries and similar foreign materials from holding tanks/hoppers, stirring devices, pumps and lines and all other equipment in contact with grout before use.

Place a screen between the ready mix truck and the grout pump to remove large particles or cement balls using a mesh that has openings no larger than 3/4 inch (19 mm).

Use a positive displacement piston type pump with a known volume per stroke that can develop peak pressures at the pump of at least 350 psi (2.4 MPa). Size the pump to maintain a smooth continuous delivery of grout while limiting pressure variations (particularly pressure drops) due to pump strokes. At the beginning of construction, provide the grout volume delivered by each pump stroke and verify this value is within 3% of the actual volume. Recalibrate the grout volume per pump stroke during construction as necessary or directed by the Engineer.

Place grout in accordance with the Contract and accepted submittals. Pump grout without difficulty to fill any soft or porous zones and with sufficient pressure to ensure a continuous monolithic pile with at least the plan cross section from the maximum borehole depth to the top of the grout column. Provide grout free of segregation, intrusions, contamination, structural damage or inadequate consolidation (honeycombing).

Begin placing grout within 5 minutes after the auger has reached plan depth. At the beginning of grout placement, lift the auger 6 to 12 inches (150 to 300 mm) and remove the sealing device by applying grout pressure or with a steel bar. Do not lift the auger beyond this range in order to minimize soil movement. After grout flow is initiated, reinsert the auger to the original depth.

Pump grout continuously while extracting the auger at a smooth steady rate. Maintain a positive grout pressure at the auger injection point at all times. If rotation occurs while removing the auger, rotate the auger in the same direction as during drilling. If grout placement is suspended for any reason, inform the Engineer and redrill the CFA pile.

Monitor the depth of the auger injection point while counting pump strokes during grouting. Record the grout volume and factor versus depth of the auger injection point in increments of 5 ft (1.5 m) or less.

C. Top of Pile Finishing and Protection

After placing grout, remove all excess grout and spoil from and place a temporary form within the top of the grout column. Use a form 3 to 5 ft (1 to 1.5 m) long with a diameter equal to or larger than the pile diameter. Place the form with equal lengths above and below the ground surface. Recheck the top of the grout and remove any foreign material. After the grout has reached initial set as determined by the Engineer, remove the form without disturbing the ground surface around the pile.

After placing the reinforcement, square the top of the CFA pile with the pile axis while grout is still fluid or by cutting off hardened grout. Construct the top of CFA pile to the elevation shown on the plans.

D. Reinforcement

Provide reinforcement for CFA piles consisting of steel piles as shown on the plans and accepted submittals. Place reinforcement as a unit while the grout is still fluid. Lower or gently push reinforcement into the grout. Do not vibrate or drive the reinforcement. Support the reinforcement at the ground surface until the grout strength reaches 2,500 psi (17.2 MPa). Contact the Engineer if reinforcement can not be properly inserted to the required depth.

6.0 CONSTRUCTION RECORDS

Provide 2 original hard copies of CFA pile construction records including the following after completing each pile.

1. Names of CFA Pile Subcontractor, Superintendent, Drill Rig Operator and Project Manager
2. Project description, county, NCDOT Contract, TIP and WBS element number
3. Wall station and number and pile location and identifier
4. The grout volume and factor versus depth of the auger injection point in increments of 5 ft (1.5 m) or less
5. CFA pile diameter, length and tip elevation, top of pile and ground surface elevations
6. Auger diameter and theoretical volume of the borehole
7. Grout temperature and flow for each ready mix truck
8. Size, length, top elevation and grade of reinforcement
9. Date and time drilling begins and ends, grout is mixed and arrives on-site, pumping grout begins and ends and reinforcement is placed
10. Weather conditions including air temperature at time of grout placement
11. All other pertinent details related to CFA pile construction

After completing all CFA piles for a sound barrier wall, submit electronic copies (pdf or jpg format on CD or DVD) of all corresponding construction records.

7.0 CFA PILE ACCEPTANCE

CFA pile acceptance is based on the following criteria.

1. Grout volume factor is greater than the minimum required for any 5 ft (1.5 m) depth increment.
2. Grout is in accordance with the Contract and does not have any evidence of segregation, intrusions, contamination, structural damage or inadequate consolidation (honeycombing).
3. CFA pile and reinforcement location, alignment and elevations are within tolerances for sound barrier walls for pile excavation and steel piles are in accordance with the Contract and accepted submittals.

If the Engineer determines a CFA pile is unacceptable or unsatisfactory, additional testing, remedial measures or replacement piles are required at no additional cost to the Department. Obtain approval for remediation proposals before performing work. No compensation will be made for losses or damages for remedial work or investigation of unacceptable or unsatisfactory piles.

8.0 MEASUREMENT AND PAYMENT

Include the cost of the CFA piles in the unit bid price for "Sound Barrier Wall". No separate payment will be made for the CFA piles. Include in this unit bid price all costs for submittals, monitoring and recording, labor, tools, equipment, reinforcement and grout complete and in place and all incidentals necessary to drill and construct CFA piles in accordance with this provision. No additional payment will be made for drilling through non-soil materials or any costs associated with unacceptable CFA piles.

PILE DRIVING ANALYZER

(11-17-06)

1.0 GENERAL

This special provision governs driving piles with a pile driving analyzer (PDA) in accordance with the plans and as directed by the Engineer. The PDA test method is described in ASTM D4945, "Standard Test Method for High-Strain Dynamic Testing of Piles". Install piles in accordance with Section 450 of the Standard Specifications and this provision.

Submit the proposed pile driving methods and equipment (Pile Driving Equipment Data Form) in accordance with the Submittal of Working Drawings Special Provision and the Standard Specifications. The Engineer will respond with preliminary approval or rejection of the proposed pile driving methods and equipment within 10 calendar days. Preliminary approval is required before driving piles with a PDA. Notify the Engineer of the pile driving schedule a minimum of 14 calendar days in advance.

Either a PDA Consultant or the NCDOT Geotechnical Engineering Unit, as directed by the Engineer, shall perform PDA testing and analysis. If required, retain a PDA Consultant and submit experience documentation with the proposed pile driving methods and equipment.

The Engineer will determine the number of piles and which piles to be tested with the PDA based upon the subsurface conditions and the pile installation sequence and progress.

The Engineer will complete the review of the proposed pile driving methods and equipment and provide the required driving resistance within 10 calendar days after the Engineer receives the PDA report or the Geotechnical Engineering Unit completes the PDA testing. A PDA report for PDA testing on multiple piles may be required as directed by the Engineer before the 10 day time period begins.

2.0 PREQUALIFICATION AND EXPERIENCE REQUIREMENTS

Use a PDA Consultant prequalified by the Contractual Services Unit of the Department for Pile Driving Analyzer work (work code 3060).

Submit documentation that the PDA Consultant has successfully completed at least 5 PDA testing projects within the last 3 years of a scope and complexity similar to that anticipated for this project. Documentation should include the General Contractor and Owner's name and current contact information with descriptions of each past project. Also, submit documentation of experience with PDA manufactured by Pile Dynamics, Inc and the CAsE Pile Wave Analysis Program (CAPWAP).

Provide a list of PDA Operators and the Project Engineer that will be assigned to this project. Submit documentation for each PDA Operator verifying employment with the PDA Consultant and a minimum of 1 year experience in collecting PDA data with past projects of scope and complexity similar to that anticipated for this project. Submit documentation for the Project Engineer verifying employment with the PDA Consultant, registration as professional engineer in North Carolina and a minimum of 5 years experience in PDA testing and analysis with past projects of scope and complexity similar to that anticipated for this project. Documentation should include resumes, references, certifications, project lists, experience descriptions and details, etc.

3.0 PREPARATION FOR PDA TESTING

Provide piles for PDA testing that are 5 ft (1.5 m) longer, or as directed by the Engineer, than the estimated pile lengths shown on the plans. Supply 110 V, 60 Hz, 30 Amp of AC electrical power to operate the PDA equipment. Direct current welders or non-constant power sources are unacceptable.

Provide a suitable shelter to protect the PDA equipment and operator from conditions of sun, water, wind and temperature. The shelter should have a minimum floor size of 6 ft x 6 ft (2 m x 2 m) and a minimum roof height of 8 ft (2.5 m). If necessary, heat or cool the shelter to maintain a temperature between 50 and 85 degrees F (10 and 30 degrees C). Place the shelter within 75 ft (23 m) of the pile such that the PDA cables reach the

computer and the operator can clearly observe the pile. The Engineer may waive the shelter requirement if weather conditions allow.

Drill up to a total of 16 bolt holes in either 2 or 4 sides of the pile, as directed by the PDA Consultant or the Engineer, at an approximate distance equal to 3 times the pile diameter below the head of the pile. If the PDA Consultant or the Engineer choose to drill the bolt holes, provide the necessary equipment, tools and assistance to do so. A hammer drill is required for concrete piles and up to 2 hours may be required to drill the holes.

Lift, align and rotate the pile to be tested with the PDA as directed by the PDA Consultant or the Engineer. Place the pile in the leads and template so that the PDA instruments and their accompanying wires will not be damaged.

The PDA Consultant or the Engineer will furnish the PDA measuring instruments and materials for installing the instruments. Attach the PDA instruments as directed by the PDA Consultant or the Engineer after the pile is placed in the leads and the template.

4.0 PDA TESTING

Use only the preliminarily approved pile driving methods and equipment to drive piles with the PDA instruments attached. Drive the pile as directed by the PDA Operator or the Engineer in order to measure the wavespeed of the pile.

Drive the pile to the required bearing capacity and specified tip elevation, if applicable, as shown on the plans or as directed by the PDA Consultant or the Engineer. During pile driving, the PDA will be used to evaluate, including but not limited to, the following: hammer performance, bearing capacity, distribution of soil resistance, pile driving stresses, energy transfer, pile integrity and various soil parameters such as quake and damping.

The PDA Operator or the Engineer may require the Contractor to modify the pile installation procedure during driving as follows:

- Reduce the hammer energy
- Drive deeper or shallower because of variations in the subsurface conditions
- Readjust the transducers
- Realign the pile

The Contractor is responsible in terms of both actual expense and time delays for any damage to the PDA instruments and supporting equipment due to the Contractor's fault or negligence. Replace any damaged equipment at no additional cost to the Department.

5.0 REDRIVING PILES

When directed by the Engineer, reattach the PDA instruments and restrike or redrive the pile in accordance with Section 4.0 above and Subarticle 450-7(E) of the Standard

Specifications. Obtain the required stroke and penetration (at least 6 in or 150 mm) or as directed by the PDA Operator or the Engineer. The PDA Operator or the Engineer will record dynamic measurements during restriking and re-driving. The Engineer may require restriking and re-driving more than once on the same pile. The Engineer will determine when PDA testing has been satisfactorily completed.

6.0 CAPWAP ANALYSIS AND PDA REPORT

The PDA Consultant shall perform analysis of the PDA raw data with the CAPWAP (version 2006 or later). At a minimum, analysis is required for a hammer blow near the end of initial drive and for each restrike and re-drive. Additional CAPWAP analysis may be required as determined by the PDA Consultant or the Engineer.

Submit three hard copies and an electronic copy (pdf or jpeg format on CD or DVD) of a PDA report sealed by the Project Engineer within 7 calendar days after field testing is complete. The PDA report shall include but not be limited to the following:

A. Title Sheet

- NCDOT TIP number and WBS element number
- Project description
- County
- Bridge station number
- Pile location
- Personnel
- Report date

B. Introduction

C. Site and Subsurface Conditions (including water table elevation)

D. Pile Details

- Pile type and length
- Required bearing capacity and factor of safety
- Concrete compressive strength and/or steel pile yield strength
- Pile splice type and locations
- Pile batter
- Installation methods including use of jetting, preaugering, spudding, vibratory hammer, template, barge, etc.

E. Driving Details

- Hammer make, model and type
- Hammer and pile cushion type and thickness
- Pile helmet weight
- Hammer efficiency and operation data including fuel settings, bounce chamber pressure, blows per minute, equipment volume and pressure
- Ground or mud line elevation and template reference elevation at the time of driving
- Final pile tip elevation
- Driving resistance (ram stroke, blows per foot (0.3 meter) and set for last 10 hammer blows)
- Restrike and redrive information

F. PDA field work details**G. CAPWAP analysis results**

- Table showing percent skin and tip, skin and toe damping, skin and toe quake and match quality

H. Summary/Conclusions**I. Attachments**

- Boring log(s)
- Pile Driving Equipment Data Form (from Contractor)
- Field pile driving inspection data (from Engineer)
- Accelerometer and strain gauge locations
- Accelerometer and strain gauge serial numbers and calibration information
- PDA hardware model and CAPWAP software version information
- Electronic copy of all PDA raw data and executable CAPWAP input and output files (version 2006 format)

7.0 MEASUREMENT AND PAYMENT

The complete and accepted PDA testing will be paid for at the unit bid price for "PDA Testing" per each. Include in the unit bid price for "PDA Testing" all costs for providing the PDA, PDA instruments and materials for installing the instruments and recording the dynamic measurements the first time the pile is tested with the PDA. Costs for providing these items for the same pile after the pile is initially tested with the PDA will be considered incidental to the unit bid price for "Pile Redrives". Also include in the unit bid price for "PDA Testing" all costs for performing the CAPWAP analysis on data collected

during initial drive, restrikes and redrives and preparing and submitting the PDA report. No payment for "PDA Testing" will be made if the PDA report submitted is incomplete as described in Section 6.0. No payment for "PDA Testing" will be made if the Department performs PDA testing. If the Department does not perform PDA testing, the number of "PDA Testing" per pile will be equal to one.

The complete and accepted PDA assistance will be paid for at the unit bid price for "PDA Assistance" per each. Include in the unit bid price for "PDA Assistance" all costs for PDA preparation and support including all materials, labor, tools, equipment, mobilization and incidentals necessary to complete the work described in this provision excluding the costs for the PDA testing described above. Costs for PDA preparation and support for restrikes and redrives will not be paid for separately. The number of "PDA Assistance" per pile will be equal to one for each pile tested with the PDA.

The cost of the pile and the installation including driving, restriking and redriving will be paid for separately in accordance with the Standard Specifications and will not be part of these PDA pay items.

PILES

(8-4-09)

Refer to Section 450 of the *Standard Specifications*.

MECHANICALLY STABILIZED EARTH RETAINING WALLS **@ STA. 30+50.000 -Y1- & STA. 10+40.000 -Y1-**

(SPECIAL)

1.0 GENERAL

A. Description

A mechanically stabilized earth (MSE) retaining wall is defined as a soil retaining system with steel or geogrid tensile reinforcements in the reinforced zone and vertical or nearly vertical facing elements. The facing elements may be precast concrete panels or segmental retaining wall (SRW) units unless required otherwise on the plans or the *NCDOT Policy for Mechanically Stabilized Earth Retaining Walls* prohibits the use of SRW units. Design and construct MSE retaining walls based on actual elevations and dimensions in accordance with the contract and accepted submittals. Use an MSE Wall Installer prequalified by the NCDOT Contractual Services Unit for MSE retaining walls work (work code 3015). For this provision, "MSE wall" refers to a mechanically stabilized earth retaining wall and "MSE Wall Vendor" refers to the vendor supplying the chosen MSE wall system. Also, "blocks" refer to SRW units and "panels" refer to precast concrete panels.

B. MSE Wall System

Use an MSE wall system approved by the Department in accordance with any restrictions for the chosen system, the plans and the *NCDOT Policy for Mechanically*

Stabilized Earth Retaining Walls. Value engineering proposals for other MSE wall systems will not be considered. Obtain the NCDOT MSE wall policy and the list of approved MSE wall systems from:

<http://www.ncdot.org/doh/preconstruct/highway/geotech/msewalls/>

MSE wall systems with conditional approval are restricted to a design height of 6.1 m and an exposed face area of 465 m² per MSE wall. The design height is defined as the difference between where the finished grade intersects the back and front of an MSE wall.

The conditional status of an MSE wall system will be reevaluated after satisfactorily completing a representative MSE wall meeting the following requirements.

- Design height exceeds 4.6 m for a horizontal distance of at least 46 m along the wall face
- Designed and constructed in accordance with this provision
- Movement monitored during construction to 3 months after wall is subject to surcharge loads or movement stops, whichever is longer, in accordance with the NCDOT MSE wall policy
- MSE wall system evaluation report submitted in accordance with the NCDOT MSE wall policy

When designing an MSE wall with a conditionally approved system, notify the Engineer if the MSE wall will meet the above requirements.

2.0 MSE WALL DESIGN SUBMITTAL

Submit 11 hard copies of working drawings and 3 hard copies of design calculations and an electronic copy (PDF on CD or DVD) of each for the MSE wall design submittal. Provide the submittal at least 30 calendar days before conducting the MSE wall preconstruction meeting. Do not begin MSE wall construction until the design submittal is accepted.

The Retaining Wall Plans show plan views, typical sections, details, notes and elevation or profile views (wall envelope) for each MSE wall. When noted on plans and before beginning MSE wall design, survey existing ground elevations shown on the plans and submit a revised wall envelope for review and acceptance. Use the accepted revised wall envelope for design.

Design MSE walls in accordance with any restrictions for the chosen MSE wall system, the plans and the *AASHTO Standard Specifications for Highway Bridges* unless otherwise required. Either the simplified or Meyerhof coherent gravity approach is acceptable for determining maximum reinforcement loads. Design steel components including reinforcement and connection hardware for non-aggressive backfill with corrosion losses in accordance with the AASHTO specifications. Also, design MSE walls with a minimum reinforcement length of 1.8 m unless shown otherwise on the plans and the reinforcement coefficients and geogrid reduction factors submitted to the Department for the approval of the chosen MSE wall system.

If existing or future obstructions such as foundations, guardrail posts, pavements, pipes, inlets or utilities will interfere with reinforcement, maintain a minimum clearance of 75 mm between the obstruction and reinforcement unless otherwise approved. Place reinforcement within 75 mm above the corresponding connection elevation.

Use 150 mm thick cast-in-place unreinforced concrete leveling pads beneath panels and blocks that are continuous at steps and extend a minimum of 150 mm in front of and behind bottom row of panels and blocks. Unless required otherwise on the plans, embed top of leveling pads in accordance with the following.

EMBEDMENT DEPTH

Front Slope (H:V)	Minimum Facing Embedment Depth* (whichever is greater)	
6:1 or Flatter (except abutment walls)	H/20	0.3 m
6:1 or Flatter (abutment walls)	H/10	0.6 m
Steeper than 6:1 to 3:1	H/10	0.6 m
Steeper than 3:1 to 2:1	H/7	0.6 m
* H is from the top of leveling pad to the grade elevation		

When a drain is required with a note on plans, extend a continuous drain along the base of the reinforced zone behind the select material. Provide drains meeting the requirements of an aggregate shoulder drain in accordance with Roadway Standard Drawing No. 816.02.

Use select material in the reinforced zone for MSE walls and extend the reinforced zone 150 mm beyond the end of reinforcement. Regardless of select material type, fill between and behind SRW units for a horizontal distance of 450 mm and, unless otherwise approved, any block core spaces with stone meeting the requirements of standard size nos. 57, 67 or 78M in accordance with Sections 1005 and 1014 of the *Standard Specifications*. Separation fabric is required between select material and overlying fill or aggregate with the exception of when concrete pavement is placed directly on the select material. Separation fabric may also be required between stone and backfill or natural ground as determined by the Engineer.

Unless shown otherwise on the plans, use reinforced concrete coping at top of walls with dimensions shown on the plans. Extend coping a minimum of 150 mm above where finished grade intersects the back of MSE walls unless required otherwise on the plans. Cast-in-place concrete coping is required when noted on plans and for MSE walls with SRW units. At the Contractor’s option, connect cast-in-place concrete coping to panels and blocks with dowels or extend coping down the back of MSE walls. Also, connect cast-in-place leveling concrete for precast concrete coping to panels with dowels. When barriers are required above MSE walls, use concrete barrier rails with moment slabs in

accordance with the plans and design reinforcement for impact loads in accordance with the *AASHTO Standard Specifications for Highway Bridges* unless otherwise required.

Submit working drawings and design calculations for review and acceptance in accordance with Article 105-2 of the *Standard Specifications*. Submit working drawings showing plan views, wall profiles with maximum applied bearing pressures, typical sections with reinforcement connection details, select material type and separation fabric locations and details of leveling pads, facing elements, coping, bin walls, slip joints, etc. If necessary, include details on working drawings for concrete barrier rails with moment slabs, reinforcement connected to end bent caps and obstructions interfering with reinforcement or extending through walls. Submit design calculations for each wall section with different surcharge loads, geometry or material parameters. A minimum of one analysis is required for each wall section with different reinforcement lengths. When using a software program other than MSEW by ADAMA Engineering, Inc. for design, provide a hand calculation verifying the analysis of the section with the longest reinforcement length. Have MSE walls designed, detailed and sealed by a Professional Engineer registered in North Carolina.

3.0 MATERIALS

A. Certifications, Storage and Handling

Provide certifications in accordance with Article 106-3 of the *Standard Specifications*. Provide Type 3 Manufacturer's Certifications for all MSE wall materials with the exception of geogrids, SRW units and precast elements. For each geogrid product, provide Type 2 Typical Certified Mill Test Reports for tensile strength. For SRW units, provide Type 4 Certified Test Reports for all block properties with the exception of durability. When a note on plans requires freeze-thaw durable blocks, provide Type 5 Typical Certified Test Reports for durability.

Load, transport, unload and store MSE wall materials such that they are kept clean and free of damage. Damaged panels or blocks with excessive discoloration, chips or cracks as determined by the Engineer will be rejected. Do not damage reinforcement connection hardware or mechanisms in handling and storing panels or blocks. Label each pallet of blocks with the information listed in Article 1077-13 of the *Standard Specifications*. Do not transport SRW units away from the casting yard until the concrete strength reaches 27.6 MPa and a period of at least 5 days elapses after casting unless otherwise approved.

Identify, store and handle geogrids and fabrics in accordance with ASTM D4873. Geogrids and fabrics with defects, flaws, deterioration or damage will be rejected. Do not leave geogrids and fabrics uncovered for more than 7 days.

B. Facing Elements

Provide facing elements produced by a manufacturer approved or licensed by the MSE Wall Vendor.

1. Precast Concrete Panels

Provide precast concrete panels meeting the requirements of Sections 1000 and 1077 of the *Standard Specifications* and reinforcing steel meeting the requirements of Section 1070 of the *Standard Specifications*. Accurately locate and secure reinforcement connection hardware and maintain a minimum 50 mm clearance to the reinforcing steel. Produce panels within 6 mm of the panel dimensions shown in the accepted submittals.

A minimum compressive strength of 27.6 MPa at 28 days is required. For testing panels for compressive strength, 4 cylinders are required per 186 m² of panel face area or a single day's production, whichever is less.

Unless required otherwise on the plans, provide a final finish in accordance with Article 1077-11 of the *Standard Specifications*.

2. Segmental Retaining Wall (SRW) Units

Unless required otherwise on the plans, provide SRW units with a vertical split face and a concrete gray color with no tints, dyes or pigments. Before beginning block production, obtain approval of sample blocks of the type, face and color proposed for the project.

Use blocks meeting the requirements of ASTM C1372 with the exception of absorption, compressive strength and durability requirements. Test blocks in accordance with ASTM C140 with the exception of the number of units in a lot. For testing blocks, a lot is defined as 5000 units or a single day's production, whichever is less, and 6 blocks are required per lot. Provide blocks with a maximum absorption of 5%.

A minimum compressive strength of 27.6 MPa at 28 days is required for blocks with the exception of freeze-thaw durable blocks. When a note on plans requires freeze-thaw durable SRW units, a minimum compressive strength of 37.9 MPa at 28 days is required.

Test freeze-thaw durable blocks in accordance with ASTM C1262. Test specimens in water. Freeze-thaw durable blocks are acceptable if the weight loss of each of 4 of the 5 specimens after 150 cycles does not exceed 1% of its initial weight.

C. Reinforcement

Provide reinforcement supplied by the MSE Wall Vendor or a manufacturer approved or licensed by the vendor.

1. Steel (Inextensible) Reinforcement

Use welded wire reinforcement mesh and mats meeting the requirements of AASHTO M55 or M221 and steel strips or straps meeting the requirements of ASTM A572 or A1011 with a grade as specified in the accepted submittals. Galvanize steel reinforcement in accordance with Section 1076 of the *Standard Specifications*.

2. Geogrid (Extensible) Reinforcement

Use geogrids approved by the Department for the chosen MSE wall system. Obtain the list of approved geogrids for each MSE wall system from the website shown elsewhere in this provision.

Test geogrids in accordance with ASTM D6637. Provide minimum average roll values (MARV) as defined by ASTM D4439 for tensile strength of geogrids. For testing geogrids, a lot is defined as a single day's production.

D. Select Material

Provide select material meeting the requirements of standard size nos. 2S, 2MS, 57, 67 or 78M in accordance with Sections 1005 and 1014 of the *Standard Specifications* with the following exception. Do not use nos. 2S or 2MS when prohibited by a note on plans or when SRW units are not allowed.

When using steel reinforcement with nos. 2S or 2MS, provide select material meeting the electrochemical requirements of Section 7.3.6.3 of the *AASHTO LRFD Bridge Construction Specifications* tested in accordance with the following methods:

Property	AASHTO Test Method
pH	T289
Resistivity	T288
Chlorides	T291
Sulfates	T290

Use select material free of deleterious materials with a maximum organic content of 1% tested in accordance with AASHTO T267.

E. Miscellaneous Components

Miscellaneous components may include attachment devices, connectors (e.g., pins, bars, plates, etc.), bearing pads, dowels, fasteners (e.g., bolts, nuts, etc.), filter fabric and any other wall components not included above. Galvanize steel components in

accordance with Section 1076 of the *Standard Specifications*. Provide miscellaneous components approved by the Department for the chosen MSE wall system. Obtain the list of approved miscellaneous components for each MSE wall system from the website shown elsewhere in this provision.

F. Coping, Leveling Concrete and Pads

Provide concrete coping and leveling pads meeting the requirements of Section 1000 of the *Standard Specifications* and reinforcing steel meeting the requirements of Section 1070 of the *Standard Specifications*. Provide precast coping meeting the requirements of Section 1077 of the *Standard Specifications* and leveling concrete for precast coping meeting the requirements of Section 1000 of the *Standard Specifications*.

Use Class A Concrete for coping, leveling concrete and pads in accordance with Article 1000-4 of the *Standard Specifications*. For testing precast coping for compressive strength, 4 cylinders are required per 31 m³ of concrete or a single day's production, whichever is less.

G. Wall Drainage Systems

Wall drainage systems consist of drains and outlet components. Use shoulder drain materials meeting the requirements of Section 816 of the *Standard Specifications*.

H. Separation Fabrics

Use separation fabrics meeting the requirements of Type 2 Engineering Fabric in accordance with Section 1056 of the *Standard Specifications*.

I. Concrete Barrier Rails with Moment Slabs

Provide concrete barrier rails with moment slabs meeting the requirements of Section 1000 of the *Standard Specifications* and reinforcing steel meeting the requirements of Section 1070 of the *Standard Specifications*.

Use Class A Concrete for moment slabs and Class AA Concrete for concrete barrier rails in accordance with Article 1000-4 of the *Standard Specifications*.

J. Joint Materials

Use joint materials in accordance with Section 1028 of the *Standard Specifications*.

4.0 CORROSION MONITORING

Corrosion monitoring is required for MSE walls with steel reinforcement. The Engineer will determine the number of monitoring locations and where to install the instrumentation. Contact the NCDOT Materials & Tests (M&T) Unit before beginning wall construction. M&T will provide the corrosion monitoring instrumentation kits and assistance with installation, if necessary.

5.0 MSE WALL PRECONSTRUCTION MEETING

Before starting MSE wall construction, conduct a preconstruction meeting to discuss the construction and inspection of the MSE walls. Schedule this meeting after all MSE wall submittals have been accepted. The Resident or Bridge Maintenance Engineer, Bridge Construction Engineer, Geotechnical Operations Engineer, Contractor and MSE Wall Installer Superintendent will attend this preconstruction meeting.

6.0 MSE WALL VENDOR SITE ASSISTANCE

Provide a representative employed by the MSE Wall Vendor to assist and guide the MSE Wall Installer on-site for at least 8 hours when the first panels or blocks are set and the first reinforcement layer is placed unless otherwise approved. If problems are encountered during construction, the Engineer may require the vendor representative to return to the site for a time period determined by the Engineer at no additional cost to the Department.

7.0 CONSTRUCTION METHODS

Control drainage during construction in the vicinity of MSE walls. Direct run off away from MSE walls, select material and backfill. Contain and maintain select material and backfill and protect material from erosion.

Perform necessary clearing and grubbing in accordance with Section 200 of the *Standard Specifications*. Excavate as necessary for MSE walls in accordance with the accepted submittals. If applicable and at the Contractor's option, "temporary shoring for wall construction" may be used in lieu of temporary slopes to construct MSE walls. For this provision, temporary shoring for wall construction is defined as temporary shoring not shown on the plans or required by the Engineer including shoring for OSHA reasons or the Contractor's convenience.

Unless prohibited by a note on plans, install foundations located in the reinforced zone before placing select material or the first reinforcement layer. Notify the Engineer when foundation excavation is complete. Do not place leveling pad concrete, select material or reinforcement until obtaining approval of the excavation depth and foundation material.

Construct cast-in-place concrete leveling pads at elevations and with dimensions shown in the accepted submittals and in accordance with Section 420 of the *Standard Specifications*. Cure leveling pads a minimum of 24 hours before placing panels or blocks.

Erect and support panels or blocks with no negative batter (wall face leaning forward) such that the final position is as shown in the accepted submittals. Stagger vertical block joints to create a running bond when possible unless shown otherwise in the accepted submittals. Place blocks with a maximum joint width of 10 mm and set panels with a joint width of 13 to 25 mm. Construct MSE walls with a vertical and horizontal tolerance of 19 mm when measured with a 3 m straight edge and a final overall vertical plumbness (batter) of less than 13 mm per 3 m of wall height.

Place reinforcement at the locations and elevations shown in the accepted submittals. Do not splice reinforcement. Contact the Engineer when unanticipated existing or future obstructions such as foundations, guardrail posts, pavements, pipes, inlets or utilities will interfere with reinforcement. To avoid obstructions, deflect, skew and modify reinforcement as shown in the accepted submittals. Place reinforcement in slight tension free of kinks, folds, wrinkles or creases.

Place select material in the reinforced zone in 200 to 250 mm thick lifts. Compact standard size nos. 2S and 2MS select material in accordance with Subarticle 235-4(C) of the *Standard Specifications*. Use only hand operated compaction equipment within 1 m of the wall face. At a distance greater than 1 m, compact select material with at least 4 passes of a 7.3 - 9.1 metric ton vibratory roller. Smooth wheeled or rubber tired rollers are also acceptable for compacting select material. Do not use sheepsfoot, grid rollers or other types of compaction equipment with feet. Compact select material in a direction parallel to the wall face. Do not damage reinforcement when placing and compacting select material. End dumping directly on the reinforcement is not permitted. Do not operate heavy equipment on the reinforcement until it is covered with at least 250 mm of select material. Replace any damaged reinforcement to the satisfaction of the Engineer. Backfill for wall construction outside the reinforced zone in accordance with Article 410-8 of the *Standard Specifications*.

If a drain is required, install wall drainage systems as shown in the accepted submittals and in accordance with Section 816 of the *Standard Specifications*. Provide drains with positive drainage towards outlets.

Place and construct coping and leveling concrete as shown in the accepted submittals. Construct cast-in-place concrete coping, leveling concrete and moment slabs in accordance with Section 420 of the *Standard Specifications*. Do not remove forms until concrete achieves a minimum compressive strength of 16.5 MPa. Provide a Class 2 Surface Finish for cast-in-place concrete coping in accordance with Article 420-17 of the *Standard Specifications*. Construct concrete barrier rails with moment slabs in accordance with the plans and concrete barrier rails in accordance with Subarticle 460-3(C) of the *Standard Specifications*.

Construct cast-in-place concrete coping joints at a maximum spacing of 3 m to coincide with vertical joints between panels or blocks. 13 mm thick expansion joints in accordance with Article 420-10 of the *Standard Specifications* are required every third joint. 13 mm deep grooved contraction joints in accordance with Subarticle 825-10(B) of the *Standard Specifications* are required for the remaining joints. Stop coping reinforcement 50 mm from either side of expansion joints.

When separation fabric is required, overlap fabric a minimum of 450 mm with seams oriented parallel to the wall face. Seal joints above and behind MSE walls between coping and ditches with joint sealer as shown on the plans.

8.0 MEASUREMENT AND PAYMENT

MSE Retaining Walls @ Sta. 30+50.000 –Y1- & MSE Retaining Walls @ Sta. 10+40.000 –Y4- will be measured and paid for in meters. MSE walls will be measured as the exposed face area with the wall height equal to the difference between the top and bottom of wall elevation. The top of wall elevation is defined as the top of coping unless shown otherwise on the plans. The bottom of wall elevation is defined as where the finished grade intersects the front face of the MSE wall. No payment will be made for portions of MSE walls below bottom of wall elevations.

The contract unit price bid for *MSE Retaining Walls @ Sta. 30+50.000 –Y1- & MSE Retaining Walls @ Sta. 10+40.000 –Y4-* will be full compensation for design, submittals, furnishing labor, tools, equipment and MSE wall materials, excavating, backfilling, hauling and removing excavated materials and providing site assistance, leveling pads, facing elements, reinforcement, select material, wall drainage systems, fabrics, coping, miscellaneous components and any incidentals necessary to design and construct MSE walls in accordance with this provision. If necessary, the contract unit price bid for *MSE Retaining Walls @ Sta. 30+50.000 –Y1- & MSE Retaining Walls @ Sta. 10+40.000 –Y4-* will also be full compensation for reinforcement connected to and select material behind end bent caps in the reinforced zone in accordance with the contract.

No separate payment will be made for temporary shoring for wall construction. Temporary shoring for wall construction will be considered incidental to the contract unit price bid for *MSE Retaining Walls @ Sta. 30+50.000 –Y1- & MSE Retaining Walls @ Sta. 10+40.000 –Y4-*.

Concrete Barrier Rail will be measured and paid for in accordance with Article 460-4 of the *Standard Specifications*. The contract unit price bid for *Concrete Barrier Rail* will be full compensation for providing concrete barrier rails with moment slabs in accordance with the contract and no separate payment for moments slabs will be made.

Payment will be made under:


Pay Item	Pay Unit
MSE Retaining Walls @ Sta. 30+50.000 –Y1-	Square Meter
MSE Retaining Walls @ Sta. 10+40.000 –Y4-	Square Meter

Revised 2-3-11

253

MECHANICALLY STABILIZED EARTH RETAINING WALLS

AT STA. 142+30 TO 149+20 -L-

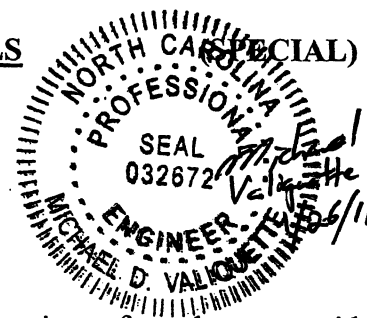

1.0 GENERAL

A. Description

A mechanically stabilized earth (MSE) retaining wall consists of steel or geogrid reinforcements in the reinforced zone connected to vertical facing elements. The facing elements may be precast concrete panels or segmental retaining wall (SRW) units unless required otherwise on the plans or the *NCDOT Policy for Mechanically Stabilized Earth Retaining Walls* prohibits the use of SRW units. Design and construct MSE retaining walls based on actual elevations and dimensions in accordance with the contract and accepted submittals. Use an MSE Wall Installer prequalified by the NCDOT Contractual Services Unit for MSE retaining walls work (work code 3015). For this provision, "MSE wall" refers to a mechanically stabilized earth retaining wall and "MSE Wall Vendor" refers to the vendor supplying the chosen MSE wall system. Also, "blocks" refer to SRW units and "panels" refer to precast concrete panels.

B. MSE Wall Systems

Use an MSE wall system approved by the Department in accordance with any NCDOT restrictions for the chosen system, the plans and the NCDOT MSE wall policy. Value engineering proposals for other MSE wall systems will not be considered. Do not use MSE wall systems with SRW units or conditional approval for critical walls or MSE walls connected to critical walls. Critical walls are defined in the NCDOT MSE wall policy. Obtain the list of approved MSE wall systems and NCDOT MSE wall policy from:

www.ncdot.org/doh/preconstruct/highway/geotech/msewalls

C. Aggregate

"Aggregate" refers to fine or coarse aggregate. Coarse aggregate is required in the reinforced zone for critical walls and when noted on the plans. Otherwise, aggregate is required in the reinforced zone for MSE walls.

2.0 DESIGN SUBMITTAL

Submit 11 hard copies of working drawings and 3 hard copies of design calculations and an electronic copy (PDF on CD or DVD) of each for the MSE wall design submittal. Provide the submittal at least 30 calendar days before conducting the MSE wall preconstruction meeting. Do not begin MSE wall construction until the design submittal is accepted.

A Design Engineer is required to design MSE walls. Use a Design Engineer approved as a Geotechnical Engineer (key person) for a consultant prequalified by the NCDOT Contractual Services Unit for the MSE retaining wall design discipline.

The Retaining Wall Plans show a plan view, typical sections, details, notes and an elevation or profile view (wall envelope) for each MSE wall. Before beginning MSE wall design, survey existing ground elevations shown on the plans and other elevations in the vicinity of MSE walls as needed. Based on these elevations, finished grades and actual MSE wall dimensions and details, submit revised wall envelopes for review and acceptance. Use the accepted revised wall envelopes for design.

Design MSE walls in accordance with any NCDOT restrictions for the chosen MSE wall system, the plans and the *AASHTO LRFD Bridge Design Specifications* unless otherwise required. Also, design MSE walls with a uniform reinforcement length throughout the wall height and a minimum reinforcement length of 0.7H or 6' (1.8 m), whichever is greater, unless shown otherwise on the plans with H as defined below. Extend the reinforced zone a minimum of 6" (150 mm) beyond the end of reinforcement as shown on the plans. Use the simplified method for determining maximum reinforcement loads and design factors for reinforcement approved by the Department for the chosen MSE wall system or default values in accordance with the AASHTO LRFD specifications. Design steel components including reinforcement and connection materials for nonaggressive backfill with corrosion losses in accordance with the AASHTO LRFD specifications.

When a note on plans requires a live load (traffic) surcharge, use a surcharge load of 250 psf (12 kPa) in accordance with Figure C11.5.5-3 of the AASHTO LRFD specifications. For steel beam guardrail with 8' (2.4 m) posts above MSE walls, design upper two rows of reinforcement for an additional horizontal load of 300 lbs/linear ft (4.38 kN/linear m) of wall in accordance with the AASHTO LRFD specifications. If existing or future obstructions such as foundations, guardrail, fence or handrail posts, pavements, pipes, inlets or utilities will interfere with reinforcement, maintain a minimum clearance of 3" (75 mm) between the obstruction and reinforcement unless otherwise approved. Place reinforcement within 3" (75 mm) above the corresponding connection elevation.

Use 6 inch (150 mm) thick cast-in-place unreinforced concrete leveling pads beneath panels and blocks that are continuous at steps and extend a minimum of 6" (150 mm) in front of and behind bottom row of panels and blocks. Unless required otherwise on the plans, embed top of leveling pads in accordance with the following.

EMBEDMENT DEPTH

Front Slope (H:V)	Minimum Facing Embedment Depth (whichever is greater)	
6:1 or Flatter (except abutment walls)	H/20	1 ft (0.3 m) for H ≤ 10' 2 ft (0.6 m) for H > 10'
6:1 or Flatter (abutment walls)	H/10	2 ft (0.6 m)
Steeper than 6:1 to 3:1	H/10	2 ft (0.6 m)
Steeper than 3:1 to 2:1	H/7	2 ft (0.6 m)
Front slope is as shown on the plans and H is the maximum design height plus embedment per wall as shown on the plans		

When a note on plans requires a drain, extend a continuous drain along the base of the reinforced zone behind the aggregate. Provide drains meeting the requirements of an aggregate shoulder drain in accordance with Roadway Standard Drawing No. 816.02.

For MSE walls with panels, place a minimum of 2 bearing pads in each horizontal panel joint such that the final horizontal joint opening is 3/4 inch (19 mm). Additional bearing pads may be required for panels wider than 5 ft (1.5 m) as determined by the Engineer. Cover joints on the back of panels with filter fabric a minimum of 12" (250 mm) wide.

For MSE walls with SRW units, place coarse aggregate between and behind blocks for a horizontal distance of at least 18" (450 mm) and fill any block core spaces with coarse aggregate.

Separation fabric is required between aggregate and overlying fill or pavement section with the exception of when concrete pavement is placed directly on aggregate. Separation fabric may also be required between coarse aggregate and backfill or natural ground as determined by the Engineer.

Unless shown otherwise on the plans, use reinforced concrete coping at top of walls with dimensions as shown on the plans. Extend coping a minimum of 6" (150 mm) above where finished grade intersects the back of MSE walls unless required otherwise on the plans. Cast-in-place concrete coping is required for MSE walls with SRW units and when noted on the plans. At the Contractor's option, connect cast-in-place concrete coping to panels and blocks with dowels or extend coping down the back of MSE walls. Also, connect cast-in-place leveling concrete for precast concrete coping to panels with dowels. When barriers are required above MSE walls, use concrete barrier rails with moment slabs as shown on the plans.

Submit working drawings and design calculations for review and acceptance in accordance with Article 105-2 of the *Standard Specifications*. Submit working drawings showing plan views, wall profiles with required resistances, typical sections with reinforcement and connection details, aggregate type and separation fabric locations and details of leveling pads, facing elements, coping, bin walls, slip joints, etc. If necessary, include details on working drawings for concrete barrier rails with moment slabs, geogrid splices, reinforcement connected to end bent caps and obstructions extending through walls or interfering with reinforcement, concrete barrier rails and moment slabs. Submit design calculations for each wall section with different surcharge loads, geometry or material parameters. A minimum of one analysis is required for each wall section with different reinforcement lengths. When designing MSE walls with computer software other than MSEW, verify the design with MSEW version 3.0 or later, manufactured by ADAMA Engineering, Inc. At least one MSEW analysis is required per 100 ft (30 m) of wall length with a minimum of one MSEW analysis for the wall section with the longest reinforcement length. Submit electronic executable MSEW input and output files with the design calculations. Have MSE walls designed, detailed and sealed by the Design Engineer.

3.0 MATERIALS

A. Certifications, Storage and Handling

Provide certifications in accordance with Article 106-3 of the *Standard Specifications*. Furnish Type 3 Manufacturer's Certifications for MSE wall materials with the exception of precast elements and the following. For reinforcement, provide Type 1 Certified Mill Test Reports for tensile strength. For SRW units, provide Type 1 Certified Mill Test Reports or Type 4 Certified Test Reports for all block properties with the exception of durability. When a note on plans requires freeze-thaw durable blocks, provide Type 2 Typical Certified Mill Test Reports or Type 5 Typical Certified Test Reports for durability.

Store steel materials on blocking a minimum of 12" (300 mm) above the ground and protect it at all times from damage; and when placing in the work make sure it is free from dirt, dust, loose mill scale, loose rust, paint, oil or other foreign materials. Load, transport, unload and store MSE wall materials such that they are kept clean and free of damage.

Damaged panels or blocks with excessive discoloration, chips or cracks as determined by the Engineer will be rejected. Do not damage reinforcement connection hardware or mechanisms in handling and storing panels or blocks. Mark, store and transport panels in accordance with Section 1077 of the *Standard Specifications*.

Label each pallet of blocks with the information listed in Article 1077-13 of the *Standard Specifications*. Do not transport SRW units away from the casting yard until the concrete strength reaches 4000 psi (27.6 MPa) and a period of at least 5 days elapses after casting unless otherwise approved.

Identify, store and handle geogrids and fabrics in accordance with ASTM D4873. Geogrids and fabrics with defects, flaws, deterioration or damage will be rejected. Do not leave geogrids and fabrics uncovered for more than 7 days.

B. Facing Elements

Provide facing elements produced by a manufacturer approved or licensed by the MSE Wall Vendor.

1. Precast Concrete Panels

Provide precast concrete panels meeting the requirements of Sections 1000 and 1077 of the *Standard Specifications* and reinforcing steel meeting the requirements of Section 1070 of the *Standard Specifications*. Accurately locate and secure reinforcement connection hardware and maintain required concrete cover. Produce panels within 1/4 inch (6 mm) of the panel dimensions shown in the accepted submittals.

A minimum compressive strength of 4000 psi (27.6 MPa) at 28 days is required. For testing panels for compressive strength, at least 4 cylinders are required per 2000 ft² (186 m²) of panel face area or a single day's production, whichever is less.

Unless required otherwise on the plans, provide panels with a smooth flat final finish in accordance with Article 1077-11 of the *Standard Specifications*.

2. Segmental Retaining Wall (SRW) Units

Unless required otherwise on the plans, provide SRW units with a vertical straight face and a concrete gray color with no tints, dyes or pigments. Before beginning block production, obtain approval of sample blocks of the type, face and color proposed for the project.

Use blocks meeting the requirements of Section 1040 of the *Standard Specifications* and ASTM C1372 with the exception of absorption, compressive strength and unit height requirements. Test blocks in accordance with ASTM C140 with the exception of the number of units in a lot. For testing blocks, a lot is defined as 5000 units or a single day's production, whichever is less, and at least 6 blocks are required per lot.

Provide blocks with a maximum absorption of 5% and a unit height within 1/16 inch (2 mm) of the dimension shown in the accepted submittals.

A minimum compressive strength of 4000 psi (27.6 MPa) at 28 days is required for blocks with the exception of freeze-thaw durable blocks. When a note on plans requires freeze-thaw durable SRW units, a minimum compressive strength of 5500 psi (37.9 MPa) at 28 days is required.

Test freeze-thaw durable blocks in accordance with ASTM C1262. Test specimens in water. Freeze-thaw durable blocks are acceptable if the weight loss of each of 4 of the 5 specimens after 150 cycles does not exceed 1% of its initial weight.

C. Reinforcement

Provide reinforcement supplied by the MSE Wall Vendor or a manufacturer approved or licensed by the vendor.

1. Steel (Inextensible) Reinforcement

Use welded wire reinforcement grids (mesh, mats and ladders) meeting the requirements of Article 1070-3 of the *Standard Specifications* and metallic strips meeting the requirements of ASTM A572 or A1011 with a grade as specified in the accepted submittals. Galvanize steel reinforcement in accordance with Section 1076 of the *Standard Specifications*.

2. Geogrid (Extensible) Reinforcement

Use geogrids that have been approved by the Department for the chosen MSE wall system. Obtain the list of approved geogrids for each MSE wall system from the website shown elsewhere in this provision.

Test geogrids in accordance with ASTM D6637. Machine direction (MD) and cross-machine direction (CD) are as defined by ASTM D4439. Provide minimum average roll values (MARV) as defined by ASTM D4439 for tensile strength of geogrids. For testing geogrids, a lot is defined as a single day's production.

D. Aggregate

Provide aggregate meeting the requirements of Sections 1005 and 1014 of the *Standard Specifications*.

1. Fine Aggregate

Use fine aggregate meeting the requirements of standard size nos. 1S, 2S, 2MS or 4S in accordance with Table 1005-2 of the *Standard Specifications*. When using steel reinforcement with fine aggregate, provide aggregate meeting the electrochemical requirements of Article 7.3.6.3 of the *AASHTO LRFD Bridge Construction Specifications* tested in accordance with the following methods:

Property	AASHTO Test Method
pH	T289
Resistivity	T288
Chlorides	T291
Sulfates	T290

2. Coarse Aggregate

Use coarse aggregate meeting the requirements of standard size nos. 5, 57, 57M, 6M, 67 or 78M in accordance with Table 1005-1 of the *Standard Specifications*.

E. Coping, Leveling Concrete and Pads

Provide concrete coping and leveling pads meeting the requirements of Section 1000 of the *Standard Specifications* and reinforcing steel meeting the requirements of Section 1070 of the *Standard Specifications*. Provide precast coping meeting the requirements of Section 1077 of the *Standard Specifications* and leveling concrete for precast coping meeting the requirements of Section 1000 of the *Standard Specifications*.

Use Class A Concrete for coping, leveling concrete and pads in accordance with Article 1000-4 of the *Standard Specifications* and curing agents for concrete in accordance with Section 1026 of the *Standard Specifications*. For testing precast coping for compressive strength, at least 4 cylinders are required per 40 yd³ (31 m³) of concrete or a single day's production, whichever is less.

F. Wall Drainage Systems

Wall drainage systems consist of drains and outlet components. Use drain and outlet materials meeting the requirements of subsurface drainage materials in accordance with Section 1044 of the *Standard Specifications*.

G. Bearing Pads

Use bearing pads approved by the Department for the chosen MSE wall system that meet the material requirements in Section 3.6.1.a of the *FHWA Manual "Design and Construction of Mechanically Stabilized Earth Walls and Reinforced Soil Slopes – Volume I"* (Publication No. FHWA-NHI-10-024). Obtain the list of approved bearing pads for each MSE wall system from the website shown elsewhere in this provision.

H. Geotextile Fabrics

Use filter and separation fabrics meeting the requirements of Type 2 Engineering Fabric in accordance with Section 1056 of the *Standard Specifications*.

I. Miscellaneous Components

Miscellaneous components may include attachment devices, connectors (e.g., pins, bars, plates, etc.), dowels, fasteners (e.g., bolts, nuts, etc.) and any other MSE wall components not included above. Galvanize steel components in accordance with Section 1076 of the *Standard Specifications*. Provide miscellaneous components approved by the Department for the chosen MSE wall system. Obtain the list of approved miscellaneous components for each MSE wall system from the website shown elsewhere in this provision.

J. Joint Sealer

Use joint sealer in accordance with Section 1028 of the *Standard Specifications*.

4.0 CORROSION MONITORING

Corrosion monitoring is required for MSE walls with steel reinforcement. The Engineer will determine the number of monitoring locations and where to install the instrumentation. Contact the NCDOT Materials & Tests (M&T) Unit before beginning wall construction. M&T will provide the corrosion monitoring instrumentation kits and if necessary, assistance with installation.

5.0 PRECONSTRUCTION MEETING

Before starting MSE wall construction, conduct a preconstruction meeting to discuss the construction and inspection of the MSE walls. Schedule this meeting after all MSE wall submittals have been accepted. The Resident or Bridge Maintenance Engineer, Bridge Construction Engineer, Geotechnical Operations Engineer, Contractor and MSE Wall Installer Superintendent will attend this preconstruction meeting.

6.0 SITE ASSISTANCE

Provide a representative employed by the MSE Wall Vendor to assist and guide the MSE Wall Installer on-site for at least 8 hours when the first panels or blocks are set and the first reinforcement layer is placed unless otherwise approved. If problems are encountered during construction, the Engineer may require the vendor representative to return to the site for a time period determined by the Engineer at no additional cost to the Department.

7.0 CONSTRUCTION METHODS

Control drainage during construction in the vicinity of MSE walls. Direct run off away from MSE walls, aggregate and backfill. Contain and maintain aggregate and backfill and protect material from erosion.

Perform necessary clearing and grubbing in accordance with Section 200 of the *Standard Specifications*. Excavate as necessary for MSE walls in accordance with the accepted submittals. If applicable and at the Contractor's option, "temporary shoring for wall construction" may be used in lieu of temporary slopes to construct MSE walls. Temporary shoring for wall construction is defined as temporary shoring not shown on the plans or required by the Engineer including shoring for OSHA reasons or the Contractor's convenience.

Unless required otherwise on the plans, install foundations located in the reinforced zone before placing aggregate or the first reinforcement layer. Notify the Engineer when foundation excavation is complete. Do not place leveling pad concrete, aggregate or reinforcement until obtaining approval of the excavation depth and foundation material.

Construct cast-in-place concrete leveling pads at elevations and with dimensions shown in the accepted submittals and in accordance with Section 420 of the *Standard Specifications*. Cure leveling pads a minimum of 24 hours before placing panels or blocks.

Erect and support panels or blocks with no negative batter (wall face leaning forward) such that the final position is as shown in the accepted submittals. Stagger vertical joints to create a running bond when possible unless shown otherwise in the accepted submittals. Place blocks with a maximum joint width of 3/8 inch (10 mm).

Set panels with a vertical joint width of 1/2 to 1 inch (13 to 25 mm). Place bearing pads in horizontal panel joints and cover panel joints with filter fabrics as shown in the accepted submittals. Attach filter fabrics to back of panels with adhesives, tapes or other approved methods.

Construct MSE walls with a vertical and horizontal tolerance of 3/4 inch (19 mm) when measured with a 10 ft (3 m) straight edge and a final overall vertical plumbness (batter) of less than 1/2 inch per 10 ft (13 mm per 3 m) of wall height.

Place reinforcement at the locations and elevations shown in the accepted submittals. Do not splice steel reinforcement. Geogrids may be spliced once per reinforcement length in accordance with the accepted submittals. Contact the Engineer when unanticipated

existing or future obstructions such as foundations, guardrail, fence or handrail posts, pavements, pipes, inlets or utilities will interfere with reinforcement. To avoid obstructions, deflect, skew and modify reinforcement as shown in the accepted submittals. Place reinforcement in slight tension free of kinks, folds, wrinkles or creases.

Place aggregate in the reinforced zone in 8 to 10 inch (200 to 250 mm) thick lifts. Compact fine aggregate in accordance with Subarticle 235-4(C) of the *Standard Specifications*. Use only hand operated compaction equipment within 3 ft (1 m) of the wall face. At a distance greater than 3 ft (1 m), compact aggregate with at least 4 passes of an 8 – 10 ton (7.3 - 9.1 metric ton) vibratory roller. Smooth wheeled or rubber tired rollers are also acceptable for compacting aggregate. Do not use sheepsfoot, grid rollers or other types of compaction equipment with feet. Compact aggregate in a direction parallel to the wall face. Do not displace or damage reinforcement when placing and compacting aggregate. End dumping directly on geogrids is not permitted. Do not operate heavy equipment on reinforcement until it is covered with at least 8" (200 mm) of aggregate. Replace any damaged reinforcement to the satisfaction of the Engineer. Backfill for wall construction outside the reinforced zone in accordance with Article 410-8 of the *Standard Specifications*.

If a drain is required, install wall drainage systems as shown in the accepted submittals and in accordance with Section 816 of the *Standard Specifications*. Provide drains with positive drainage towards outlets.

Place and construct coping and leveling concrete as shown in the accepted submittals. Construct cast-in-place concrete coping and leveling concrete in accordance with Section 420 of the *Standard Specifications*. When single faced precast concrete barriers are placed in front of MSE walls, stop coping just above barriers such that coping does not interfere with placing barriers up against wall faces. Do not remove forms until concrete achieves a minimum compressive strength of 2400 psi (16.5 MPa). Provide a Class 2 Surface Finish for cast-in-place concrete coping in accordance with Article 420-17 of the *Standard Specifications*.

Construct cast-in-place concrete coping joints at a maximum spacing of 10 ft (3 m) to coincide with vertical joints between panels or blocks. Half-inch (13 mm) thick expansion joints in accordance with Article 420-10 of the *Standard Specifications* are required every third joint. Half-inch (13 mm) deep grooved contraction joints in accordance with Subarticle 825-10(B) of the *Standard Specifications* are required for the remaining joints. Stop coping reinforcement 2" (50 mm) from either side of expansion joints.

When separation fabric is required, overlap fabric a minimum of 18" (450 mm) with seams oriented parallel to the wall face. Seal joints above and behind MSE walls between coping and ditches with joint sealer.

8.0 MEASUREMENT AND PAYMENT

MSE Retaining Walls will be measured and paid for in square feet (meters). MSE walls will be measured as the exposed face area with the wall height equal to the difference between the top and bottom of wall elevation. The top of wall elevation is defined as the

top of coping or top of panels or blocks for MSE walls without coping. The bottom of wall elevation is as shown on the plans and no payment will be made for portions of MSE walls below bottom of wall elevations.

The contract unit price for *MSE Retaining Walls* will be full compensation for providing design, submittals, labor, tools, equipment and MSE wall materials, excavating, backfilling, hauling and removing excavated materials and providing site assistance, leveling pads, facing elements, reinforcement, aggregate, wall drainage systems, fabrics, bearing pads, coping, miscellaneous components and any incidentals necessary to design and construct MSE walls in accordance with this provision. If necessary, the contract unit price for *MSE Retaining Walls* will also be full compensation for reinforcement connected to and aggregate behind end bent caps in the reinforced zone in accordance with the contract.

No separate payment will be made for temporary shoring for wall construction. Temporary shoring for wall construction will be considered incidental to the contract unit price for *MSE Retaining Walls*.

The contract unit price for *MSE Retaining Walls* does not include the cost for fences, handrails, ditches, guardrail and barriers associated with MSE walls as payment for these items will be made elsewhere in the contract.


Payment will be made under:

Pay Item

Pay Unit

MSE Retaining Walls at 146+39.081 -L-

Square Foot (Meter)

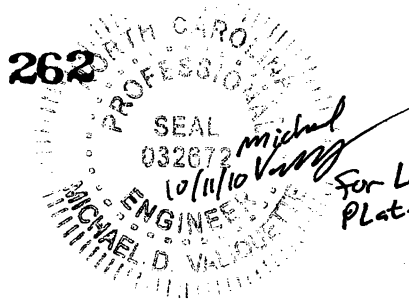

LOAD TRANSFER PLATFORM (LTP)

DESCRIPTION

The work covered by this provision consists of furnishing all equipment, labor, and materials required to construct the load transfer platform as specified herein, shown on the Pile Supported MSE Wall and Embankment plans, and directed by the Engineer. The LTP is made of high strength fabric, geogrid, and Select Material, Class IV as shown on the plans.

MATERIALS

1. Select Material, Class IV

Select Material, Class IV shall be a coarse aggregate material meeting the gradation requirements of standard size ABC as described in Section 1010 of the Standard Specifications for Roads and Structures.

2. High Strength Fabric

High strength fabric shall be made of high-tenacity polyester in the machine direction with a plain or straight-warp weave pattern and polyester or polypropylene in the cross machine direction or approved equal. The fabric shall be composed of strong rot-proof synthetic fibers formed into a fabric of the woven type. The fabric shall be free of any treatment or coating which might significantly alter its physical properties after installation. The fabric shall contain stabilizers and/or inhibitors to make the filaments resistant to deterioration resulting from ultraviolet or heat exposure. The fabric shall be a pervious sheet of synthetic fibers oriented into a stable network so that the fibers retain their relative positions with respect to each other. The edges of the fabric shall be finished to prevent the outer yarn from pulling away from the fabric. The fabric shall be free of defects or flaws which significantly affect its physical and/or filtering properties. No seams are permitted perpendicular to the machine direction. Lamination of fabric sheets to produce the physical requirements of a fabric layer will not be accepted.

During all periods of shipment and storage, the fabric shall be wrapped in a heavy duty protective covering to protect the fabric from direct sunlight ultraviolet rays, mud, dust, dirt, and debris. The fabric shall not be exposed to temperatures greater than 60°C. After the protective wrapping has been removed, the fabric shall not be left uncovered under any circumstances for longer than one (1) week.

The fabric shall meet the following physical requirements:

All values represent minimum average roll values (any roll in a lot should meet or exceed the minimum values in this table).

<u>Fabric Property</u>	<u>Test Method</u>	<u>Requirements</u>
AOS, US STD Sieve	ASTM D-4751	20-70
Tensile Strength at 5% Strain	ASTM D-4595 (Wide Strip Test)	Machine Direction 350 kN/m
Ultimate Tensile Strength	ASTM D-4595 (Wide Strip Test)	Machine Direction 1000 kN/m Cross-Machine Direction 100 kN/m
Seam Strength	ASTM D-4884	Cross-Machine Direction Only 30 kN/m

The Contractor shall furnish certified test reports by an approved independent testing laboratory with each shipment of material attesting that the fabric meets the requirements of this provision; however, the material shall be subject to inspection, test, or rejection by the Engineer at any time.

3. Geogrid

Geogrid shall be biaxial geogrid composed of polyester or polypropylene. The biaxial geogrid shall be a regular network of integrally connected elements with aperture geometry sufficient to permit significant mechanical interlock with the surrounding soil. The geogrid shall have high flexural rigidity and high tensile modulus in relation to the soil being reinforced and shall also have a high continuity of tensile strength through all of its elements. The geogrid shall be dimensionally stable and able to retain its geometry under construction stresses. The material shall have high resistance to ultraviolet degradation and to all forms of chemical and biological degradation encountered in the soil being reinforced.

Geogrids used must meet the following properties:

MINIMUM GEOGRID PROPERTY VALUES

Geogrid Properties	Test Method	Machine Direction	Perpendicular to Machine Direction (Cross-Machine Direction)
Aperture Size (mm)	Direct Measure	20 to 40	20 to 40
Wide Width Strip Tensile Strength at 5% Strain (KN/m)	ASTM D 6637-01	8.0	8.0
Wide Width Strip Tensile Strength – Ultimate Strength (KN/m)	ASTM D 6637-01	15.0	15.0
Ultimate Junction Strength (KN/m)	GRI-GG2-05	7.0	7.0
Aperture Stability (m-N/deg)	U.S. Army C.O.E.*	0.3	0.3

*The Aperture Stability is based on resistance to in-plane rotational movement measured by applying a 20 kg-cm (2 m-N) moment to the central junction of a 22.86 cm by 22.86 cm specimen at its perimeter in accordance with the U.S. Army Corps of Engineers Methodology for measurement of Torsional Rigidity.

mm = millimeter

cm = centimeter

m = meter

N = Newton

Unless indicated otherwise, values shown are minimum average roll values (MARV) determined in accordance with ASTM D-4759-02. Multiple layers of geogrid used to meet the requirements set forth in the preceding table will not be accepted.

Acceptance Requirements - The actual minimum average roll values furnished by the manufacturer must be based on representative test results from the manufacturing plant which produced the geogrid, and must meet or exceed each of the specified minimum values. Label all geogrids clearly as being part of the same production run certified as meeting all applicable requirements.

The Contractor shall furnish certified test reports by an approved independent testing laboratory with each shipment of material attesting that the fabric meets the requirements of this provision; however, the material shall be subject to inspection, test, or rejection by the Engineer at any time.

CONSTRUCTION

Excavate embankment and/or the existing ground as required to construct the LTP. Perform excavation in accordance with Section 225 of the Standard Specifications. Place the first lift of Select Material, Class IV at the bottom of the excavation to a thickness of 0.2 meters after compaction. Compact the select material and place the bottom LTP reinforcement layer as shown in the Pile Supported MSE Wall and Embankment plans. Place the subsequent layers of Select Material, Class IV and the LTP reinforcement layers to build the LTP as shown in the plans. Compact Select Material, Class IV to a minimum density equal to 92% of AASHTO T180 as modified by the Department or to the highest density that can be reasonably obtained. Compaction equipment shall be such that it will not harm the fabric and the geogrid. Do not operate heavy equipment on any of the LTP reinforcement layers until it is covered with the select material.

At the time of installation, the fabric or geogrid will be rejected if it has defects, rips, holes, flaws, deterioration or damage incurred during manufacture, transportation, or storage.

The fabric and geogrid shall be placed with the machine directions as shown on the plans or as directed by the engineer. Fabric and geogrid shall be laid smooth and free from tension, stress fold, wrinkles or creases. Adjacent layers of geogrid shall have the minimum overlap shown on the plans. No seams or overlap will be allowed perpendicular to the machine direction of the fabric. All fabric joints parallel to the machine direction shall be sewn by an approved method to develop the required seam strength. All sewn seams shall be placed facing upward to allow for inspection. All fabric and geogrid which is damaged as a result of installation shall be replaced or repaired at the discretion of the Engineer with no additional cost to the Department.

Maintain the LTP in an acceptable condition and minimize the use of heavy equipment on it in order to avoid damaging it. Provide and maintain proper drainage measures as required to prevent entrapping water in the LTP.

MEASUREMENT AND PAYMENT

Excavation down to LTP, excavation of actual LTP volume, stockpiling of excavated material, backfilling of excavated material, and rebuilding of the embankment will be considered incidental to the LTP pay items. No separate measurement for payment will be made of any material excavation, stockpiling of excavated material, backfilling of excavated material, and rebuilding of the embankment will be made.

No separate measurement for payment will be made of any drainage measures to prevent entrapping water in the LTP since it is considered as incidental to the cost of LTP construction..

The quantity of Select Material, Class IV to be paid for will be the number of metric tons of the material which has been acceptably placed. Select Material Class IV will be measured by weighing the material in trucks in accordance with Article 106-7 of the Standard Specifications. The quantity of Select Material, Class IV, measured as described herein, will be paid for at the contract unit price per metric ton for "Select Material, Class IV for LTP".

The quantity of high strength fabric to be paid for will be the number of square meters of the fabric measured along the surface of the ground which has been acceptably placed. No separate measurement will be made of overlapping fabric. The quantity of high strength fabric, measured as described herein, will be paid for at the contract unit price per square meter for "High Strength Fabric for LTP".

The quantity of geogrid to be paid for will be the number of square meters of the geogrid measured along the surface of the ground which has been acceptably placed. No separate measurement will be made of overlapping geogrid. The quantity of geogrid, measured as described herein, will be paid for at the contract unit price per square meter for "Geogrid for LTP".

Such prices and payment shall be considered as full compensation for all work covered by this provision including, but not limited to, furnishing, hauling, handling, placing, compacting, and testing Select Material, Class IV; furnishing, placing, and testing high strength fabric and geogrid; maintaining the LTP, installing and maintaining drainage measures; any excavation and backfilling necessary to construct the LTP, and all incidentals to complete the work described in this provision.

Payment will be made under:

Pay Items: Select Material, Class IV for LTP	Metric Ton
High Strength Fabric for LTP	Square Meter
Geogrid for LTP	Square Meter

PROJECT SPECIAL PROVISIONS
ELECTRICAL CONDUIT SYSTEM



1. DESCRIPTION

The work covered by this section consists of furnishing and installing a conduit system encased in concrete and buried. The work shall be in accordance with these special provisions, the plans, and the National Electrical Code (NEC). The conduit systems shall be installed in accordance with NEC requirements as an approved raceway for electrical circuits.

The Contractor actually performing the work described in these special provisions shall have a license of the proper classification from the North Carolina State Board of Examiners of Electrical Contractors.

The Contractor shall provide for someone who has passed the N. C. State Board of Examiners of Electrical Contractors test for either limited, intermediate or unlimited classification, to be available on the job site as necessary when work is being performed or when requested by the Engineer. This person shall have a set of plans and special provisions in his possession on the job site and shall maintain accurate "as built" plans and shall be qualified to instruct and direct all of the Contractor's employees regarding the work.

The Contractor shall submit for the Engineer's review and approval, eight (8) copies of catalog cuts for all materials he proposes to use. Each submittal shall show the brand name, stock number, description, size, rating, manufacturing specification, and applicable contract item number(s). The Contractor shall allow forty (40) days for review of each submittal. The Engineer will advise the Contractor of reasons for rejected submittals and will return three (3) copies of approved submittals to the Contractor. Material shall not be delivered to the project prior to approval of submittals.

2. MATERIALS

Rigid galvanized conduit (RGC) shall be in accordance with UL 6 "Rigid Metallic Conduit", with rigid full weight galvanized threaded fittings.

Cast outlet boxes shall be zinc electroplated with a grounding lug. The boxes shall be deep enough to assure a minimum of 50mm (2") concrete over the conduit. Cast outlet boxes and junction boxes shall be installed with blank covers and gaskets to provide a weatherproof installation. The boxes shall be designed for flush-mounted installations in poured concrete. Field drilled holes may be provided in lieu of drilled and tapped conduit entrances. Lightweight, stamped metal boxes with knockouts are not acceptable.

Incidental bolts, nuts, and washers shall be high strength and galvanized in accordance with Article 1072-7 of the Standard Specifications.

Pull lines shall be specifically designed for pulling a rope through conduit so that electrical circuits can be installed. The pull line shall be 2-ply line with a tensile strength of 110 kilograms (240 pounds) minimum. It shall be resistant to tangling when being dispensed and shall be rot and mildew resistant.

Zinc rich paint shall conform to Section 1080-9 of the Standard Specifications.

3. CONSTRUCTION METHODS

Conduit shall be installed continuous, watertight, free of kinks, and all runs shall be made with as few couplings as standard lengths will permit. The total angle of all bends between outlets shall not exceed 270° (3-90 bends) unless approved by the Engineer.

Protection shall be provided at all times against the entrance of water or other foreign matter into the conduit. Conduit shall be plugged or capped when work is temporarily suspended, including nightly stoppage of work.

Expansion fittings shall be provided where conduit crosses structure expansion joints.

All conduit and boxes shall be securely fastened with ties prior to placing any concrete. After the conduit is encased in concrete, the Contractor shall clean each conduit by snaking with a steel band to which shall be attached an approved tube cleaner equipped with a mandrel of a diameter not less than 85% of the nominal inside diameter of the conduit.

All exposed raw metal surfaces shall be covered with a cold galvanized, zinc rich paint to ensure against corrosion in the area where galvanizing has been damaged.

Conduits stubbed for future use shall be threaded and capped with a waterproof galvanized cap. All conduit-to-box connections shall be made with locknuts and insulating bushings. Install a pull line in all conduit runs. Include enough slack to allow easy conductor installation.

All work shall be inspected and approved by the Engineer before concealment.

4. METHOD OF MEASUREMENT

No direct measurement will be made for the conduit system, since it will be paid for on a lump sum basis.

5. BASIS OF PAYMENT

Lump Sum Basis:

Payment for the conduit system will be made at the contract lump sum price for "Electrical Conduit System at Station _____".

Compensation:

Such price and payment for the conduit system as provided above will be considered full compensation for all materials, equipment, and labor necessary to complete the work in accordance with the plans and these special provisions.

Payment will be made under:

Electrical Conduit System at Station _____.....Lump Sum

CSX TRANSPORTATION, INC. - RAILROAD SPECIAL PROVISIONSNOTICE TO THE RAILROAD COMPANY OF START OF WORK:

The Contractor shall notify CSX Transportation, Inc., herein called the Railroad Company, at least thirty (30) days in advance of the date on which he expects to start work on the railroad right-of-way. A written notice is required. No work shall commence on CSXT right-of-way until the Railroad Company has received and approved the Contractor's insurance policy.

RELOCATION OF WIRE LINES:

Any temporary or permanent changes in wire lines necessitated by the construction of the project will be made by others without cost to the Contractor. However, the Contractor will be required to bear the cost of any changes that are made at his request solely for his convenience in the conduct of his operations.

DELAYS CAUSED BY OPERATIONS OF OTHERS:

The Contractor's attention is called to the fact that neither the North Carolina Department of Transportation, herein called the Department of Transportation, nor the Railroad Company assumes any responsibility for any work performed by others in connection with the construction of the project, and the Contractor shall have no claim whatsoever against the Department of Transportation or the Railroad Company for any inconvenience, delay, or additional cost incurred by him on account of such operations by others.

COOPERATION WITH OTHERS:

The Contractor shall cooperate with others participating in the construction of the project to the end that all work may be carried on to the best advantage.

AUTHORITY OF RAILROAD ENGINEER:

The authorized representative of the Railroad Company hereinafter referred to as Railroad Engineer, shall have the final authority in all matters affecting the safe maintenance of railroad traffic of his company.

CONSTRUCTION CORRESPONDENCE AND SUBMITTALS:

Initially, direct all construction related correspondence to the Philadelphia DMJM+Harris office, CSXT's General Engineering Contractor. The Philadelphia office address is:

Mr. Brian V. Harrison, PE
AECOM
1700 Market Street
Suite 1600
Philadelphia, PA 19103

And a copy to:

Clyde Gray
CSX Transportation
1610 Forest Avenue
Suite 120
Richmond, VA 23229

All required construction submittals shall be forwarded to and approved in writing by the Railroad Company prior to proceeding with construction of each applicable phase. Thirty (30) days will be required to review all construction submittals. An additional thirty (30) day will be required to review any subsequent submissions returned not approved.

EMERGENCY ACTION PLAN:

The Contractor shall develop and submit an emergency action plan indicating the location of the site, contact names and phone numbers, access to the site, instructions for emergency response, and location of the nearest hospitals. The plan shall also cover the Contractor's means of fire suppression that may include the phone number and location of the nearest fire department. The plan shall cover all items required in the event of an emergency at the site.

CONSTRUCTION SCHEDULE:

The Contractor shall prepare and submit a detailed construction schedule for the duration of the project clearly indicating the time periods while working on and around CSXT right-of-way.

INTERFERENCE WITH RAILROAD OPERATIONS:

The Contractor shall so arrange and conduct his work that there will be no interference with railroad operations, including train, signal, telephone and telegraphic services, or damage to the property of the Railroad Company or to the poles, wire, and other facilities of tenants on the rights-of-way of the Railroad Company. Wherever work is liable to affect the operations or safety of trains, the method of doing such work shall first be submitted to the Railroad Engineer for approval, but such approval shall not relieve the Contractor from liability.

Should conditions arising from or in connection with the work, require that immediate and unusual provisions be made to protect train operations and property of the Railroad Company, it shall be a part of the required services by the Contractor to make such provisions and if, in the judgement of the Railroad Engineer such provisions is insufficient, the Railroad Engineer or the Highway Engineer, may at the expense of the Contractor, require or provide such provisions as may be deemed necessary.

The Contractor will not be permitted to provide less than the following temporary clearances during construction of the proposed overhead bridge:

15'-0" horizontal clearance measured to track from centerline of track to falsework.

22'-0" vertical clearance from top of rail to falsework.

STRUCTURE EXCAVATION AND SHORING:

The Contractor shall furnish evidence to the Department of Transportation and the Railroad Company that, upon starting construction of the proposed grade separation structure, he shall expedite the excavation and bridge work continuously and diligently to completion.

The Contractor will be required to take special precaution and care in connection with excavating and shoring pits, and in driving piles, for highway bridge footings adjacent to track to provide adequate lateral support for the track and loads which it carries without disturbance of track alignment and service, and to avoid obstructing track clearances with working equipment, tools or other material. The procedure for doing such work, including need of and plans for shoring, shall first be approved by the Railroad, but such approval shall not relieve the contractor from liability.

Shoring or sheeting protection shall be provided when excavating adjacent to an active railroad track, except as noted below.

Shoring will not be required if both the following conditions are satisfied:

1. Excavation does not encroach upon a 1½ horizontal: 1 vertical theoretical slope line starting 1'-6" below top of rail and at 12'-0" minimum from centerline of the track.
2. Track is on level ground or in a cut section and on stable soil.

When track is on embankment, excavating the toe of embankment without shoring may affect the stability of the embankment. Therefore, excavation of embankment toe without shoring will not be permitted.

Preferred protection is the cofferdam type that completely encloses the excavation. Where dictated by conditions, partial cofferdams with open sides away from the track may be used. Cofferdams shall be constructed using steel sheet piling or steel soldier beams with timber lagging. Wales and struts shall be provided as needed. The following shall be considered when designing cofferdams:

- a. Sheeting shall be designed to resist a vertical live load surcharge of 1800 lbs per square foot, in addition to active earth pressure. The surcharge shall be assumed to act on a continuous strip, 8'-6" wide. Lateral pressures due to surcharge shall be computed using the strip load formula shown in A.R.E.M.A. specifications, Chapter 8, Part 20.
- b. Allowable stresses in materials shall be in accordance with A.R.E.M.A. Specifications, Chapter 7, 8, and 15.
- c. A construction procedure for temporary shoring shall be shown on the drawing.

- d. Safety railing shall be installed when temporary shoring is within 12 feet of track.
- e. A minimum distance of 10 feet from centerline of the track to face of sheeting shall be maintained.

The Contractor shall submit the following drawings and calculations for Railroad review and approval.

1. Three (3) sets of detailed drawings of the shoring systems showing sizes of all structural members, details of connections, and distances from centerline of track to face of shoring. Drawing shall show a section showing height of sheeting and track elevation in relation to bottom of excavation.
2. One set of calculations of the cofferdam design prepared in accordance with CSXT's Criteria for Overhead Bridges dated September, 14, 2007. The drawings and calculations shall be prepared by a North Carolina Registered Professional Engineer experienced in the design of shoring and cofferdams and shall bear his seal and signature.

The subgrade of an operated track shall be maintained with edge of berm at least 10' from centerline of track and not more than 24" below top of rail. Unless so indicated on the plans the Contractor will not be required to make the existing section meet this specification and if substandard, the existing section will be maintained.

DEMOLITION OF EXISTING STRUCTURE:

Railroad tracks shall be protected from damage during demolition of existing structure or replacement of deck slab.

During demolition of the deck, a protection shield shall be erected over the track to catch falling debris. The protection shield shall be supported from girders or beams and shall not be lower than allowed temporary clearance. The deck shall be removed by cutting it in sections and lifting out. All cranes and hardware used in picks is to account for a 150% Factor of Safety. Factor of safety implied in crane charts is not to be considered in determination of lifting capacity. Large pieces of deck shall not be allowed to fall on protection shield.

Blasting will not be permitted to demolish a structure over or within railroad right-of-way.

The Contractor shall submit detailed demolition plans, including protection shield details to the Railroad Engineer for approval prior to the start of demolition. The plans shall also indicate the location and capacity of the proposed cranes and estimated lifting loads. The plans shall be prepared by a North Carolina Registered Professional Engineer and shall bear his seal and signature.

BLASTING:

Explosives shall not be used adjacent to any track or other railroad property without the advance approval of the Highway Engineer and the Railroad Engineer, but such approval will not relieve the Contractor of any liability. If use of explosives is permitted, the blasting shall be done with light charges under the direct experienced supervision of a responsible officer or employee of the Contractor, or of the Department of Transportation. Electric detonating fuses or charges shall not be used on account of possible premature explosions resulting from operation of 2-way train radios. Every precaution shall be taken to avoid damage to property, injury to persons and interruption of railroad operations.

No blasting shall be done without an authorized Railroad representative present, who will determine the approximate location of trains in order that the Contractor can be certain whether or not sufficient time will be available for blasting and subsequent cleanup without delaying trains. The Contractor shall notify the Railroad Engineer at least 10 days in advance of blasting to permit arrangement for the presence of an authorized Railroad representative and such flagging service as may be deemed necessary.

The Contractor shall have adequate equipment, labor, and materials at the job site and provide sufficient time to clean up the debris resulting from the blasting without delay to trains. He will at his expense correct any track misalignment or other damage to railroad property resulting from the blasting as directed by the Railroad Engineer. If his actions result in delays to trains, the Contractor shall bear the entire cost thereof.

Blasting shall be discontinued immediately upon notice by the Railroad Engineer or the Highway Engineer that it is too hazardous.

STORAGE OF MATERIALS:

Materials and equipment shall not be stored where they will interfere with railroad operations, nor on the rights-of-way of the Railroad Company without first having obtained permission from the Railroad Engineer, and such permission will be with the understanding that the Railroad Company will not be liable for damage to such material and equipment from any cause and that the Railroad Engineer may move or require the Contractor to move, at the Contractor's expense, such material and equipment.

DAMAGES:

The Contractor shall assume all liability for any and all damages to his work, employees, servants, equipment and materials caused by railroad traffic.

MAINTENANCE OF DITCHES ADJACENT TO RAILROAD TRACKS:

The Contractor shall submit plans indicating the proposed methods of erosion control during construction, in particular, excavation for the piers and grading.

The Contractor shall exercise necessary precautions to prevent fouling of track ballast and existing ditches in the excavation of material at the proposed structure site. He shall maintain the

existing railroad ditches free from obstruction and silt through the duration of his construction operations and upon completion of the structure shall leave the ditches in conditions satisfactory to the Railroad Engineer.

Should material from excavating at the proposed structure site foul the track ballast, the Contractor will be required to clean or replace the fouled ballast under the direction of and to the satisfaction of the Railroad Engineer.

Any cost incurred by the Railroad Company for repairing damage to its property or to property of its tenants, caused by or resulting from the operations of the Contractor, shall be paid by the Contractor to the Railroad Company.

TEMPORARY RAILROAD GRADE CROSSINGS:

Where the plans show or imply that equipment or materials of any nature must be transported across a Railroad, unless the Department of Transportation has included arrangements for such crossings in its agreement with the Railroad, the Contractor will be required to first obtain authority for its installation, maintenance, and removal from the Railroad Engineer. The Contractor shall execute CSX Railroad's standard private road crossing agreement. Railroad Forces will do all work within two feet of the rail and the Contractor will pay all cost associated with the installation, maintenance and removal of the temporary grade crossing. The Contractor shall arrange for any resulting necessity of watching and flagging and to furnish the Railroad Company with a separate Railroad Protective Liability Policy other than the one required by these special provisions. All the above shall be at no cost to the Department of Transportation.

In the event the Department of Transportation has made arrangements for the Temporary Grade Crossings, the Contractor will need to have a railroad flagman on site during any use of the crossing and the crossings must be physically barricaded during such times that it is not required for use. The Contractor shall construct the road and approaches such that it does not interrupt existing drainage patterns and to the satisfaction of the Railroad. Flagman must be on site for construction and the roadway must be removed upon completion of the project. The Contractor shall restore the property including any drainage ditches. The Contractor's attention is called to the fact that he will not be required to bear the cost of the flagging services required by the Railroad Company or provide any additional railroad insurance except that required by the Insurance Special Provision.

ERECTION PROCEDURE:

The Contractor shall submit a detailed procedure for erecting the spans over railroad tracks. Equipment used for the erection, or removal of structures over railroad facilities, shall have a minimum lifting capacity of one hundred-fifty percent (150%). Factor of safety implied in crane charts is not to be considered in determination of lifting capacity. The procedure shall indicate the capacity of cranes, location of cranes with respect to the tracks and estimated lifting loads. The erection procedure must follow CSX Construction Guidelines and be prepared by a North Carolina Registered Professional Engineer and shall bear his seal and signature. The procedure must be approved by the Railroad.

FLAGGING PROTECTION OR WATCHMAN SERVICE:

The watchman and flagging service required by the Railroad Company for the safety of railroad operations because of work performed by the Contractor or subcontractors in connection with the construction of the proposed overhead structures will be provided by CSX Transportation, Inc. and the Contractor's special attention is called to the fact that he will not be required to bear the cost of any watchman or flagging service required by CSX Transportation, Inc., other than that required at any temporary grade crossing, as the Railroad Company will be reimbursed by the Department of Transportation on bills rendered monthly. All bills to be prepared in accordance with the Federal-Aid Policy Guide 23 CFR 646B.

When the Contractor's men or equipment are working within eighteen (18) feet of the nearest rail, over, under or adjacent to the track over which trains are operated, or when work is being performed adjacent to an operated track which may present a hazard to train operations, or when equipment is being used which does, or may infringe on such limits, and at other times, when in the opinion of the Railroad Engineer such protection is necessary, the services of a man or men will be used for flagman or watchman service.

The Contractor shall give 10 days advance notice to the Railroad Engineer in order that flagging service can be arranged and provided. No work shall be undertaken until the flagman, or flagmen, are at the job site. The estimated number and classification of men are shown in the Force Account Estimate.

The estimated cost of Flagging Protection or Watchman Service is shown in the Force Account Estimates prepared by CSX Transportation, Inc., and made a part of the Plans, Specifications and Estimate.

If the Railroad Company for any reason finds it necessary to furnish a watchman or flagman of a different classification from that shown in the Force Account Estimate, bills will be rendered and shall be paid on the basis of the rate of pay for the men used whether that is above or below the rate given. If the rate of pay of any employee that is to be used for watchman or flagging service is changed before the work is started or during the progress of the work, either by law or agreement between the Railroad Company and its employees, or if the tax rates on labor are changed, bills will be rendered by the Railroad Company and paid by the Department of Transportation on the new rates.

The Contractor's attention is also called to the fact that he will be required to carry on his operations which require flagging protection or watchman service in such a manner and sequence that the cost of such will be as economical as possible.

COMPLETION AND ACCEPTANCE OF WORK:

Upon completion of the work, the Contractor shall remove from within the limits of the railroad right of way all machinery, equipment, surplus materials, rubbish or temporary buildings of the Contractor, and leave said rights-of-way in a neat and orderly condition. After the final inspection has been made and work found to be completed in a satisfactory manner acceptable to

the Department of Transportation and the Railroad Company, the Department of Transportation will be notified of the Railroad Company's acceptance in writing by the Railroad Engineer within ten (10) days or as soon thereafter as practicable.

At project completion, a complete set of "As Built" plans for the proposed construction shall be submitted to CSXT Bridge Maintenance and Design Group. CSXT will keep these plans on file in Jacksonville for future reference. Please address these plans to:

Mr. Rick Garro
500 Water Street
J-350
Jacksonville, FL 32202

INSURANCE SPECIAL PROVISIONS FOR
CSX TRANSPORTATION, INC.

STRUCTURE

TIP: X-2BC

Cumberland County

A. In addition to any other forms of insurance or bonds required elsewhere in the contract documents, the Contractor will be required to provide coverage conforming to the requirements of the Federal-Aid Policy Guide outlined under 23 CFR 646A for all work to be performed on Railroad right(s)-of-way under the terms of the contract by carrying insurance of the following kinds:

1. CONTRACTOR'S COMMERCIAL GENERAL LIABILITY INSURANCE:

a. The Contractor shall furnish an original and one copy of the certificates of insurance and one certified copy of the policy to the Department of Transportation as evidence that, with respect to the operations he performs on railroad right-of-way, he carries Commercial General Liability Insurance including "XCU" coverage providing for limits of liability as follows:

<u>COVERAGE</u>	<u>MINIMUM COMBINED LIMITS OF LIABILITY</u>
Bodily Injury Liability	\$ 5,000,000 Per Occurrence
Property Damage Liability	\$ 5,000,000 Aggregate

b. If any part of the work is sublet, similar insurance and evidence thereof in the same amounts as required of the Prime Contractor, shall be provided by the subcontractor to cover his operations on railroad right-of-way. As an alternative, the Prime Contractor may provide insurance for the subcontractor by means of separate and individual policies.

c. Certificates of Insurance holders are to be sent to the addressees given below. Certificates shall make reference to the project, milepost and county.

NCDOT Rail Division
Engineering & Safety Branch
c/o State Railroad Agent
1556 Mail Service Center
Raleigh, N.C. 27699-1556

CSX Transportation, Inc.
Risk Manager
500 Water Street
Jacksonville, Florida
32202

2. RAILROAD PROTECTIVE LIABILITY INSURANCE:

- a. The Contractor shall furnish to the Department of Transportation an original and one duplicate of the Railroad Protective Liability Insurance Policy with limits of liability as follows:

<u>COVERAGE</u>	<u>MINIMUM COMBINED LIMITS OF LIABILITY</u>
Bodily Injury Liability	\$5,000,000 Per Occurrence
Property Damage Liability	\$10,000,000 Aggregate Per Annual Policy Period
Physical Damage to Property	

- b. The Railroad Protective Liability Policy is to be written on the ISO/RIMA Form No. CG 00 35 10 93 (or updates thereof) including Endorsements CG 28 31 11 85 and IL 00 21 or their equivalents.
- c. The insurer must be financially stable and rated A- or better in A.M. Best & Company's Insurance Reports.
- d. The name and address of Contractor and Department of Transportation must be shown on the Declarations page.
- e. The named insured, description of the work and designation of the job site to be shown on the Policy are as follows:

Named Insured: CSX Transportation, Inc.
 Casualty Insurance Department (J-907)
 500 Water Street
 Jacksonville, Florida 32202

Description and Designation: Construction of three (3) new overhead structures over the tracks of CSX Transportation, Inc. in Cumberland County, North Carolina near Railroad Milepost AE-203.80 identified as State WBS 35196.3.18 (X-2BC).

- B. The Railroad Protective Liability Policy shall contain a clause requiring that sixty (60) days written notice be given the Department of Transportation and the Railroad Company prior to cancellation or change.

All other policies and certificates shall contain a clause requiring that thirty (30) days written notice be given to the Department of Transportation and the Railroad Company prior to cancellation or change. The notices shall make reference to the project, milepost and county.

NOTICE TO:

CSX Transportation, Inc.
 Risk Manager
 500 Water St.
 Jacksonville, Florida
 32202

COPY NOTICE TO:

NCDOT Rail Division
 Engineering & Safety Branch
 c/o State Railroad Agent
 1556 Mail Service Center
 Raleigh, N. C. 27699-1556

- C. All insurance herein before specified shall be carried until the final inspection and acceptance of the project, or that portion of the project within railroad right-of-way, by the Department of Transportation or, in the case of subcontractors, until the Contractor furnishes a letter to the Engineer stating that the subcontractor has completed his subcontracted work within railroad right-of-way to the satisfaction of the Contractor and that the Contractor will accomplish any additional work necessary on railroad right-of-way with his own forces. It is understood that the amounts specified are minimum amounts and that the Contractor may carry insurance in larger amounts if he so desires. As to "aggregate limits", if the insurer establishes loss reserves equal to or in excess of the aggregate limit specified in any of the required insurance policies, Contractor shall immediately notify the Department of Transportation and shall cease all operations until the aggregate limit is reinstated. If the insurer establishes loss reserves equal to or in excess of one-half of the aggregate limit, Contractor shall arrange to restore the aggregate limit to at least the minimum amount stated in these requirements. Any insurance policies and certificates taken out and furnished due to these requirements shall be approved by the Department of Transportation and the Railroad Company as to form and amount prior to beginning work on railroad right-of-way.

No extra allowance will be made for the insurance required hereunder; the entire cost of same is to be included in the unit contract price bids for the several pay items.

- D. Evidence of insurance as required above shall be furnished for review to the Department of Transportation at the address shown below after which it will be forwarded by the Department of Transportation to the Railroad.

Send to Department:

NCDOT Rail Division
 Engineering & Safety Branch
 c/o State Railroad Agent
 1556 Mail Service Center
 Raleigh, NC 27699-1556

X-0002BC - Cumberland County**Railroad Site Data:**

The following information was received from the Railroad on August 7, 2008, and is provided as a convenience to the Contractor in bidding this project. This information is subject to change and the Contractor may, at his discretion, contact the Railroad directly to verify its current accuracy. Since this information is shown as a convenience to the Contractor, but is subject to change, the Contractor shall have no claims whatsoever against either the Railroad or the Department of Transportation for any delays or additional costs incurred based on changes in this information which occur after the above date of receipt.

Type and number of tracks within 50 ft. of project (mainline, branchline, siding, yard, etc.).

1 - Mainline

Number of trains on affected track per day.

1

Type of trains (passenger or freight).

Freight

Maximum authorized operating speed of trains.

70 mph

Type and number of RR employees assigned to job.

1 - Flagman