


SDO

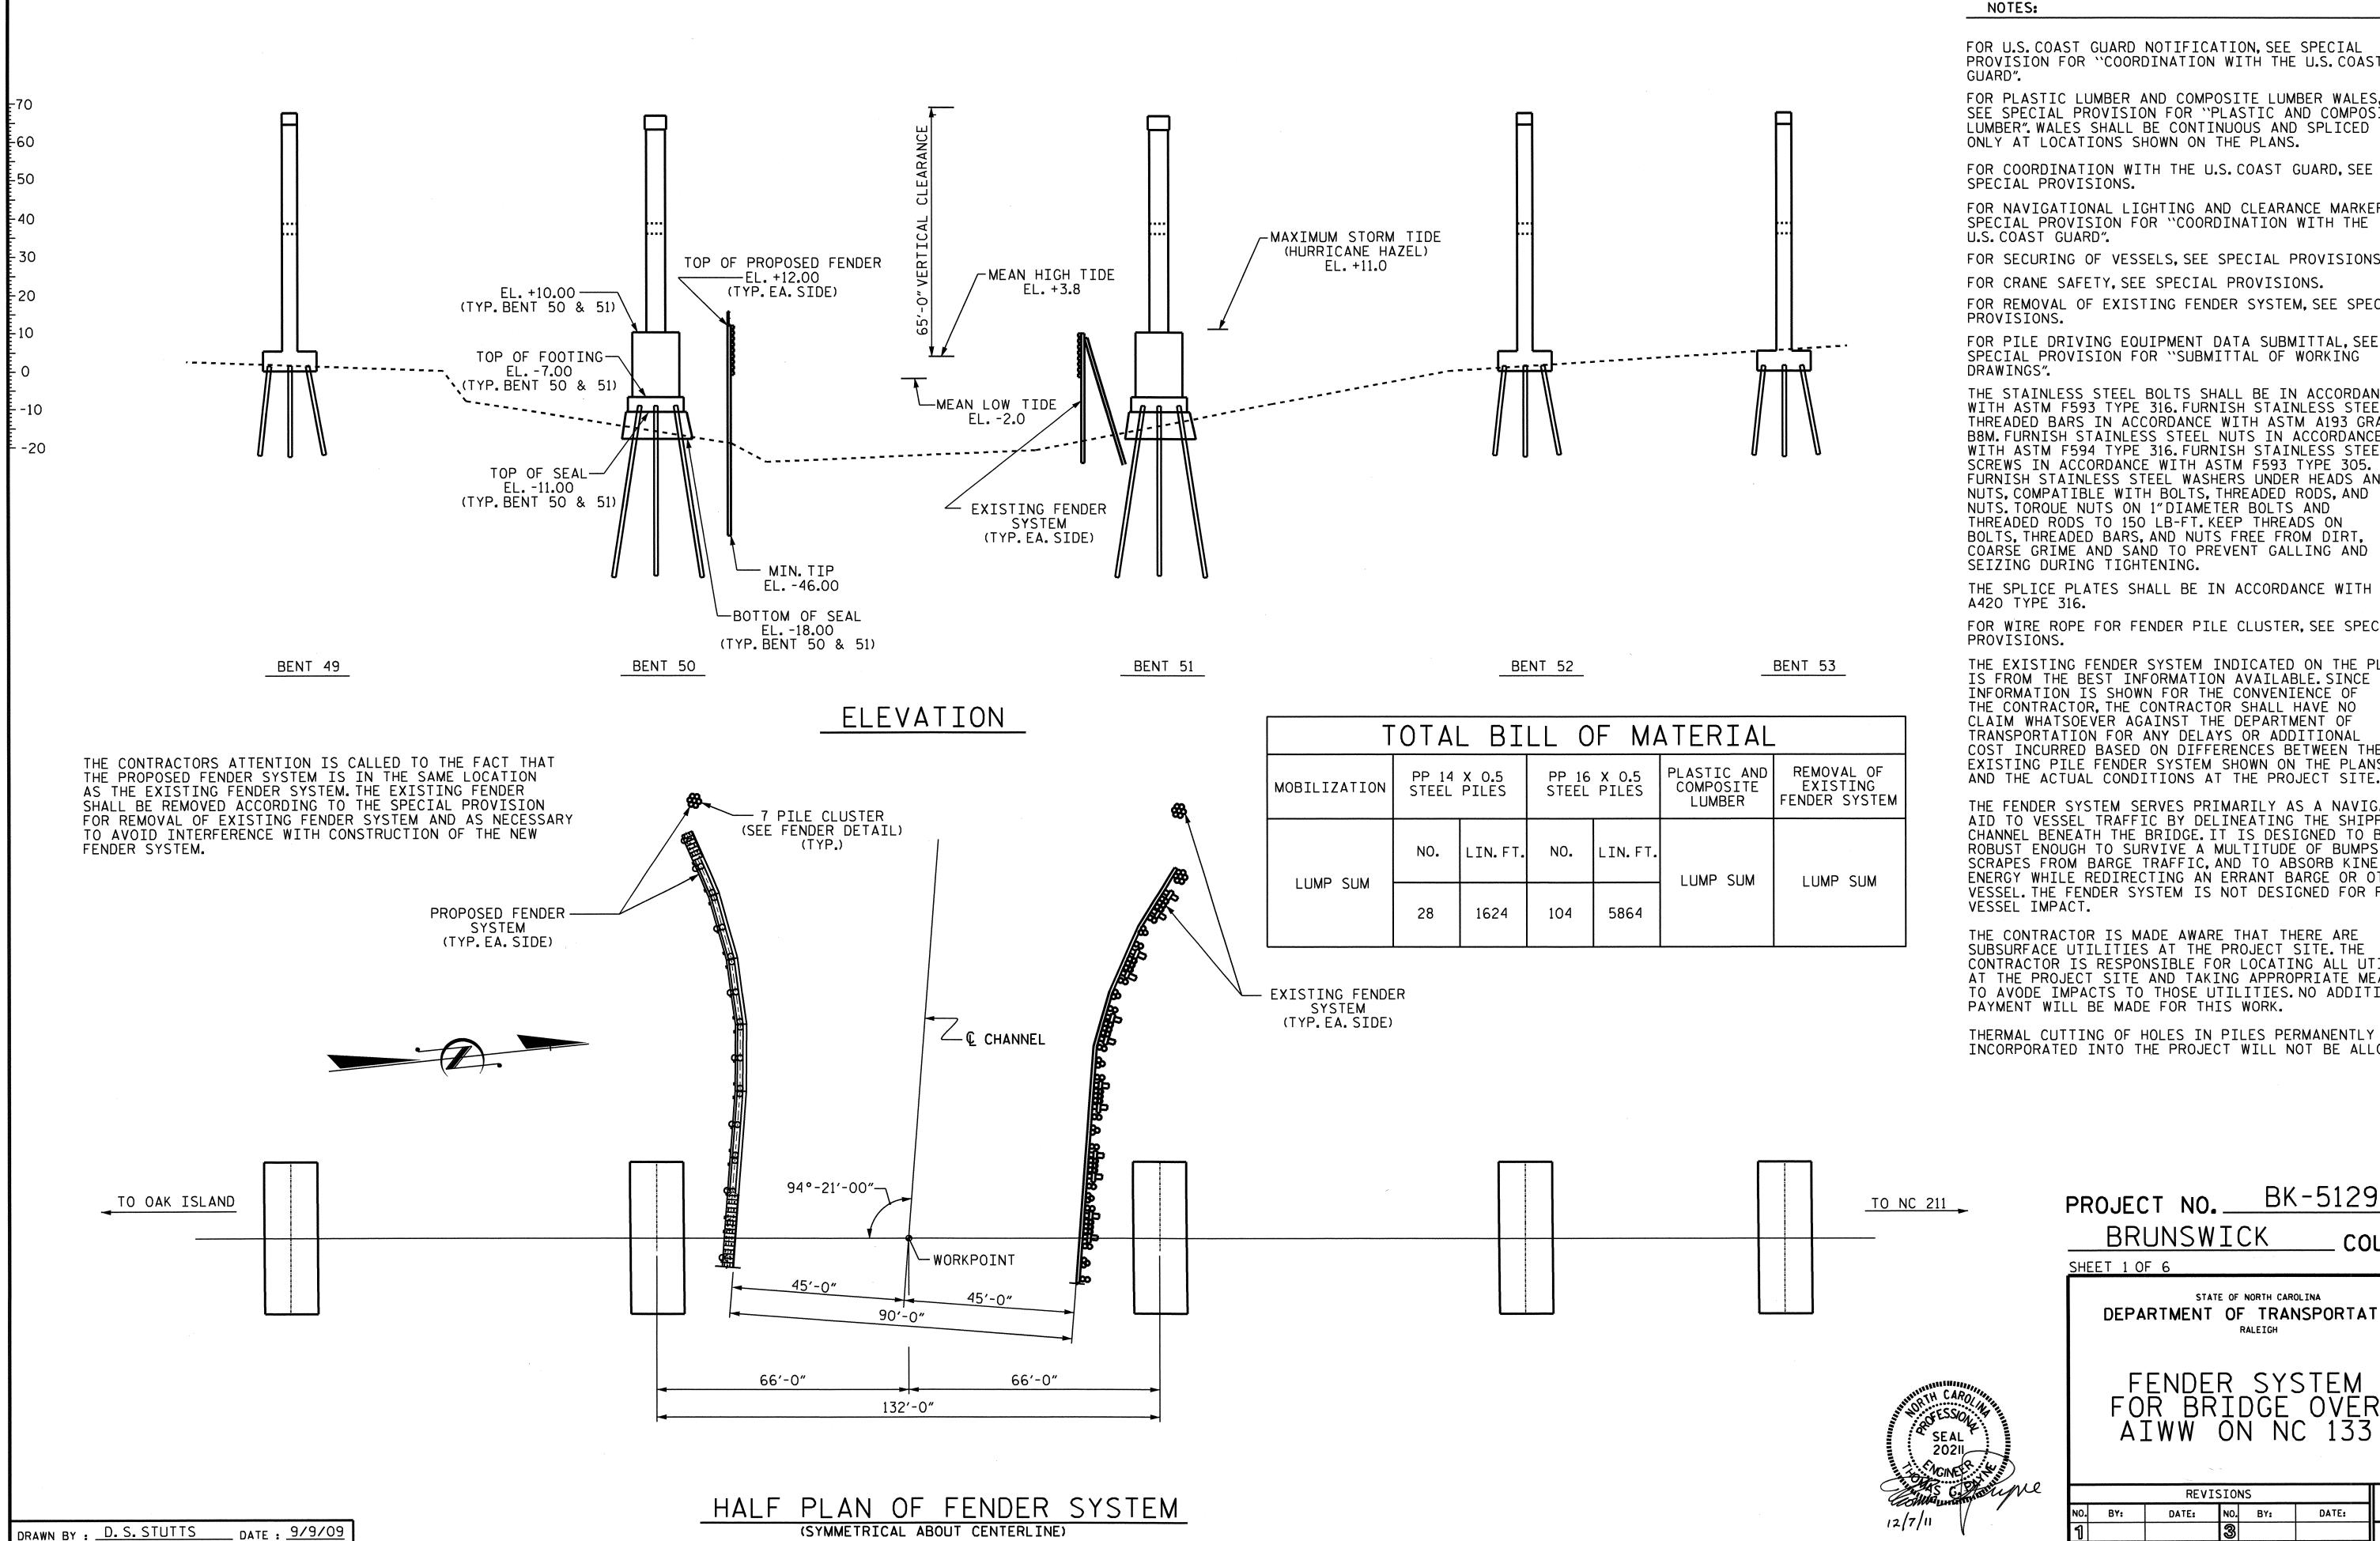

FOR U.S. COAST GUARD NOTIFICATION, SEE SPECIAL PROVISION FOR "COORDINATION WITH THE U.S. COAST

FOR PLASTIC LUMBER AND COMPOSITE LUMBER WALES, SEE SPECIAL PROVISION FOR "PLASTIC AND COMPOSITE LUMBER". WALES SHALL BE CONTINUOUS AND SPLICED

FOR COORDINATION WITH THE U.S. COAST GUARD, SEE

FOR NAVIGATIONAL LIGHTING AND CLEARANCE MARKER, SEE SPECIAL PROVISION FOR "COORDINATION WITH THE

FOR SECURING OF VESSELS, SEE SPECIAL PROVISIONS.

FOR CRANE SAFETY, SEE SPECIAL PROVISIONS. FOR REMOVAL OF EXISTING FENDER SYSTEM, SEE SPECIAL

FOR PILE DRIVING EQUIPMENT DATA SUBMITTAL, SEE SPECIAL PROVISION FOR "SUBMITTAL OF WORKING

THE STAINLESS STEEL BOLTS SHALL BE IN ACCORDANCE WITH ASTM F593 TYPE 316. FURNISH STAINLESS STEEL THREADED BARS IN ACCORDANCE WITH ASTM A193 GRADE B8M. FURNISH STAINLESS STEEL NUTS IN ACCORDANCE WITH ASTM F594 TYPE 316. FURNISH STAINLESS STEEL SCREWS IN ACCORDANCE WITH ASTM F593 TYPE 305. FURNISH STAINLESS STEEL WASHERS UNDER HEADS AND NUTS, COMPATIBLE WITH BOLTS, THREADED RODS, AND NUTS. TORQUE NUTS ON 1"DIAMETER BOLTS AND THREADED RODS TO 150 LB-FT. KEEP THREADS ON BOLTS. THREADED BARS. AND NUTS FREE FROM DIRT. COARSE GRIME AND SAND TO PREVENT GALLING AND

THE SPLICE PLATES SHALL BE IN ACCORDANCE WITH ASTM

FOR WIRE ROPE FOR FENDER PILE CLUSTER, SEE SPECIAL

THE EXISTING FENDER SYSTEM INDICATED ON THE PLANS IS FROM THE BEST INFORMATION AVAILABLE. SINCE THIS INFORMATION IS SHOWN FOR THE CONVENIENCE OF THE CONTRACTOR, THE CONTRACTOR SHALL HAVE NO CLAIM WHATSOEVER AGAINST THE DEPARTMENT OF TRANSPORTATION FOR ANY DELAYS OR ADDITIONAL COST INCURRED BASED ON DIFFERENCES BETWEEN THE EXISTING PILE FENDER SYSTEM SHOWN ON THE PLANS AND THE ACTUAL CONDITIONS AT THE PROJECT SITE.

THE FENDER SYSTEM SERVES PRIMARILY AS A NAVIGATION AID TO VESSEL TRAFFIC BY DELINEATING THE SHIPPING CHANNEL BENEATH THE BRIDGE. IT IS DESIGNED TO BE ROBUST ENOUGH TO SURVIVE A MULTITUDE OF BUMPS AND SCRAPES FROM BARGE TRAFFIC, AND TO ABSORB KINETIC ENERGY WHILE REDIRECTING AN ERRANT BARGE OR OTHER VESSEL. THE FENDER SYSTEM IS NOT DESIGNED FOR FULL

THE CONTRACTOR IS MADE AWARE THAT THERE ARE SUBSURFACE UTILITIES AT THE PROJECT SITE. THE CONTRACTOR IS RESPONSIBLE FOR LOCATING ALL UTILITIES AT THE PROJECT SITE AND TAKING APPROPRIATE MEASURES TO AVODE IMPACTS TO THOSE UTILITIES. NO ADDITIONAL

INCORPORATED INTO THE PROJECT WILL NOT BE ALLOWED.


BK-5129 COUNTY


STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION


FENDER SYSTEM FOR BRIDGE OVER AIWW ON NC 133


REVISIONS						SHEET NO.
NO.	BY:	DATE:	NO.	BY:	DATE:	S-1
1			3			TOTAL SHEETS
2			4			6

CHECKED BY : T. G. PAYNE DATE : 9/9/09

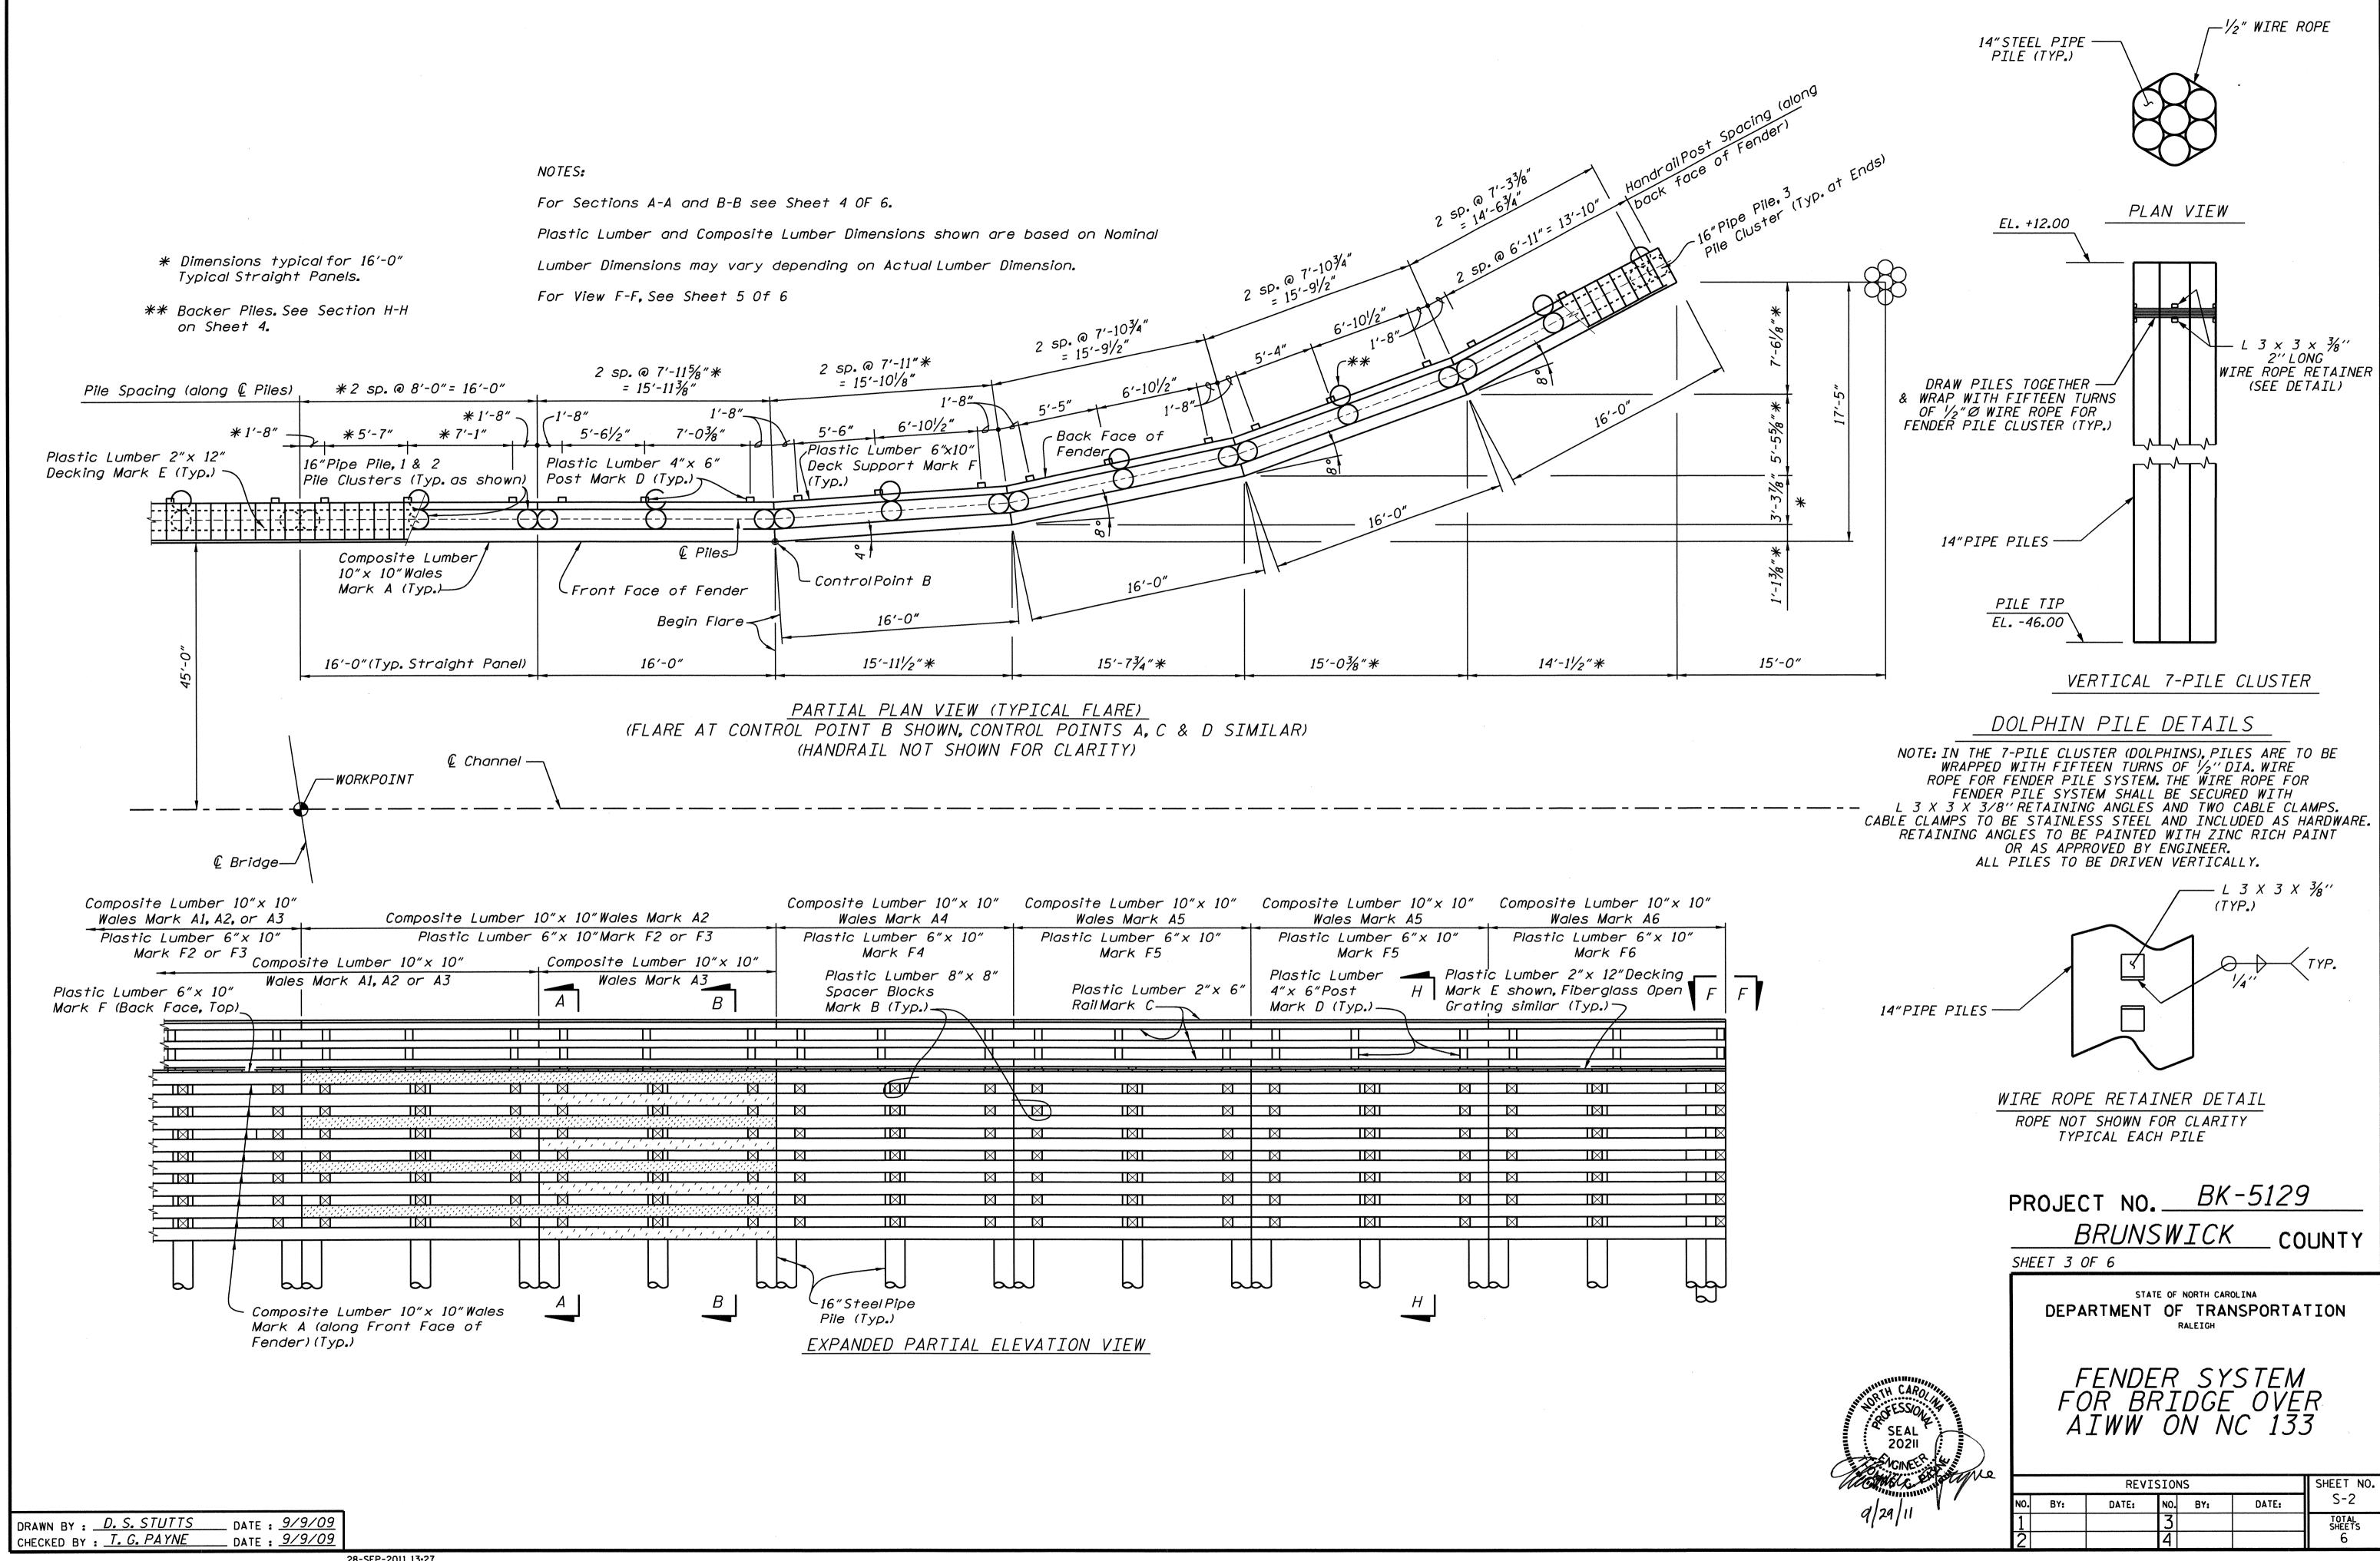

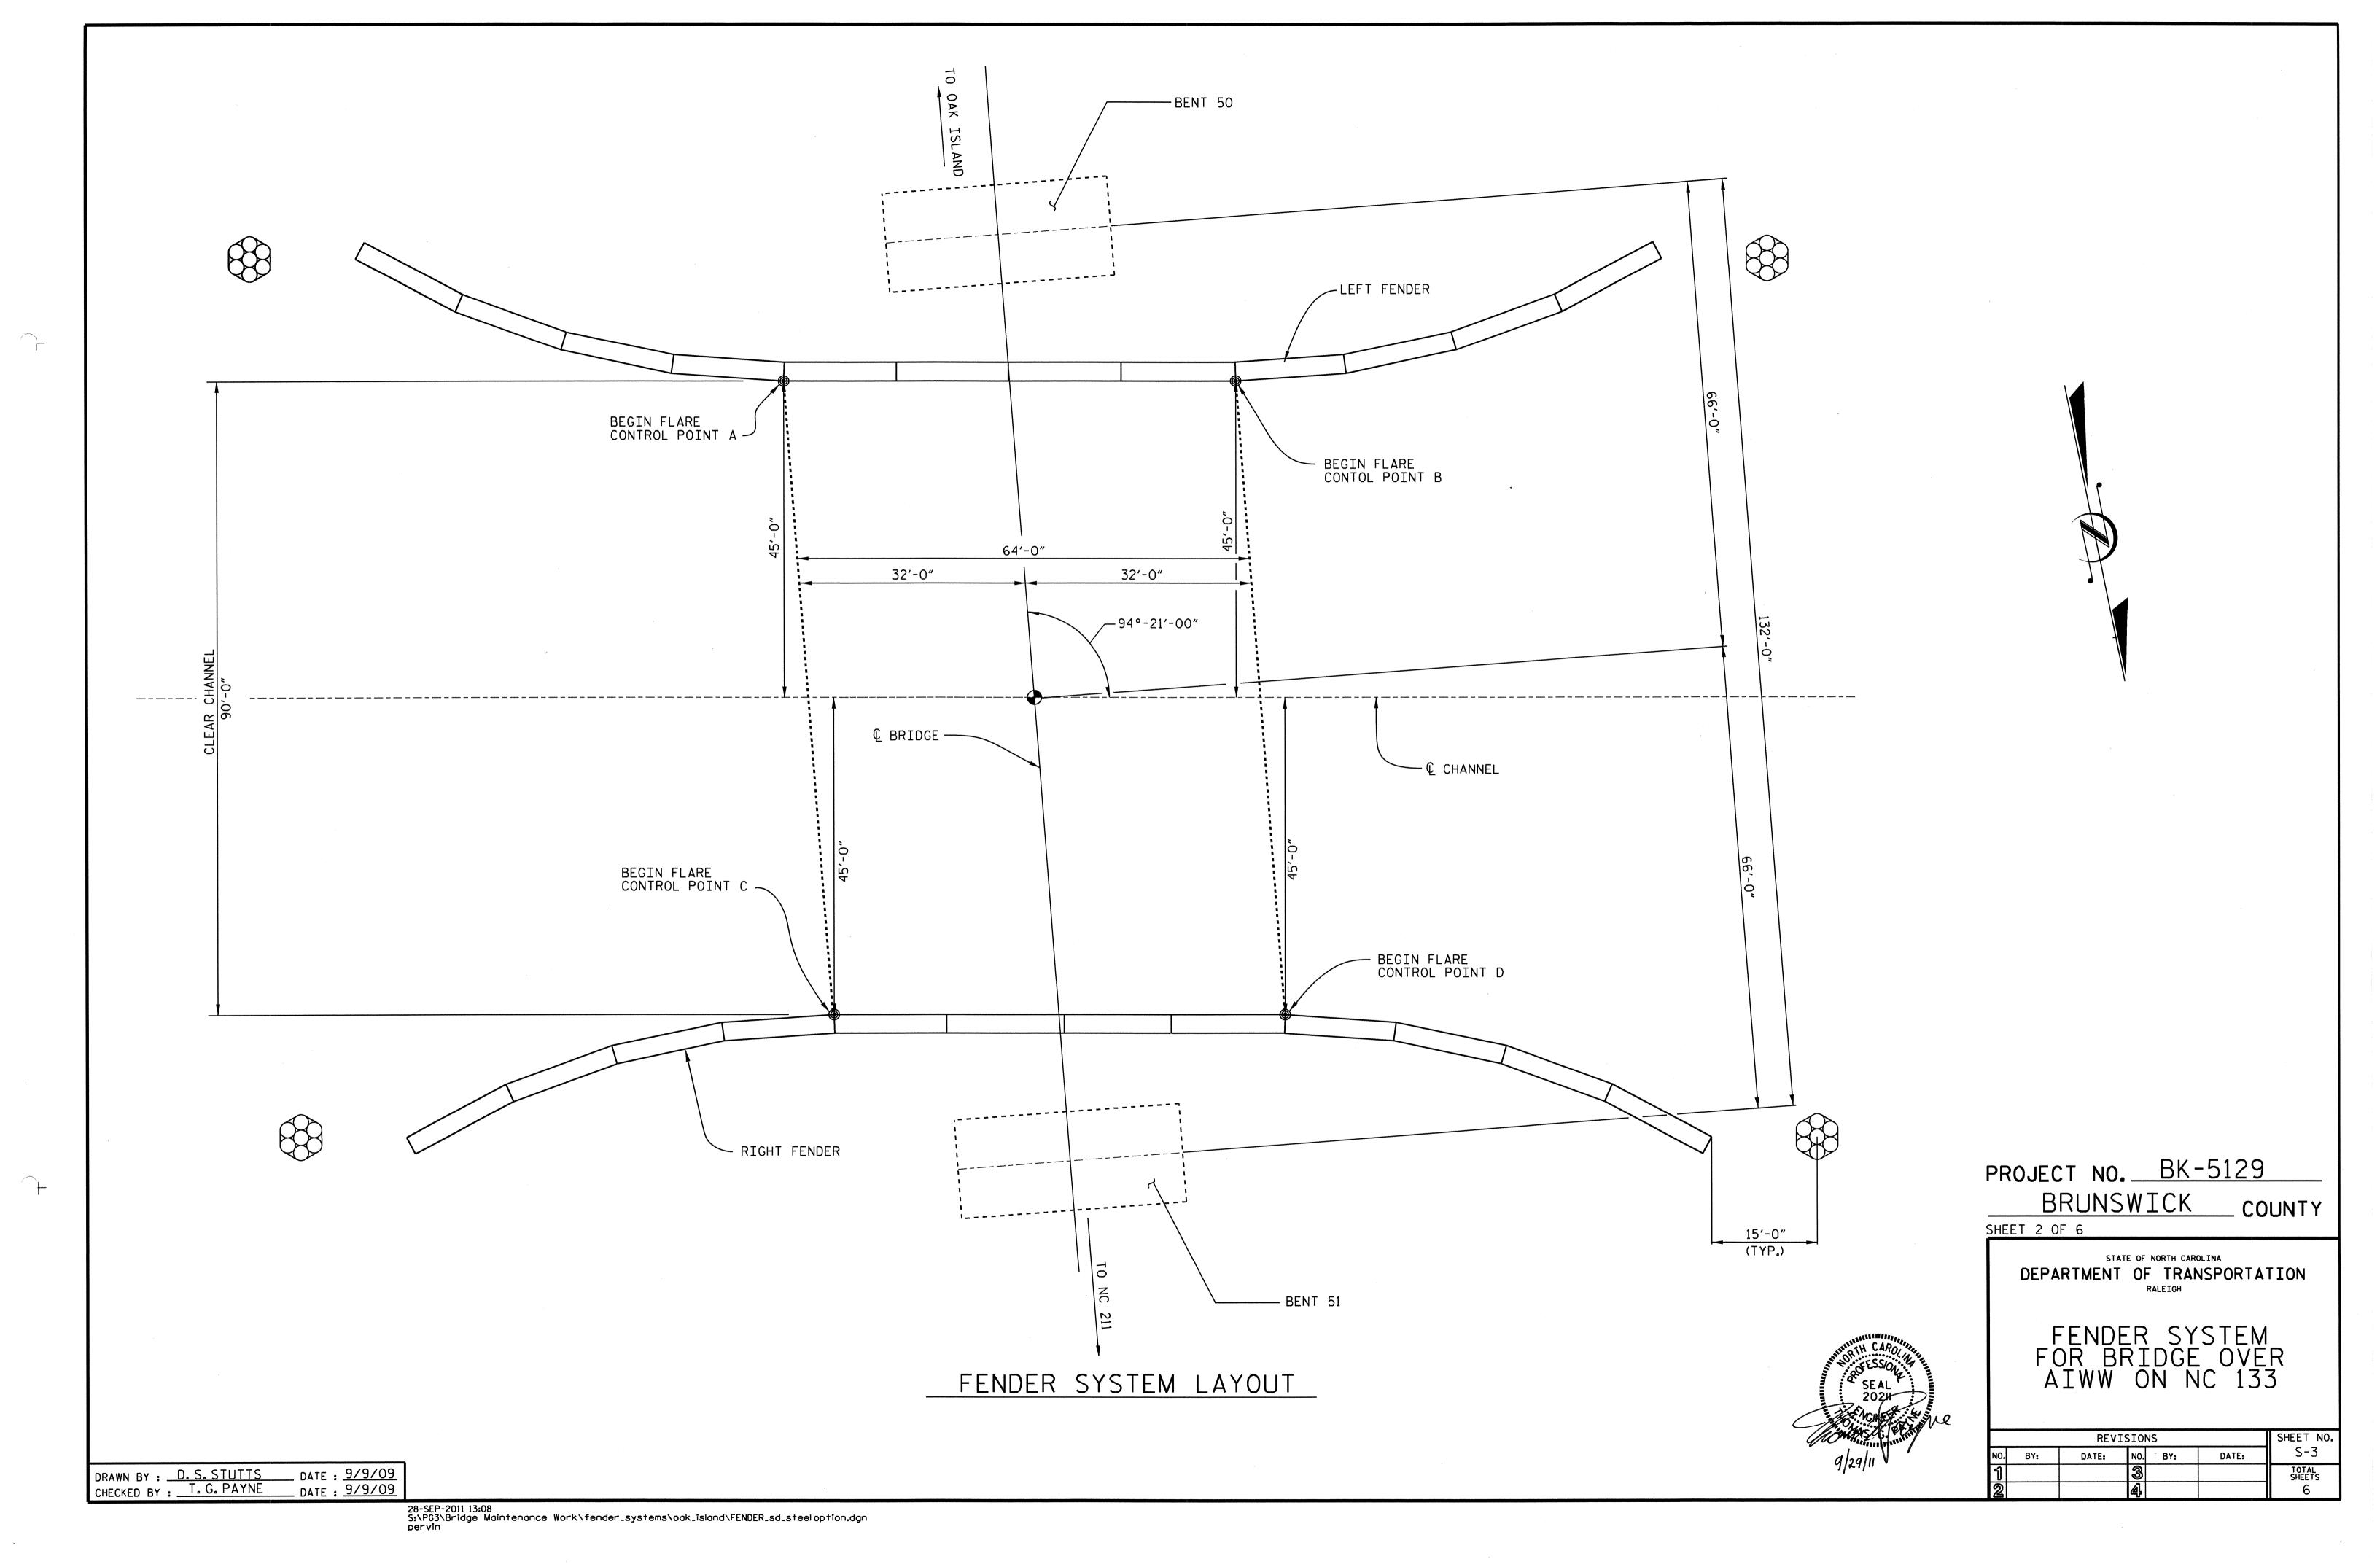

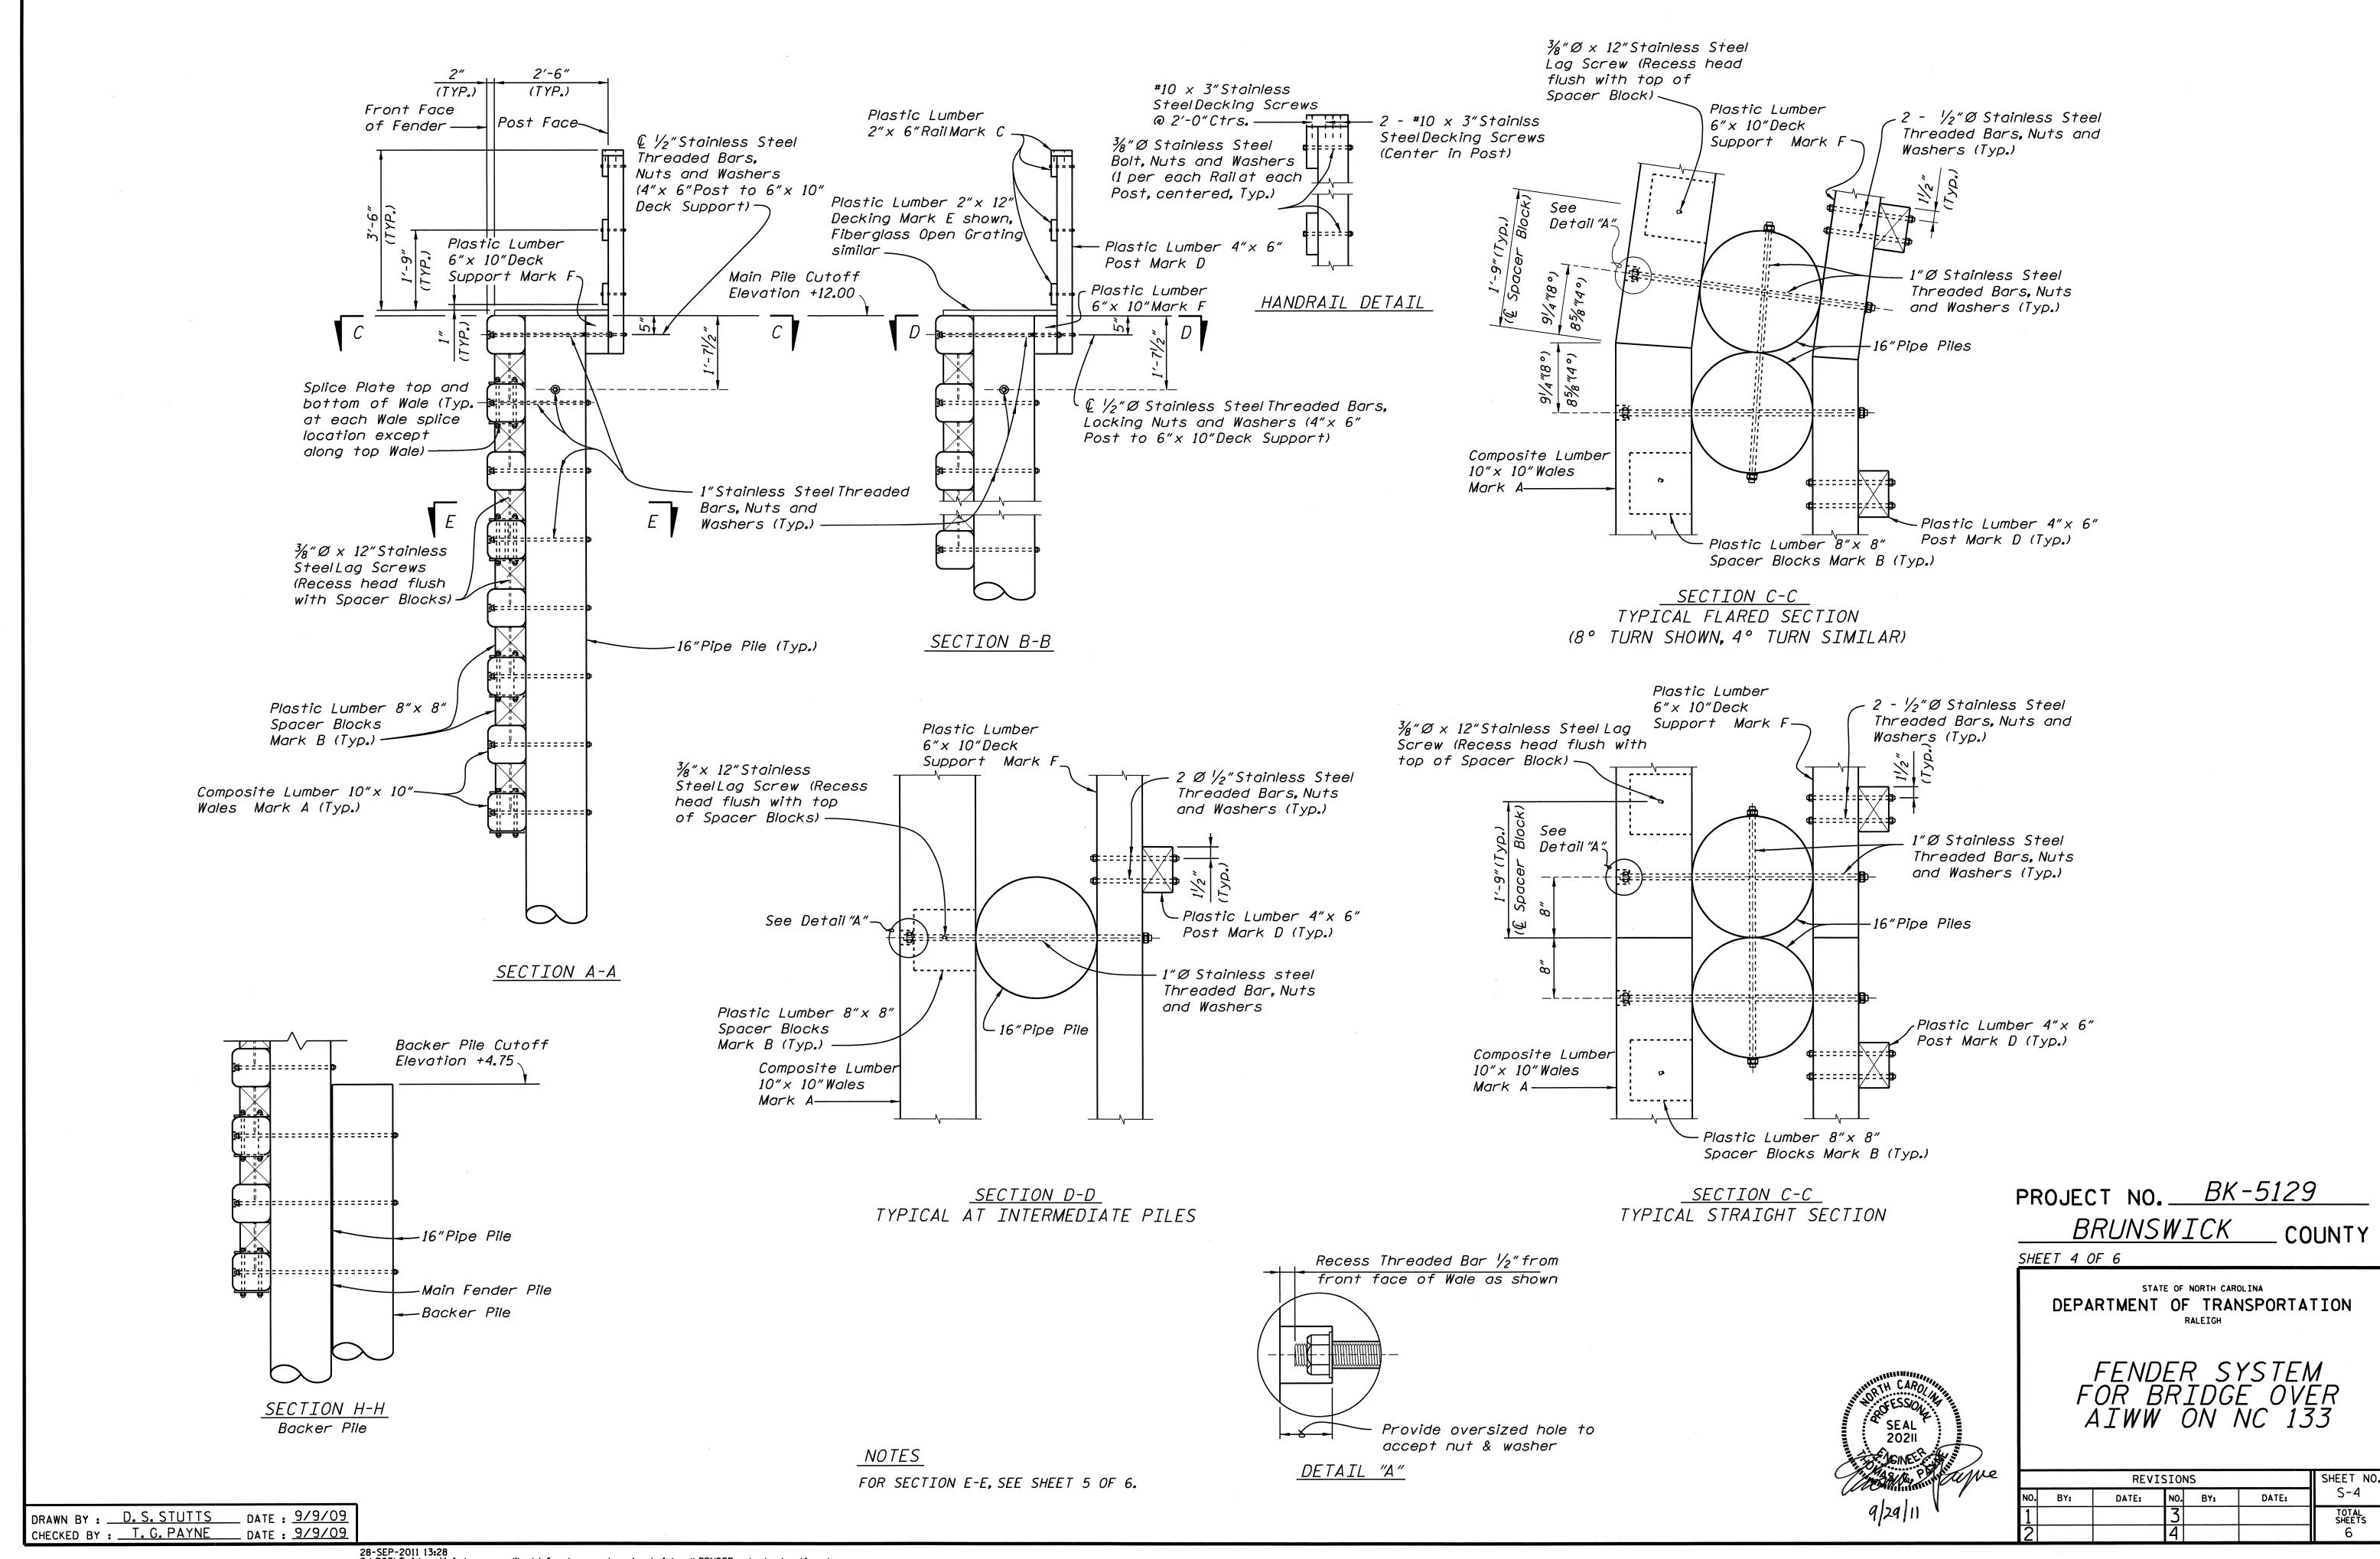

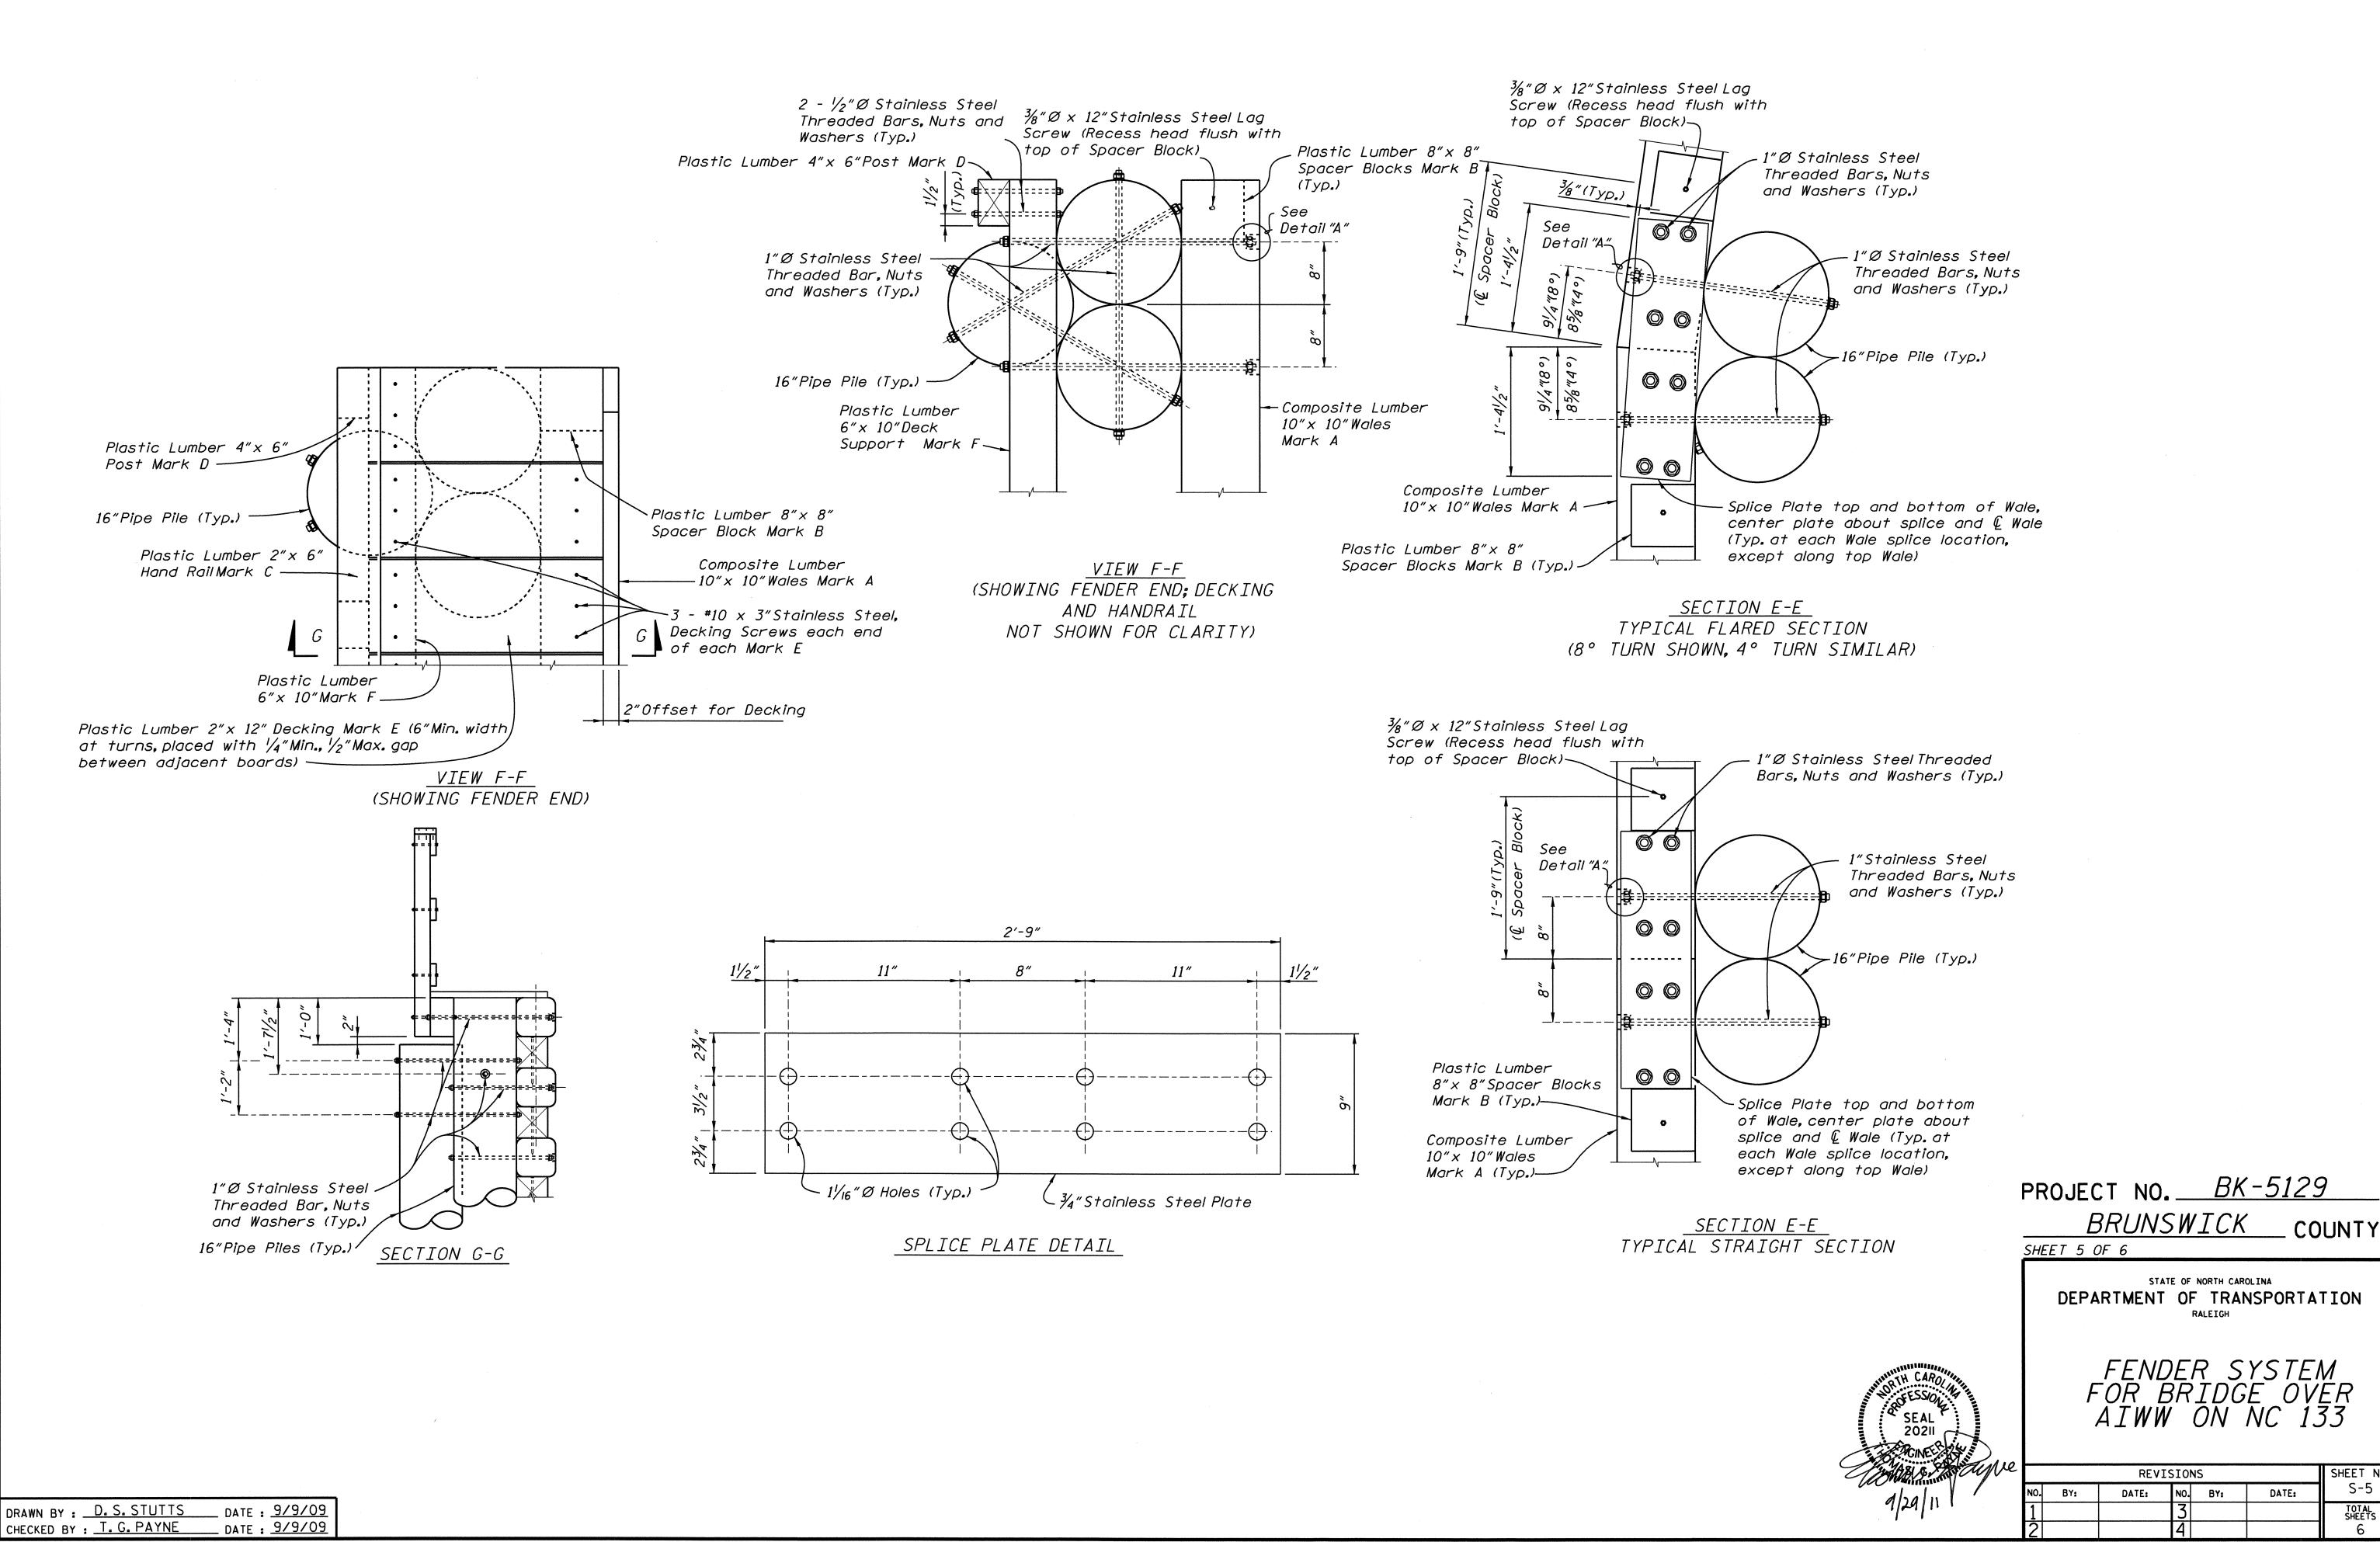


SHEET NO. S-5

TOTAL SHEETS


* COMPOSITE LUMBER BILL OF MATERIALS						
MARK	SIZE (NOMINAL)	DIMENSIONS	BOARD FT. PER EACH	NO. REOD.	OUANTITY (BOARD FT.	
A1	10"X 10" COMPOSITE LUMBER	32'-O"(STRAIGHT)	266.6	8	2132.8	
A2	10"X 10" COMPOSITE LUMBER	3/8"- -	266.6	16	4265.6	
A3	10"X 10" COMPOSITE LUMBER	16'-0"	133 . 3	16	2132.8	
A4	10"X 10" COMPOSITE LUMBER	0 3/8" 5/8" 16'-0"	133 . 3	32	4265.6	
A5	10"X 10" COMPOSITE LUMBER	16'-0"	133 . 3	64	8531 . 2	
A6	10"X 10" COMPOSITE LUMBER	16'-0"	<i>133.</i> 3	32	4265.6	

* PLASTIC LUMBER BILL OF MATERIALS						
MARK	SIZE (NOMINAL)	DIMENSIONS	BOARD FT. PER EACH	NO. REOD.	QUANTITY (BOARD FT.)	
В	8"X 8" PLASTIC LUMBER	8"(STRAIGHT)	3.6	504	1814.4	
С	2"X 6" PLASTIC LUMBER	16'-0" (STRAIGHT) (Trim & Miter Ends as required)	16.0	96	1536.0	
D	4"X 6" PLASTIC LUMBER	4'-4"(STRAIGHT)	8 . 7	144	1252 . 8	
* ₩ E	2"X 12" PLASTIC LUMBER	2'-6"(STRAIGHT) (Miter as required)	5.0	384	1920.0	
F2	6"X 10" PLASTIC LUMBER	16'-0"	80.0	4	320.0	
F3	6"X 10" PLASTIC LUMBER	15'-11"	79 . 6	4	318.4	
F4	6"X 10" PLASTIC LUMBER	15'-9'/4"	78.8	4	<i>315.2</i>	
F5	6"X 10" PLASTIC LUMBER	15'-8'/4"	78 . 4	8	627.2	
F6	6"X 10" PLASTIC LUMBER	15'-101/4"	79 . 2	4	316 . 8	

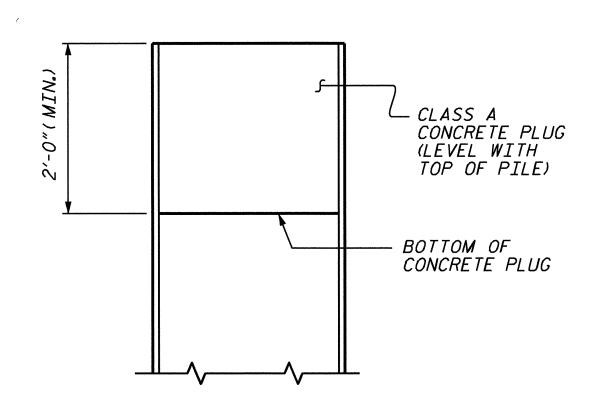

ELEVATION PP 16 X 0.50 STEEL PILE

ALSO TYPICAL FOR PP 14 × 0.50

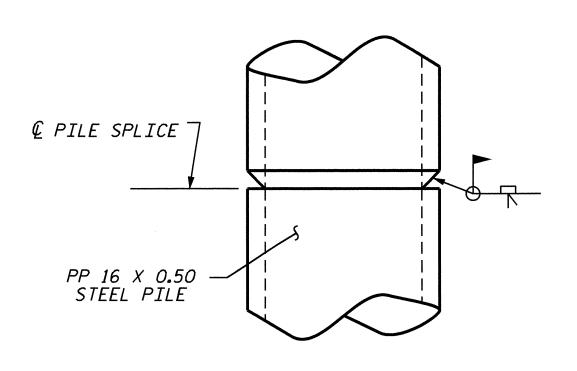

PIPE PILE SPLICE DETAIL ALSO TYPICAL FOR PP 14 x 0.50

STEEL PIPE PILE BILL OF MATERIALS							
PILE TYPE	LENGTH	NO. REOD.	TOTAL LENGTH (FT.)				
PP 14 X 0.50	58′-0′′	28	1624				
PP 16 X 0.50	58′-0′′	80	4640				
PP 16 X 0.50	51'-0''	24	1224				

NOTES:

AND AWS D1.1.

* ALL PLASTIC LUMBER AND COMPOSITE LUMBER DIMENSIONS AND QUANTITIES SHOWN ARE BASED ON NOMINAL LUMBER DIMENSIONS AND MAY VARY DEPENDING ON ACTUAL LUMBER DIMENSIONS.

** CONTRACTOR MAY PROVIDE FIBERGLASS OPEN GRATING IN LIEU OF 2"X 12" PLASTIC LUMBER AT NO ADDITIONAL COST TO THE DEPARTMENT.

FIBERGLASS OPEN GRATING SHALL BE HEAVY DUTY DESIGN SUITABLE FOR EXTERIOR INSTALLATIONS. MAXIMUM GAP OPENING ON THE WALKWAY SURFACE SHALL BE 1/2". DESIGN LIVE LOAD AND DEFLECTIONS SHALL BE A 50 PSF UNIFORMLY DISTRIBUTED LOAD WITH A MAXIMUM DEFLECTION OF 3/8" OR L/120 AT THE CENTER OF A SIMPLE SPAN. COLOR OF FIBERGLASS OPEN GRATING SHALL BE GRAY OR BLACK.

INSTALL FIBERGLASS OPEN GRATING ACCORDING TO MANUFACTURER'S RECOMMENDATIONS USING STAINLESS STEEL HARDWARE, SCREWS, BOLTS, NUTS, AND WASHERS. ATTACH FIBERGLASS OPEN GRATING TO WALES AND DECK SUPPORTS AT A 2'-O"MAXIMUM SPACING SO AS TO RESIST PEDESTRIAN LIVE LOADS AND UPLIFT FORCES FROM WIND, BOUYANCY AND WAVE ACTION.

PIPE PILES SHALL BE IN ACCORDANCE WITH SECTION 1084 OF THE STANDARD SPECIFICATIONS.

REMOVE AND REPLACE OR REPAIR TO THE SATISFACTION OF THE ENGINEER PILES THAT ARE DAMAGED, DEFORMED OR COLLAPSED DURING INSTALLATION OR DRIVING. PILE SPLICES SHALL BE IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS

FOR OPEN END PIPE PILES, REMOVE ENOUGH SOIL AND WATER FROM INSIDE THE PILES TO CONSTRUCT THE CONCRETE PLUG WITHOUT FOULING THE CONCRETE.

CLASS A CONCRETE AND PAINTING ARE CONSIDERED INCIDENTAL TO THE CONTRACT PRICE FOR THE PIPE PILES.

PILES SHALL BE PAINTED IN ACCORDANCE WITH SECTION 442 OF THE STANDARD SPECIFICATIONS. PILES SHALL BE PAINTED THEIR ENTIRE LENGTH AND SYSTEM 2 OF SECTION 442-7 SHALL BE USED.

PILES SHALL CONTAIN 0.2% COPPER.

PROJECT NO. <u>BK-5129</u> BRUNSWICK SHEET 6 OF 6 STATE OF NORTH CAROLINA



FENDER SYSTEM FOR BRIDGE OVER AIWW ON NC 133

DEPARTMENT OF TRANSPORTATION

___ COUNTY

REVISIONS						SHEET NO.
١٥.	BY:	DATE:	NO.	BY:	DATE:	S-6
1			3			TOTAL SHEETS
2			4			6

DRAWN BY: D. S. STUTTS DATE: 9/9/09
CHECKED BY: T. G. PAYNE DATE: 9/9/09

STANDARD NOTES

DESIGN DATA:

A.A.S.H.T.O. (CURRENT) SPECIFICATIONS LIVE LOAD IMPACT ALLOWANCE STRESS IN EXTREME FIBER OF 20,000 LBS. PER SQ. IN. STRUCTURAL STEEL - AASHTO M270 GRADE 36 27,000 LBS. PER SQ. IN. - AASHTO M270 GRADE 50W 27,000 LBS. PER SQ. IN. - AASHTO M270 GRADE 50 REINFORCING STEEL IN TENSION -- 24,000 LBS. PER SQ. IN. CONCRETE IN COMPRESSION CONCRETE IN SHEAR STRUCTURAL TIMBER - TREATED OR 1,800 LBS. PER SQ. IN. UNTREATED - EXTREME FIBER STRESS COMPRESSION PERPENDICULAR TO GRAIN OF TIMBER

MATERIAL AND WORKMANSHIP:

EQUIVALENT FLUID PRESSURE OF EARTH

EXCEPT AS MAY OTHERWISE BE SPECIFIED ON PLANS OR IN THE SPECIAL PROVISIONS, ALL MATERIAL AND WORKMANSHIP SHALL BE IN ACCORDANCE WITH THE 2006 "STANDARD SPECIFICATIONS FOR ROADS AND STRUCTURES" OF THE N. C. DEPARTMENT OF TRANSPORTATION.

30 LBS. PER CU. FT.

STEEL SHEET PILING FOR PERMANENT OR TEMPORARY APPLICATIONS SHALL BE HOT ROLLED.

CONCRETE:

UNLESS OTHERWISE REQUIRED ON PLANS, CLASS A CONCRETE SHALL BE USED FOR ALL PORTIONS OF ALL STRUCTURES WITH THE EXCEPTION THAT: CLASS AA CONCRETE SHALL BE USED IN BRIDGE SUPERSTRUCTURES, ABUTMENT BACKWALLS, AND APPROACH SLABS; AND CLASS B CONCRETE SHALL BE USED FOR SLOPE PROTECTION AND RIP RAP.

CONCRETE CHAMFERS:

UNLESS OTHERWISE NOTED ON THE PLANS, ALL EXPOSED CORNERS ON STRUCTURES SHALL BE CHAMFERED 3/4" WITH THE FOLLOWING EXCEPTIONS: TOP CORNERS OF CURBS MAY BE ROUNDED TO 1-1/2" RADIUS WHICH IS BUILT INTO CURB FORMS; CORNERS OF TRANSVERSE FLOOR EXPANSION JOINTS INTO CURB FORMS; CORNERS OF TRANSVERSE FLOOR EXPANSION JOINTS OTHERWISE REQUIRED ON PLANS; AND CORNERS OF EXPANSION JOINTS IN THE ROADWAY FACES AND TOPS OF CURBS AND SIDEWALKS SHALL BE ROUNDED TO A 1/4" RADIUS AND TOPS OF CURBS AND SIDEWALKS SHALL BE ROUNDED TO A 1/4" RADIUS WITH A FINISHING STONE OR TOOL UNLESS OTHERWISE REQUIRED ON PLANS.

DOWELS:

DOWELS WHEN INDICATED ON PLANS AS FOR CULVERT EXTENSIONS, SHALL BE EMBEDDED AT LEAST 12" INTO THE OLD CONCRETE AND GROUTED INTO PLACE WITH 1:2 CEMENT MORTAR.

ALLOWANCE FOR DEAD LOAD DEFLECTION. SETTLEMENT. ETC. IN CASTING SUPERSTRUCTURES:

BRIDGES SMALL BE BUILT ON THE GRADE OR VERTICAL CURVE SHOWN ON PLANS.

SLABS, CURBS AND PARAPETS SMALL CONFORM TO THE GRADE OR CURVE.

ALL DIMENSIONS WITCH ARE GIVEN IN SECTION AND ARE AFFECTED BY DEAD LOAD DEFLECTIONS ARE DIMENSIONS AT CENTER LINE OF BEARING UNLESS OTHERWISE NOTED ON PLANS. IN SETTING FORMS FOR STEEL BEAM BRIDGES AND PRESTRESSED CONCRETE GIRDER BRIDGES, ADJUSTMENTS SMALL BE MADE DUE TO THE DEAD LOAD DEFLECTIONS FOR THE ELEVATIONS SMOWN, WHERE BLOCKS ARE SMOWN OVER BEAMS FOR BUILDING UP TO THE SLAB, THE VERTICAL DIMENSIONS OF THE BLOCKS SMALL BE ADJUSTED BETREEN BEARINGS TO COMPENSATE FOR DEAD LOAD DEFLECTIONS, VERTICAL CURVE ORDINATE, AND ACTUAL BEAM CAMBER. WHERE BOTTOM OF SLAB IS IN LINE WITH BOTTOM OF TOP FLANGES, DEPTH OF SLAB BETWEEN BEARINGS SMALL BE ADJUSTED TO COMPENSATE FOR DEAD LOAD DEFLECTION, VERTICAL CURVE ORDINATE, AND ACTUAL BEAM CAMBER.

IN SETTING FALSEWORK AND FORMS FOR REINFORCED CONCRETE SPANS, AN ALLOWANCE SMALL BE MADE FOR DEAD LOAD DEFLECTIONS, SETTLEMENT OF FALSEWORK, AND PERMANENT CAMBER WITCH SMALL BE PROVIDED FOR IN ADDITION TO THE SLEVATIONS SHOWN, AFTER REMOVAL OF THE FALSEWORK, THE FINISHED STRUCTURES SMALL CONFORM TO THE PROFILE AND ELEVATIONS SHOWN ON THE PLANS AND CONSTRUCTION ELEVATIONS FURNISHED BY THE ENGINEER.

DETAILED DRAWINGS FOR FALSEWORK OR FORMS FOR BRIDGE SUPERSTRUCTURE AND ANY STRUCTURE OR PARTS OF A STRUCTURE AS NOTED ON THE PLANS SHALL BE SUBMITTED TO THE ENGINEER FOR APPROVAL BEFORE CONSTRUCTION OF THE FALSEWORK OR FORMS FOR BRIDGE SUPERSTRUCTURE AND ANY STRUCTURE OR PARTS OF A STRUCTURE AS NOTED ON THE PLANS SHALL BE SUBMITTED TO THE ENGINEER FOR APPROVAL BEFORE CONSTRUCTION OF THE FALSEWORK OR FORMS IS STARTED.

REINFORCING STEEL:

ALL REINFORCING STEEL SHALL BE DEFORMED. DIMENSIONS RELATIVE TO PLACEMENT OF REINFORCING ARE TO CENTERS OF BARS UNLESS OTHERWISE INDICATED IN THE PLANS. DIMENSIONS ON BAR DETAILS ARE TO CENTERS OF BARS OR ARE OUT TO OUT AS INDICATED ON PLANS.

WIRE BAR SUPPORTS SHALL BE PROVIDED FOR REINFORCING STEEL WHERE INDICATED ON THE PLANS. WHEN BAR SUPPORT PIECES ARE PLACED IN CONTINUOUS LINES, THEY SHALL BE SO PLACED THAT THE ENDS OF THE SUPPORTING WIRES SHALL BE LAPPED TO LOCK LEGS ON ADJOINING PIECES.

STRUCTURAL STEEL:

AT THE CONTRACTOR'S OPTION, HE MAY SUBSTITUTE 7/8" SHEAR STUDS FOR THE 34" STUDS SPECIFIED ON THE PLANS. THIS SUBSTITUTION SHALL BE MADE AT THE RATE OF 3 - 7/8" STUDS FOR 4 - 3/4" STUDS STUD SPACING CHANGES SMALL BE MADE AS NECESSARY TO PROVIDE THE SAME EQUIVALENT NUMBER OF 7/8" STUDS ALONG THE BEAM AS SMOTH FOR 3/4" STUDS BASED ON THE RATIO OF 3 - 7/8" STUDS FOR 4 - 3/4" STUDS. STUDS OF THE LENGTH SPECIFIED ON THE PLANS MUST BE PROVIDED. THE MAXIMUM SPACING SHALL BE 2"-0".

PLATE IS IN CONTACT WITH BEARING PLATE, THE CONTRACTOR MAY, AT HIS OPTION, SUBSTITUTE FOR THE COVER PLATES DESIGNATED ON THE PLANS COVER PLATES OF THE EQUIVALENT AREA PROVIDED THESE PLATES ARE AT LEAST 5/16" IN THICKNESS AND DO NOT EXCEED A WIDTH EQUAL TO THE FLANGE WIDTH LESS 2" OR A THICKNESS EQUAL TO 2 TIMES THE FLANGE THICKNESS. THE SIZE OF FILLET WELDS SHALL CONFORM TO THE REQUIREMENTS OF THE CURRENT ANSI/AASHTD/AWS "BRIDGE WELDING CODE".

PLECTROSLAG WELDING WILL NOT BE PERMITTED.

WITH THE SOLE EXCEPTION OF EDGES AT SURFACES WHICH BEAR ON OTHER SURFACES, ALL SMARP EDGES AND EMBS OF SMAPES AND PLATES SHALL BE SLIGHTLY ROUNDED BY SUITABLE MEANS TO A RADIUS OF APPROXIMATELY 1/16 INCH OR CRUIVALENT FLAT SURFACE AT A SUITABLE ANGLE PRIOR TO PAINTING, GALVANIZING, OR METALLIZING.

HANDRAILS AND POSTS:

METAL STANDARDS AND FACES OF THE CONCRETE END POSTS FOR THE METAL RAIL SMALL BE SET NORMAL TO THE GRADE OF THE CURB, UNLESS OTHERWISE SHOWN ON PLANS. THE METAL RAIL AND TOPS OF CONCRETE POSTS USED WITH THE ALUMINUM RAIL SHALL BE BUILT PARALLEL TO THE GRADE OF THE CURB.

METAL HANDRAILS SHALL BE IN ACCORDANCE WITH THE PLANS. RAILS SHALL BE AS MANUFACTURED FOR BRIDGE RAILING. CASTINGS SHALL BE OF A UNIFORM APPEARANCE. FINS AND OTHER DEFORMATIONS RESULTING FROM CASTING OR OTHERWISE SHALL BE REMOVED IN A MANNER SO THAT A UNIFORM COLORING OF THE COMPLETED CASTING SHALL BE OBTAINED. CASTINGS WITH DISCOLORATIONS OR OF NON-UNIFORM COLORING WILL NOT BE ACCEPTED. CERTIFIED MILL REPORTS ARE REQUIRED FOR METAL RAILS AND POSTS.

SPECIAL NOTES:

GENERALLY, IN CASE OF DISCREPANCY, THIS STANDARD SHEET OF NOTES SHALL GOVERN OVER THE SPECIFICATIONS, BUT THE REMAINDER OF THE PLANS SHALL GOVERN OVER NOTES HEREON, AND SPECIAL PROVISIONS SHALL GOVERN OVER ALL. SEE SPECIFICATIONS ARTICLE 105-4.

ENGLISH

JANUARY, 1990

STD. NO. SN