




NOTE: OVERHEAD POWER TRANSMISSION LINES WILL NOT BE MOVED OR DE-ENERGIZED

UTILITIES BY OTHERS

NOTE:
ALL PROPOSED UTILITY WORK SHOWN ON THIS SHEET WILL BE DONE BY OTHERS

-L-

PI Sta 11+54.94 $\Delta = 6^{\circ} 46' 22.1" (LT)$ $D = 2^{\circ} 24' 26.6"$ $L = 281.33'$ $T = 140.83'$ $R = 2,380.00'$ SE = SEE PLAN	PI Sta 20+09.74 $\Delta = 11^{\circ} 08' 39.8" (RT)$ $D = 3^{\circ} 49' 11.0"$ $L = 291.76'$ $T = 146.34'$ $R = 1,500.00'$ SE = SEE PLAN
---	--

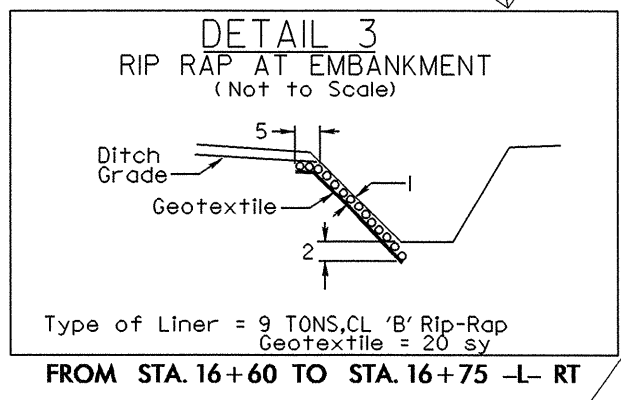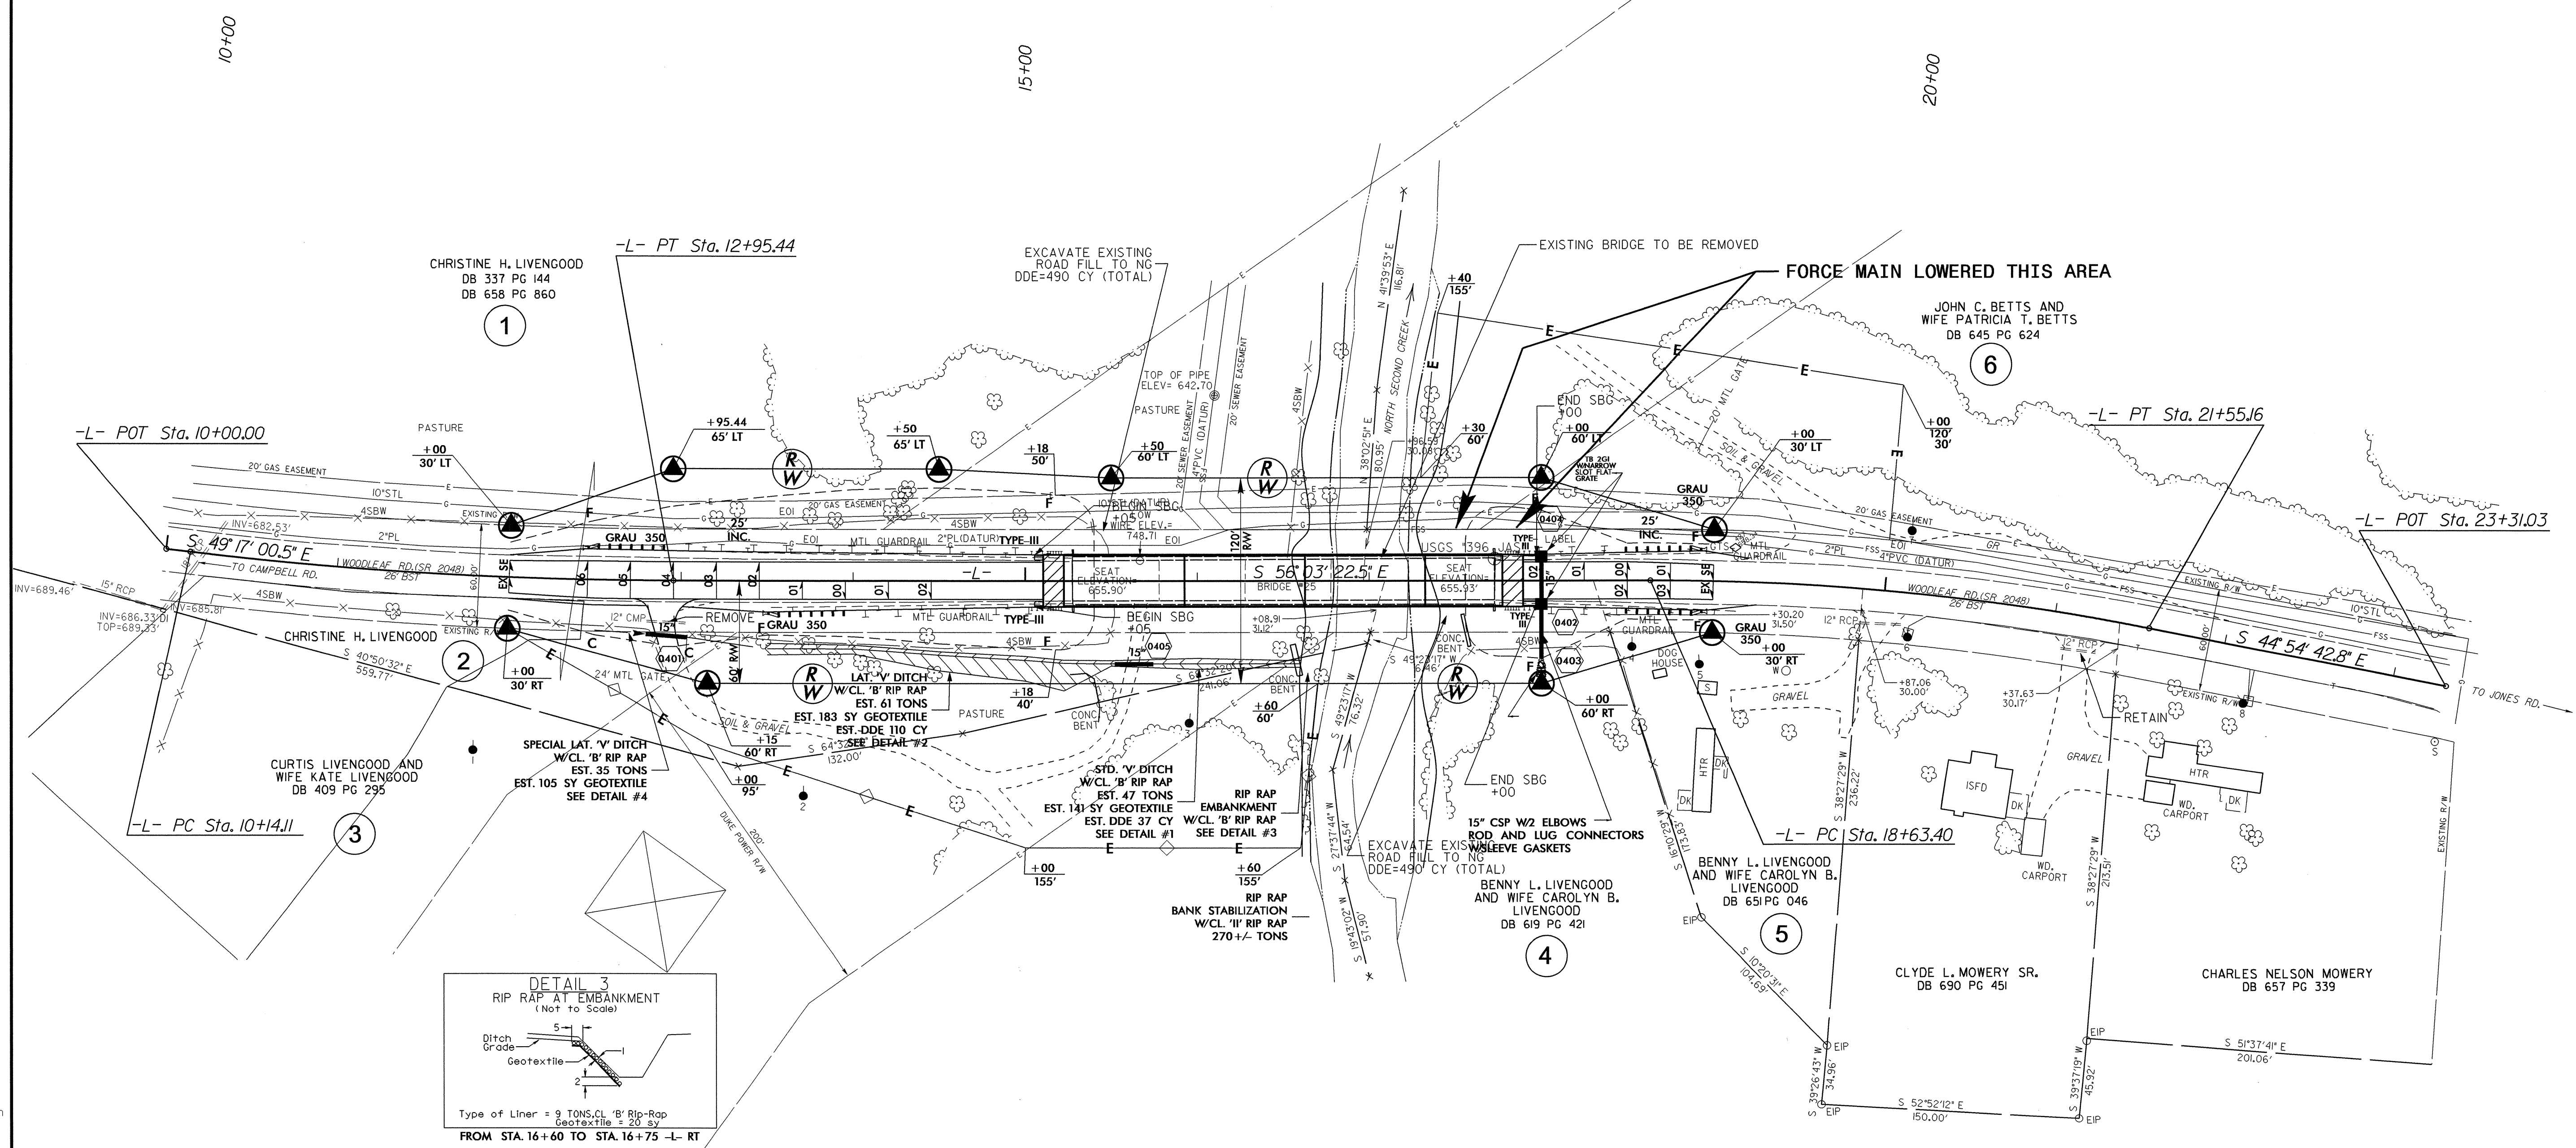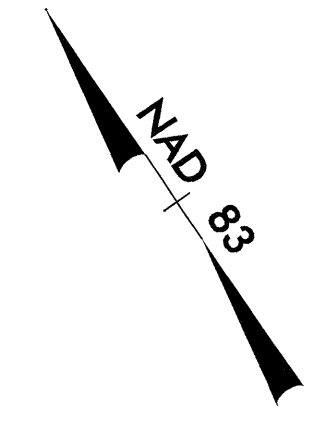

5/14/99

R:\11_09-JAN-2012 15:08
333.3151.002.dwg
164629.U02.psh.dgn