PROJECT REFERENCE NO.	SHEET NO.
B-5127	U0-2

UTILITIES BY OTHERS

NOTE TO CONTRACTOR:
DUKE ENERGY PROGRESS OWNS A 115,000 VOLT TRANSMISSION LINE THAT DIAGONALLY CROSSES THE -L- AT APPROX. STA. 13+81.32. THE POWER LINES WILL REMAIN IN PLACE DURING CONSTRUCTION. DUKE ENERGY PROGRESS CAN DE-ENERGIZE THE POWER LINES DURING NONPEAK SEASONS (SPRING AND FALL) FOR THE DURATION OF ONE WEEK WITH THREE WEEKS' NOTICE. THE CONTRACTOR IS ADVISED OF SPECIAL CONDITIONS WHICH WILL AFFECT WORK AT THE SITE OF THIS BRIDGE REPLACEMENT. THE CONTRACTOR IS ADVISED THAT ALTERNATIVE CONSTRUCTION METHODS WILL BE REQUIRED DUE TO THE PROXIMITY OF THE POWER LINES. THE CONTRACTOR IS RESPONSIBLE FOR MEETING ALL OSHA REQUIREMENTS FOR WORKING IN THE PROXIMITY OF POWER LINES. THE CONTRACTOR IS RESPONSIBLE FOR USING CONSTRUCTION METHODS AND EQUIPMENT WHICH WILL MAINTAIN A CLEAR DISTANCE OF 15 FEET FROM THE ACTIVE POWER LINE AT ALL TIMES. THE 15 FOOT CLEAR DISTANCE WILL APPLY TO ANY EQUIPMENT OR ANYTHING PROJECTING FROM THE EQUIPMENT. THE CONTRACTOR SHALL PLACE HIGH VOLTAGE OVERHEAD POWER SIGNS INSIDE THE PROJECT LIMITS. SEE STRUCTURES PLANS AND SPECIAL PROVISIONS FOR ADDITIONAL INFORMATION CONCERNING CONTRUCTABILITY IN PROXIMITY OF OVERHEAD POWER LINES.

NOTE:
ALL PROPOSED UTILITY WORK SHOWN ON THIS SHEET WILL BE DONE BY OTHERS.
NO PAYMENT WILL BE MADE TO THE CONTRACTOR FOR PRPOSED UTILITY WORK SHOWN ON THIS SHEET.

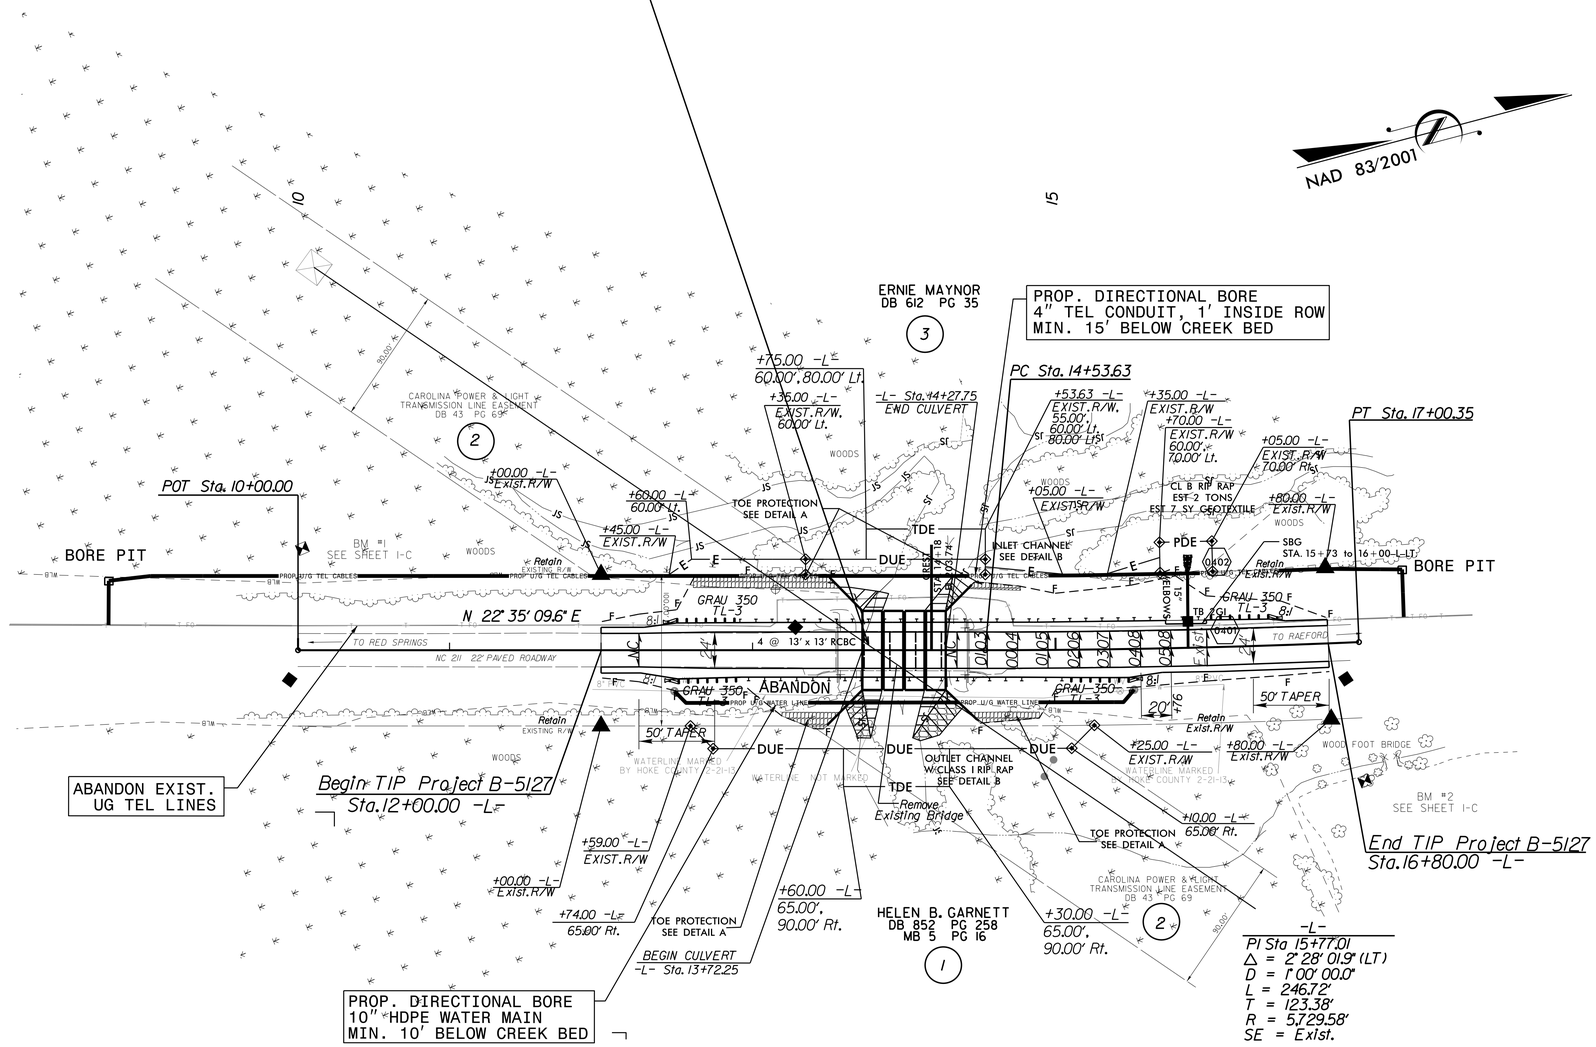

REVISIONS

04-NOV-2014 17:12
Y:\Projects\NCDOT\NCDOT Utility On-Call Contract\B-5127 Hoke County\Utilities\B5127_ut_rdy4_U02_psh.dgn
PROJECTS
01 FEAT WORKING

Baker

Michael Baker Engineering, Inc.
8000 Regency Parkway, Suite 600
Cary, NC 27518
919-463-5488