

BILL OF MATERIAL

APPROACH SLAB AT EB 1

BAR NO.	NO.	SIZE	TYPE	LENGTH	WEIGHT
*A1	69	#4	STR	32'-2"	1,483
A2	75	#4	STR	32'-0"	1,603
*B1	79	#5	STR	23'-0"	1,895
B2	79	#6	STR	23'-11"	2,838
*B3	8	#5	STR	7'-4"	61
B4	8	#6	STR	7'-4"	88
*J1	87	#4	①	1'-5"	82

REINFORCING STEEL ** LBS. 4,529
 *EPOXY COATED REINFORCING STEEL ** LBS. 3,521

CLASS AA CONCRETE ** C.Y. 43.9


APPROACH SLAB AT EB 2

BAR NO.	NO.	SIZE	TYPE	LENGTH	WEIGHT
*A1	69	#4	STR	32'-2"	1,483
A2	75	#4	STR	32'-0"	1,603
*B1	79	#5	STR	23'-0"	1,895
B2	79	#6	STR	23'-11"	2,838
*B3	8	#5	STR	7'-4"	61
B4	8	#6	STR	7'-4"	88
*J1	87	#4	①	1'-5"	82

REINFORCING STEEL ** LBS. 4,529
 *EPOXY COATED REINFORCING STEEL ** LBS. 3,521

CLASS AA CONCRETE ** C.Y. 43.9

BAR TYPE

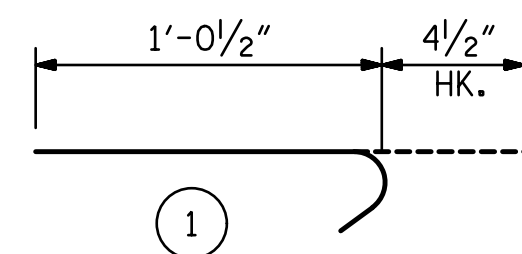


ALL BAR DIMENSIONS ARE OUT TO OUT

** QUANTITIES FOR BARRIER RAIL ARE NOT INCLUDED. SEE SHEET 2 OF 3.

THE QUANTITY OF #4J1 BARS ON THE BILL OF MATERIAL IS BASED ON 1'-0" CENTERS. J1 BARS SHALL BE PLACED AT EACH VERTICAL STUD ANCHOR BOLT. IN THE EVENT THAT THE NUMBER OF VERTICAL STUD ANCHORS EXCEEDS THE NUMBER OF J1 BARS SPECIFIED, ADDITIONAL J1 BARS WILL NOT BE REQUIRED.


SPLICE LENGTHS

BAR SIZE	EPOXY COATED	UNCOATED
#4	2'-0"	1'-9"
#5	2'-6"	2'-2"
#6	3'-10"	2'-7"

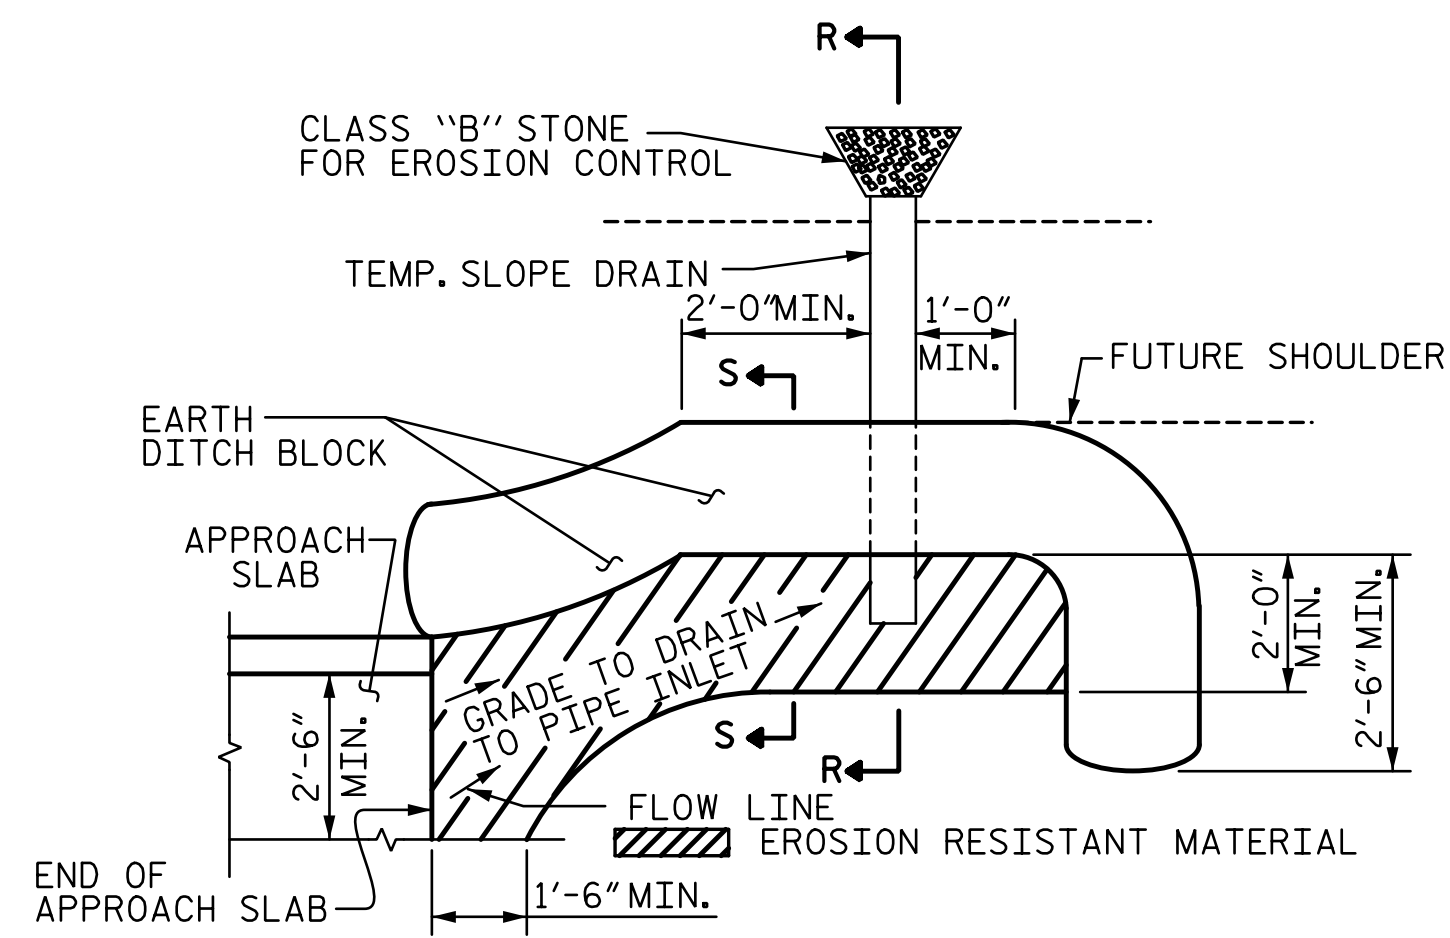


NOTE: IMMEDIATELY AFTER THE CONSTRUCTION OF THE APPROACH SLAB, THE CONTRACTOR SHALL PROVIDE TEMPORARY BERM AND SLOPE DRAIN. CONTRACTOR SHALL GRADE TO PIPE INLET AND PROVIDE EROSION RESISTANT MATERIAL AS SHOWN. THE EROSION RESISTANT MATERIAL SHALL BE EITHER 1) ASPHALT PLANT MIX, TYPE 1 OR TYPE 2, MIN. 2" DEPTH, 2) EROSION CONTROL MAT, OR 3) CONCRETE, AS DIRECTED BY THE ENGINEER. THE SLOPE DRAIN SHALL CONSIST OF A NON-PERFORATED TEMPORARY DRAINAGE PIPE, 12 INCHES IN DIAMETER.

PLAN VIEW

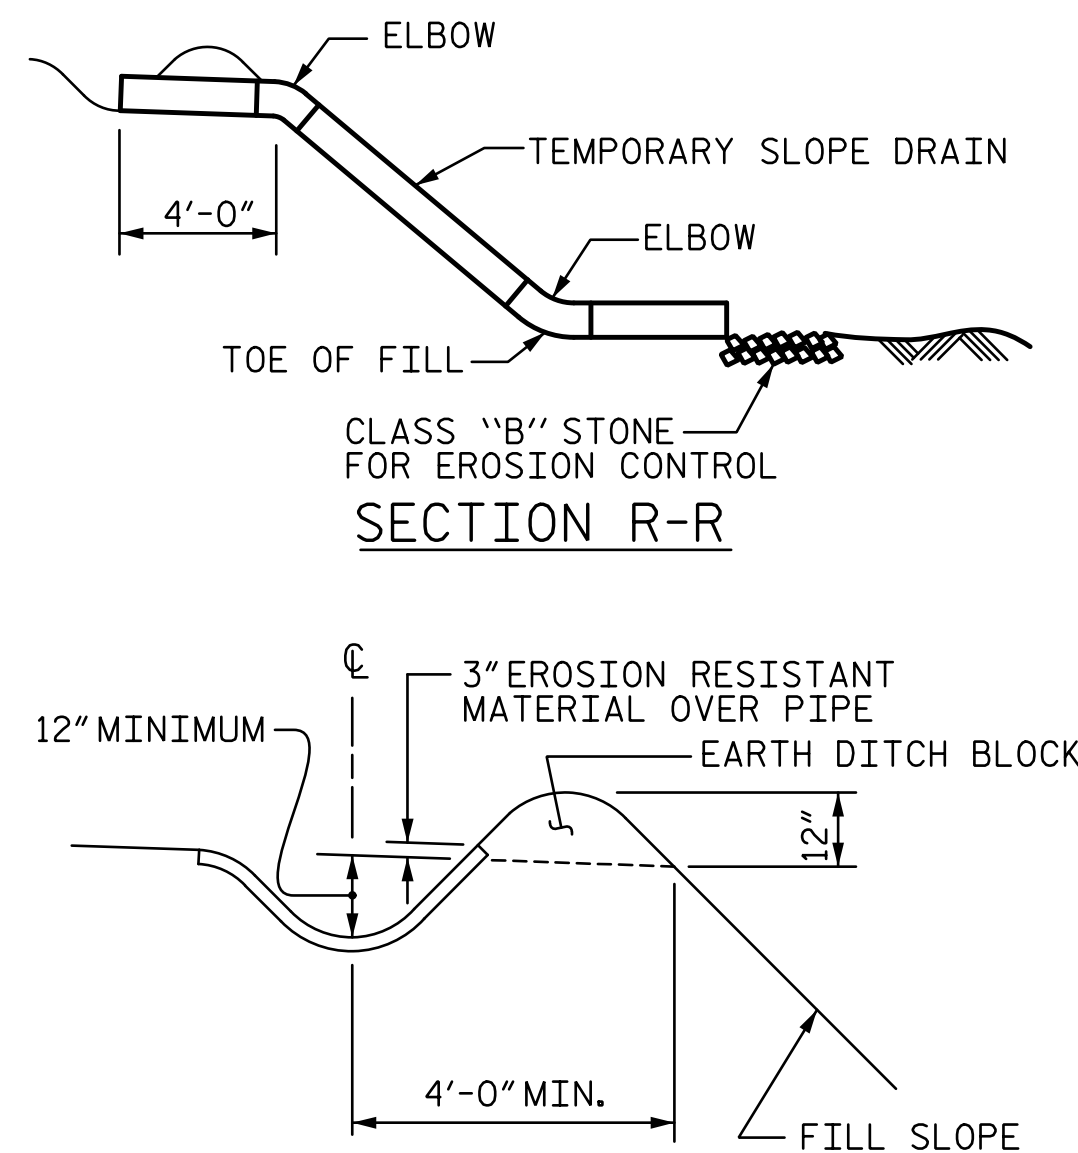

SECTION S-S

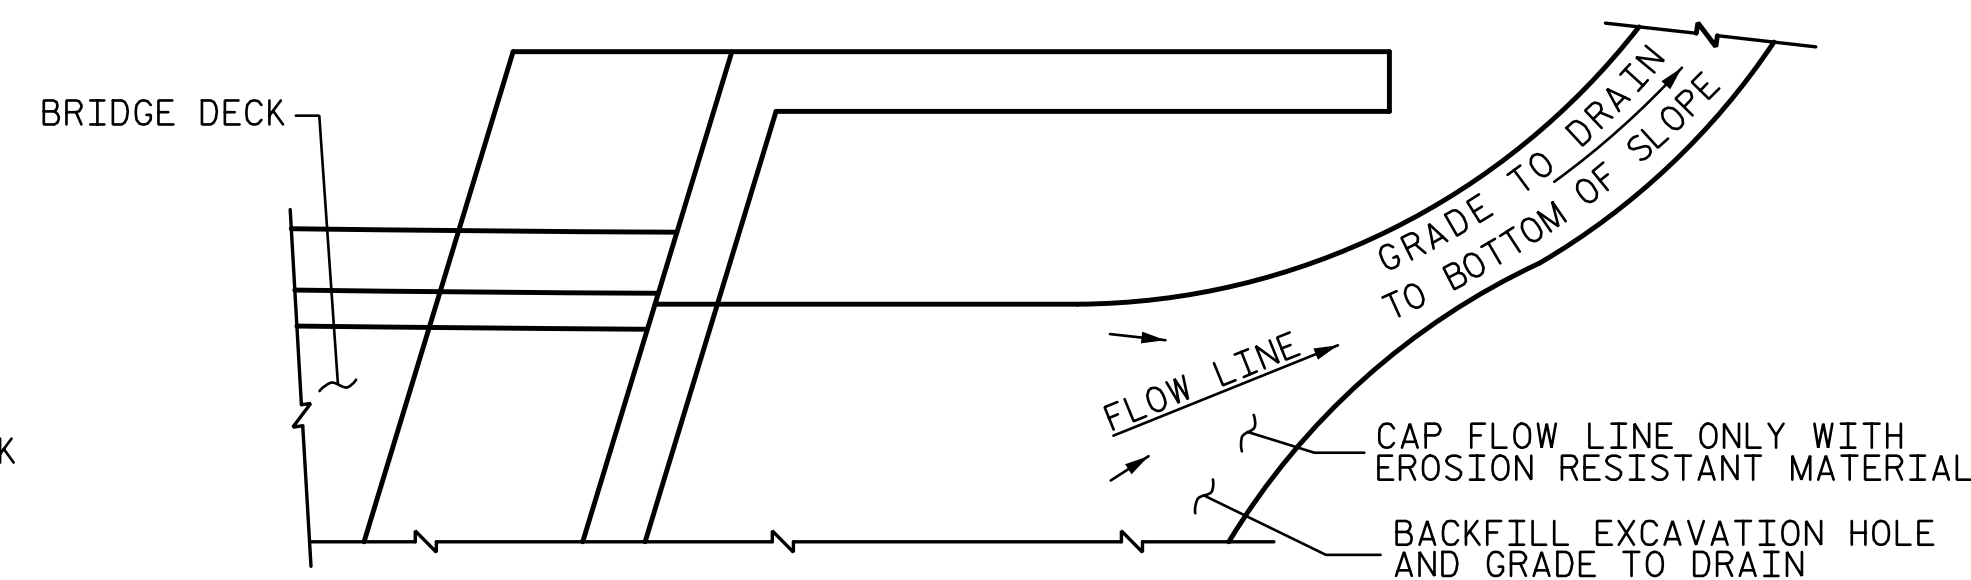

NOTE: IF THE APPROACH SLAB IS NOT CONSTRUCTED IMMEDIATELY AFTER THE BACKFILLING OF THE END BENT EXCAVATION, GRADE TO DRAIN TO THE BOTTOM OF THE SLOPE AND PROVIDE EROSION RESISTANT MATERIAL, SUCH AS FIBERGLASS ROVING OR AS DIRECTED BY THE ENGINEER TO PREVENT SOIL EROSION AND TO PROTECT THE AREA ADJACENT TO THE STRUCTURE. THE CONTRACTOR WILL BE REQUIRED TO REMOVE THESE MATERIALS PRIOR TO CONSTRUCTION OF THE APPROACH SLAB.

TEMPORARY DRAINAGE DETAIL

TEMPORARY BERM AND SLOPE DRAIN DETAILS

(TO BE USED WHEN SHOULDER BERM GUTTER IS REQUIRED)

R:\Site 6\usta\Finals\Site 6 LL\411_038_R2514D_SMU_BAS03.dgn 9:09:39 AM 3/6/2015

PROJECT NO. R-2514D

JONES & CRAVEN COUNTY


STATION: 526+71.12 -L-
 = 16+08.07 -Y6-

SHEET 3 OF 3

STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH

**BRIDGE APPROACH SLAB
 DETAILS**

-LEFT LANE-

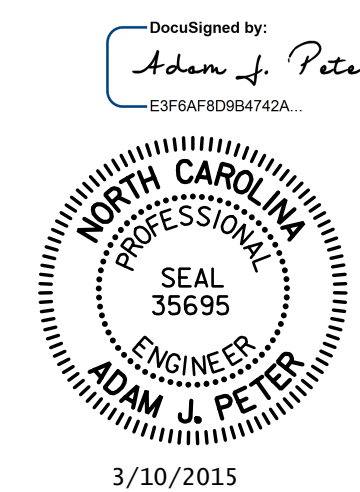

DRAWN BY: CLG DATE: 6-14
 CHECKED BY: AJP DATE: 6-14

DESIGN ENGINEER OF RECORD: A. PETER DATE: 6-14

STV / Ralph Whitehead Associates, Inc.
 900 West Trade Street, Suite 715
 Charlotte, NC 28202
 NC License Number F-0991

REVISIONS				SHEET NO.
NO.	BY:	DATE:	NO.	DATE:
1			3	
2			4	

TOTAL SHEETS: 38