


# WATER LINES OWNED BY ONSLOW WATER AND SEWER AUTHORITY

PREPARED IN THE OFFICE OF:



PROJECT REFERENCE NO. <b>R-2514B</b>	SHEET NO. <b>UC-10</b>
DESIGNED BY: BJPO	
DRAWN BY: TK	
CHECKED BY: BJPO	
APPROVED BY: MDS	
REVISED:	





ONLY WATER LINE CONSTRUCTION SHOWN ON THIS SHEET

UTILITY CONSTRUCTION

REVISIONS  
R/W Revision 7/28/14 - JCL Added new Parcel #43Z.

MATCHLINE SHEET UC-8 -Y2- STA. 28 +50.00

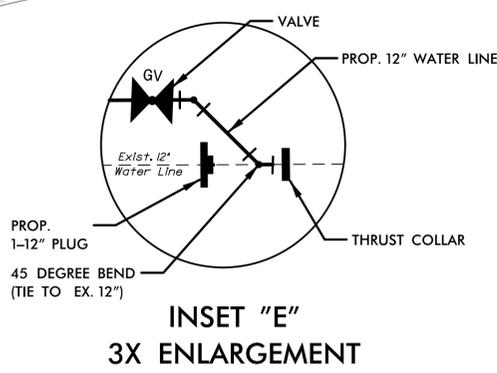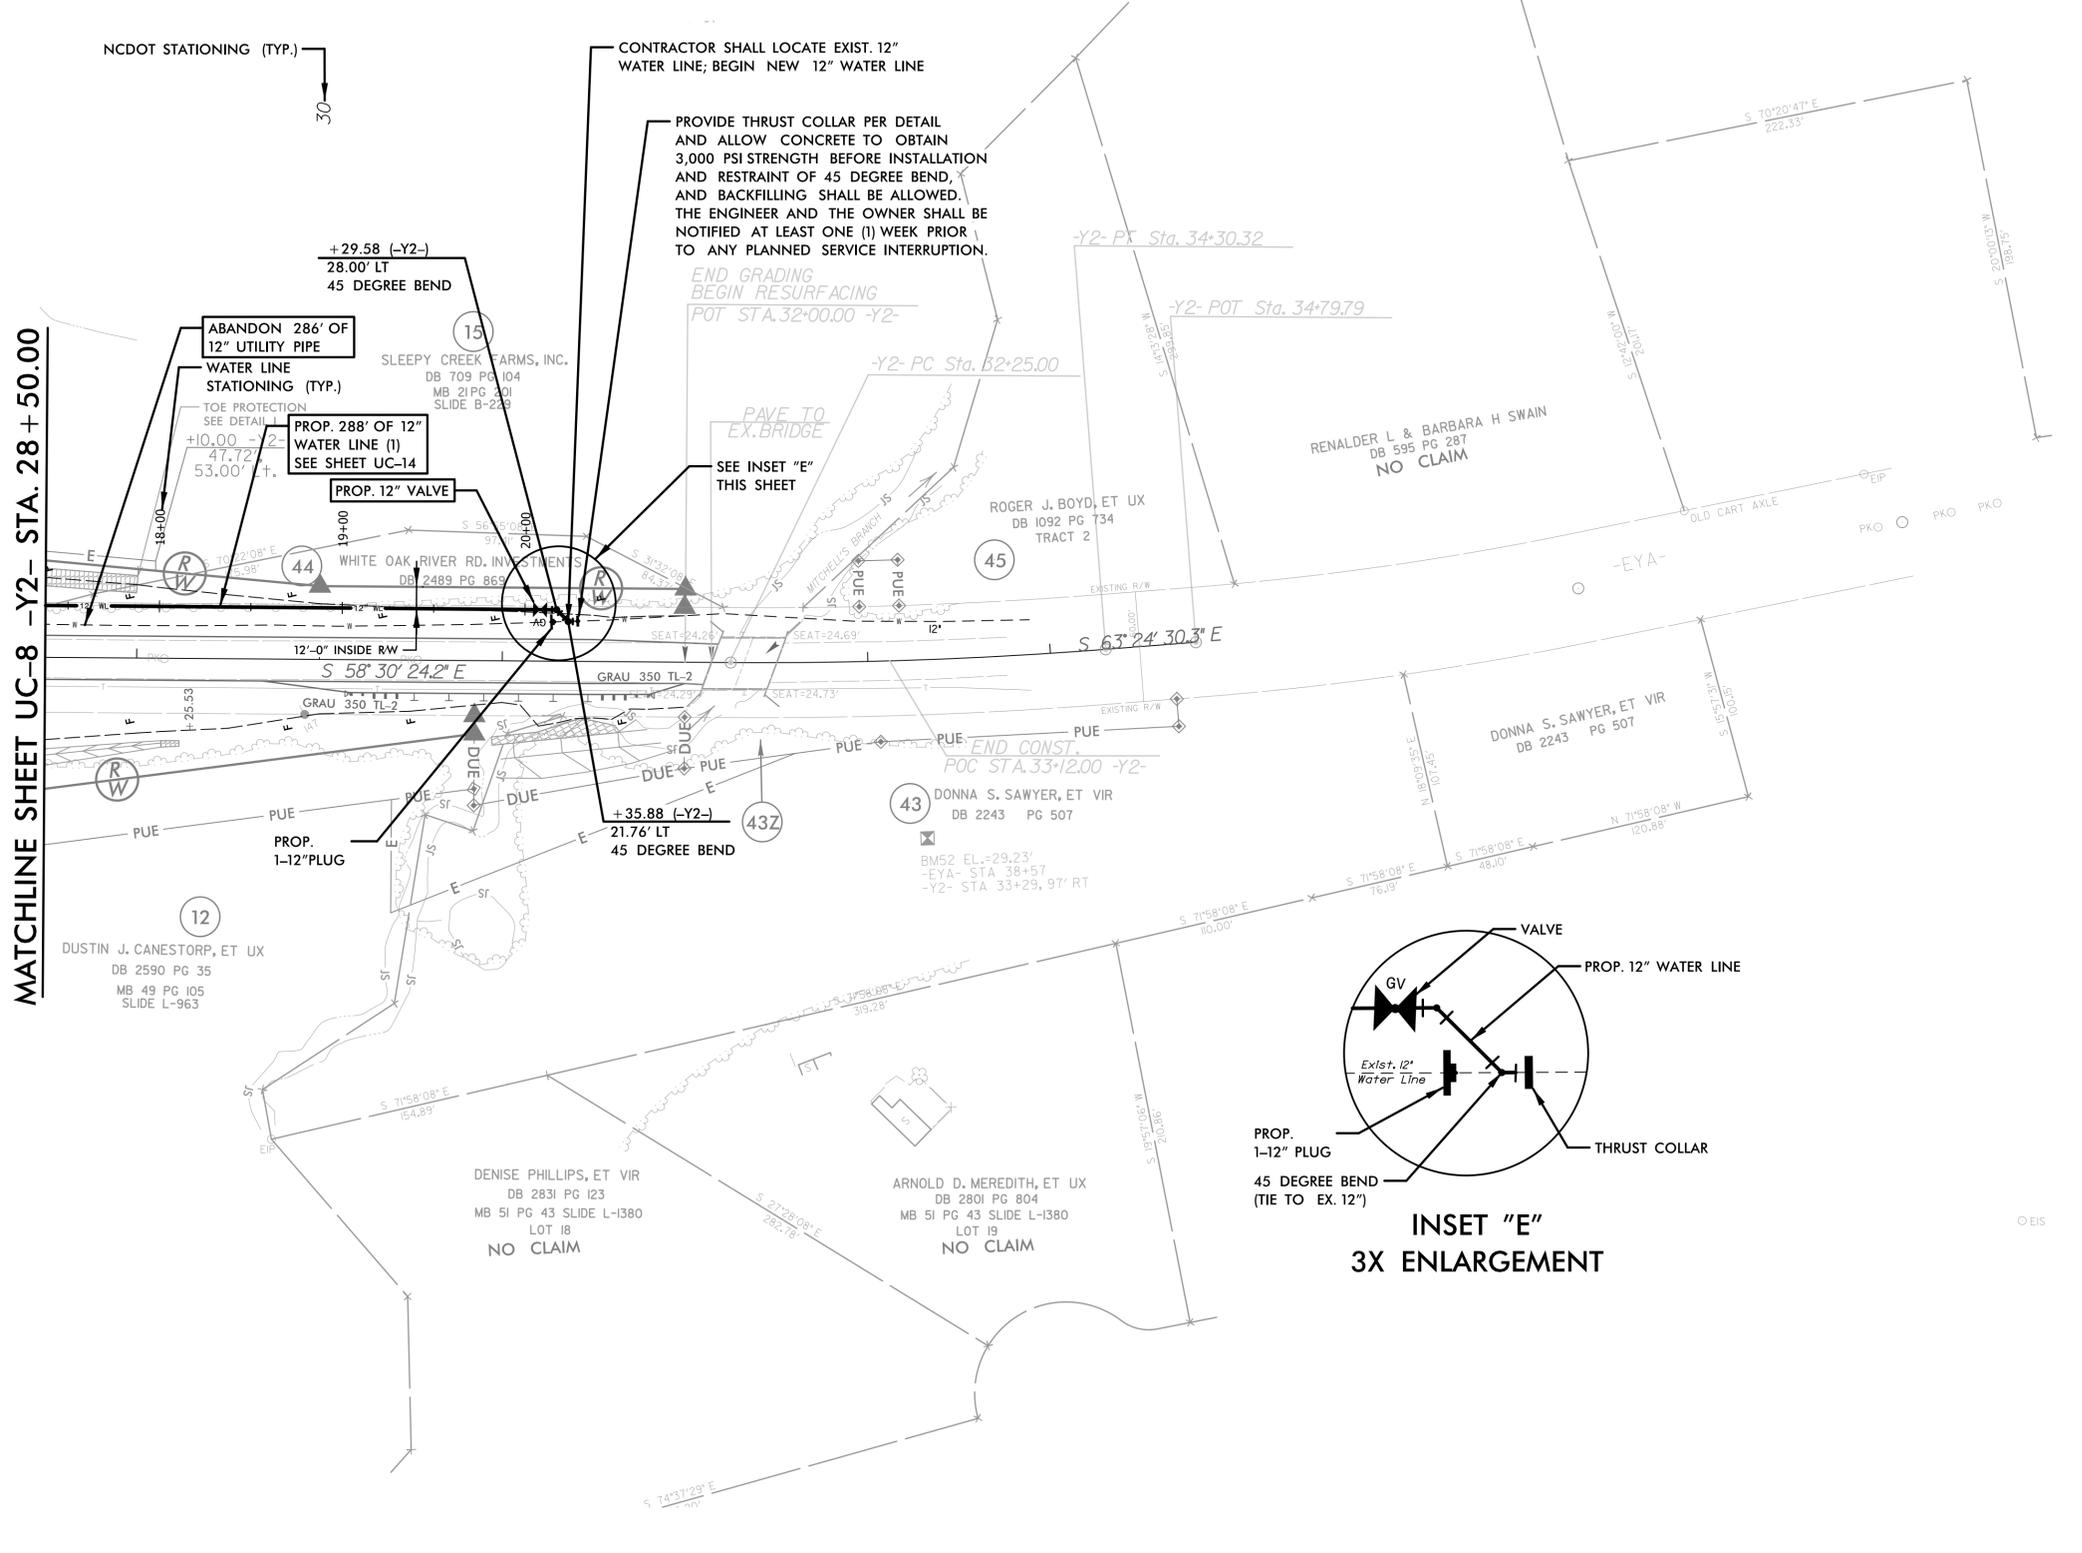

CONTRACTOR SHALL LOCATE EXIST. 12" WATER LINE; BEGIN NEW 12" WATER LINE

PROVIDE THRUST COLLAR PER DETAIL AND ALLOW CONCRETE TO OBTAIN 3,000 PSI STRENGTH BEFORE INSTALLATION AND RESTRAINT OF 45 DEGREE BEND, AND BACKFILLING SHALL BE ALLOWED. THE ENGINEER AND THE OWNER SHALL BE NOTIFIED AT LEAST ONE (1) WEEK PRIOR TO ANY PLANNED SERVICE INTERRUPTION.

END GRADING  
BEGIN RESURFACING  
POT STA. 32+00.00 -Y2-

PAVE TO EX. BRIDGE

SEE INSET "E" THIS SHEET

END CONST.  
POC STA. 33+12.00 -Y2-

NCDOT STATIONING (TYP.)

+29.58 (-Y2-)  
28.00' LT  
45 DEGREE BEND

ABANDON 286' OF 12" UTILITY PIPE  
WATER LINE  
STATIONING (TYP.)

PROP. 288' OF 12" WATER LINE (I)  
SEE SHEET UC-14

PROP. 12" VALVE

12  
DUSTIN J. CANESTORP, ET UX  
DB 2590 PG 35  
MB 49 PG 105  
SLIDE L-963

DENISE PHILLIPS, ET VIR  
DB 2831 PG 123  
MB 51 PG 43 SLIDE L-1380  
LOT 18  
NO CLAIM

ARNOLD D. MEREDITH, ET UX  
DB 2801 PG 804  
MB 51 PG 43 SLIDE L-1380  
LOT 19  
NO CLAIM

ROGER J. BOYD, ET UX  
DB 1092 PG 734  
TRACT 2

RENALDER L & BARBARA H SWAIN  
DB 595 PG 287  
NO CLAIM

DONNA S. SAWYER, ET VIR  
DB 2243 PG 507

43  
DONNA S. SAWYER, ET VIR  
DB 2243 PG 507  
BM52 EL.=29.23'  
-EYA- STA. 38+57  
-Y2- STA. 33+29.97' RT

+35.88 (-Y2-)  
21.76' LT  
45 DEGREE BEND

44  
WHITE OAK RIVER RD. INVESTMENTS  
DB 2489 PG 869

15  
SLEEPY CREEK FARMS, INC.  
DB 709 PG 104  
MB 21 PG 201  
SLIDE B-238

5/14/99

66  
67  
68  
69  
70  
71  
72  
73  
74  
75  
76  
77  
78  
79  
80  
81  
82  
83  
84  
85  
86  
87  
88  
89  
90  
91  
92  
93  
94  
95  
96  
97  
98  
99  
00