CLTWater STANDARD DETAILS

0400DEL_P30

DGN

1" - 2" 1-2 ASPHALT

SEE SPECIFICATIONS

EXIST. ASPHALT, CONCRETE, OR CABC BASE.

1" MIN.

12" MIN.

12" MIN.

VARIES (NOTE 6)

VARIES (NOTE 6)

COMPACTED EARTH

NOMINAL PIPE DIAMETER
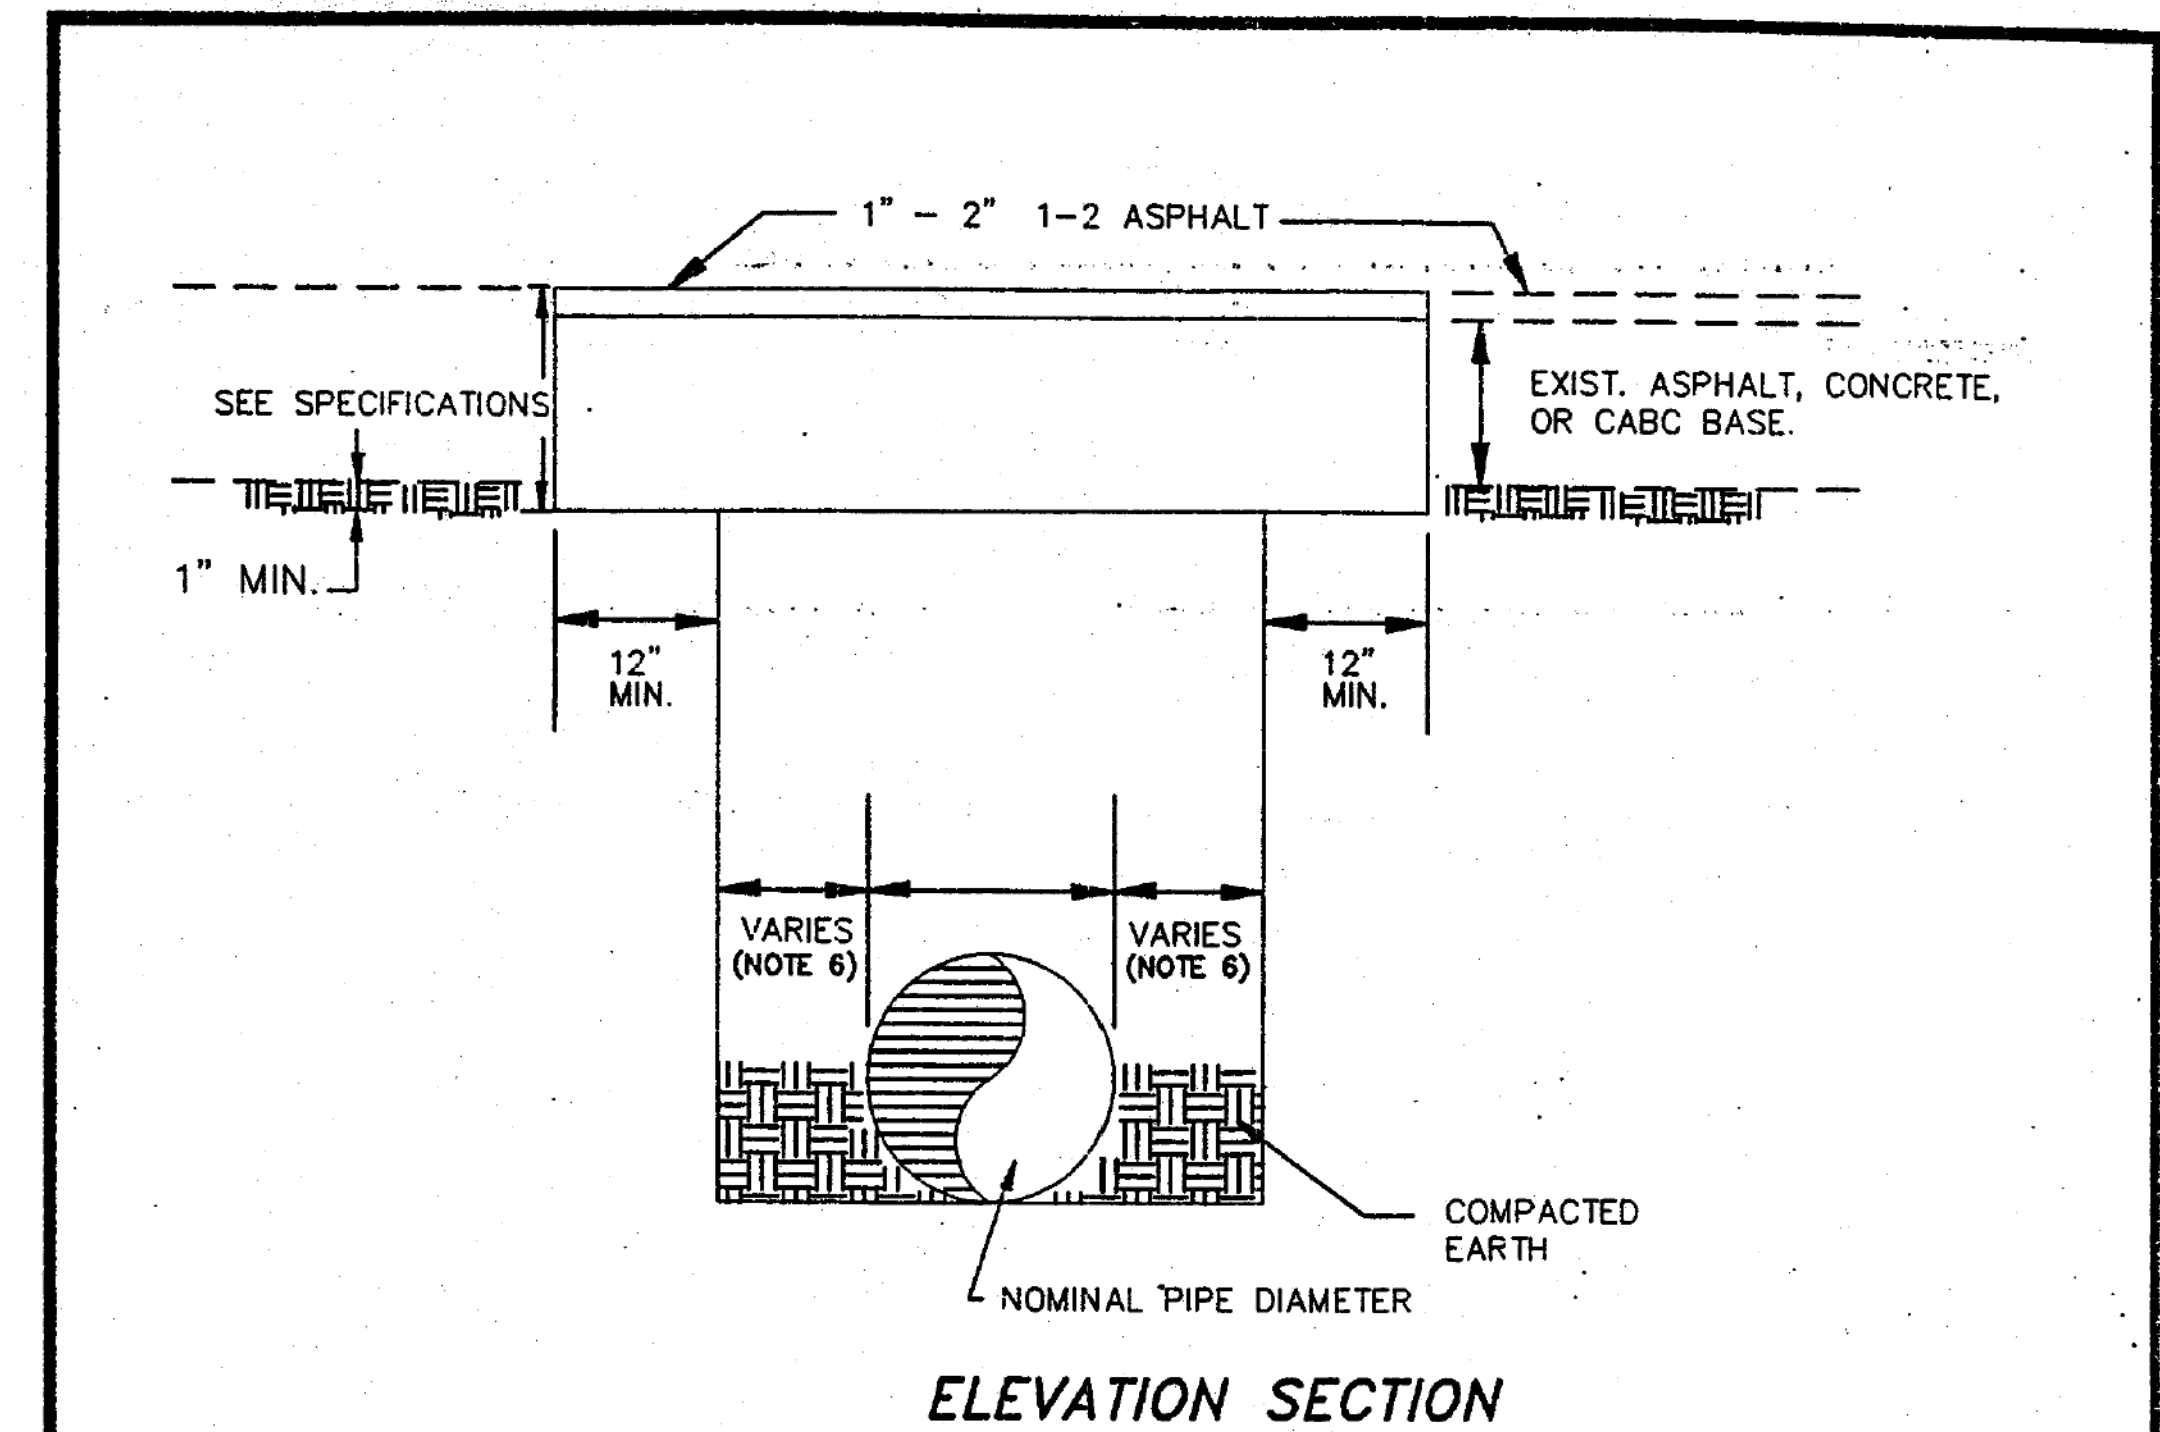
ELEVATION SECTION

NOTES:

1. ALL CONCRETE AND ASPHALT PAVEMENT, INCLUDING DRIVEWAYS, TO BE CUT WITH A SAW.

2. WHERE CONCRETE PAVEMENT IS OVERLAID WITH ASPHALT H- BINDER MAY BE SUBSTITUTED FOR CONCRETE, AS A BASE MATERIAL, WITH THE APPROVAL OF THE CONTROLLING AGENCY.

3. ALL PAVEMENT REPAIRS ARE SUBJECT TO APPROVAL BY CITY OF CHARLOTTE DOT OR N.C. DOT AS APPLICABLE.

4. 12-INCH MIN. MINIMUM CUT OUTSIDE TRENCH IS ALSO REQUIRED FOR SLOPED TRENCH WALLS.

5. SHORING REQUIRED IN ACCORDANCE WITH OSHA STANDARDS PART 1926, SUBPART P.

6. SEE DETAILED SPECIFICATIONS FOR TRENCH WIDTH.

CHARLOTTE—MECKLENBURG
UTILITY DEPARTMENT
ENGINEERING DIVISION
CHARLOTTE, NORTH CAROLINA

Job No.	File No.
Scales	
PLAN	NTS
PROFILE Hor.	
Vert.	
As Built	Date

STANDARD DETAIL
WATER

PAVEMENT REPAIR DETAIL

No.	Date	By	Revision	Surveyed By	Designed By	Drawn By	Project-Eng	Approved By	Date	Sheet	Of
						SC		K.Bl		9	

2/6/2015
W:\Transportation\TRIL036.00 (U-5008)\Utilities\permit\280_026_U5008.dgn
lwiles
REV: 2/1/2012