


SCALE: 10 0 20

UTILITY CONSTRUCTION

NAD 83/95

MATCHLINE -L- STA.59+00 SEE SHEET 12

MATCHLINE -L- STA.64+50 SEE SHEET 14

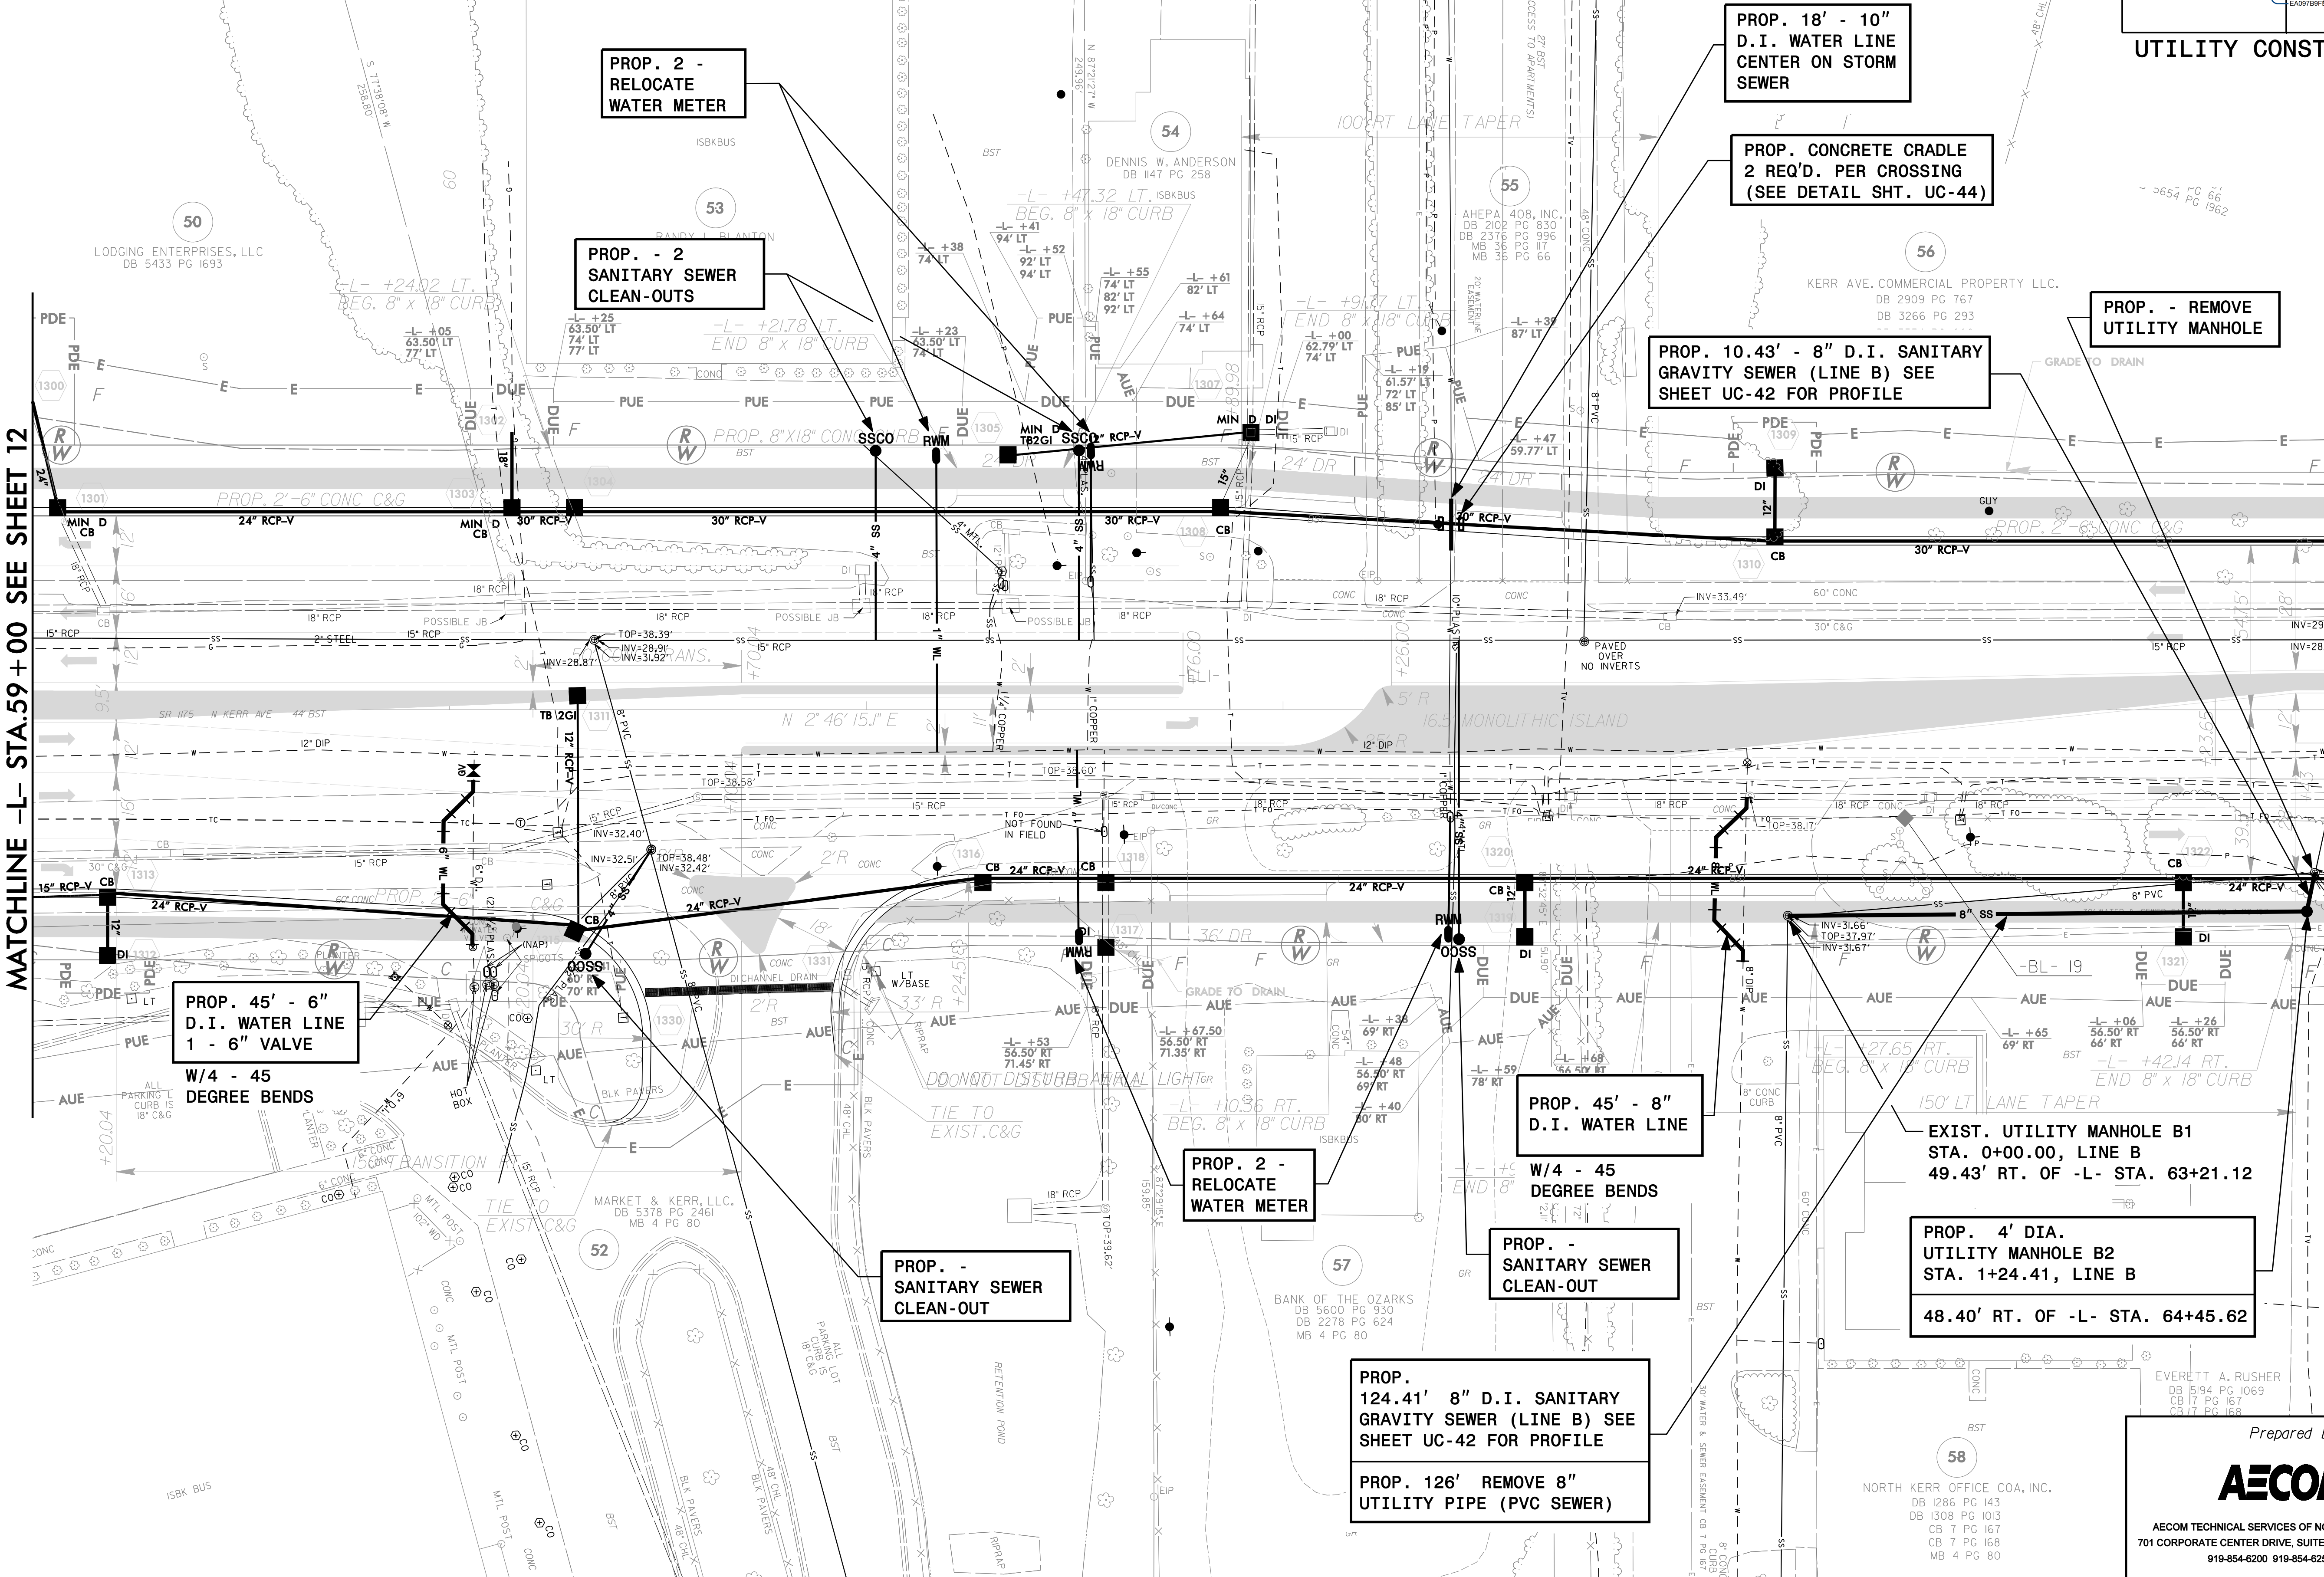

PROP. 45' - 6" D.I. WATER LINE 1 - 6" VALVE
 W/4 - 45 DEGREE BENDS

PROP. - SANITARY SEWER CLEAN-OUT

PROP. 2 - RELOCATE WATER METER

PROP. 45' - 8" D.I. WATER LINE
 W/4 - 45 DEGREE BENDS

PROP. - SANITARY SEWER CLEAN-OUT

PROP. 124.41' 8" D.I. SANITARY GRAVITY SEWER (LINE B) SEE SHEET UC-42 FOR PROFILE
PROP. 126' REMOVE 8" UTILITY PIPE (PVC SEWER)

PROP. 18' - 10" D.I. WATER LINE CENTER ON STORM SEWER

PROP. CONCRETE CRADLE 2 REQ'D. PER CROSSING (SEE DETAIL SHT. UC-44)

PROP. 10.43' - 8" D.I. SANITARY GRAVITY SEWER (LINE B) SEE SHEET UC-42 FOR PROFILE

PROP. - REMOVE UTILITY MANHOLE

EXIST. UTILITY MANHOLE B1 STA. 0+00.00, LINE B 49.43' RT. OF -L- STA. 63+21.12

PROP. 4' DIA. UTILITY MANHOLE B2 STA. 1+24.41, LINE B 48.40' RT. OF -L- STA. 64+45.62

Prepared by:

AECOM TECHNICAL SERVICES OF NORTH CAROLINA, INC.
 701 CORPORATE CENTER DRIVE, SUITE 475, RALEIGH, NC 27607
 919-854-6200 919-854-6259 (fax)