

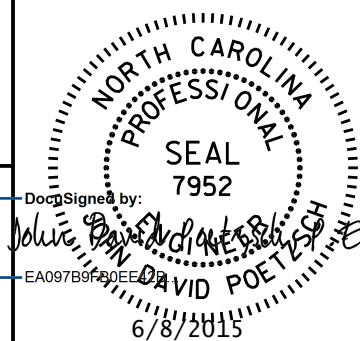


PROJECT REFERENCE NO. U-3338B	SHEET NO. UC-25
SCALE: 10 0 20	
UTILITY CONSTRUCTION	

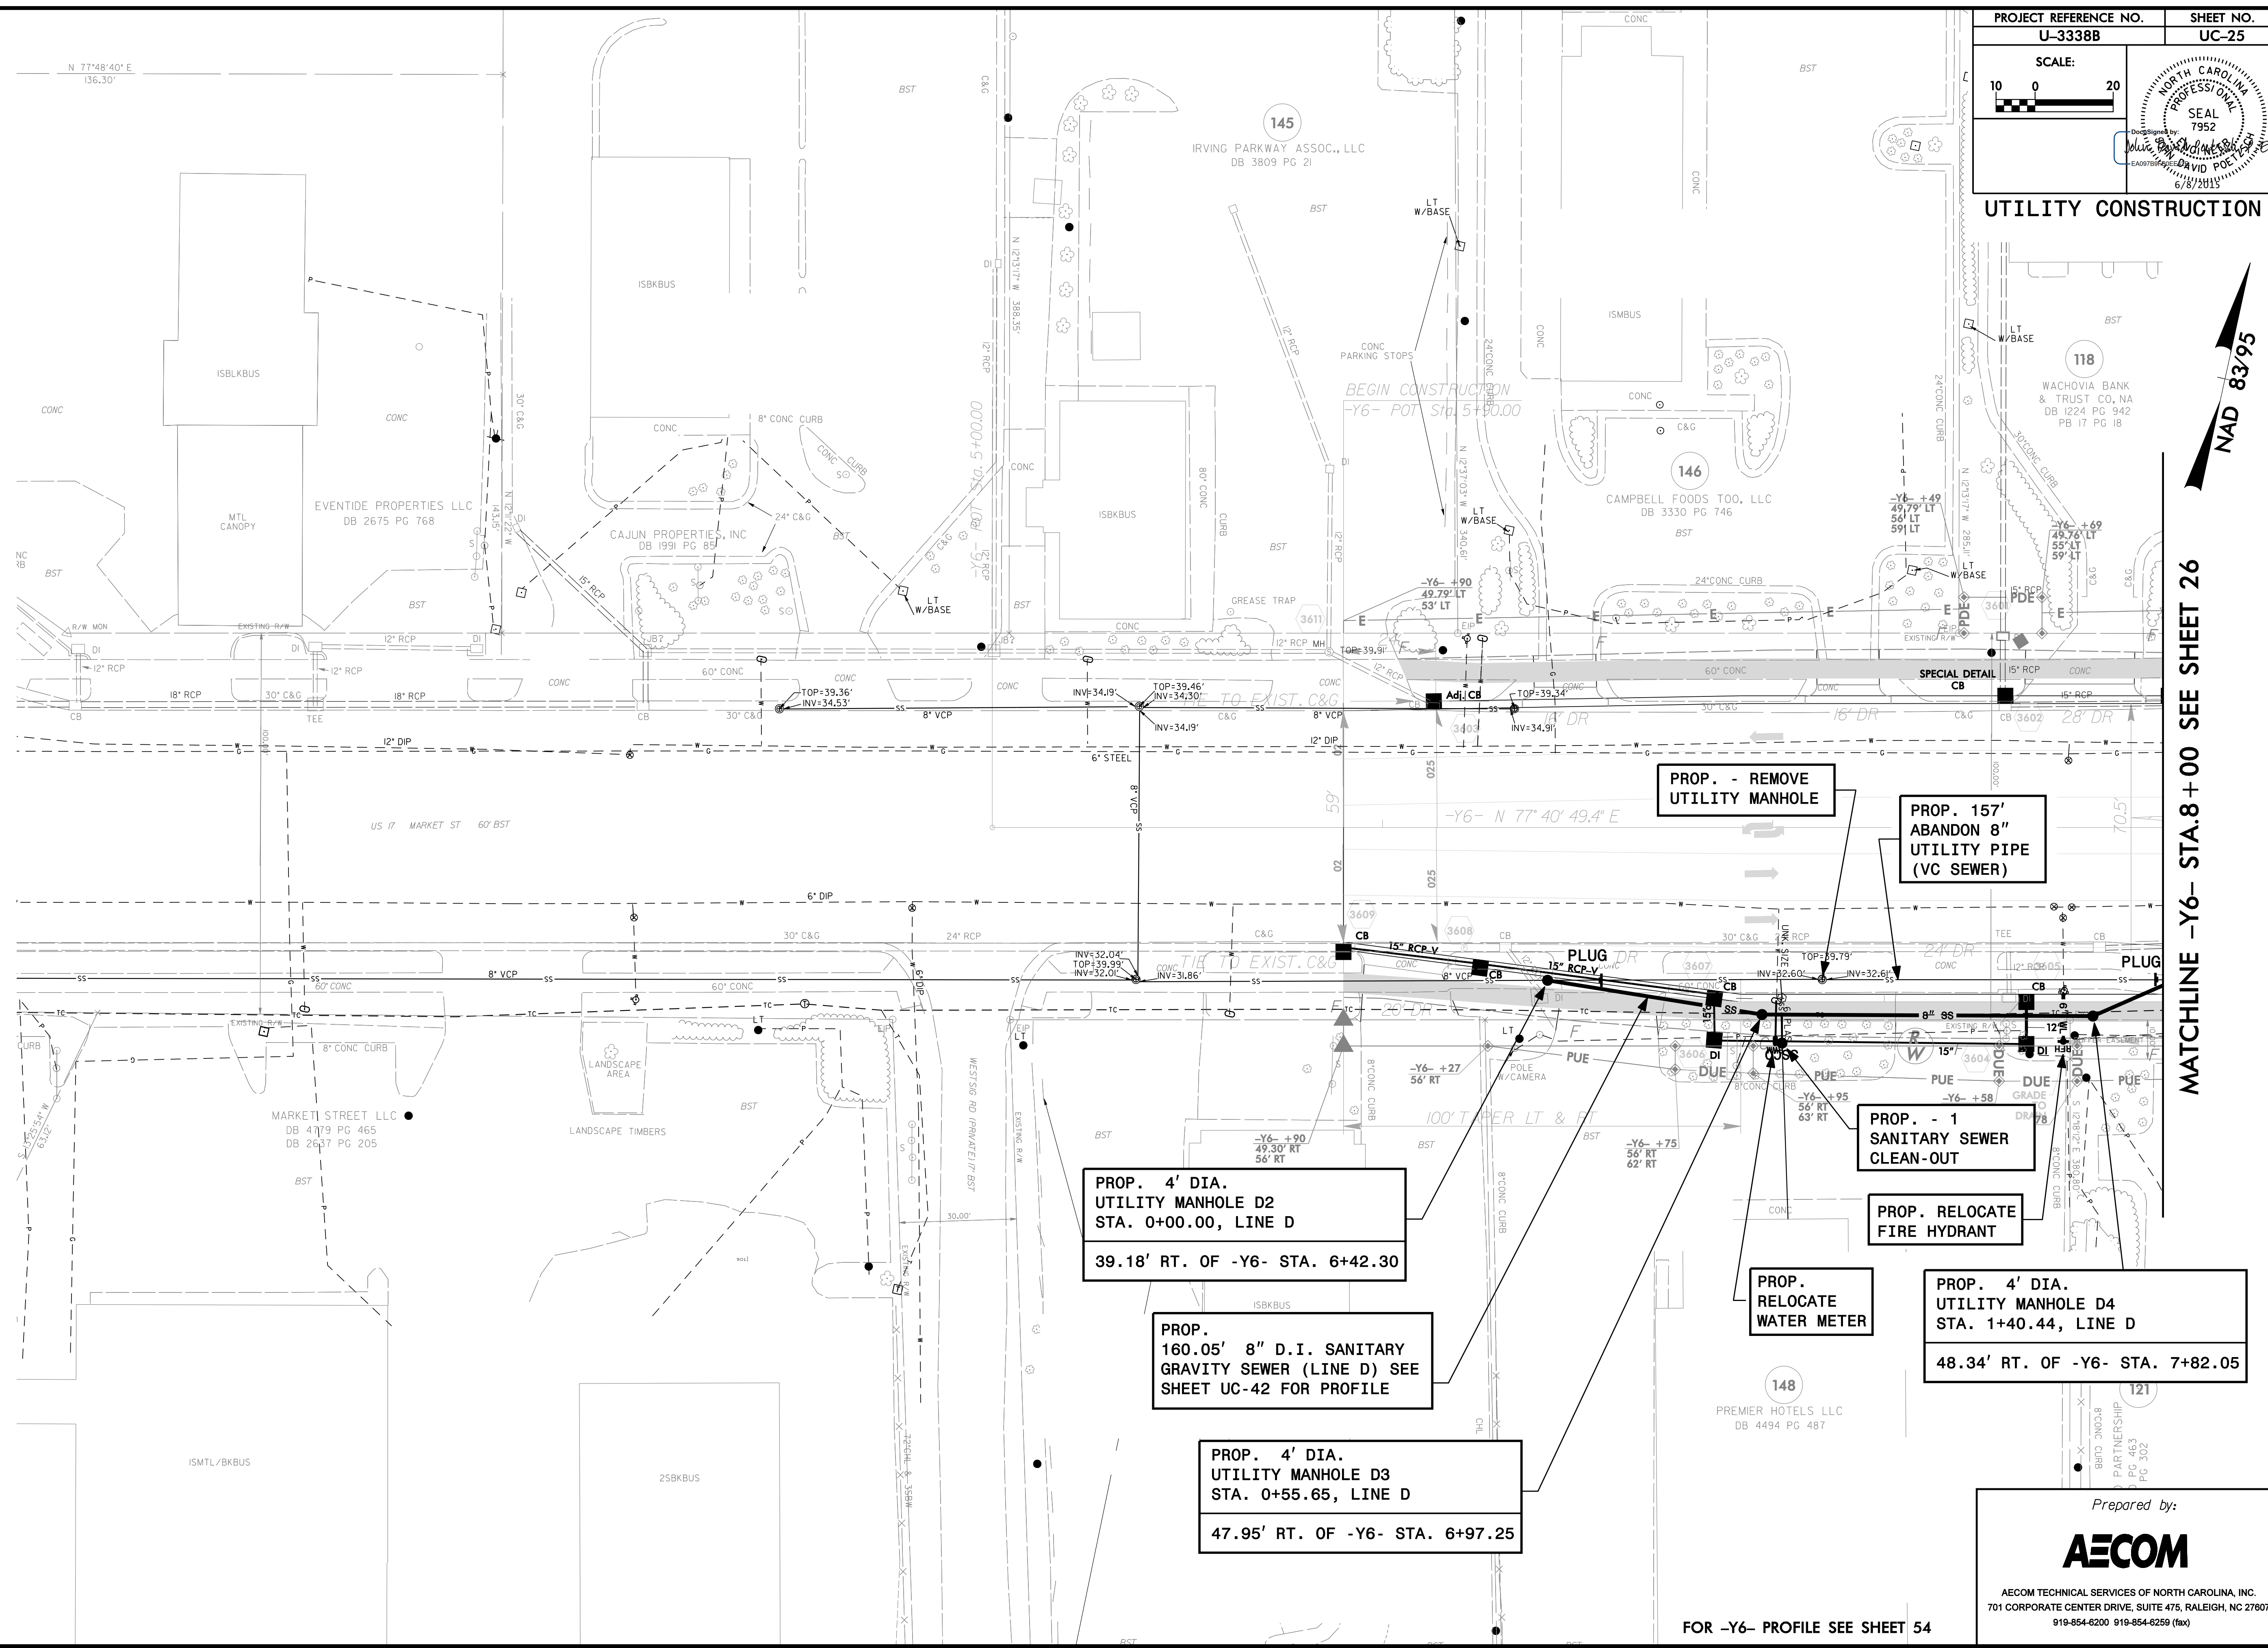

MATCHLINE -Y6- STA.8+00 SEE SHEET 26

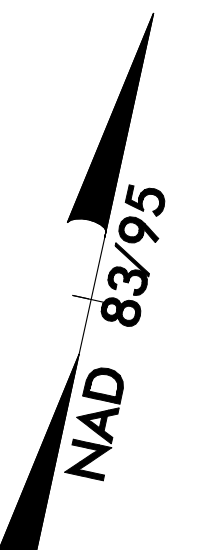

PROP. 4' DIA.
UTILITY MANHOLE D2
STA. 0+00.00, LINE D
39.18' RT. OF -Y6- STA. 6+42.30

PROP.
160.05' 8" D.I. SANITARY
GRAVITY SEWER (LINE D) SEE
SHEET UC-42 FOR PROFILE

PROP. 4' DIA.
UTILITY MANHOLE D3
STA. 0+55.65, LINE D
47.95' RT. OF -Y6- STA. 6+97.25

PROP. - REMOVE
UTILITY MANHOLE

PROP. 157'
ABANDON 8"
UTILITY PIPE
(VC SEWER)

PROP. - 1
SANITARY SEWER
CLEAN-OUT

PROP. RELOCATE
FIRE HYDRANT

PROP.
RELOCATE
WATER METER

PROP. 4' DIA.
UTILITY MANHOLE D4
STA. 1+40.44, LINE D
48.34' RT. OF -Y6- STA. 7+82.05

FOR -Y6- PROFILE SEE SHEET 54

Prepared by:
AECOM
AECOM TECHNICAL SERVICES OF NORTH CAROLINA, INC.
701 CORPORATE CENTER DRIVE, SUITE 475, RALEIGH, NC 27607
919-854-6200 919-854-6259 (fax)

DATE: 6/16/2015
DWG: U3338B_UC_25.dgn