
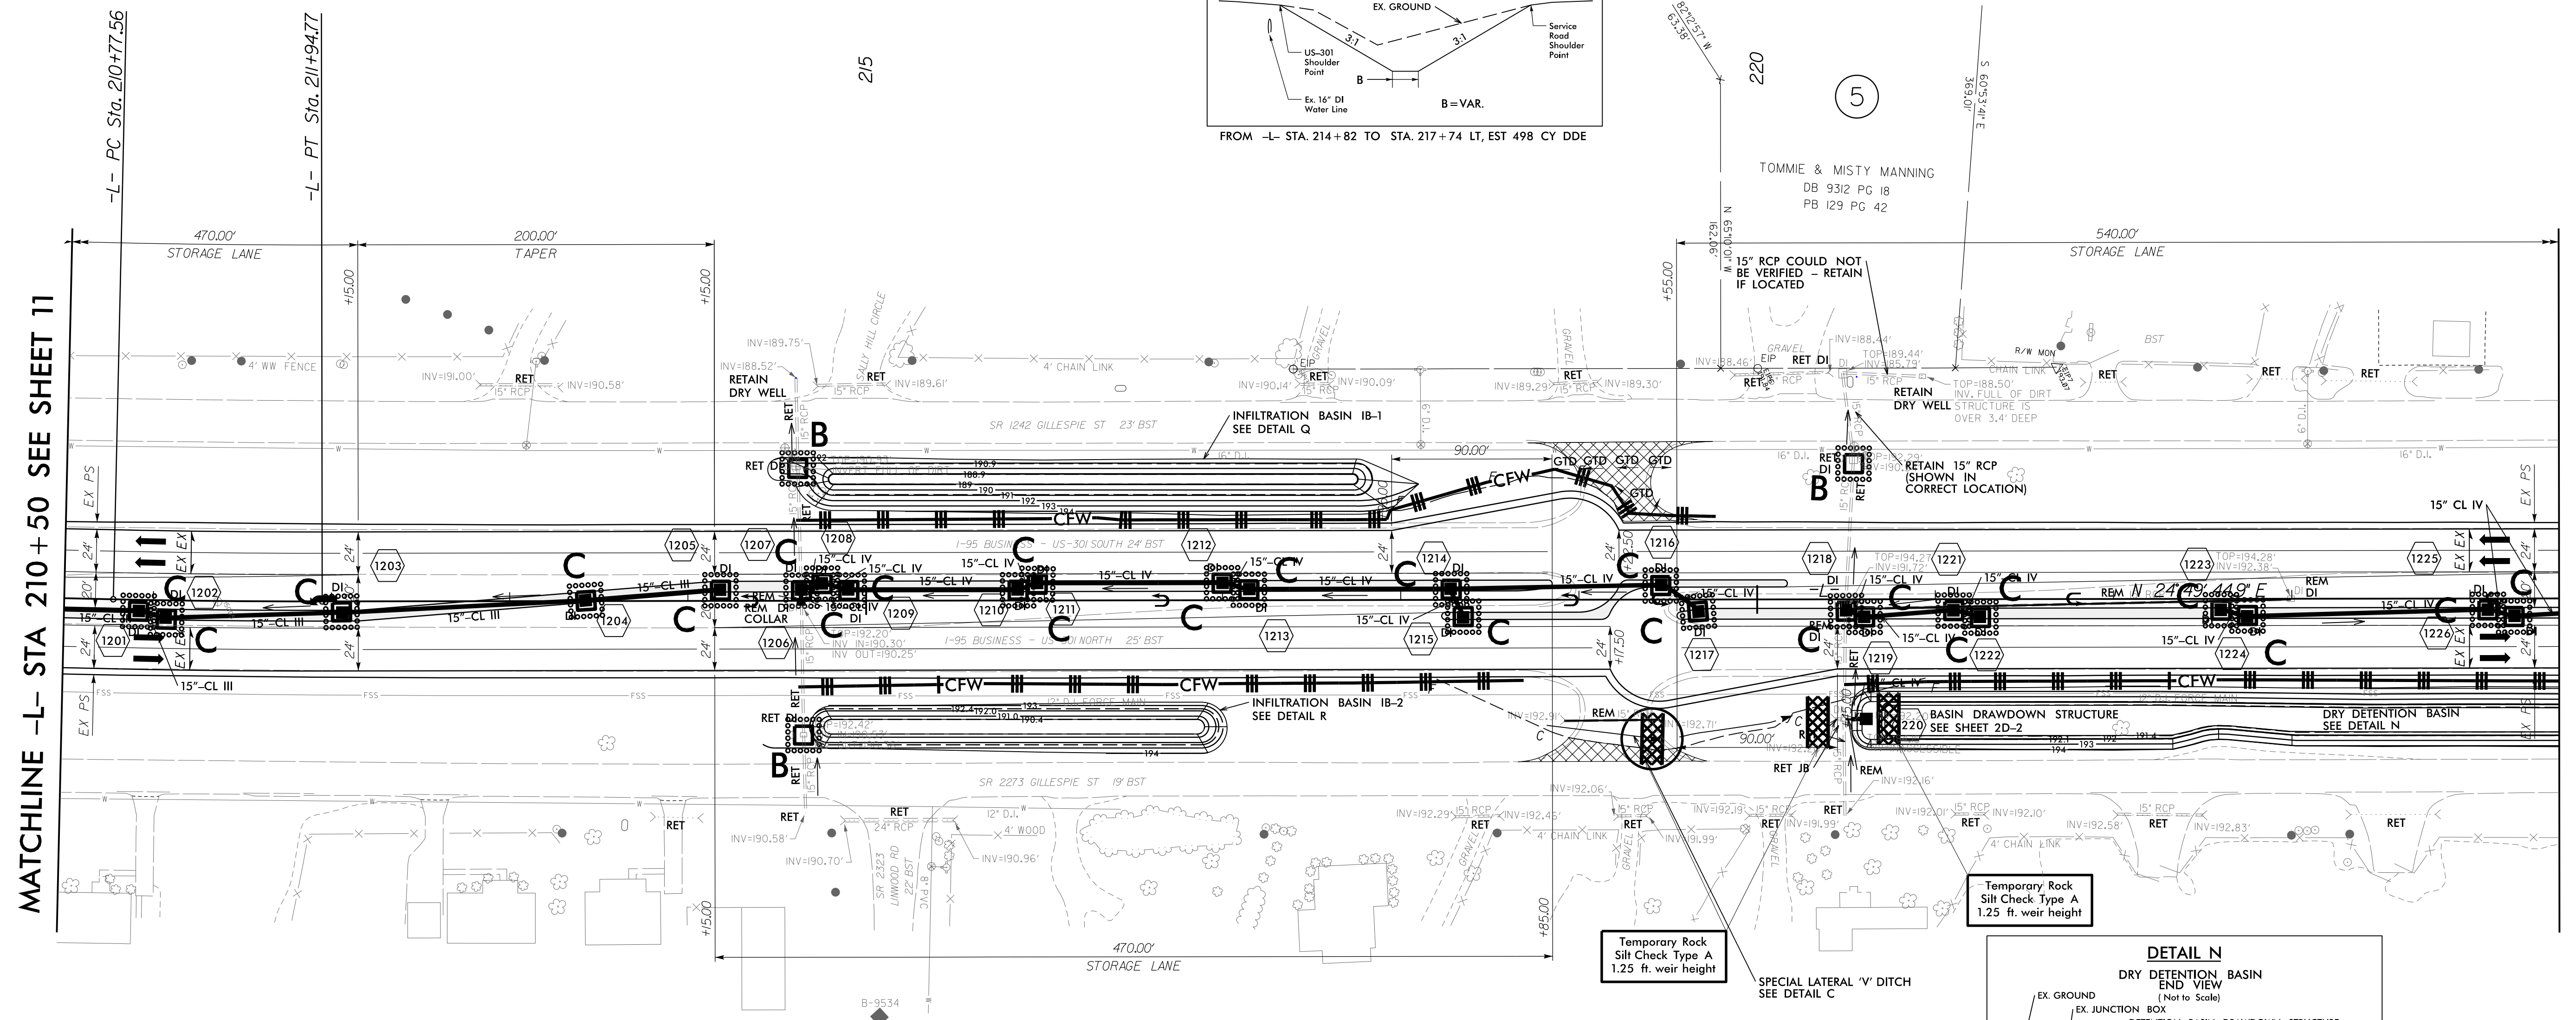


-L-
 PI Sta 211+36.17
 $\Delta = 1' 20'' 34.9'' (LT)$
 $D = 1' 08'' 45.3''$
 $L = 117.20'$
 $T = 58.60'$
 $R = 5,000.00'$

NOTE:
 SILT FENCE AND COIR FIBER WATTLE BREAKS
 SHALL BE INSTALLED AS DIRECTED BY ENGINEER.

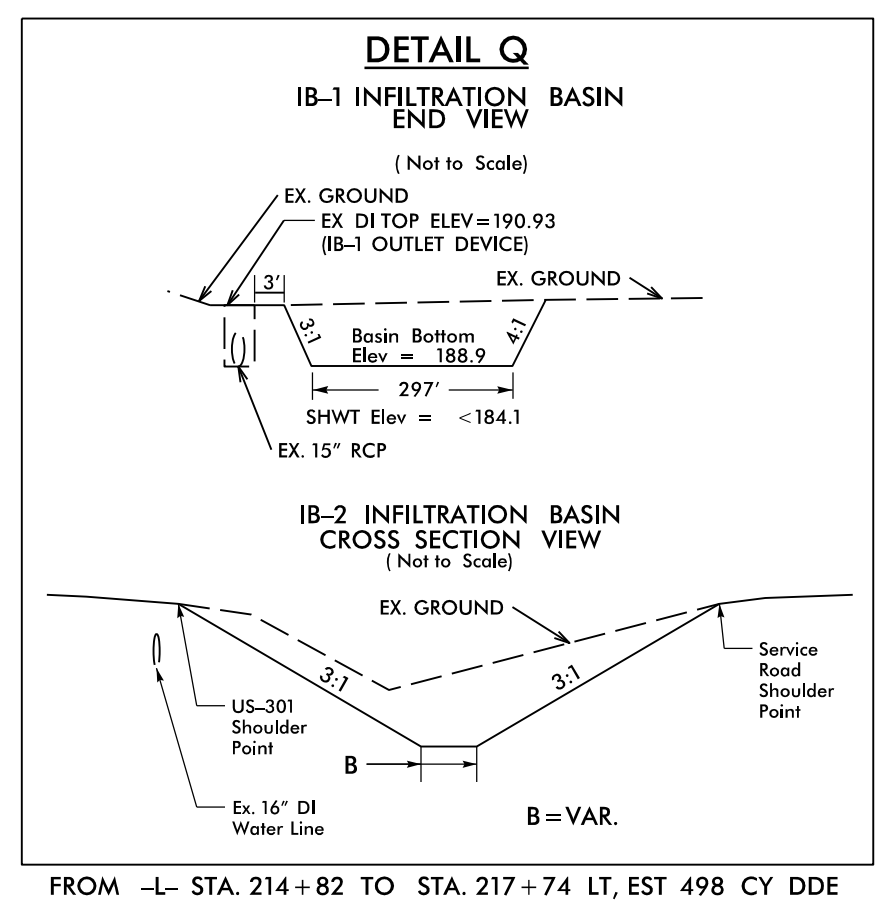




MATCHLINE -L- STA 210+50 SEE SHEET 11

MATCHLINE -L- STA 224+50 SEE SHEET 13

INSTALL MATTING FOR
 EROSION CONTROL IN THE
 PROPOSED DITCH LINE.

For Slopes Excavated Greater Than 10 feet
 Install Matting for Erosion Control on
 Entire Slope as Work Allows.

All Upgradient Areas Must be Stabilized
 and Infiltration and Dry Detention Basins Must be
 Cleaned Out and Returned to Design State
 Before Erosion Control Devices are Removed.

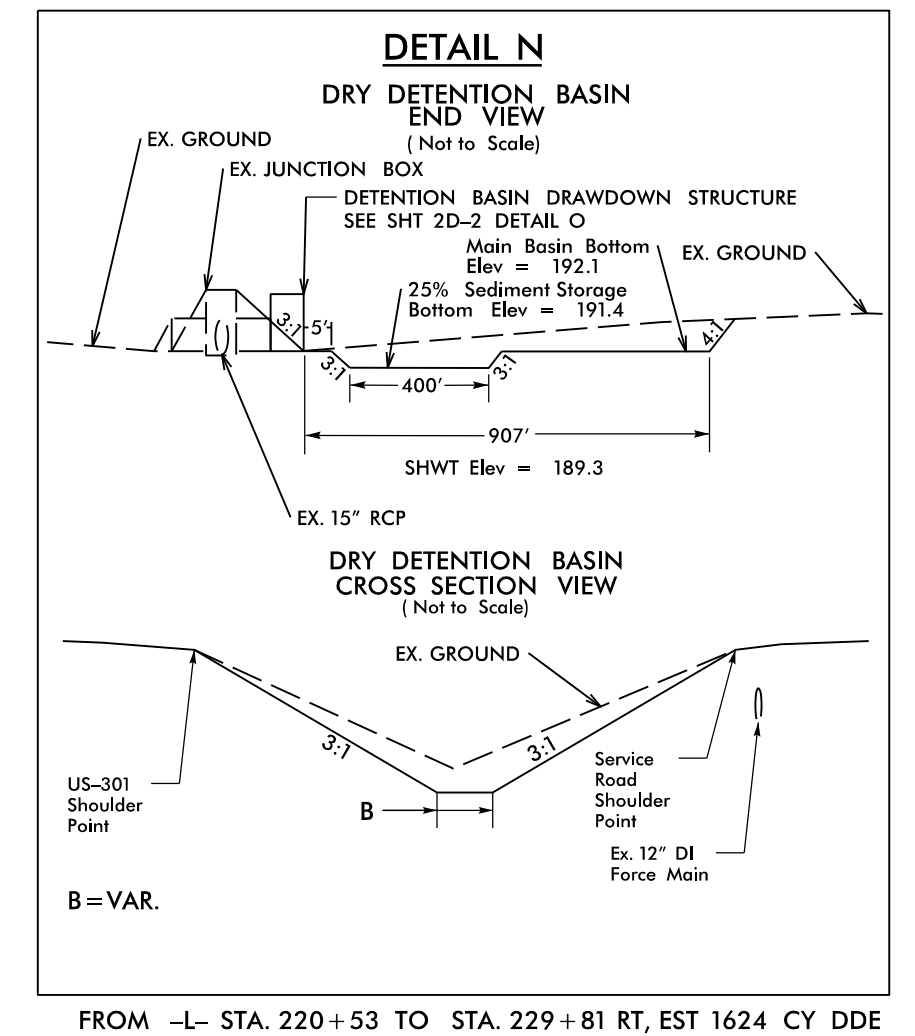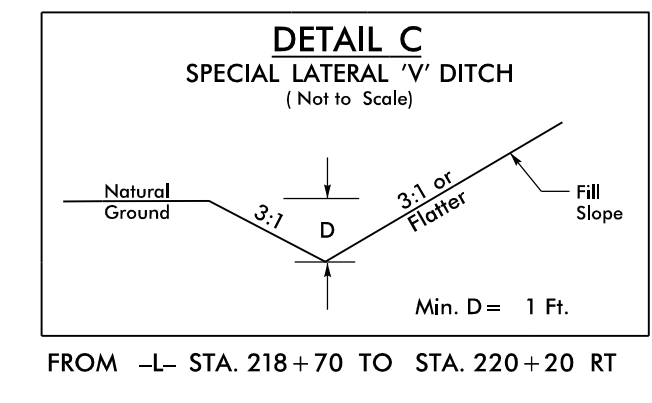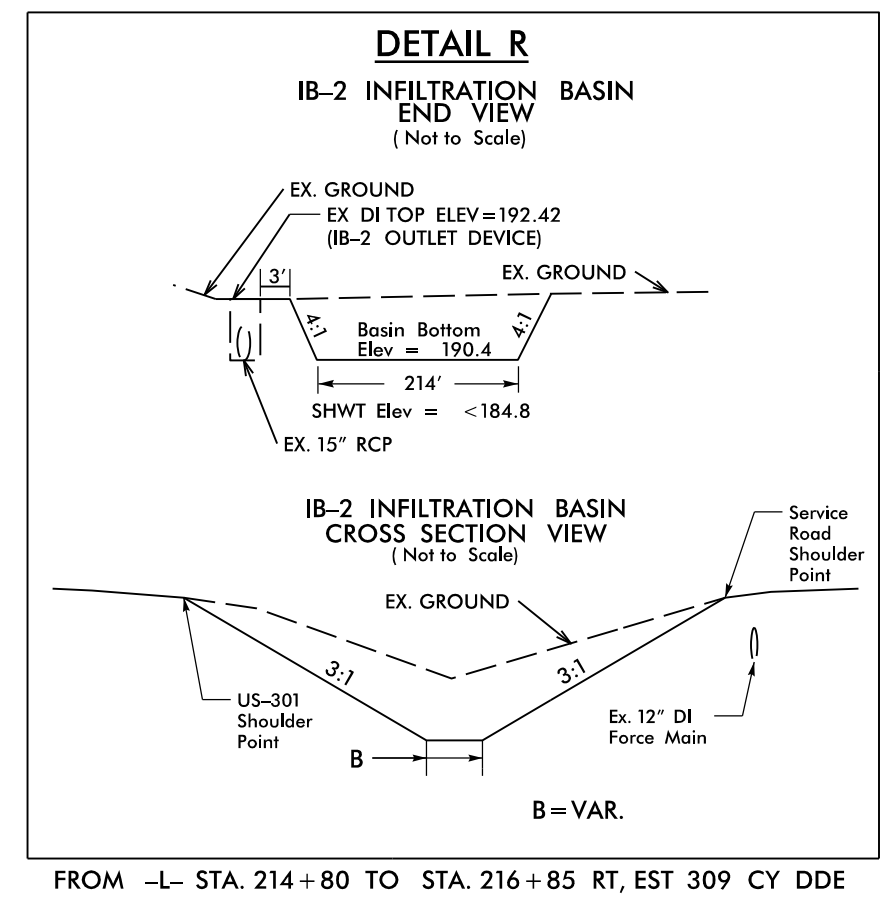

SEE SHEET 2D-1 FOR PROPOSED CURB ELEVATION TABLE

8/17/99
 8/14/2015
 R:\Projects\15\15-0000\W-5519_REL_PSH36_FINAL.dgn
 localuser