
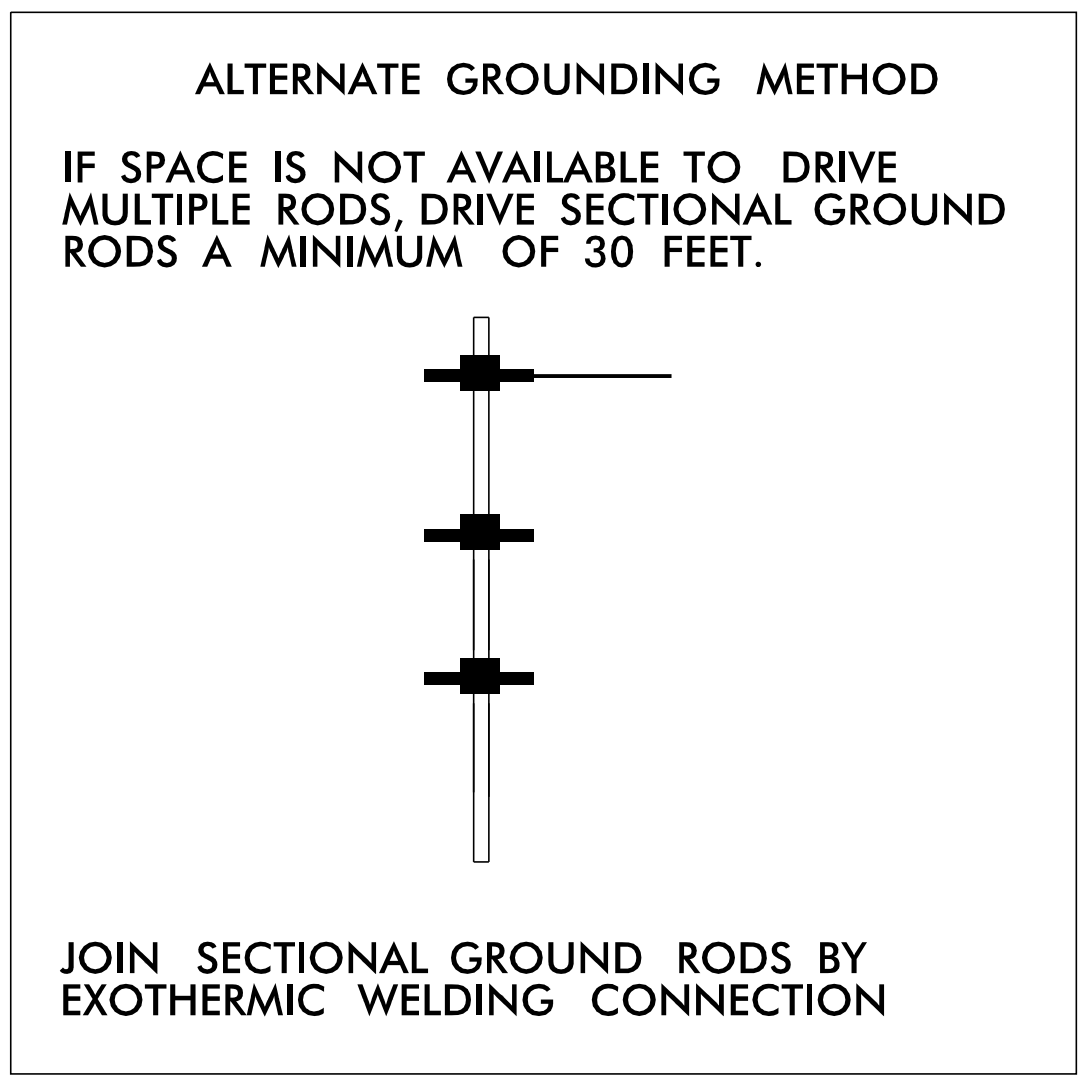


BOND #4 AWG SOLID BARE COPPER WIRE TO CAMERA SUPPORT BASE BY AN ALUMINUM TO COPPER #2 - #14 AWG LUG. ATTACH TO CAMERA BASE WITH A STAINLESS STEEL SELF TAPPING SCREW. REMOVE PAINT OR PROTECTIVE COATING WHERE ATTACHING LUG ONLY.

INSTALL 2-INCH PVC U-GUARD OVER COPPER CONDUCTOR FROM GROUND LEVEL TO 10 FEET (MINIMUM) ABOVE THE GROUND.

2-INCH RIGID GALVANIZED STEEL RISER FOR POWER AND CONTROL WIRES

INSTALL MARKER TAPE 12 INCHES BELOW GRADE AND ABOVE ALL GROUNDING CONDUCTORS.

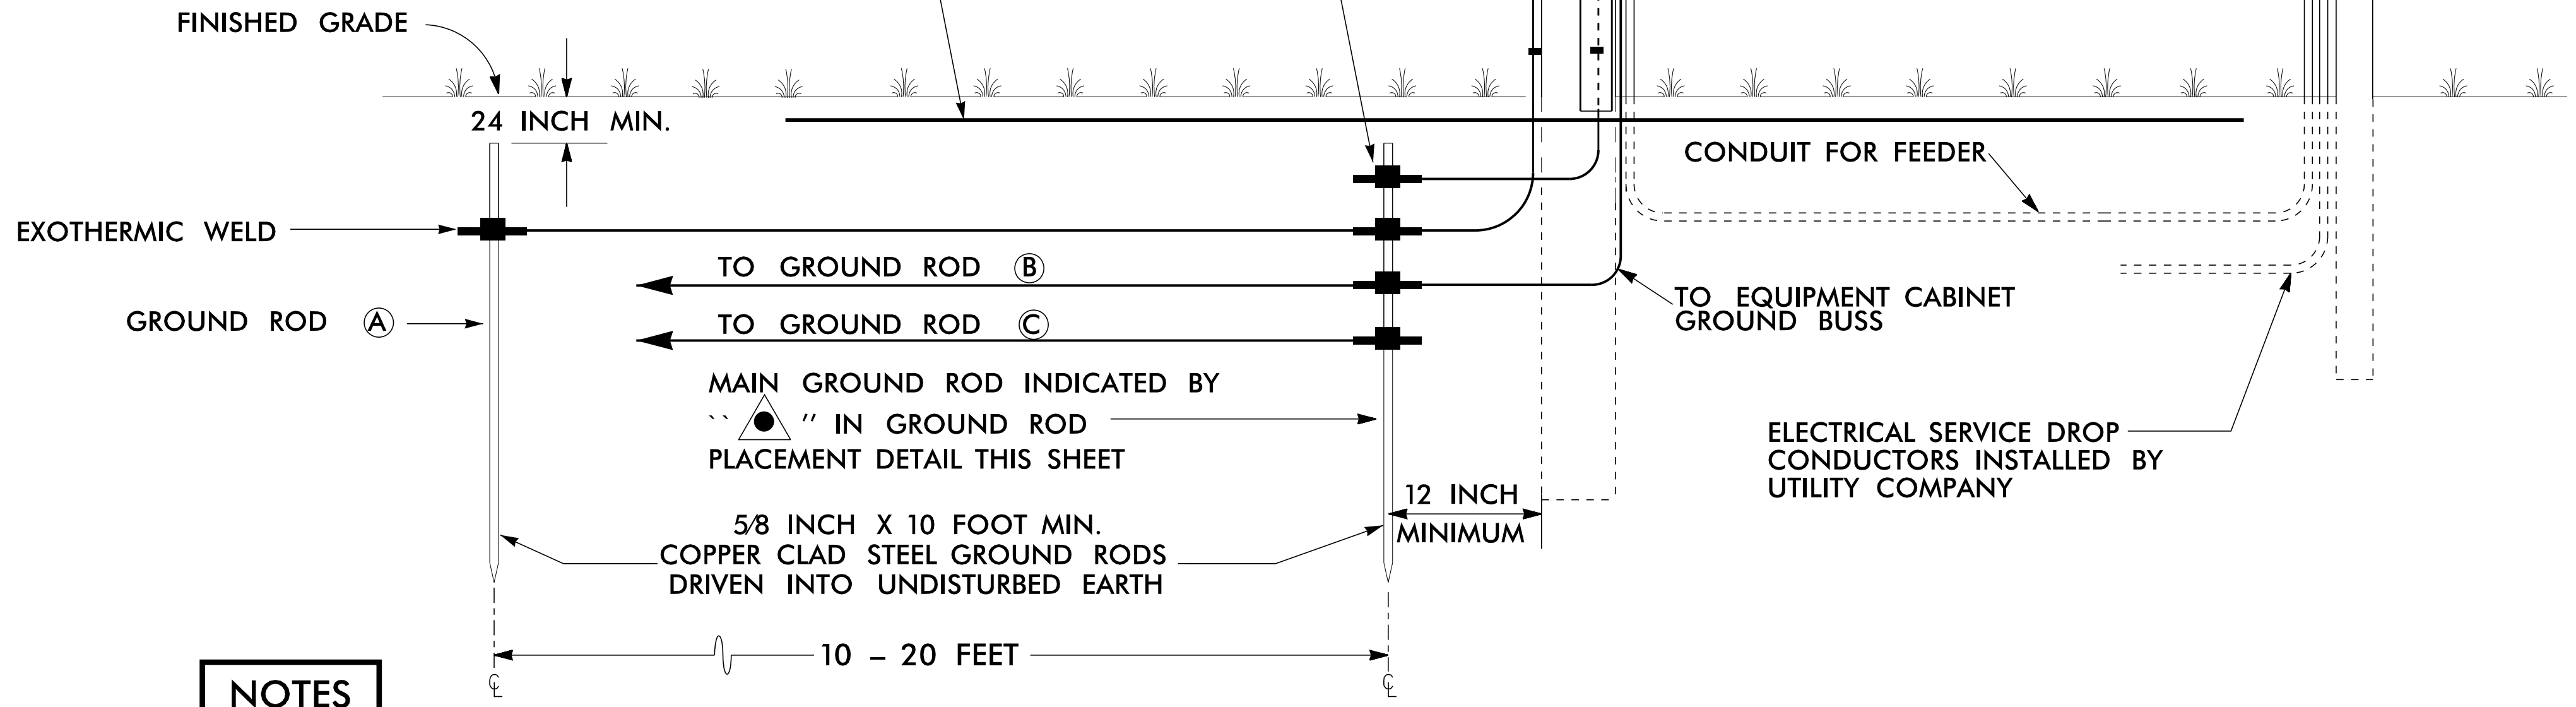

NOTES

1. BOND CLASS II, 28 STRAND (MINIMUM), 15 AWG (MINIMUM) ROPE-LAY BARE COPPER CONDUCTOR TO THE MAIN GROUND ROD BY AN EXOTHERMIC WELD METHOD. MAINTAIN MAXIMUM HORIZONTAL SEPARATION BETWEEN COPPER CONDUCTOR AND RISER.
2. EXOTHERMICALLY WELD ALL CONNECTIONS TO GROUND RODS.
3. THE CONTRACTOR MAY, UPON APPROVAL OF THE ENGINEER, INSTALL A 30-FOOT SECTIONAL GROUND ROD FOR INSTANCES WHEN CONDITIONS WILL NOT ALLOW FOR THE INSTALLATION OF THE 3 - RADIAL GROUND RODS.
4. INSTALL MARKER TAPE DIRECTLY ABOVE ALL GROUNDING ELECTRODES AND CONDUCTORS AT A DEPTH OF 12 INCHES.
5. REMOVE BONDING JUMPER BETWEEN EQUIPMENT CABINET GROUND BUSS AND NEUTRAL BUSS.

6/30/2016 12:37:03 PM jerry.gross K:\ARL_TPTD_ITS\01036317 - INDDOT 1-295 ITS\Plans X-0002F_ITS_psh_7.dgn

Kimley»Horn
 NC License #F-0102
 P.O. Box 33068
 Raleigh, NC 27636
 Tel: (919) 677-2000
 Fax: (919) 677-2050

	NC-295 FAYETTEVILLE OUTER LOOP ITS CCTV ELECTRICAL SERVICE (EXISTING) AND GROUNDING		SEAL
	DIVISION 06 CUMBERLAND COUNTY		
PLAN DATE: JUNE 2016 PREPARED BY: J. CROSS	REVIEWED BY: K. SMITH		DocuSigned by: Kevin W. Smith 6/30/2016
REVISIONS	INIT.	DATE	
SCALE: 0			CADD File name: