




PROJECT REFERENCE NO. R-5023B	SHEET NO. UC-10
UTILITY DESIGN ENGINEER	
<small>398 East Chatham Street - Suite 137 Cary, NC 27511 Phone: 919.297.0220 Fax: 919.297.0221 NC License: F01160</small>	

NOTES:

1. PROPOSED WATER LINE SHALL BE DUCTILE IRON RESTRAINED JOINT.
2. CONTRACTOR SHALL VERIFY LOCATION AND DEPTH OF ALL UTILITIES BEFORE BEGINNING CONSTRUCTION.
3. FOR DOWN & UNDER RELOCATION OF 12" WATER LINE IN CONFLICT WITH PROPOSED DRAINAGE, SEE DETAIL ON SHEET UC-3D.
4. REFER TO PROJECT NOTE 5 ON SHEET UC-03 FOR JOINT RESTRAINT REQUIREMENTS ON EXISTING WATER LINE.

MATCHLINE SEE SHEET UC-09
-L- STA 98 + 00

PROP. 36 LF 12" WATER LINE
PROP. 24 LF ABANDON 12" UTILITY PIPE

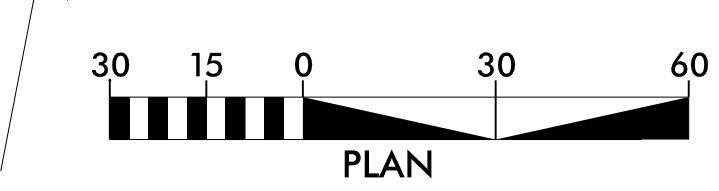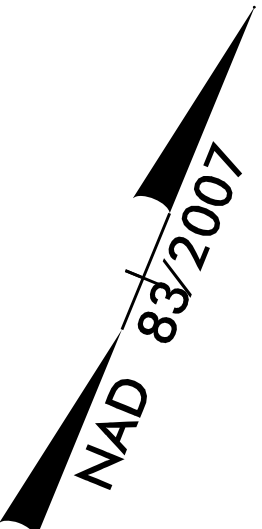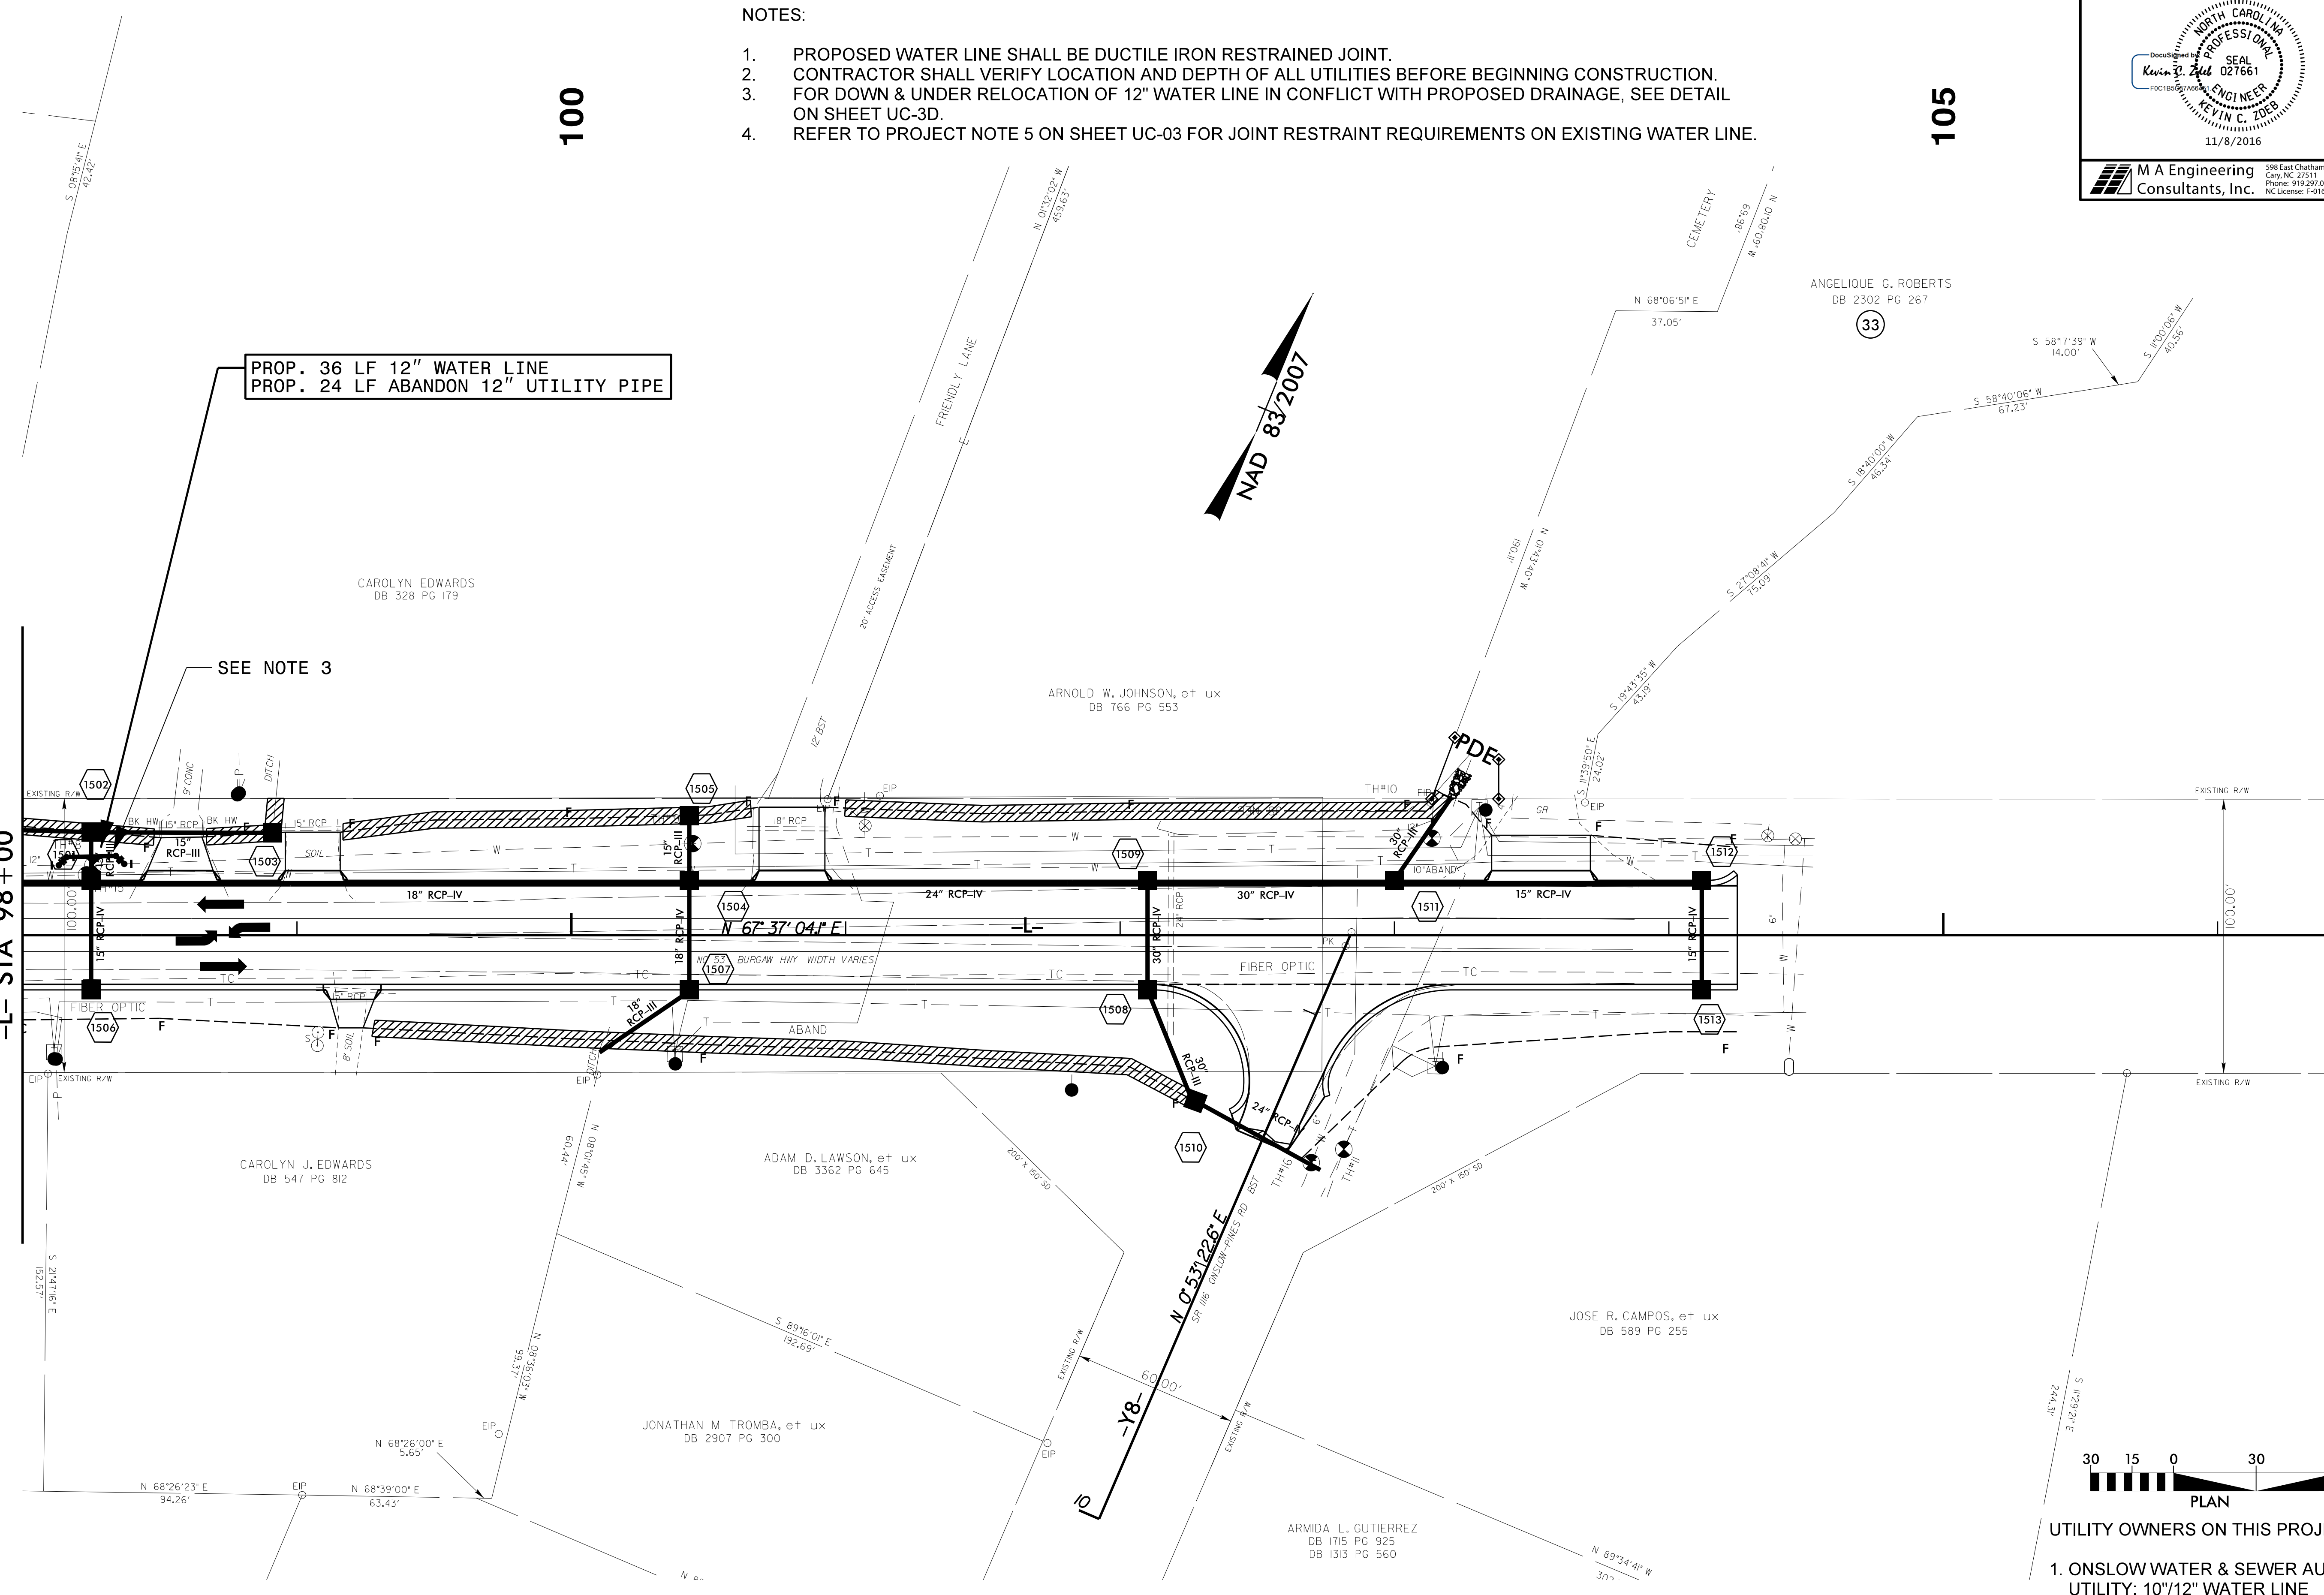

UTILITY OWNERS ON THIS PROJECT:

1. ONSLOW WATER & SEWER AUTHORITY
UTILITY: 10"/12" WATER LINE
CONTACT: CARL H. BAKER, PE
PHONE: (910) 937-7521

B:\0\02016\069596\020\11000 R-5023\R-5023_0nslow\Utilities\Redl\Ut\Proc\URE023_UC-UC-10_psh15.dgn

5/28/19