


DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED


PROJECT REFERENCE NO. <i>U-4910A</i>	SHEET NO. <i>UC-12</i>
RW SHEET NO.	
UTILITIES ENGINEER	

Prepared in the Office of: **AECOM**
NC FIRM LICENSE No. F-0342
 701 Corporate Center Drive, Suite 475
 Raleigh, NC 27607
 (919) 854-6200 • (919) 854-6259(FAX)


UTILITY CONSTRUCTION

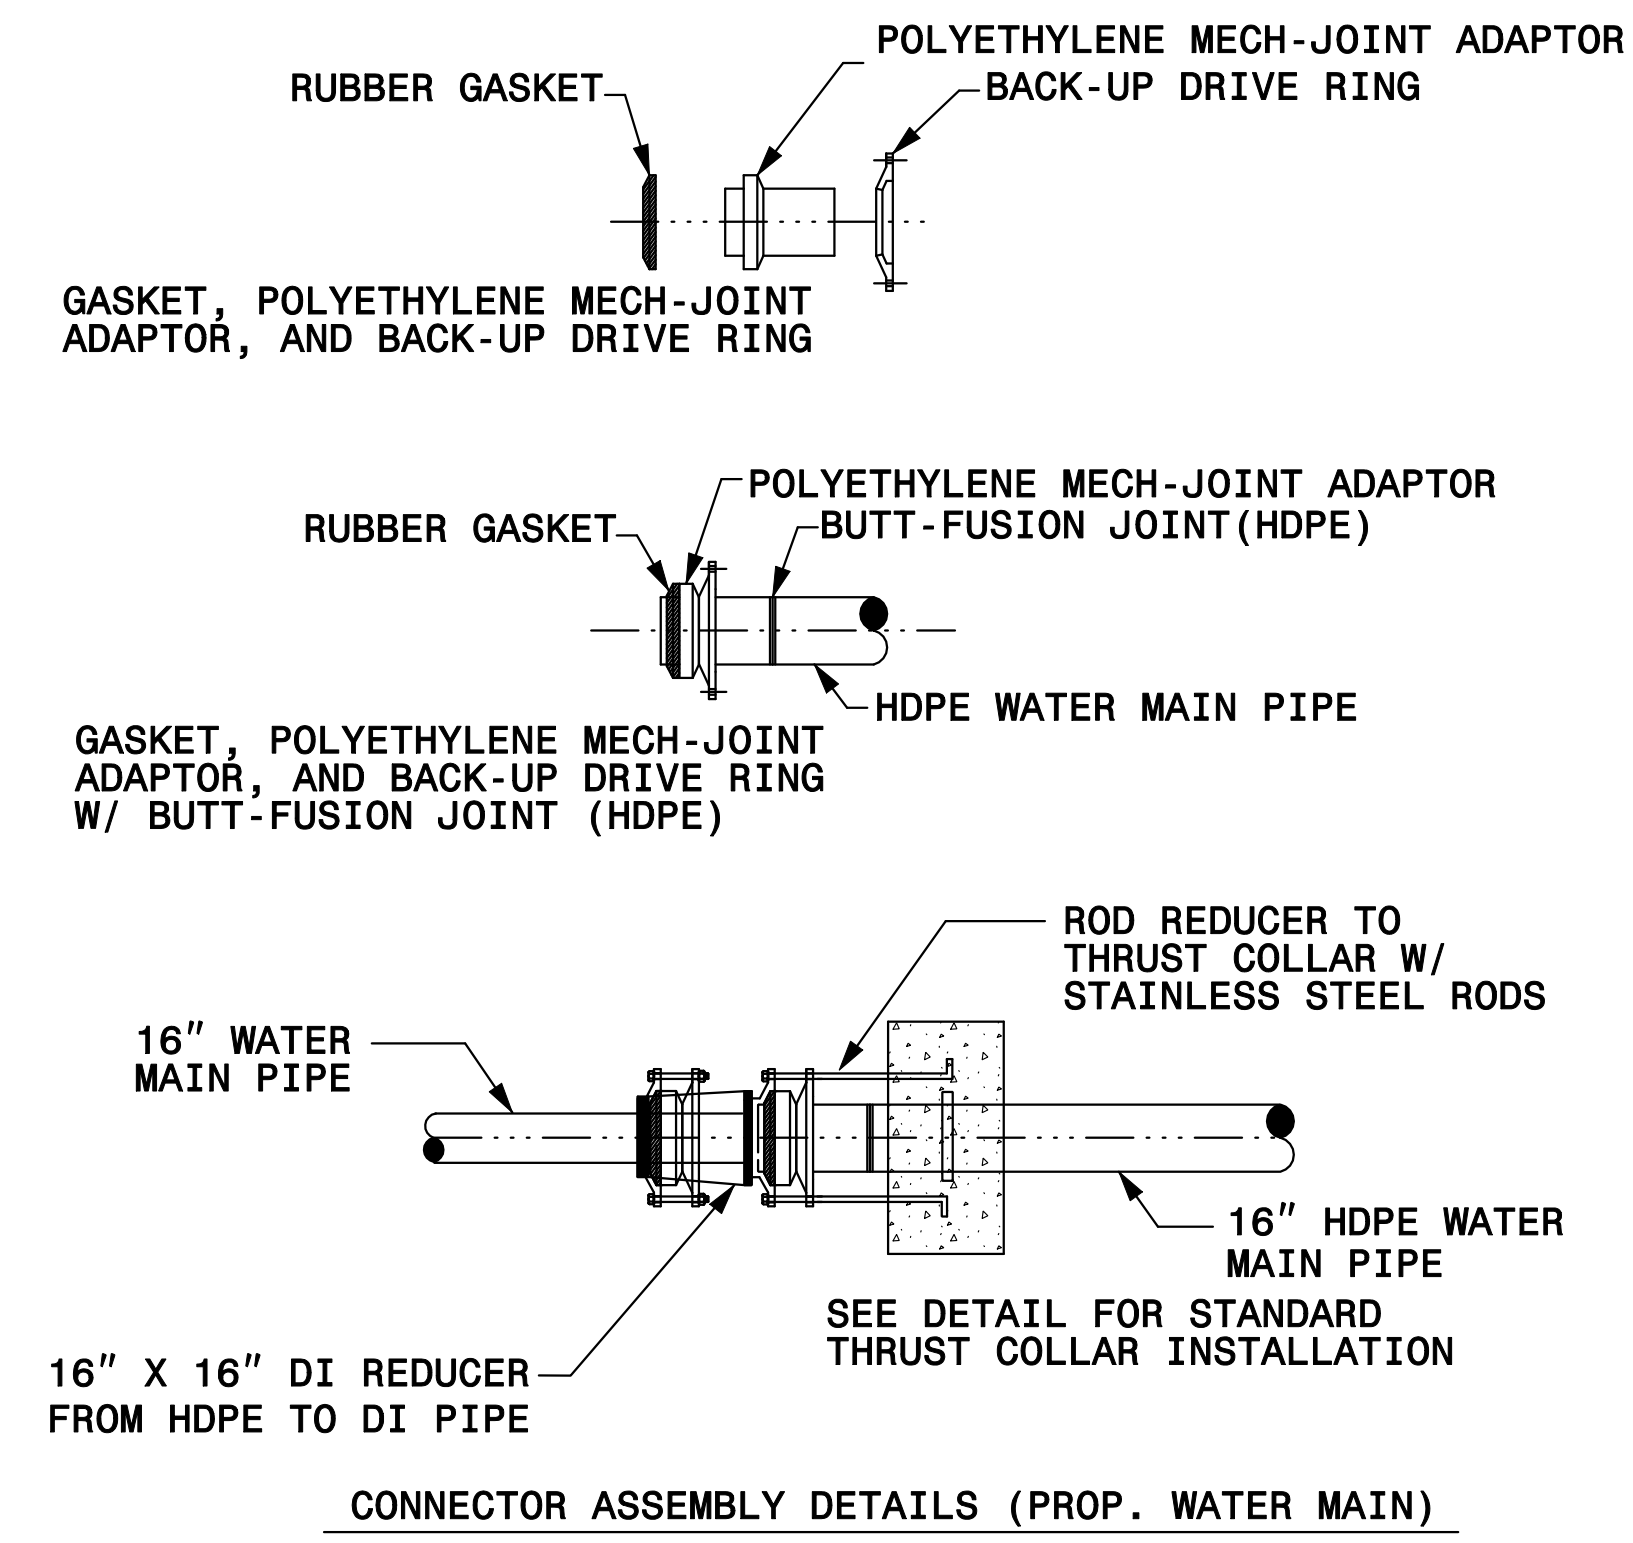

CONNECTOR ASSEMBLY DETAILS (PROP. WATER MAIN)

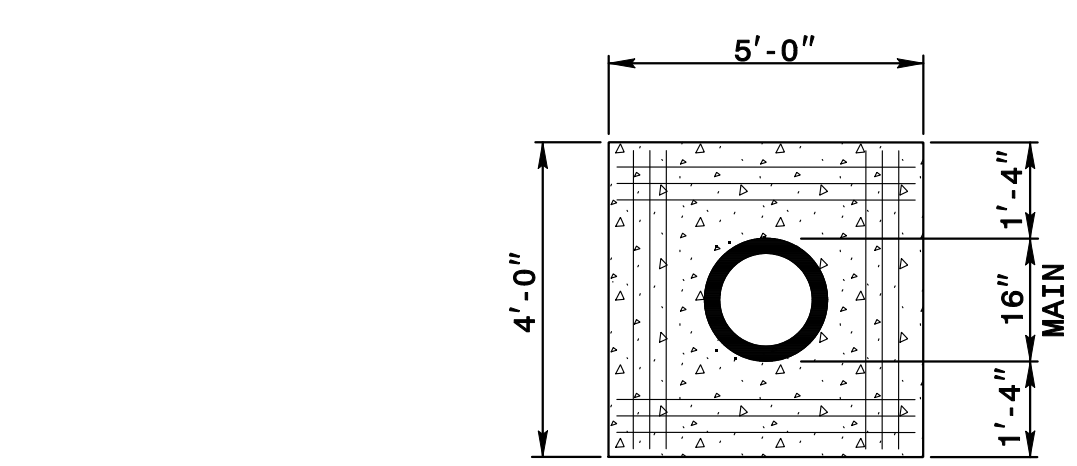


REINFORCING
NOTE:
 6" TO 16" MAINS = 12-NO. 7 BARS
 BARS PLACED AS SHOWN

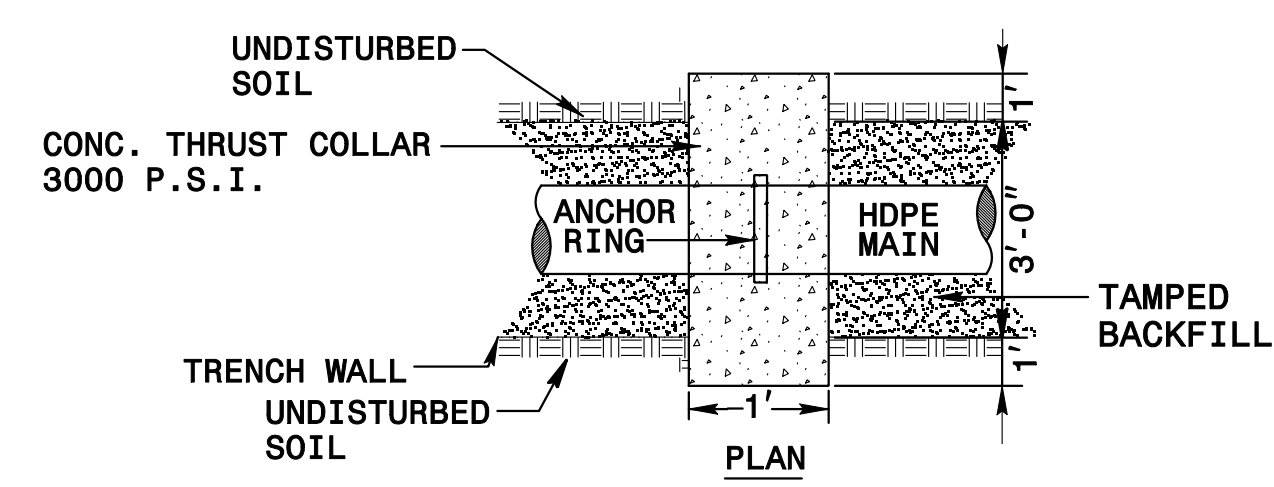

THRUST COLLAR DETAIL

TRENCHLESS INSTALLATION ANCHOR DETAIL FOR HDPE PIPE

NTS

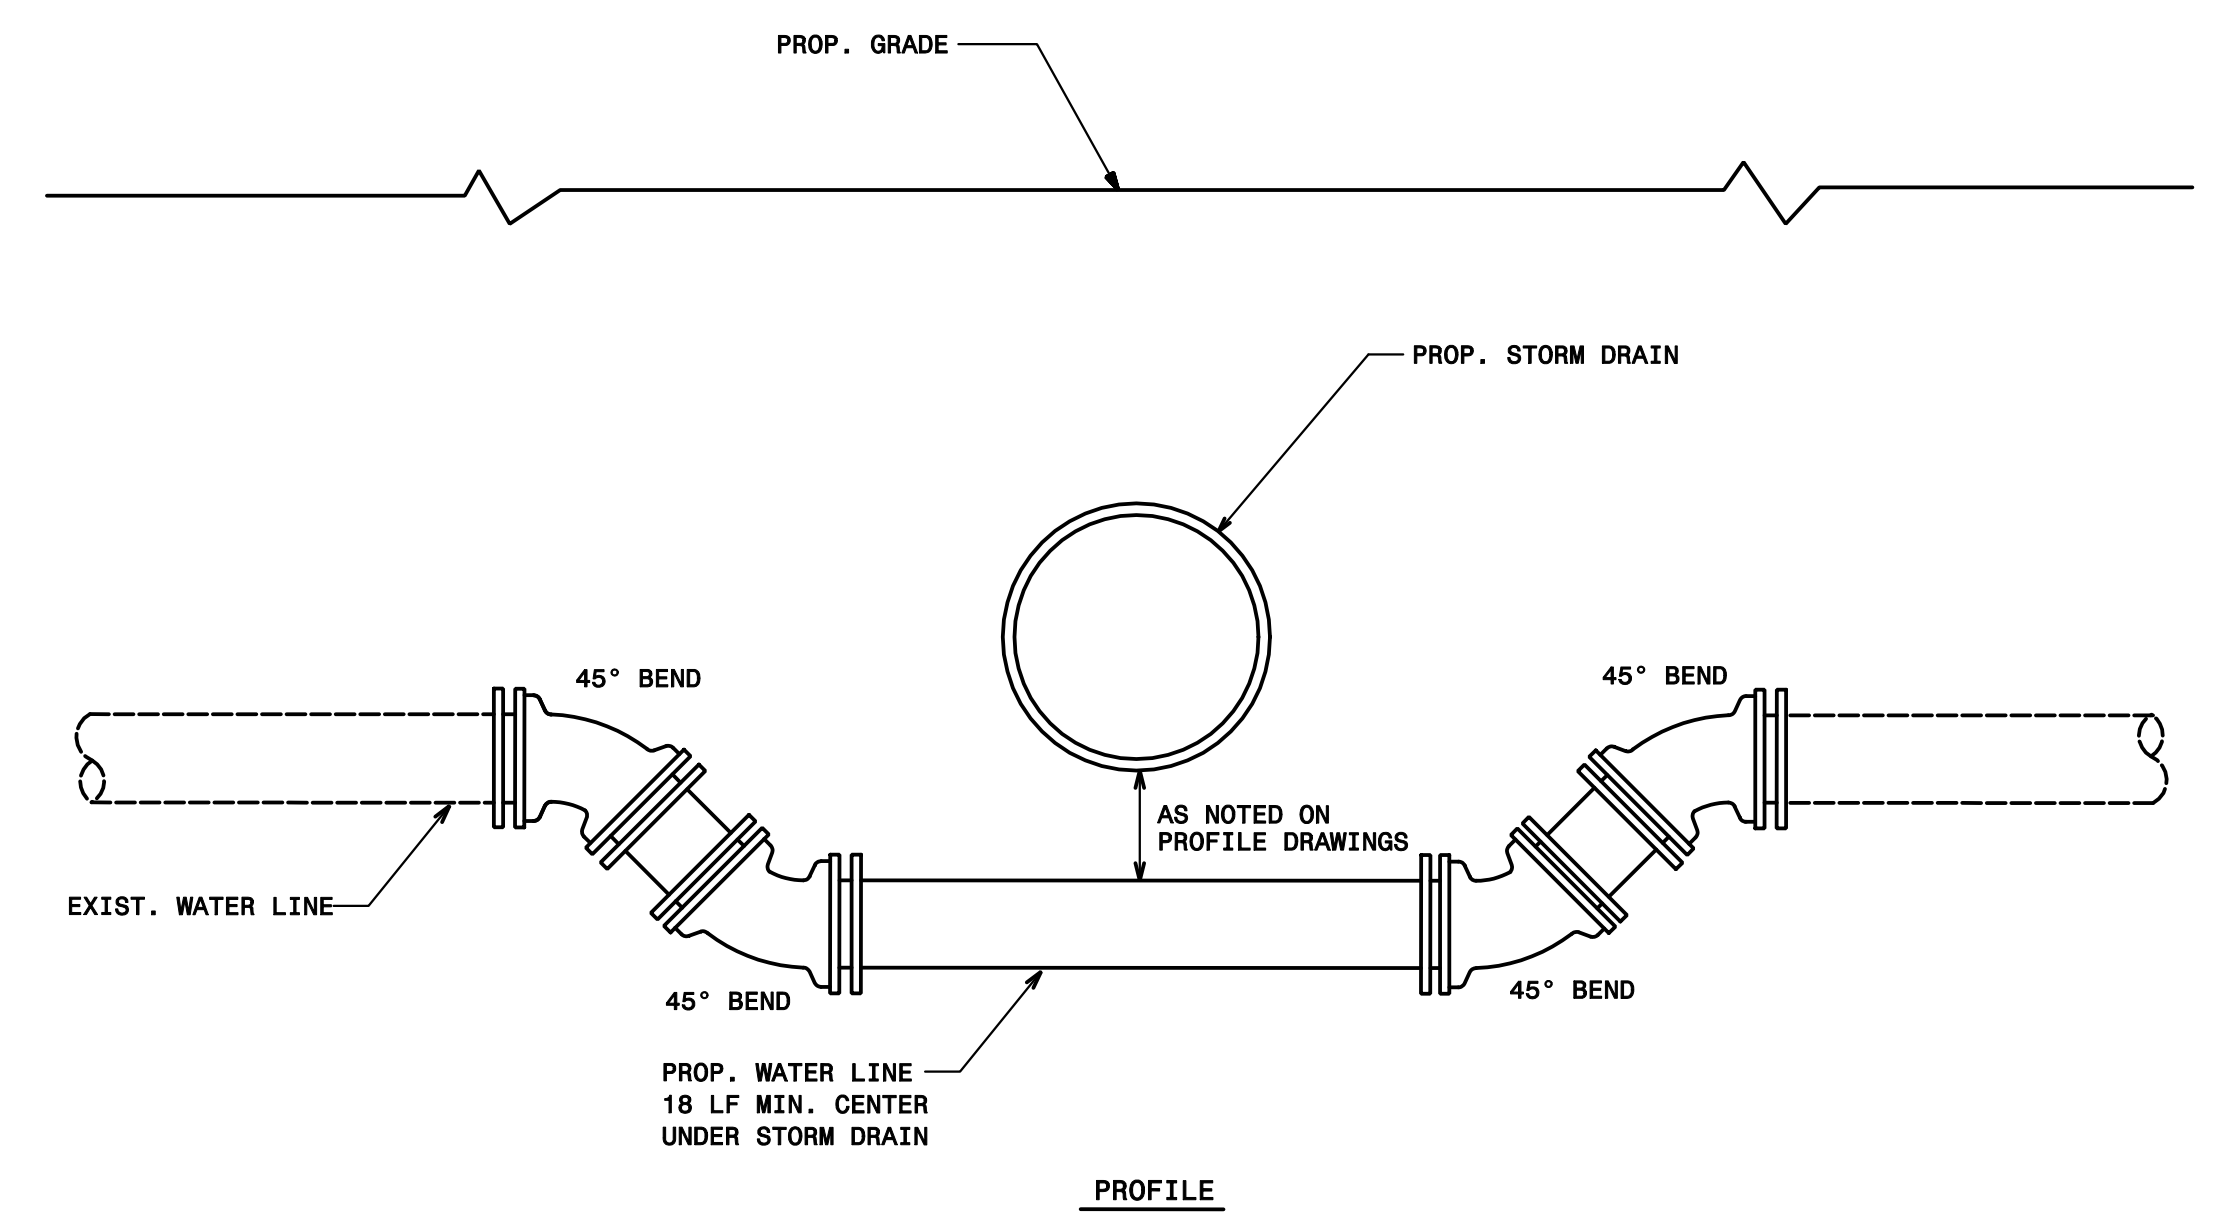

**WATER MAIN RELOCATION
 AT PROPOSED STORM DRAIN CROSSING**

NTS

REVISIONS

Revisions:

DN: u4910_uc_01/12.dgn
 USER: sw/hsong
 DATE: 1/11/2017
 TIME: 12:30:31 PM