5/14/99

DOCUMENT NOT CONSIDERED FINAL UNTIL ALL SIGNATURES COMPLETE

NOTE:
ALL LOCATIONS WHERE PROPOSED WATER LINE CROSSES DRAINAGE SYSTEMS SHALL PROVIDE MINIMUM OF 24" VERTICAL CLEARANCE

PROJECT REFERENCE NO.	SHEET NO.
R-3100B	UC-8
DESIGNED BY: RJM	
DRAWN BY: RAB	
CHECKED BY: DGC	
APPROVED BY:	
REVISED:	
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION	
UTILITIES ENGINEERING SEC. PHONE:(919)707-6690 FAX:(919)250-4151	UTILITY CONSTRUCTION PLANS ONLY

NORTH CAROLINA PROFESSIONAL ENGINEER SEAL 037837 RAMIREZ R. J. MOZ

DocuSigned by: RJ Mozley AE23FBE18BBC42C...

UTILITY CONSTRUCTION

Prepared by

McGill ASSOCIATES
ENGINEERING · PLANNING · FINANCE
1240 19th STREET, LANE NW HICKORY, NC 28601 PH. (828) 328-2024 FIRM LICENSE # C-0459

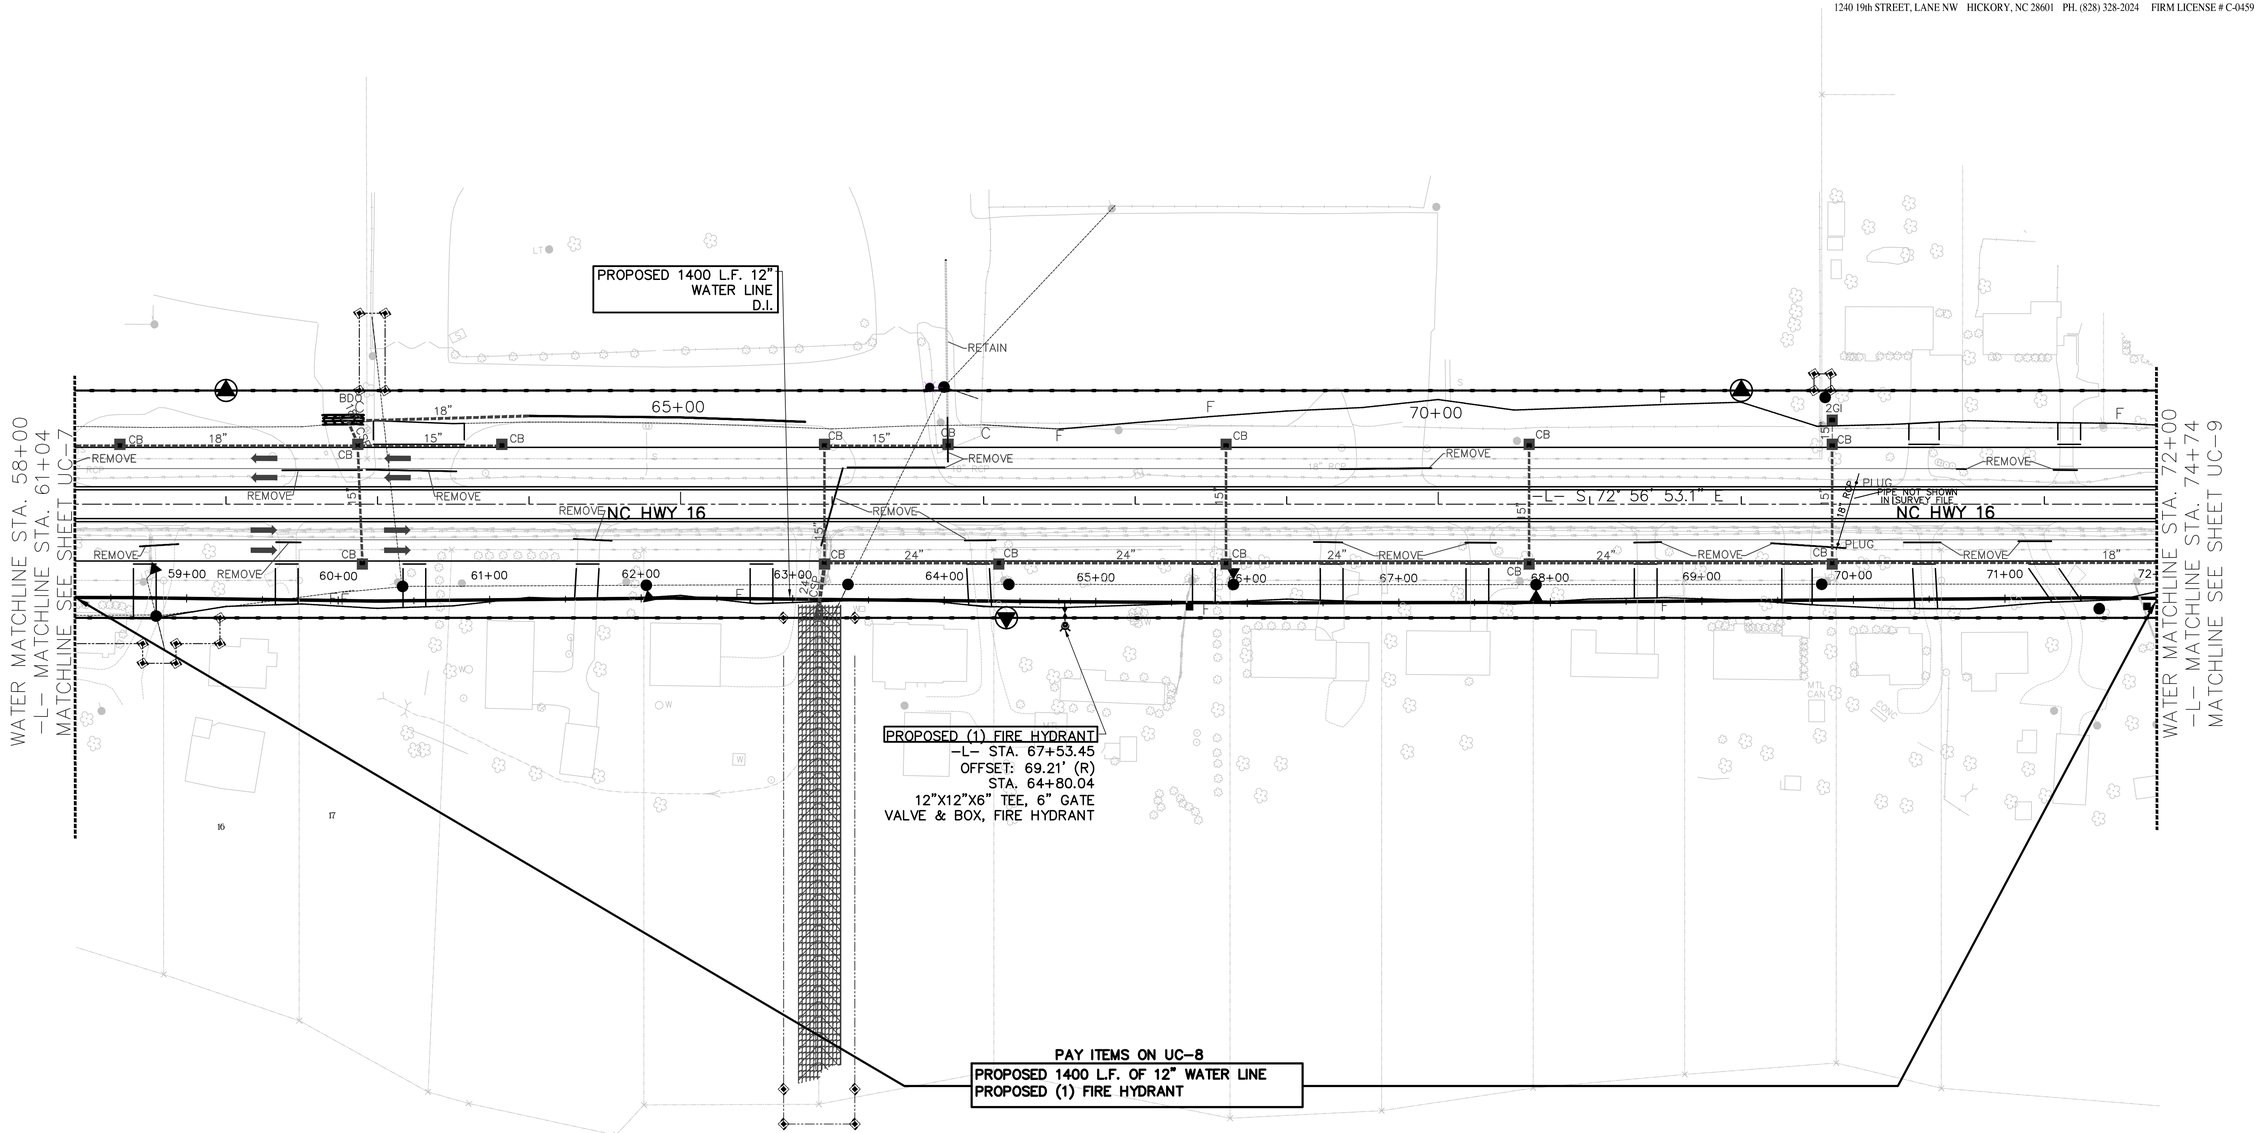

PAY ITEMS ON UC-8
PROPOSED 1400 L.F. OF 12" WATER LINE
PROPOSED (1) FIRE HYDRANT

$$$$$$$$SYSTIME$$$$$$$$
$$$$$$$$DGN$$$$$$$$
$$$$$$$$USERNAME$$$$$$$$