


5/14/99

PROJECT REFERENCE NO. R-3100B	SHEET NO. UC-11
DESIGNED BY: RJM	
DRAWN BY: RAB	
CHECKED BY: DGC	
APPROVED BY:	
REVISED:	
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151	
UTILITY CONSTRUCTION PLANS ONLY	


DOCUMENT NOT CONSIDERED FINAL
UNTIL ALL SIGNATURES COMPLETE

NOTE:
ALL LOCATIONS WHERE PROPOSED
WATER LINE CROSSES DRAINAGE
SYSTEMS SHALL PROVIDE
MINIMUM OF 24" VERTICAL CLEARANCE

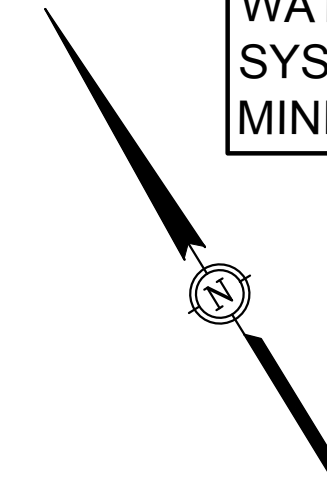

UTILITY CONSTRUCTION

Prepared by

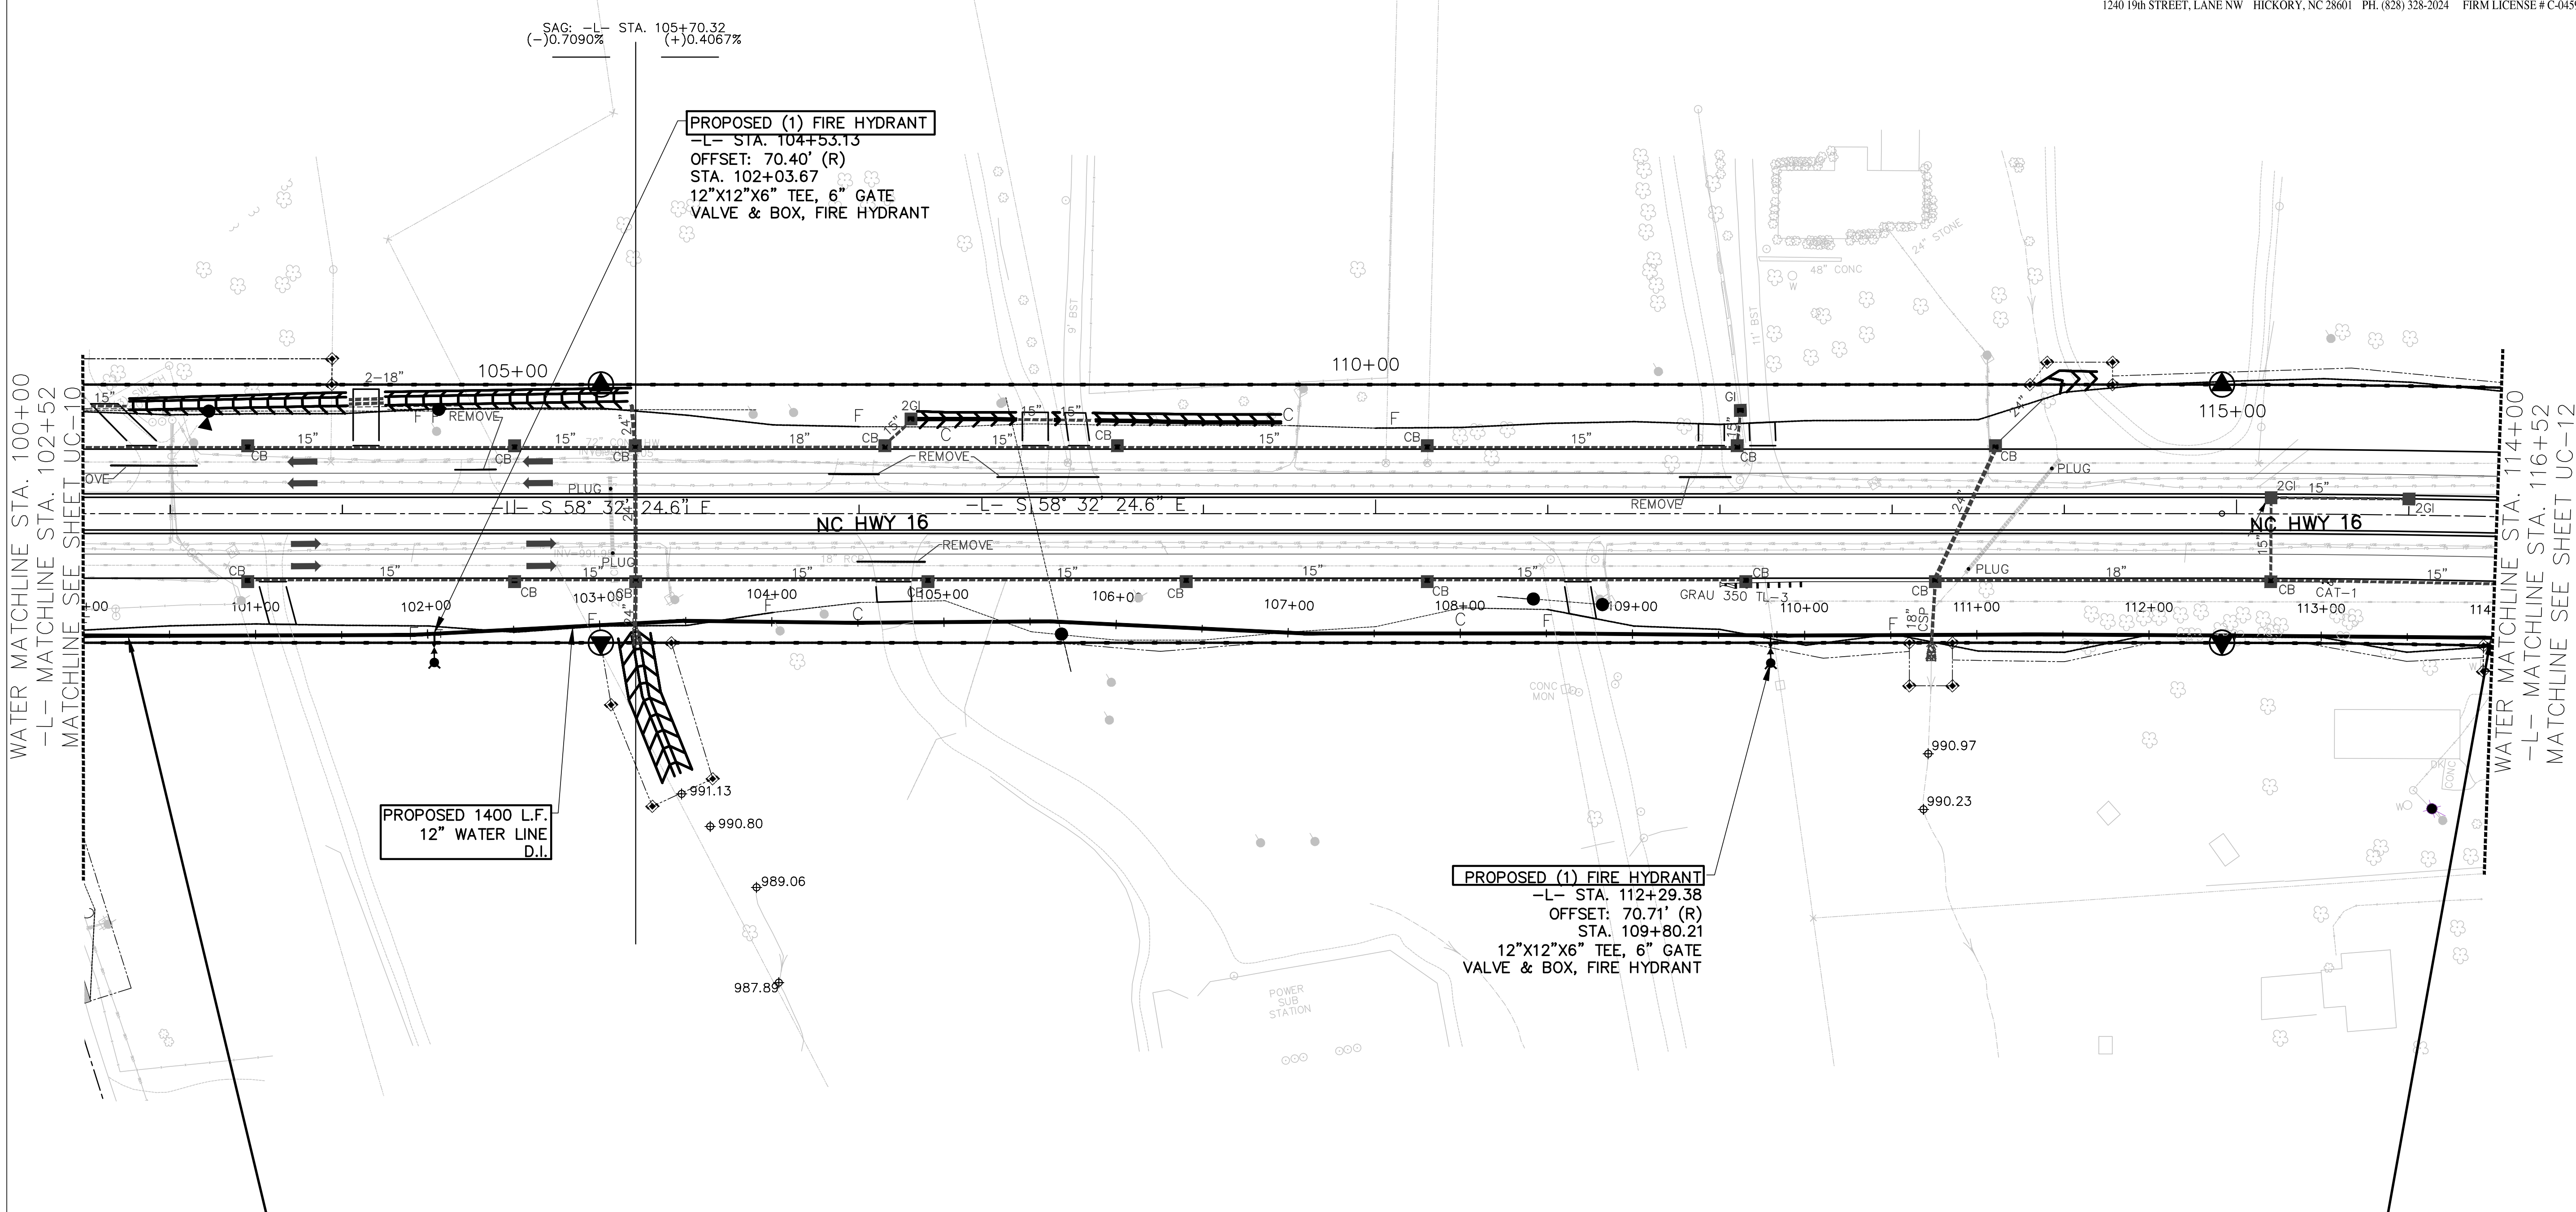

PROPOSED (1) FIRE HYDRANT
 -L- STA. 104+53.13
 OFFSET: 70.40' (R)
 STA. 102+03.67
 12"X12"X6" TEE, 6" GATE
 VALVE & BOX, FIRE HYDRANT

**PROPOSED 1400 L.F.
 12" WATER LINE
 D.I.**

PROPOSED (1) FIRE HYDRANT
 -L- STA. 112+29.38
 OFFSET: 70.71' (R)
 STA. 109+80.21
 12"X12"X6" TEE, 6" GATE
 VALVE & BOX, FIRE HYDRANT

PAY ITEMS ON UC-11
 PROPOSED 1400 L.F. OF 12" WATER LINE
 PROPOSED (2) FIRE HYDRANT

SYSTEMS
 TO BE
 REMOVED
 AND
 REPAIRED
 AS
 SHOWN
 ON
 THESE
 PLANS