




BENCHMARK #3: CHISELED SQUARE IN CORNER OF UTILITY BOX BASE, STA. 11+80.00 -Y1- 56 FT. LEFT; EL. 739.23; N 567774 E 1347226

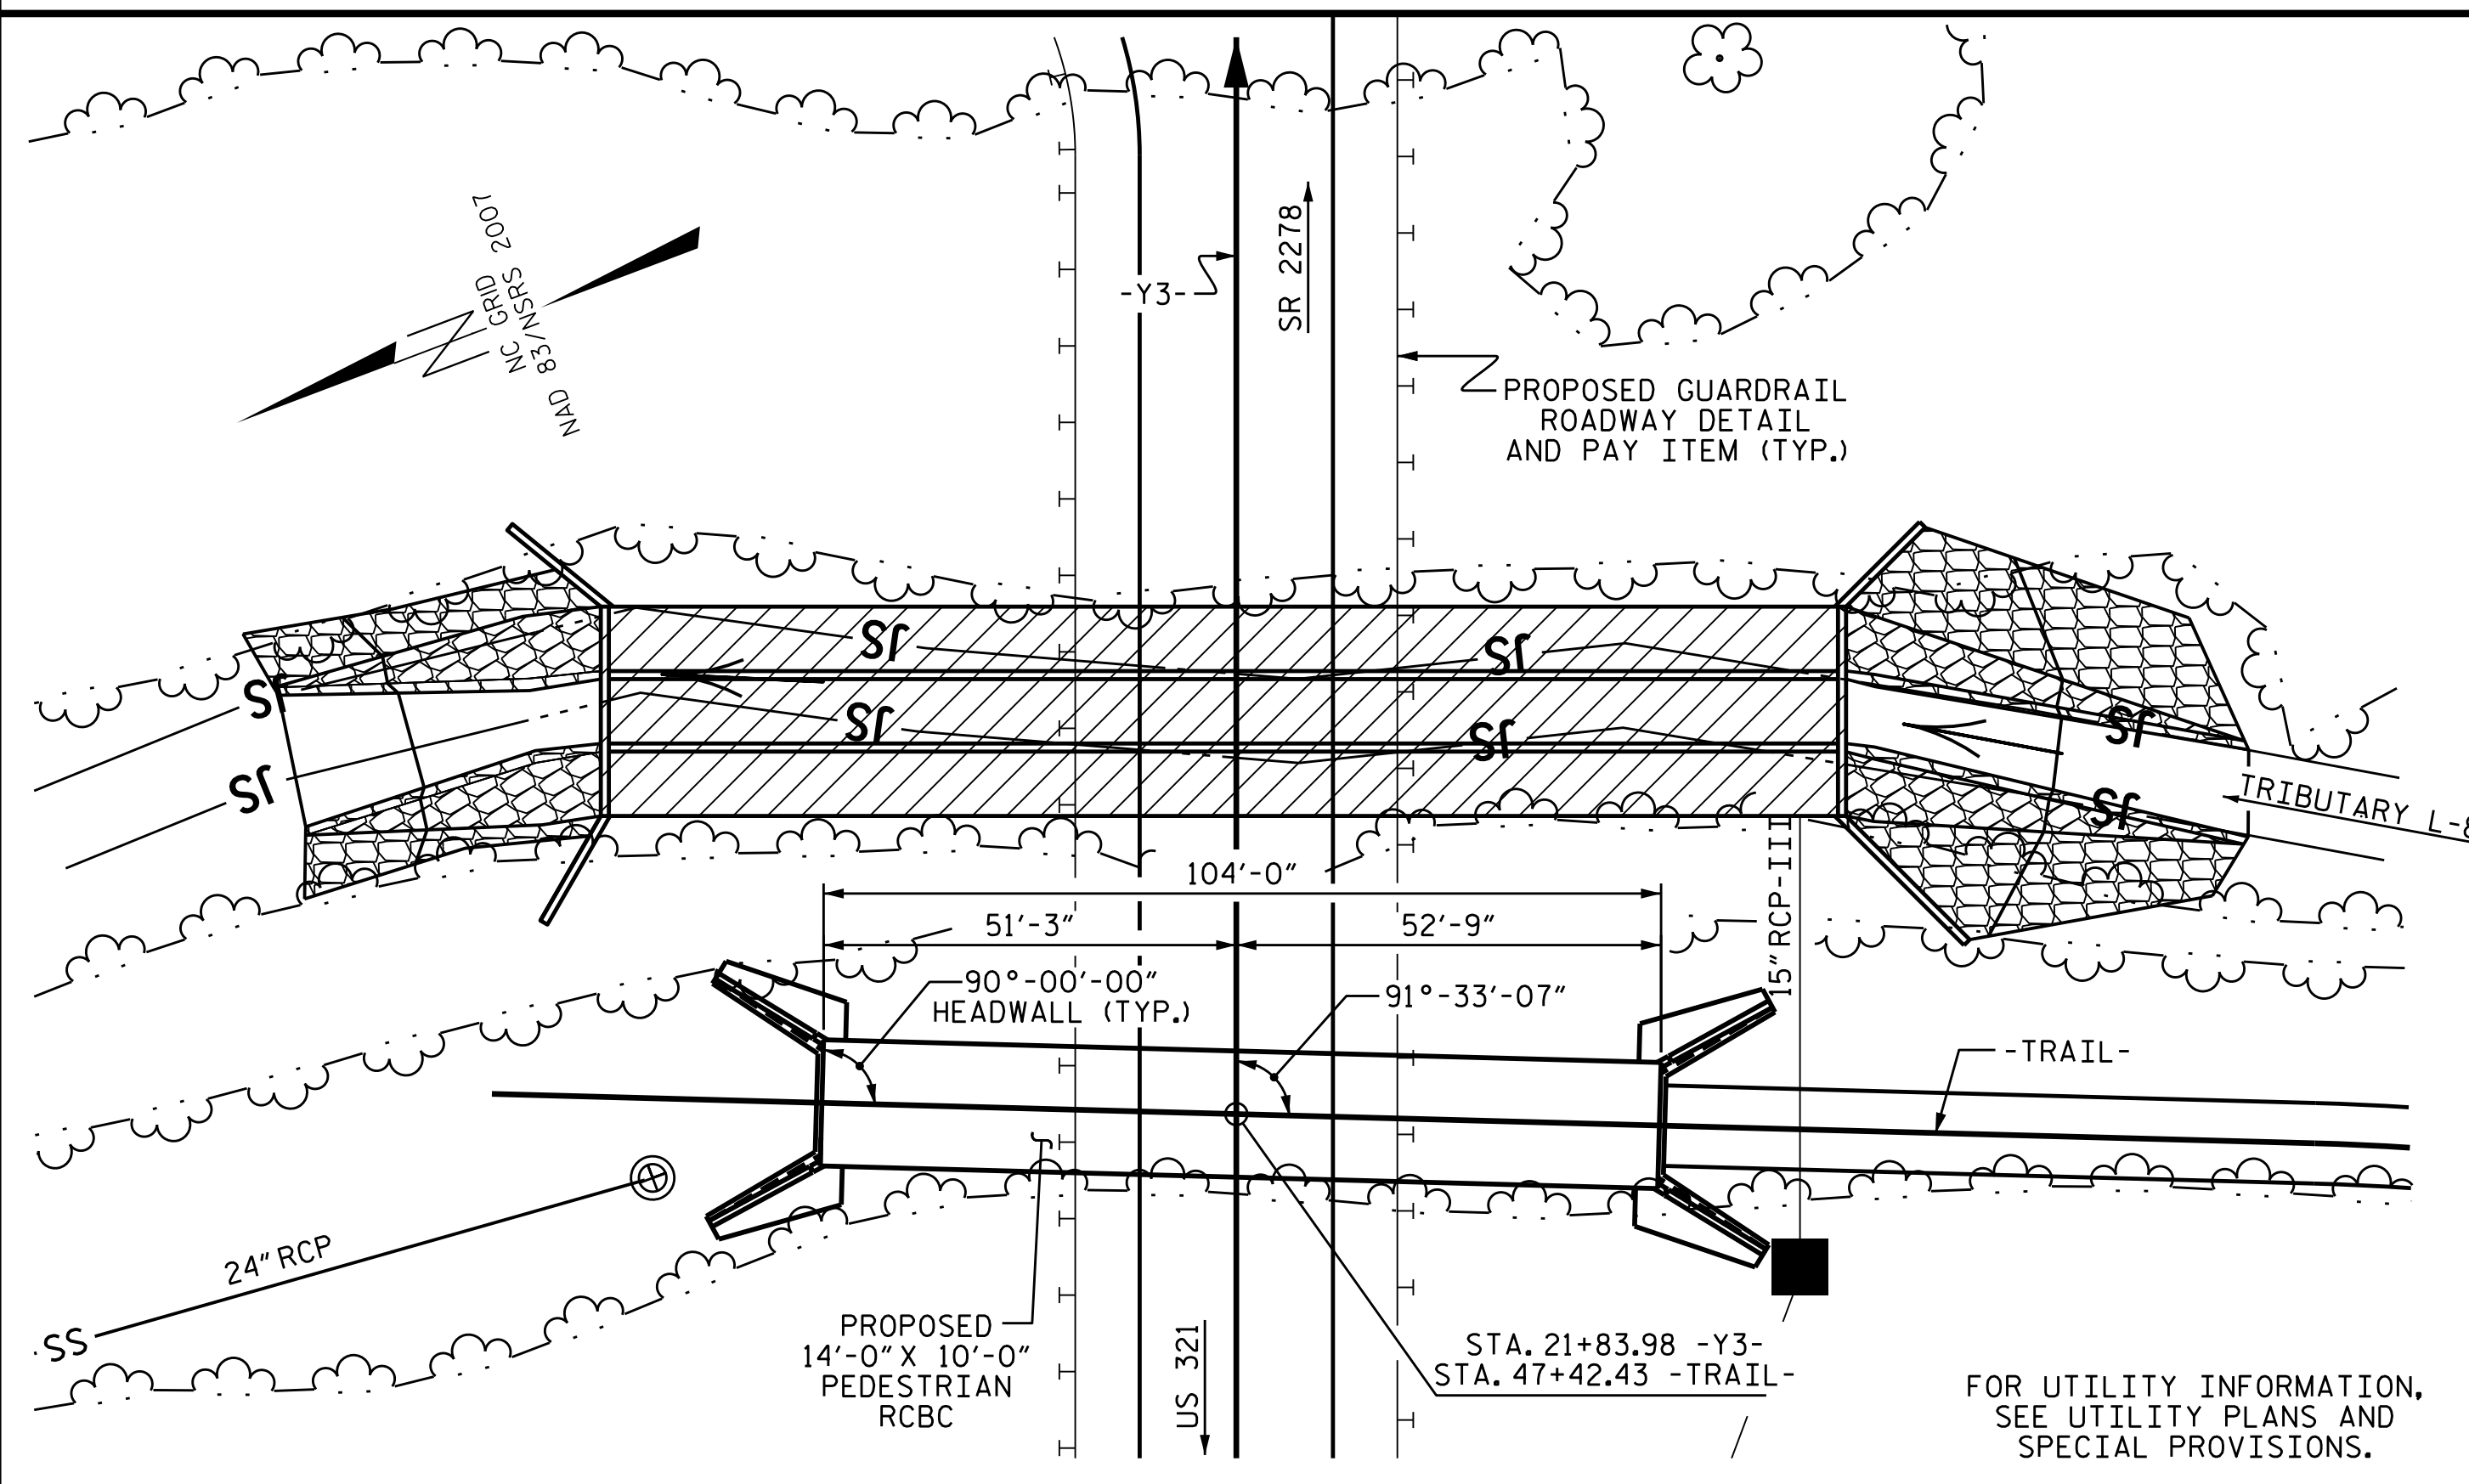

LOCATION SKETCH

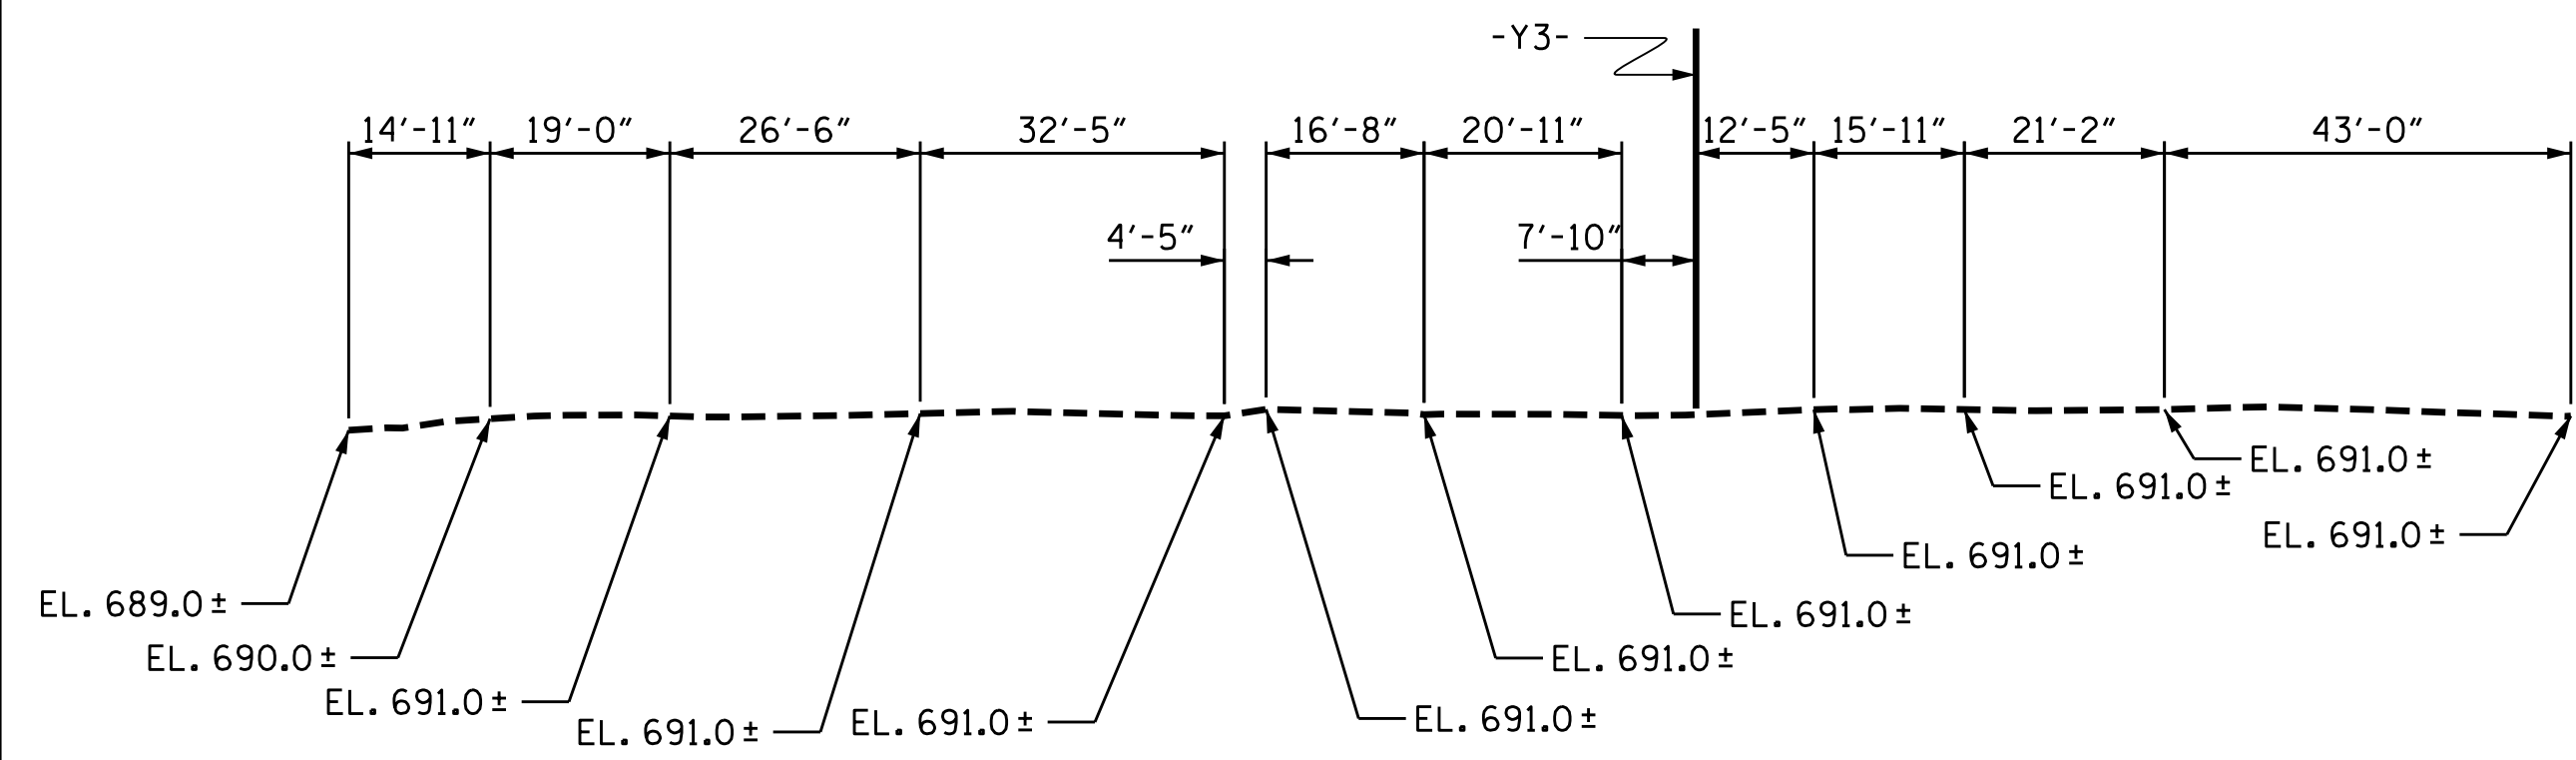

PROFILE ALONG CULVERT

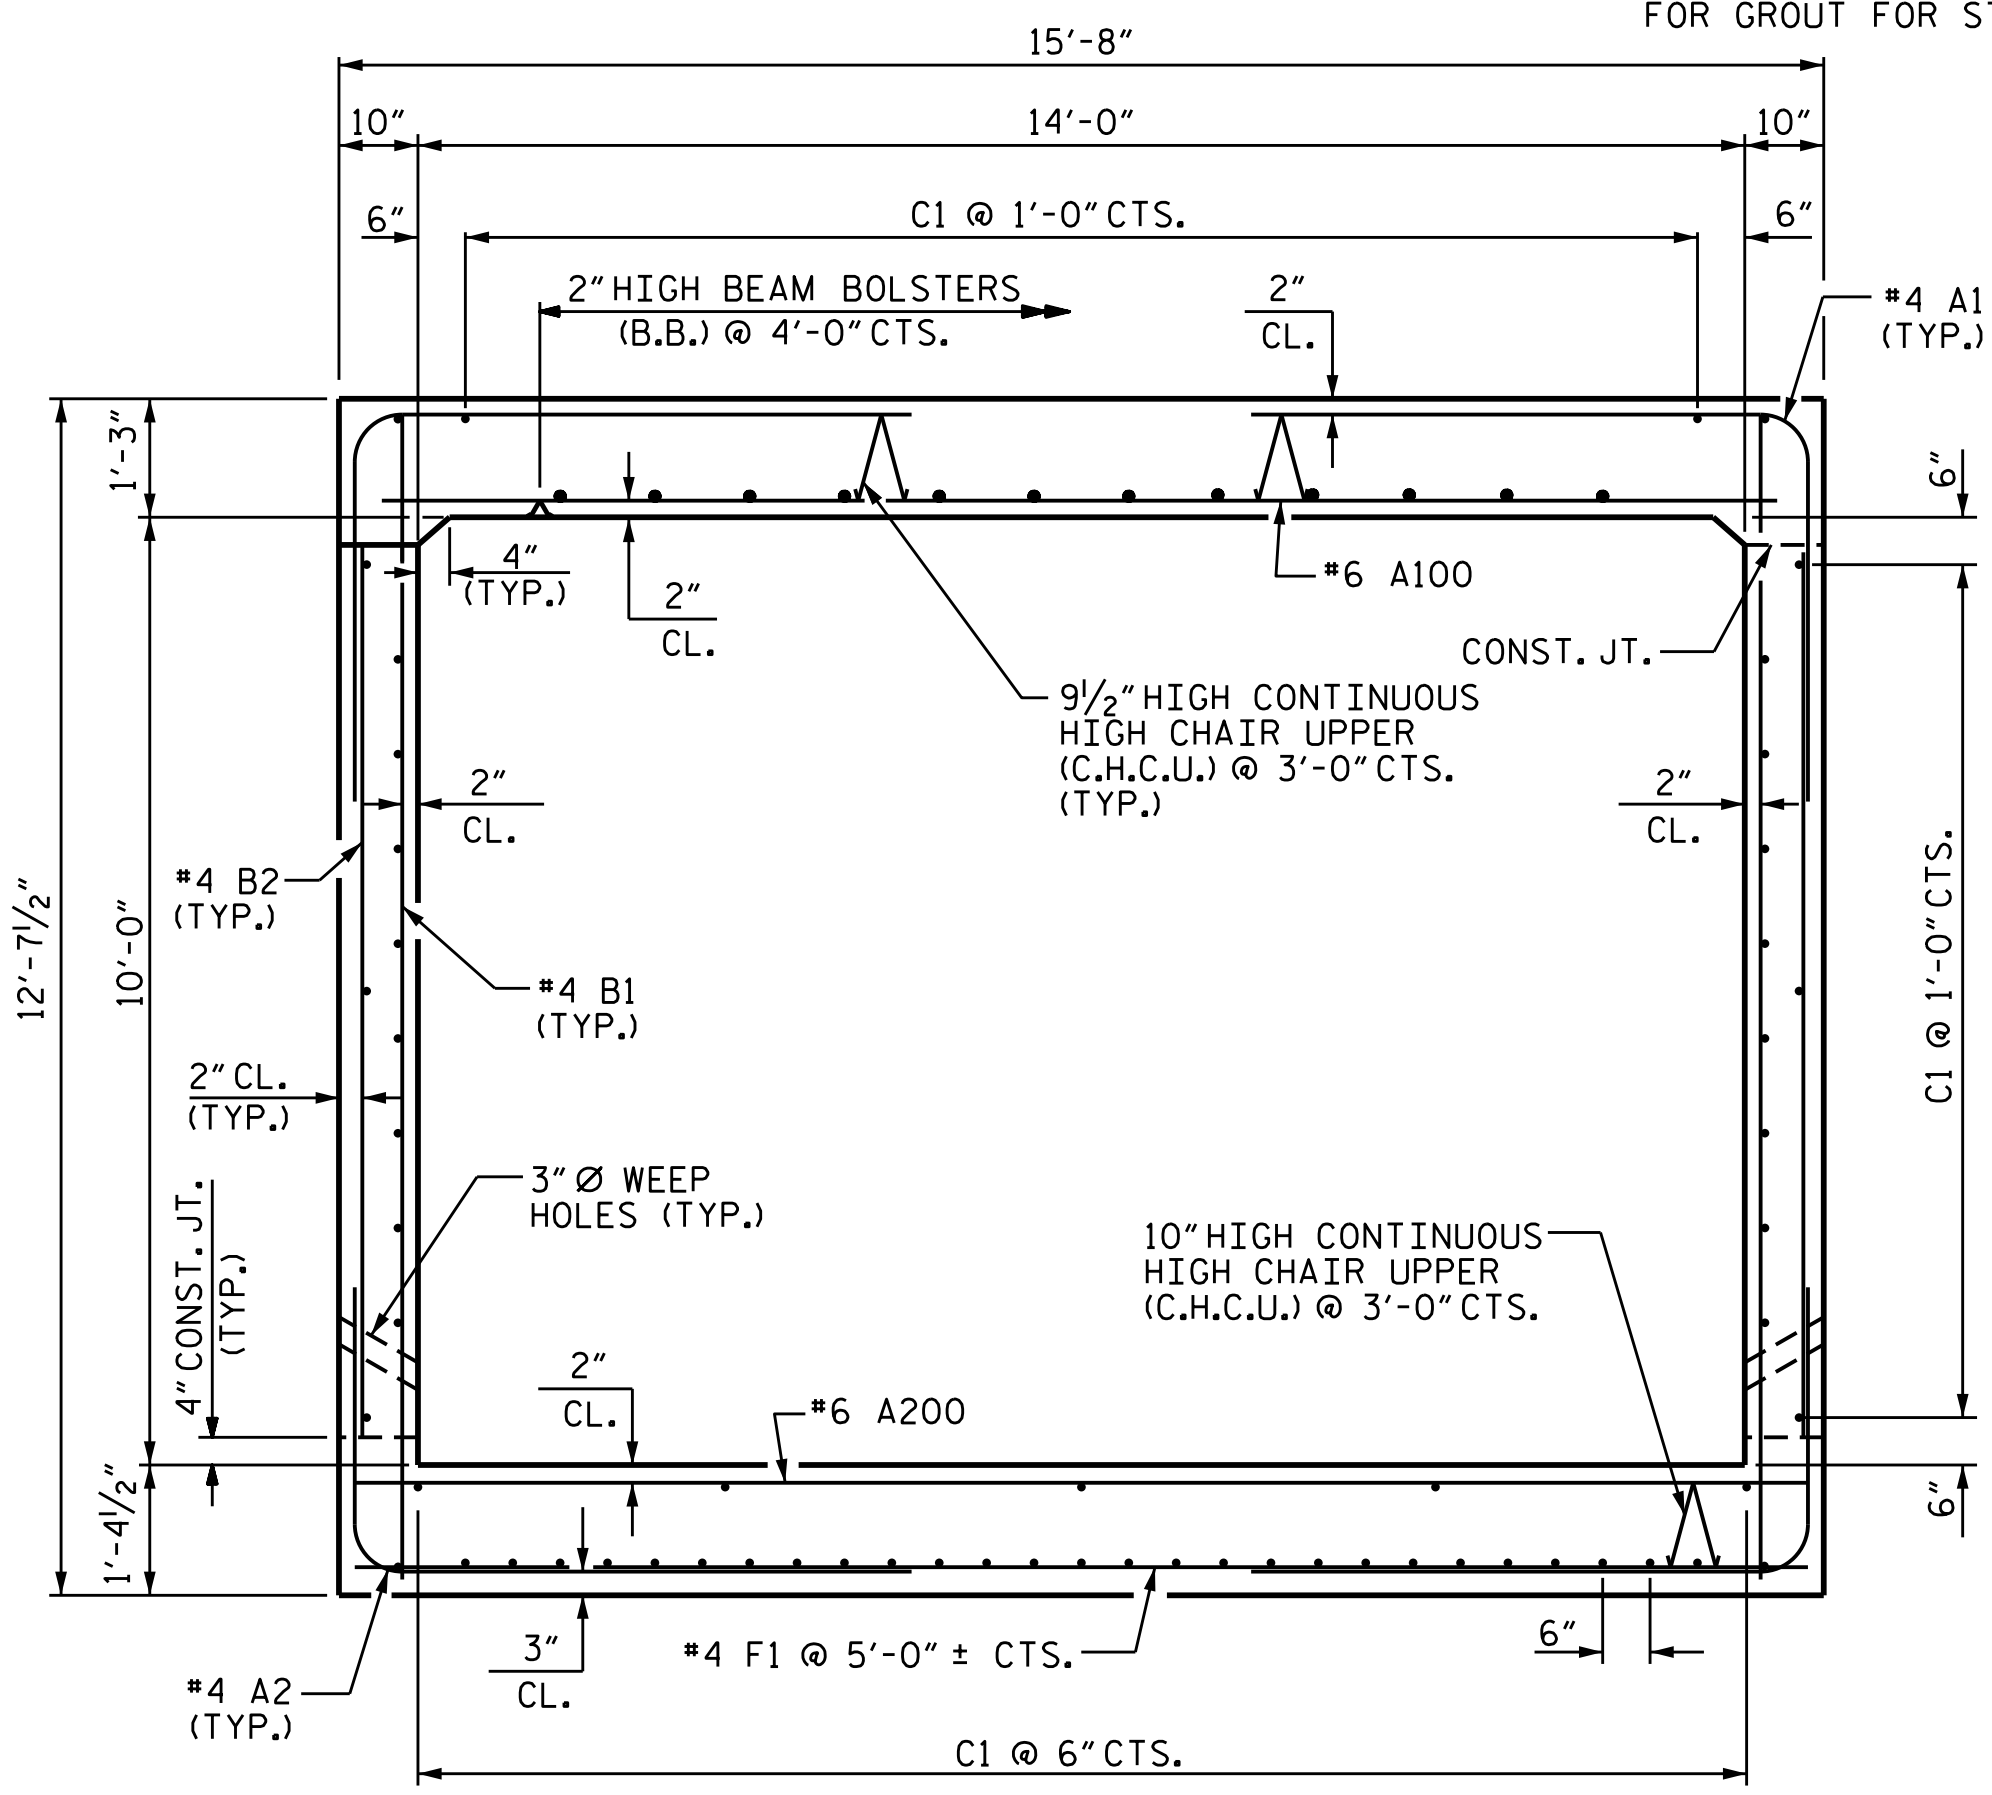

RIGHT ANGLE SECTION OF BARREL

THERE ARE 73 "C" BARS IN SECTION OF BARREL

ROADWAY DATA

GRADE POINT ELEV. @ STA. 21+83.98 -Y3- = 717.68  
 BED ELEV. @ STA. 47+42.43 -TRAIL- = 691.37  
 ROADWAY SLOPES = 2:1

TOTAL STRUCTURE QUANTITIES

CLASS A CONCRETE  
 BARREL @ 2.145 C.Y./FT. 223.1 CU.YDS.  
 WING ETC. 34.2 CU.YDS.  
 TOTAL 257.3 CU.YDS.

REINFORCING STEEL  
 BARREL 33170 LBS.  
 WINGS ETC. 2427 LBS.  
 TOTAL 35597 LBS.

CULVERT EXCAVATION LUMP SUM  
 FOUNDATION CONDITIONING MATERIAL 230.0 TONS

NOTES:


- ASSUMED LIVE LOAD ----- HL-93 OR ALTERNATE LOADING.
- DESIGN FILL ----- 15.55 FT. (MIN.) 16.67 FT. (MAX.)
- FOR OTHER DESIGN DATA AND NOTES SEE STANDARD NOTE SHEET.
- 3" Ø WEEP HOLES INDICATED TO BE IN ACCORDANCE WITH THE SPECIFICATIONS.
- CONCRETE IN CULVERTS TO BE POURED IN THE FOLLOWING ORDER:
  1. WING FOOTINGS, CURTAIN WALL AND FLOOR SLAB INCLUDING 4" OF ALL VERTICAL WALLS.
  2. THE REMAINING PORTIONS OF THE WALLS AND WINGS FULL HEIGHT FOLLOWED BY ROOF SLAB AND HEADWALLS.
- THE RESIDENT ENGINEER SHALL CHECK THE LENGTH OF CULVERT BEFORE STAKING IT OUT TO MAKE CERTAIN THAT IT WILL PROPERLY TAKE CARE OF THE FILL.
- DIMENSIONS FOR WING LAYOUT AS WELL AS ADDITIONAL REINFORCING STEEL EMBEDDED IN BARREL ARE SHOWN ON WING SHEET.
- TRANSVERSE CONSTRUCTION JOINTS SHALL BE USED IN THE BARREL, SPACED TO LIMIT THE POURS TO A MAXIMUM OF 70 FT. LOCATION OF JOINTS SHALL BE SUBJECT TO APPROVAL OF THE ENGINEER.
- AT THE CONTRACTOR'S OPTION, HE MAY SPLICE THE VERTICAL REINFORCING STEEL IN THE INTERIOR FACE OF EXTERIOR WALL ABOVE LOWER WALL CONSTRUCTION JOINT. THE SPLICE LENGTH SHALL BE AS PROVIDED IN THE SPLICE LENGTH CHART SHOWN ON THE PLANS. EXTRA WEIGHT OF STEEL DUE TO THE SPLICES SHALL BE PAID FOR BY THE CONTRACTOR.
- THE CONTRACTOR SHALL PROVIDE INDEPENDENT ASSURANCE SAMPLES OF REINFORCING STEEL AS FOLLOWS: FOR PROJECTS REQUIRING UP TO 400 TONS OF REINFORCING STEEL, ONE 30 INCH SAMPLE OF EACH SIZE BAR USED, AND FOR PROJECTS REQUIRING OVER 400 TONS OF REINFORCING STEEL, TWO 30 INCH SAMPLES OF EACH SIZE BAR USED. THE BARS FROM WHICH THE SAMPLES ARE TAKEN MUST THEN BE SPLICED WITH REPLACEMENT BARS OF THE SIZE AND LENGTH OF THE SAMPLE, PLUS A MINIMUM LAP SPLICE OF THIRTY BAR DIAMETERS. PAYMENT FOR THE SAMPLES OF REINFORCING STEEL SHALL BE CONSIDERED INCIDENTAL TO VARIOUS PAY ITEMS.
- A 3 FOOT STRIP OF FILTER FABRIC SHALL BE ATTACHED TO THE FILL FACE OF THE WING COVERING THE ENTIRE LENGTH OF THE EXPANSION JOINT.
- NO PRECAST REINFORCED BOX CULVERT OPTION WILL BE ALLOWED.
- FOR FALSEWORK AND FORMWORK, SEE SPECIAL PROVISIONS.
- FOR CRANE SAFETY, SEE SPECIAL PROVISIONS.
- FOR PEDESTRIAN CULVERT LIGHTING SYSTEMS, SEE SHEET C-26.
- FOR SUBMITTAL OF WORKING DRAWINGS, SEE SPECIAL PROVISIONS.
- FOR GROUT FOR STRUCTURES, SEE SPECIAL PROVISIONS.

F. A. PROJECT No.: IMF-085-1(113)17

PROJECT NO. I-5000  
 GASTON COUNTY  
 STATION: 21+83.98 -Y3-

SHEET 1 OF 4

STATE OF NORTH CAROLINA  
 DEPARTMENT OF TRANSPORTATION  
 RALEIGH  
 SINGLE 14 FT. X 10 FT.  
 RCBC  
 91°-33'-07" SKEW

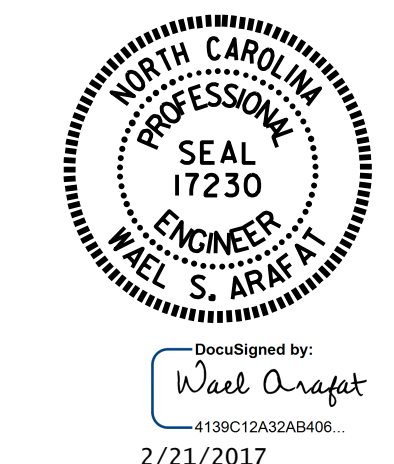

DRAWN BY: H. T. BARBOUR DATE: 8-15-16  
 CHECKED BY: A. M. LEE DATE: 9-28-16  
 DESIGN ENGINEER OF RECORD: O. PUIGSERVER DATE: 10-31-16

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

| REVISIONS |     |       |     | SHEET NO. |       |
|-----------|-----|-------|-----|-----------|-------|
| NO.       | BY: | DATE: | NO. | BY:       | DATE: |
| 1         |     |       | 3   |           |       |
| 2         |     |       | 4   |           |       |

C-1  
 TOTAL SHEETS  
 26

CULVERT #1