



**DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED**

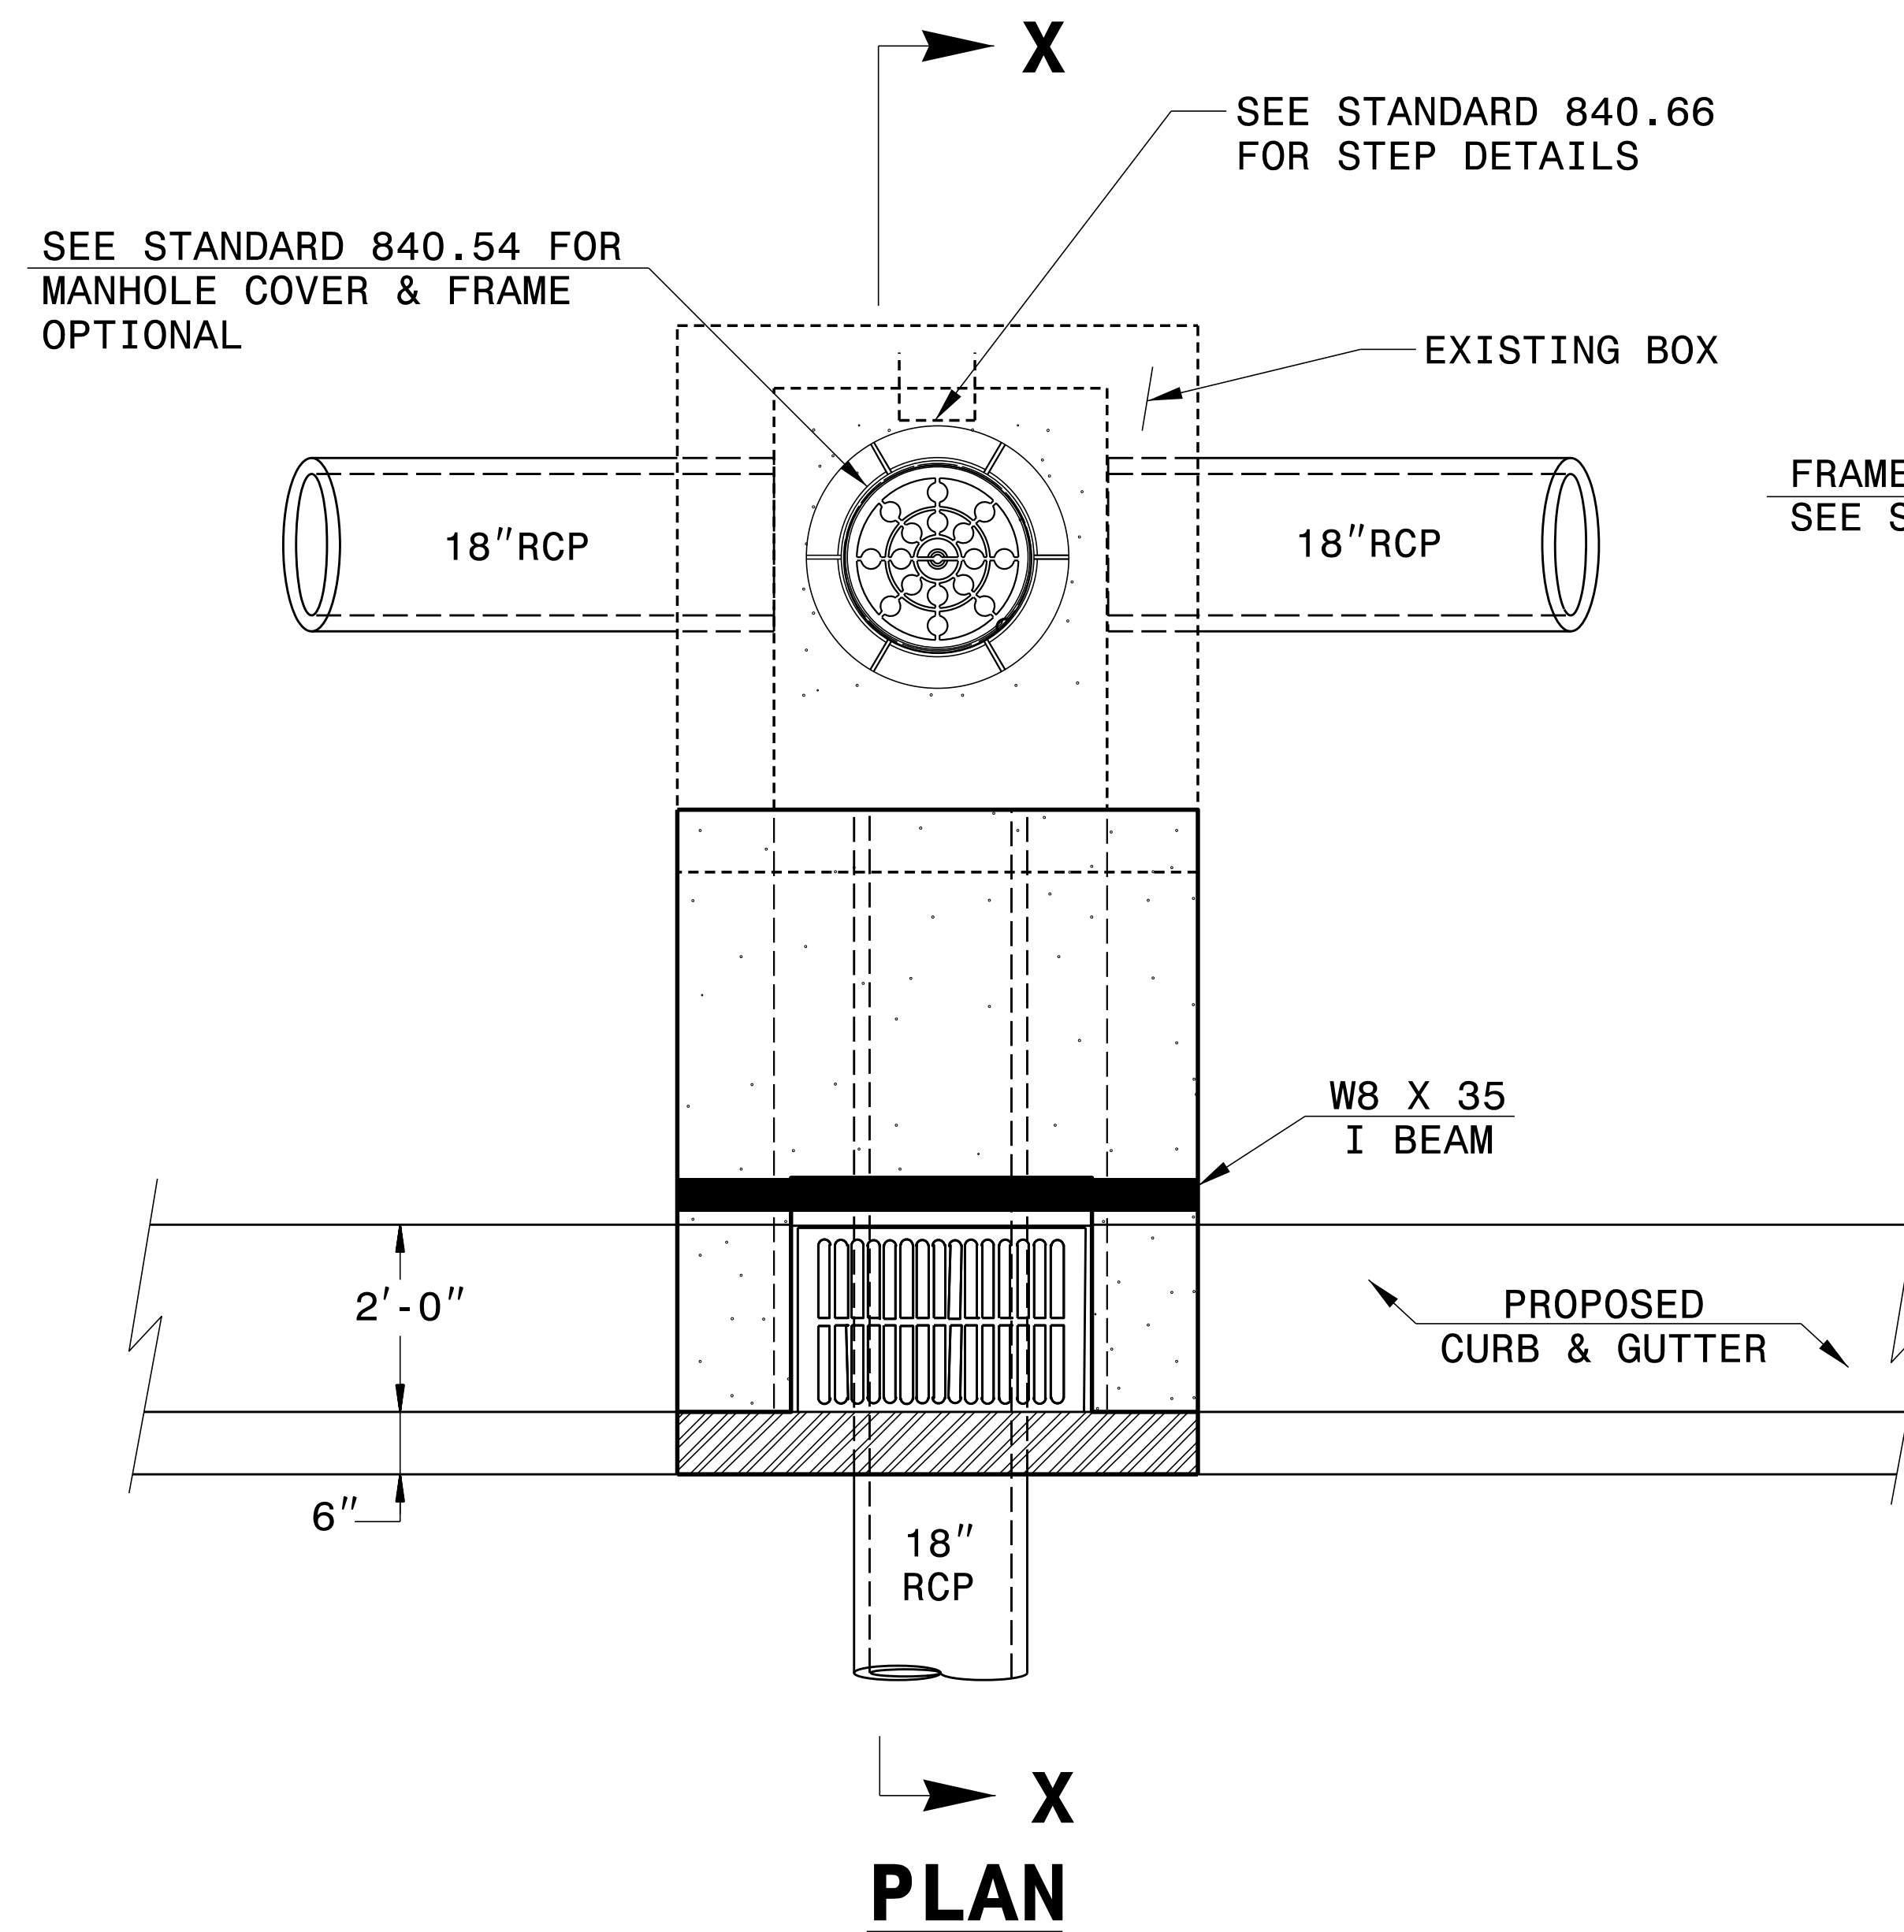

FRAME, GRATE AND HOOD
SEE STD. NO. 840.03

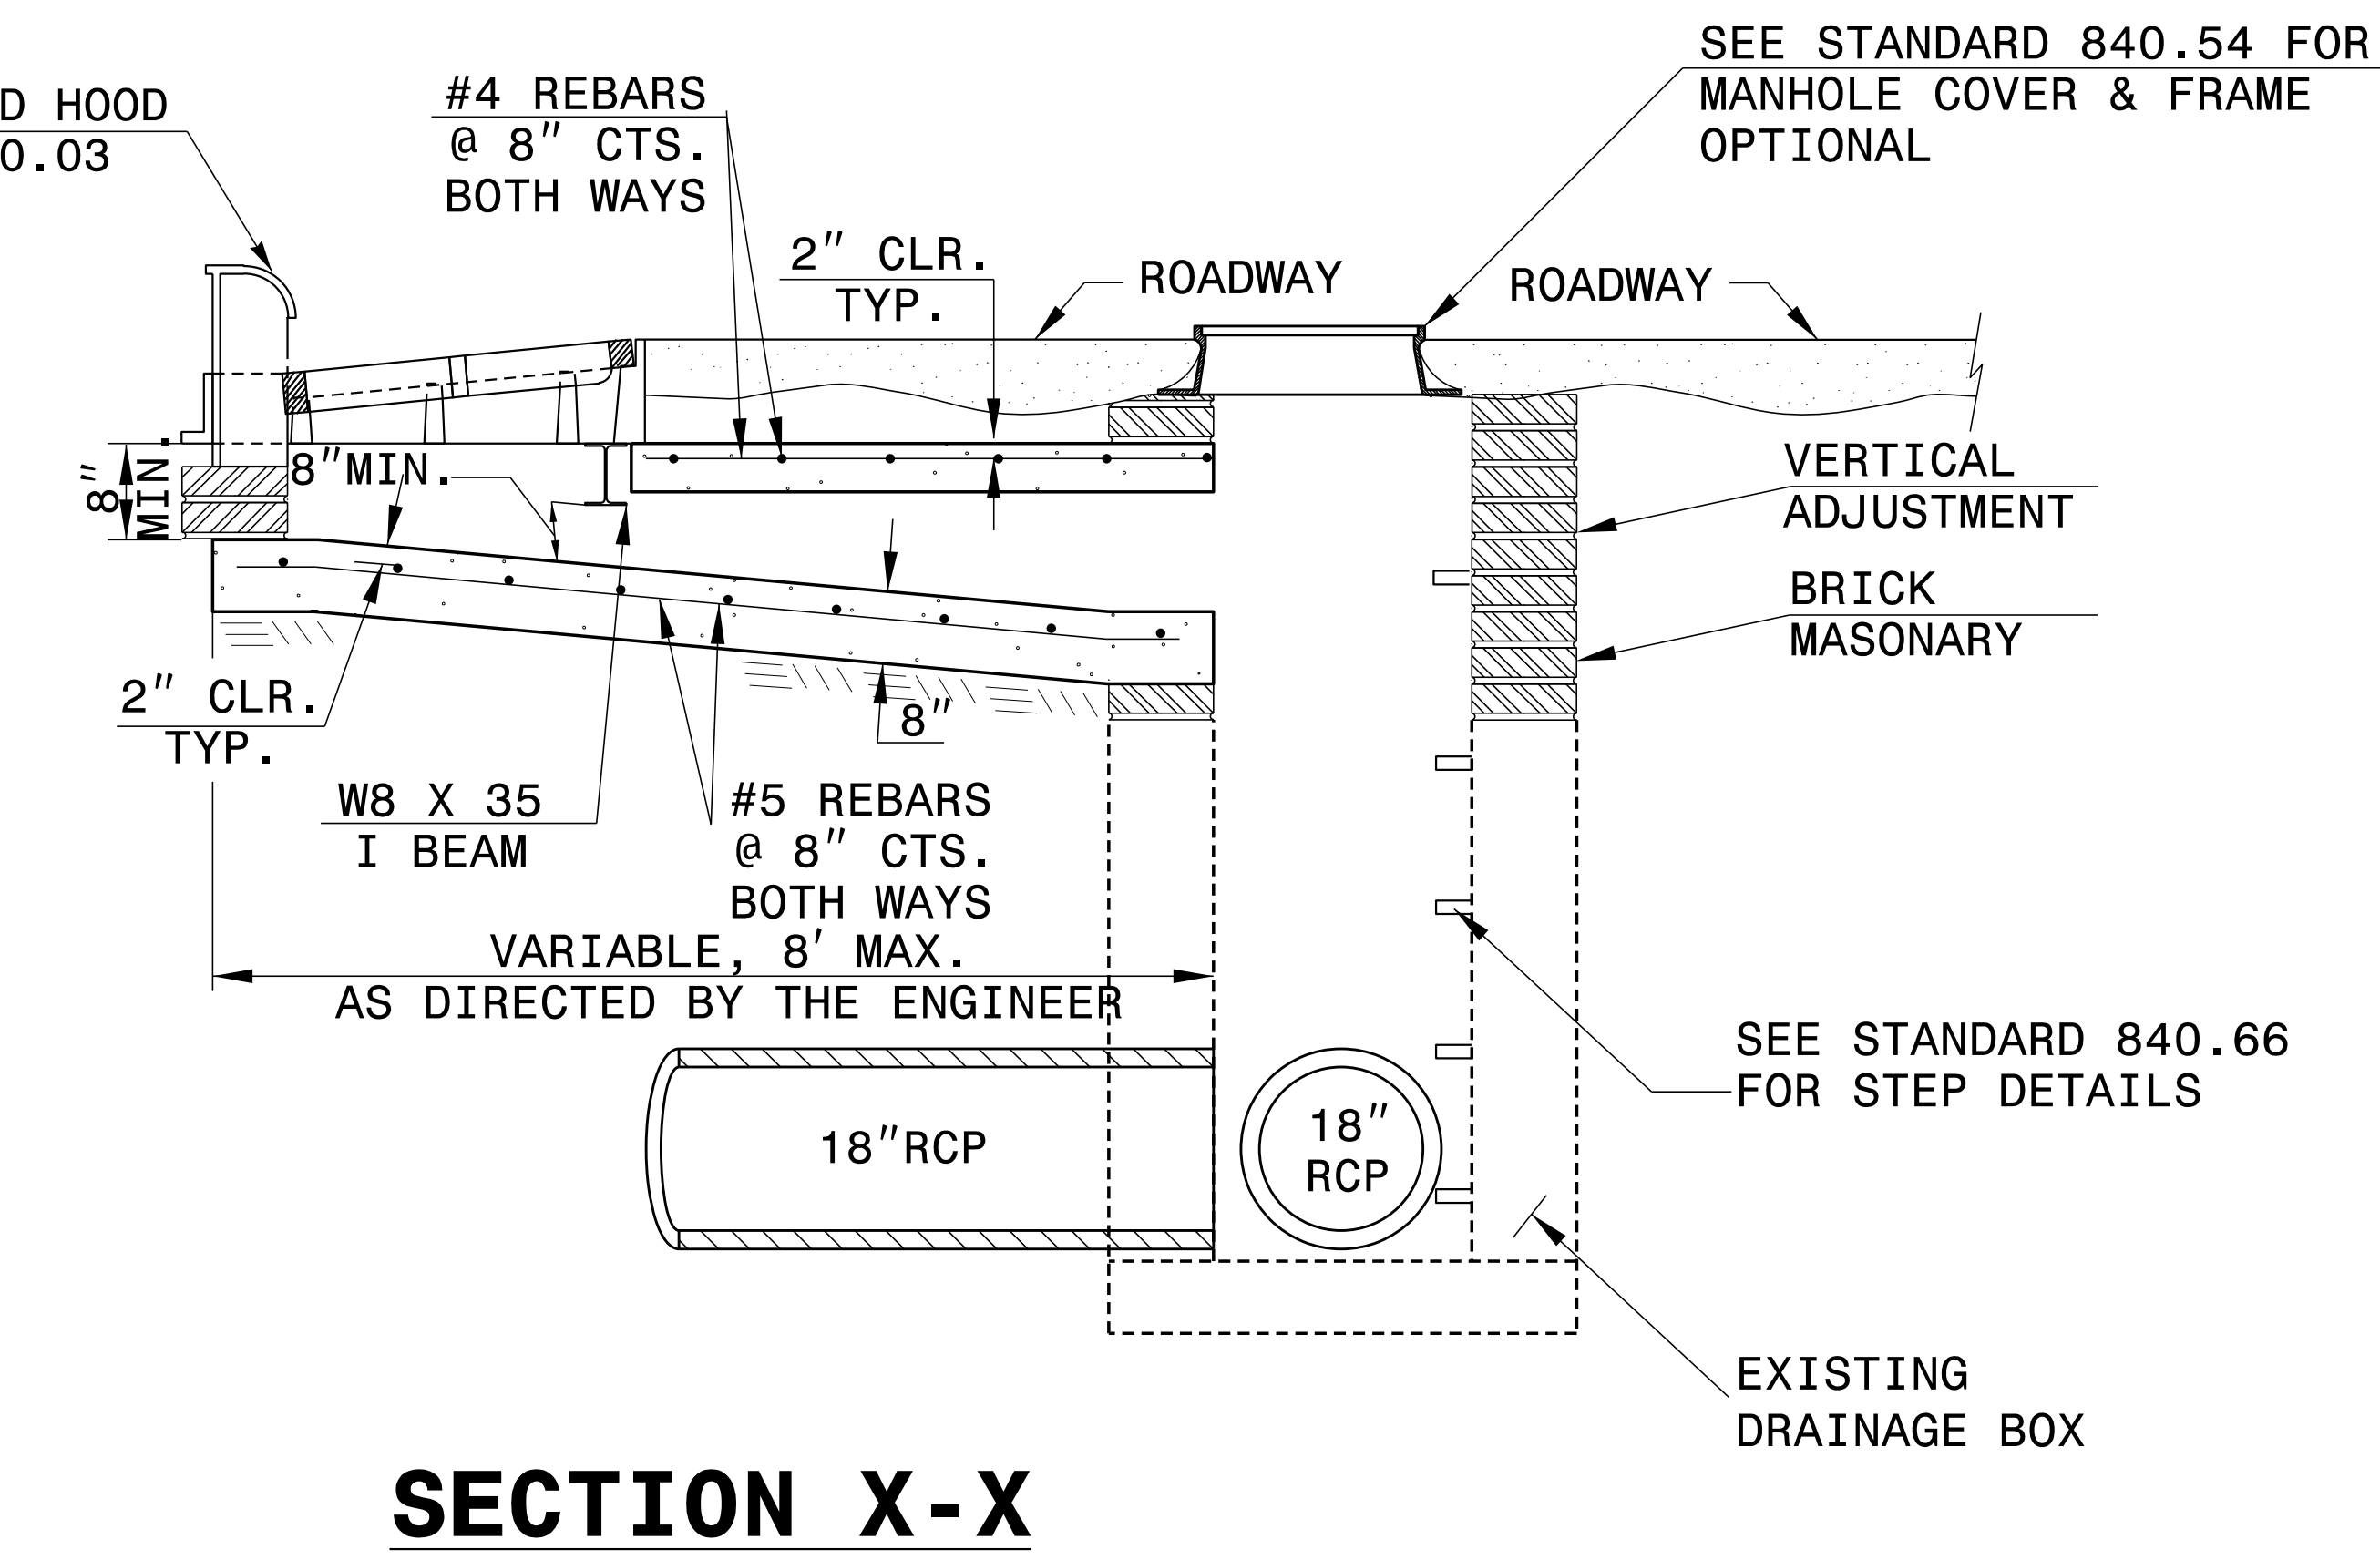

NOTES:
 MORTAR JOINTS 1/2" TO 1/4" THICK.
 USE CLASS "B" CONCRETE THROUGHOUT.
 USE TYPE "E", "F" AND "G" GRATES UNLESS OTHERWISE INDICATED.
 USE BRICK OR CONCRETE BLOCK WHICH COMPLIES WITH THE REQUIREMENTS
 OF SECTION 840 OF THE STANDARD SPECIFICATIONS.
 CHAMFER ALL EXPOSED CORNERS 1".
 ALL CONVERSIONS SHALL BE ACCORDANCE WITH SECTION 859 OF THE
 STANDARD SPECIFICATIONS.
 PROVIDE ALL CATCH BASINS OVER 3'-6" IN DEPTH WITH STEPS 12"
 ON CENTER. USE STEPS WHICH COMPLY WITH STD. DRAWING NO. 840.66.
 DRAWING NOT TO SCALE.

CONTRACT STANDARDS & DEVELOPMENT UNIT STANDARDS AND SPECIAL DESIGN Office 919-707-6950 FAX 919-250-4119	
CONVERSION OF EXISTING DRAINAGE BOX TO CATCH BASIN - DETAIL AA	
ORIGINAL BY: E.E. WARD	DATE: 1-24-02
MODIFIED BY: VMD	DATE: 4-08-15
CHECKED BY:	DATE:
FILE SPEC.: nbritt/english/hydro/edb_to_offsetcb.dgn	

12/21/2016 9:04:48 AM
N:\Roadway\Proj\W5520_Rej_psh_0201.dgn
awt