
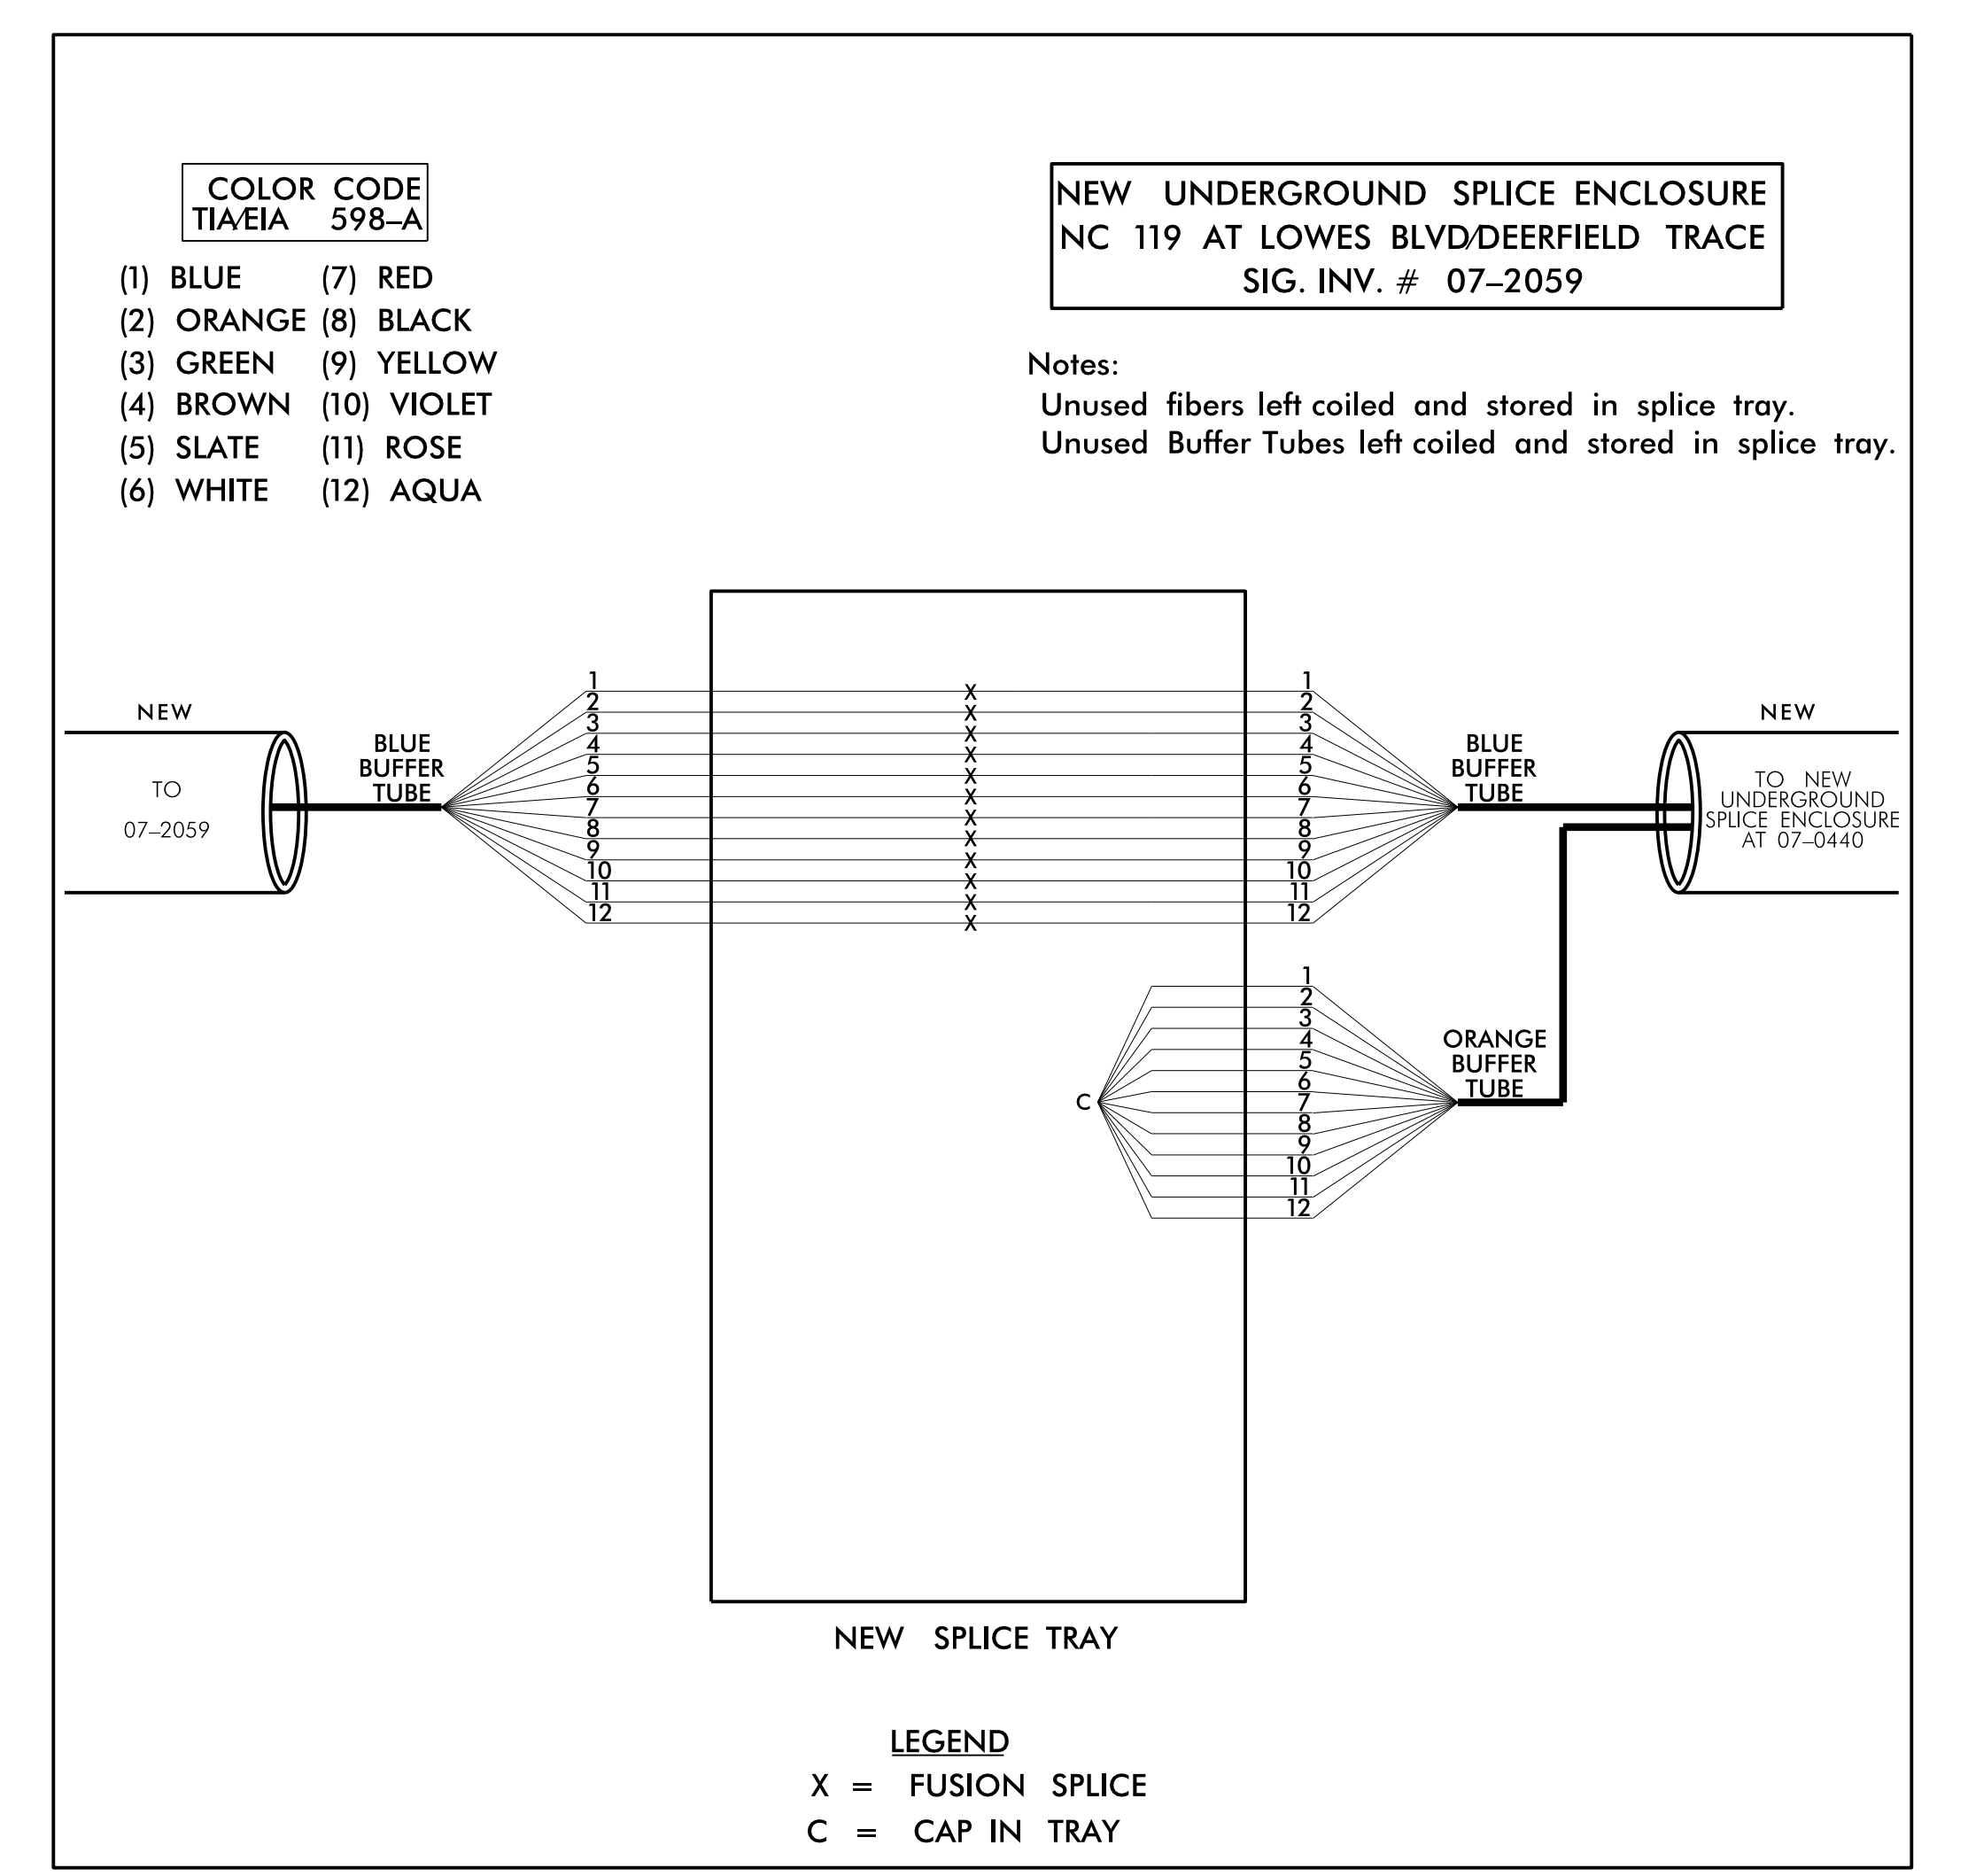


# TMP PHASE III - FINAL

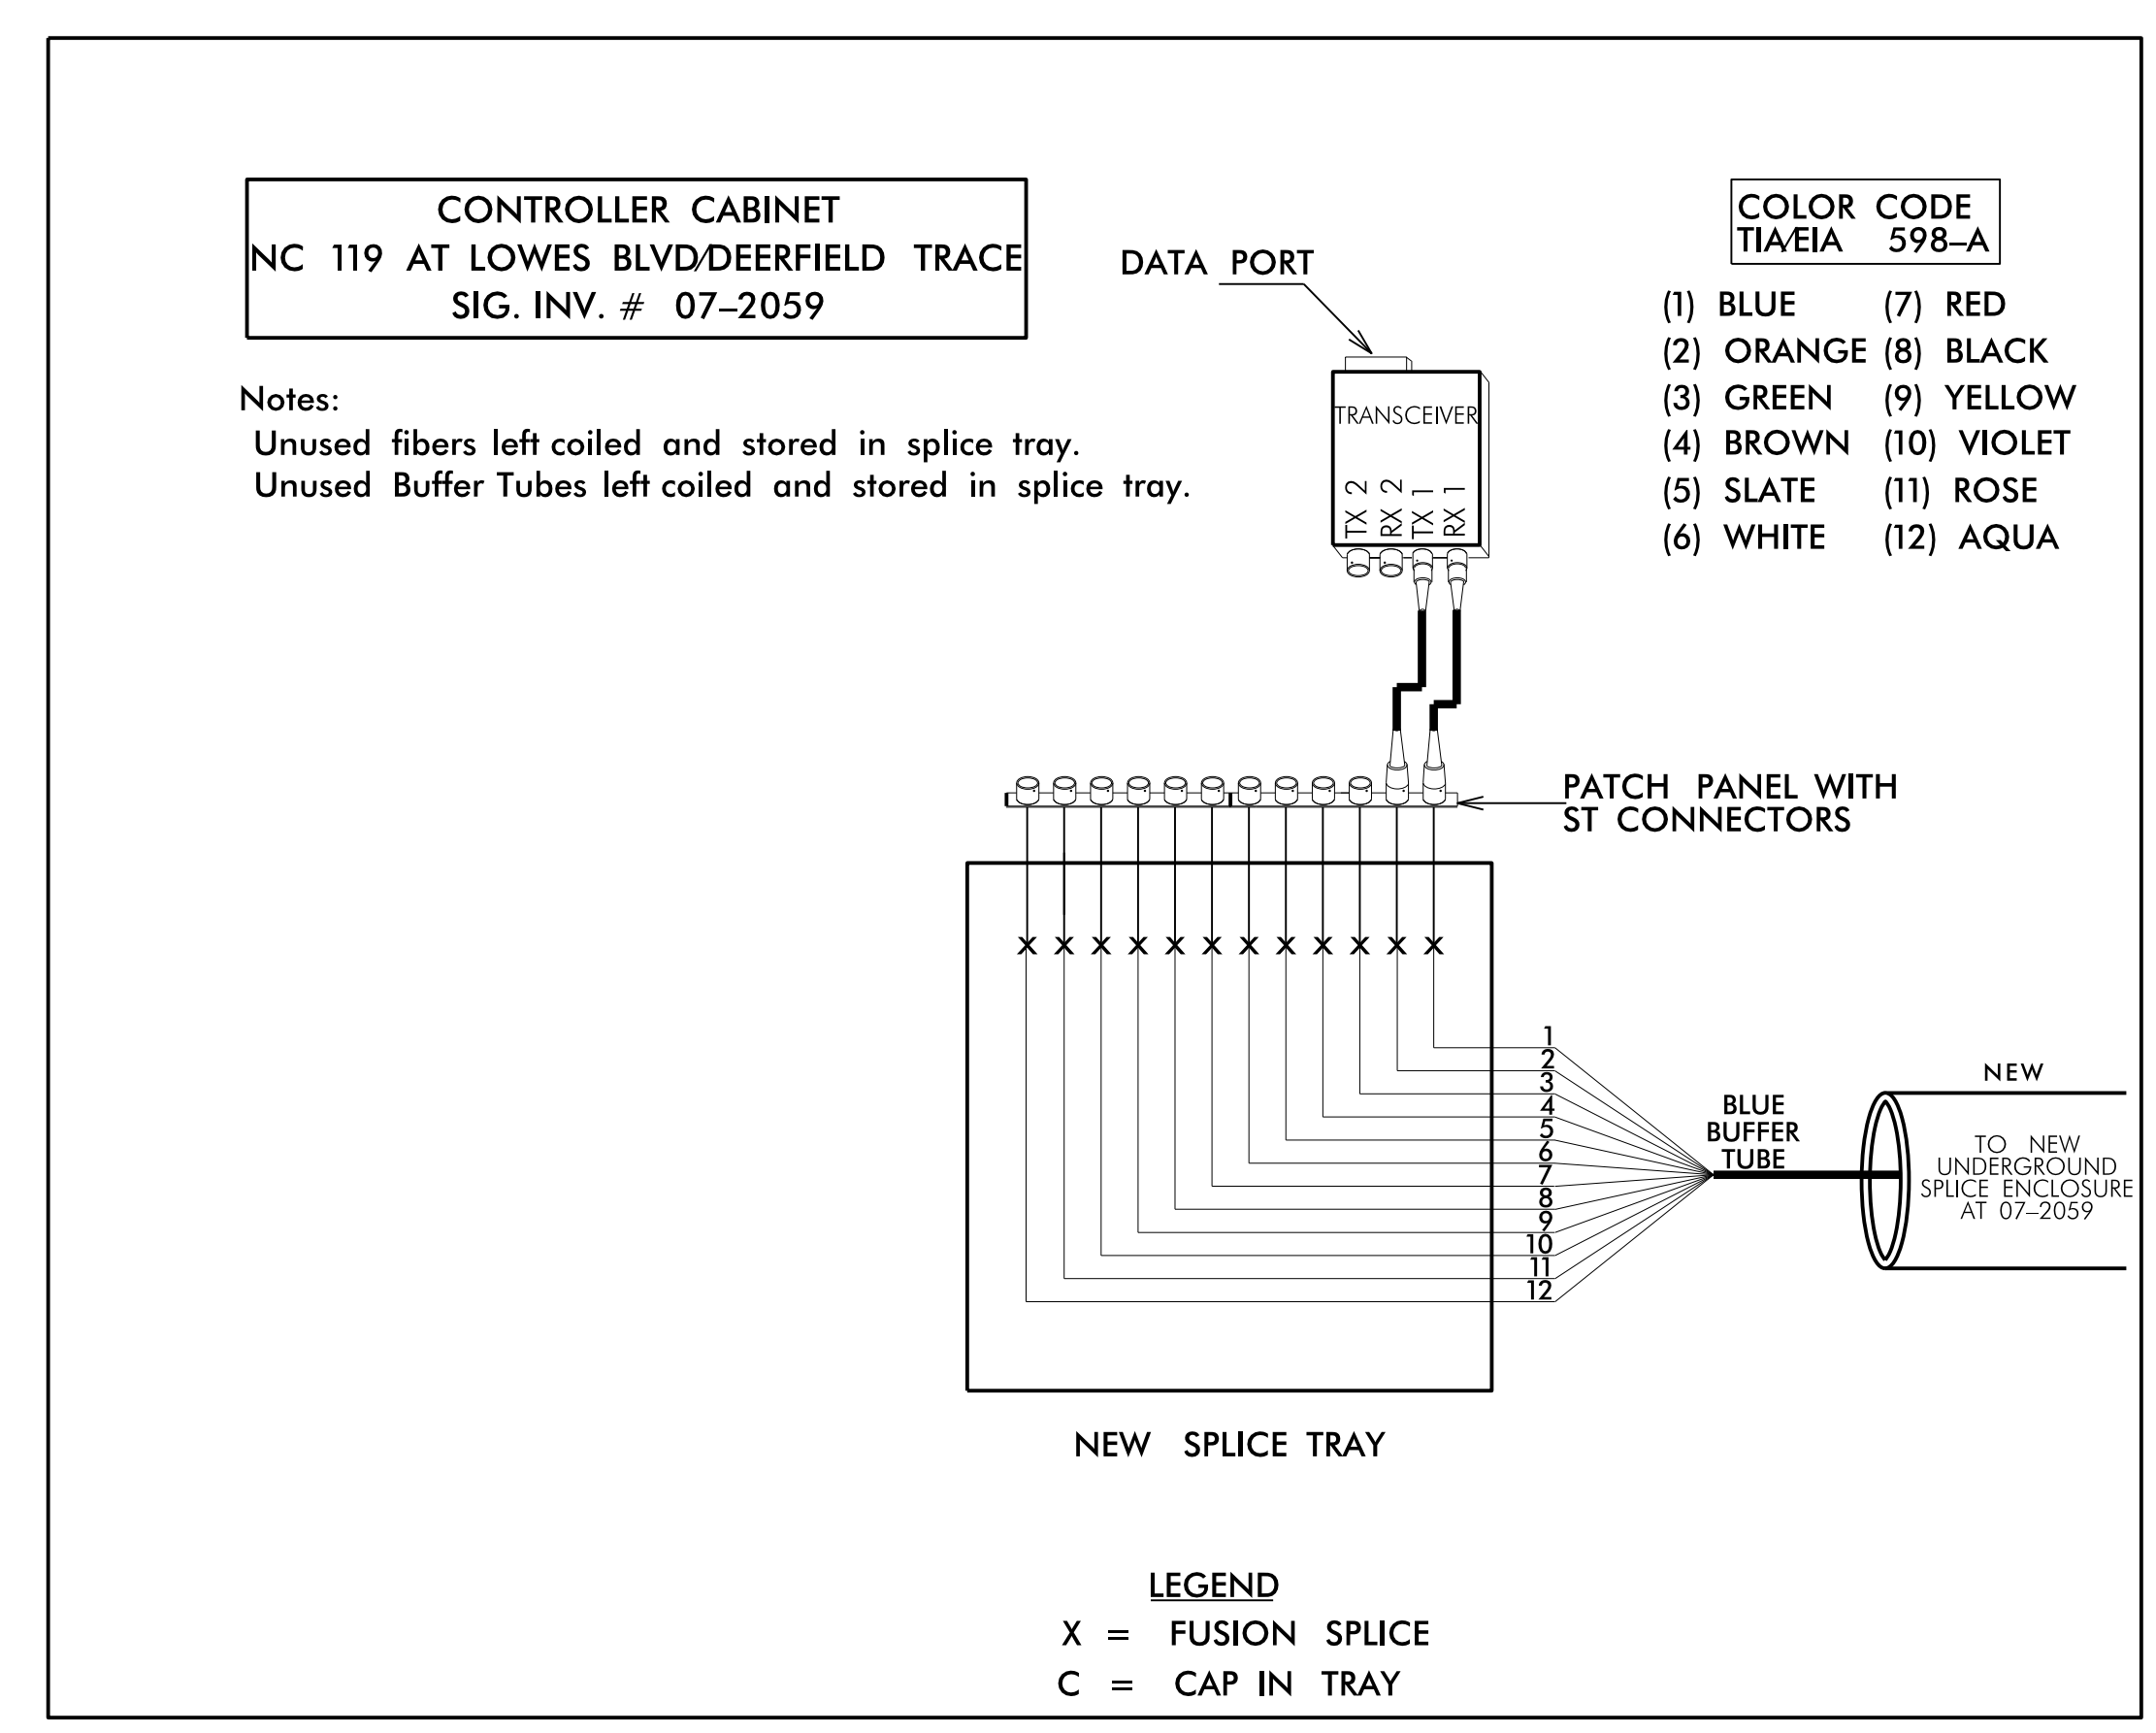

- 1) TRANSCEIVER TERMINATION CONFIGURATIONS ARE GENERIC. CONTRACTOR IS RESPONSIBLE FOR DETERMINING \ ENSURING PROPER TERMINATIONS.
- 2) INCLUDE ON THE COVER OF EACH SPlice TRAY THE FOLLOWING: REFERENCE SECTION 1731 "FIBER OPTIC SPlice ENCLOSURE"
  - 1) SPlice LOCATION
  - 2) DATE
  - 3) COMPANY NAME
  - 4) NAME OF INDIVIDUAL PERFORMING THE SPlicing

PRIOR TO INSTALLING THE COVER ON THE SPlice TRAY TAKE A DIGITAL PHOTOGRAPH SHOWING THE SPlice TRAY AND INFORMATION SHOWN ABOVE (1-4) AND SUBMIT PHOTOGRAPH ALONG WITH OTDR TEST RESULTS.

TMP PHASE III - FINAL

**DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED**

|   |  |   |      |
|---|--|---|------|
|   | <b>SPlice DETAIL</b>   |   |      |
|   | DIVISION 07 ALAMANCE COUNTY<br>PLAN DATE: JANUARY 2017<br>PREPARED BY: A. J. SKUCE | REVIEWED BY: <i>Neil Avery</i><br>DATE: |      |
| REVISIONS                                 |  | INIT.                                   | DATE |
| 750 N. Greenfield Pkwy., Garner, NC 27529 |  | Gregory A. Fuller 1/27/2017             |      |