


EDI MODEL 2010ECL-NC CONFLICT MONITOR PROGRAMMING DETAIL


(remove jumpers and set switches as shown)

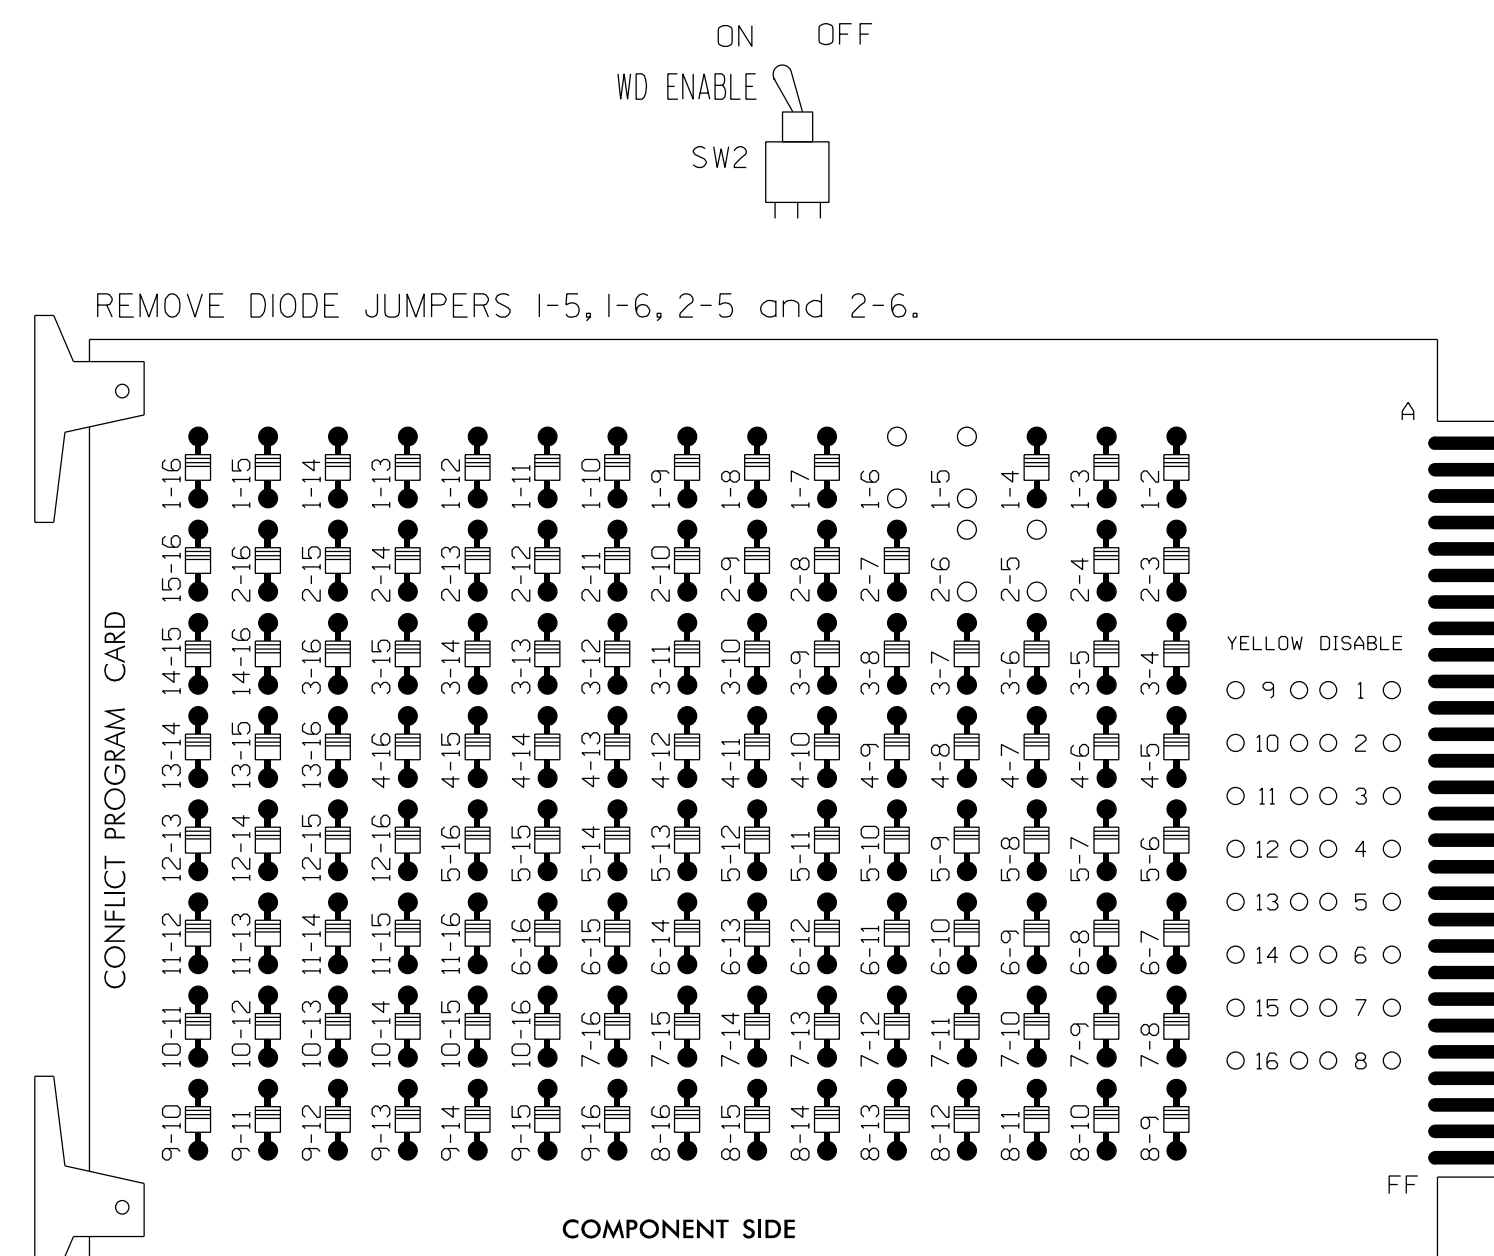

REMOVE JUMPERS AS SHOWN

NOTES:

- Card is provided with all diode jumpers in place. Removal of any jumper allows its channels to run concurrently.
- Make sure jumpers SEL2-SEL5 are present on the monitor board.

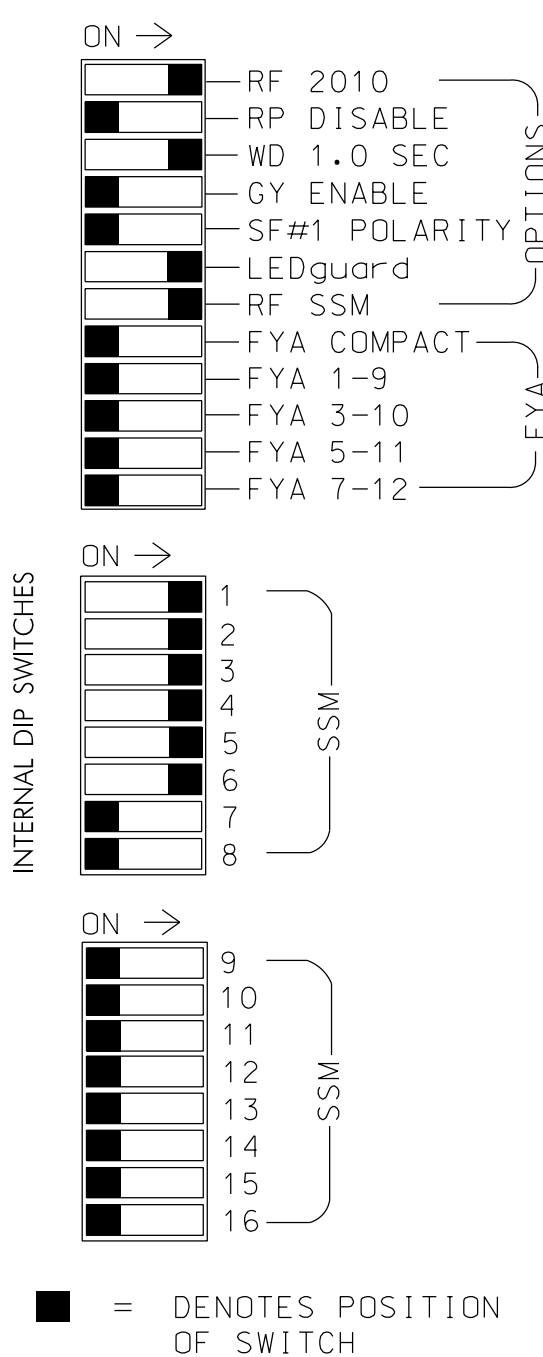

NOTES

- To prevent "flash-conflict" problems, insert red flash program blocks for all unused vehicle load switches in the output file. The installer shall verify that signal heads flash in accordance with the Signal Plans.
- Ensure that Red Enable is active at all times during normal operation. To prevent Red Failures on unused monitor channels, tie unused red monitor inputs 7,8,9,10, 11,12,13,14,15 & 16 to load switch AC+ per the cabinet manufacturer's instructions.
- Enable Simultaneous Gap-Out for all phases.
- Program phases 2 and 6 for Start Up In Green.
- Program phases 2 and 6 for Yellow Flash.
- The cabinet and controller are part of the Rocky Mount Signal System.

EQUIPMENT INFORMATION

CONTROLLER.....2070
 CABINET.....EXISTING 332
 SOFTWARE.....ECONOLITE OASIS
 CABINET MOUNT.....BASE
 OUTPUT FILE POSITIONS...12
 LOAD SWITCHES USED.....S1,S2,S3,S4,S5,S6
 PHASES USED.....1,2,3,4,5,6

PROJECT REFERENCE NO.	SHEET NO.
U-3330	Sig. 4.3

SIGNAL HEAD HOOK-UP CHART

LOAD SWITCH NO.	S1	S2	S2P	S3	S4	S4P	S5	S6	S6P	S7	S8	S8P
PHASE	1	2	2 PED	3	4	4 PED	5	6	6 PED	7	8	8 PED
SIGNAL HEAD NO.	11	21,22	NU	31	32	41	42	NU	51	61,62	NU	NU
RED		128		116	116	101	101			134		
YELLOW		129		117	117	102	102			135		
GREEN		130		118	118	103	103			136		
RED ARROW	125									131		
YELLOW ARROW	126									132		
GREEN ARROW	127									133		

NU = Not Used


EMERGENCY VEHICLE PREEMPTION PROGRAMMING DETAIL

(program controller as shown below)

From Main Menu press 'A' (Preemption), then '1' (Standard Preemptions). Press 'NEXT' to advance to Preemption #3 and 5.

INPUT FILE POSITION LAYOUT


(front view)

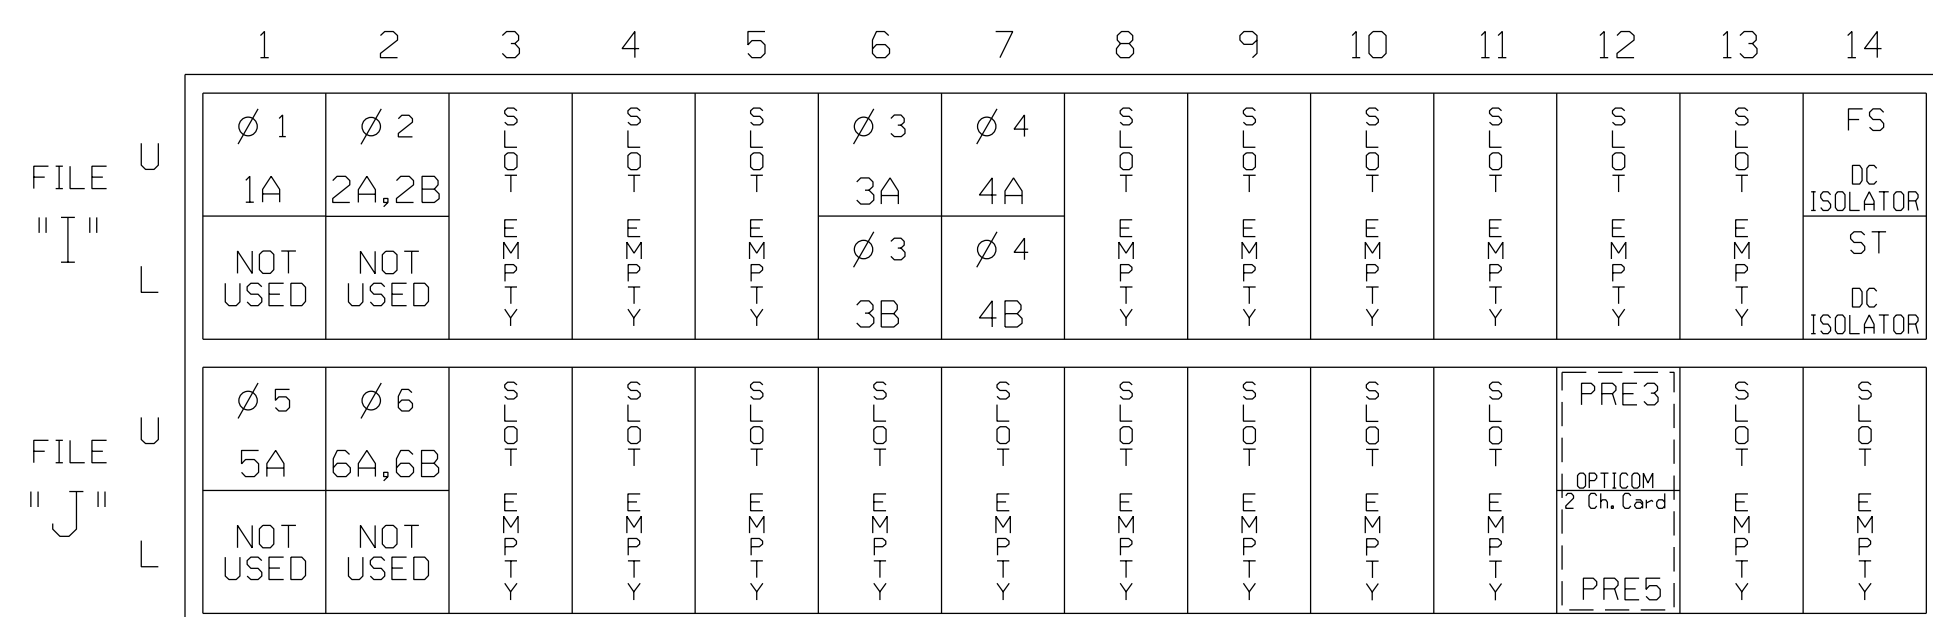

EX.: 1A, 2A, ETC. = LOOP NO.'S

FS = FLASH SENSE
 ST = STOP TIME
 PRE = PREEMPT

INPUT FILE POSITION LEGEND: J2L

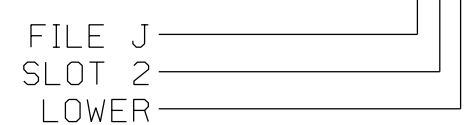


INPUT FILE CONNECTION & PROGRAMMING CHART

LOOP NO.	LOOP TERMINAL	INPUT FILE POS.	PIN NO.	INPUT ASSIGNMENT NO.	DETECTOR NO.	NEMA PHASE	CALL	EXTEND	FULL TIME DELAY	STRETCH TIME	DELAY TIME
1A	TB2-1,2	I1U	56	18	1	1	Y	Y			
2A,2B	TB2-5,6	I2U	39	1	2	2	Y	Y			
3A	TB4-9,10	I6U	41	3	4	3	Y	Y			3
3B	TB4-11,12	I6L	45	7	14	3	Y	Y			15
4A	TB6-1,2	I7U	65	27	34	4	Y	Y			3
4B	TB6-3,4	I7L	78	40	44	4	Y	Y			10
5A	TB3-1,2	J1U	55	17	5	5	Y	Y			
6A,6B	TB3-5,6	J2U	40	2	6	6	Y	Y			

THIS ELECTRICAL DETAIL IS FOR THE SIGNAL DESIGN: 04-0666
 DESIGNED: November 2016
 SEALED: 1/30/2017
 REVISED:

TYPICAL OPTICOM FIELD WIRE DETAIL

(input file, rear view)

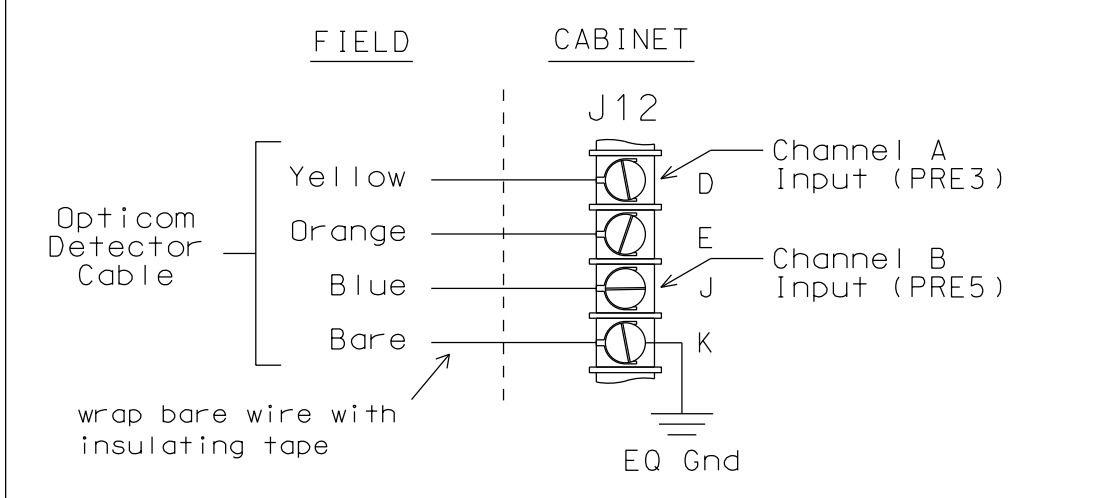

PREEMPTION #3	SETTINGS (NEXT:1-10)
INTERVAL/TIMING	CLEAR/DWELL PHASES
GRN YEL RED	12345678910111213141516
1 255 0.0 0.0	X X
2 0 0.0 0.0	
3 0 0.0 0.0	
4 0 0.0 0.0	
5 0 0.0 0.0	

EXIT CALLS	OPTIONS
PRIORITY (Y/N TO SELECT)	MED
DELAY TIMER (0-255 SEC)	0
MIN GREEN BEFORE PRE (0= DEFAULT)...	1
PED CLEAR BEFORE PRE (0= DEFAULT)...	0
YELLOW CLEAR BEFORE PRE (0= DEFAULT)...	0,0
RED CLEAR BEFORE PRE (0= DEFAULT)...	0,0
DWELL MIN TIMER (0-255 SEC)	10
DWELL MAX TIMER (0=OFF,1-255MIN)	0
DWELL HOLD-OVER TIMER (0-255)	0
LATCH CALL?	N
LINK TO NEXT PREEMPT?	N
ENABLE BACKUP PROTECTION?	N
HOLD CLEAR 1 PHASES DURING DELAY?	N
FAST GREEN FLASH DWELL PHASES?	N
PED CLEARANCE THROUGH YELLOW?	N
INHIBIT OVERLAP GREEN EXTENSION?	N
SERVICE DURING SOFTWARE FLASH?	N
REST IN RED DURING DWELL INTERVAL?	N
FLASH DWELL INTERVAL?	N
ALLOW PEDS IN DWELL INTERVAL?	N
RE-TIME DWELL INTERVAL?	N
OVERLAPS:	ABCDEFGHIJKLMNPO
DWELL INT FLASH YELLOW	
OMIT OVERLAPS:	

PRESS 'NEXT' TWICE

Program extend time an optical detector unit for 5.0 seconds.

PREEMPTION #5	SETTINGS (NEXT:1-10)
INTERVAL/TIMING	CLEAR/DWELL PHASES
GRN YEL RED	12345678910111213141516
1 255 0.0 0.0	X X
2 0 0.0 0.0	
3 0 0.0 0.0	
4 0 0.0 0.0	
5 0 0.0 0.0	

EXIT CALLS	OPTIONS
PRIORITY (Y/N TO SELECT)	MED
DELAY TIMER (0-255 SEC)	0
MIN GREEN BEFORE PRE (0= DEFAULT)...	1
PED CLEAR BEFORE PRE (0= DEFAULT)...	0
YELLOW CLEAR BEFORE PRE (0= DEFAULT)...	0,0
RED CLEAR BEFORE PRE (0= DEFAULT)...	0,0
DWELL MIN TIMER (0-255 SEC)	10
DWELL MAX TIMER (0=OFF,1-255MIN)	0
DWELL HOLD-OVER TIMER (0-255)	0
LATCH CALL?	N
LINK TO NEXT PREEMPT?	N
ENABLE BACKUP PROTECTION?	N
HOLD CLEAR 1 PHASES DURING DELAY?	N
FAST GREEN FLASH DWELL PHASES?	N
PED CLEARANCE THROUGH YELLOW?	N
INHIBIT OVERLAP GREEN EXTENSION?	N
SERVICE DURING SOFTWARE FLASH?	N
REST IN RED DURING DWELL INTERVAL?	N
FLASH DWELL INTERVAL?	N
ALLOW PEDS IN DWELL INTERVAL?	N
RE-TIME DWELL INTERVAL?	N
OVERLAPS:	ABCDEFGHIJKLMNPO
DWELL INT FLASH YELLOW	
OMIT OVERLAPS:	

PROGRAMING COMPLETE

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

ELECTRICAL DETAIL - TMP Area 1, Phase III & Final Design

ELECTRICAL AND PROGRAMMING DETAILS FOR: Prepared for the Offices of: 	US 64 Business (Sunset Avenue) at Irving Street Division 04 Nash County Rocky Mount		SEAL NORTH CAROLINA PROFESSIONAL ENGINEER SEAL 025892 MELISSA B. TOTH
	PLAN DATE: November 2016 PREPARED BY: AM Encarnacion	REVIEWED BY: MB Toth REVIEWED BY:	
REVISIONS:		INIT. DATE:	SIGNED BY:
1616 EAST MILLBROOK ROAD, SUITE 160 RALEIGH, NORTH CAROLINA 27609 (919) 876-6888 NCBEEES #F-0326		750 N. Greenfield Pkwy, Garner, NC 27529	

ATKINS 1616 EAST MILLBROOK ROAD, SUITE 160
 RALEIGH, NORTH CAROLINA 27609
 (919) 876-6888 NCBEEES #F-0326