


PROJECT REFERENCE NO.	SHEET NO.
U-3330	UC-8
DESIGNED BY: GJB	
DRAWN BY: GJB	
CHECKED BY: KCZ	
APPROVED BY: KCZ	
REVISER:	3/2/2017
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION	UTILITY CONSTRUCTION PLANS ONLY
UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151	


UTILITY OWNERS ON THIS PROJECT:
 CITY OF ROCKY MOUNT
 WATER LINES: 6", 8", 16", 20"
 SANITARY SEWER: 8"
 CONTACT: DONALD M. PERRY, PE
 PHONE: (252) 972-1122

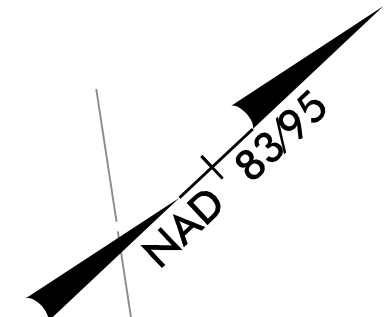

UTILITY CONSTRUCTION

M A Engineering Consultants, Inc.
 NC License: F-0160
 598 East Chatham Street Suite 137 Cary, NC 27511
 Phone: 919.297.0220 Fax: 919.297.0221

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

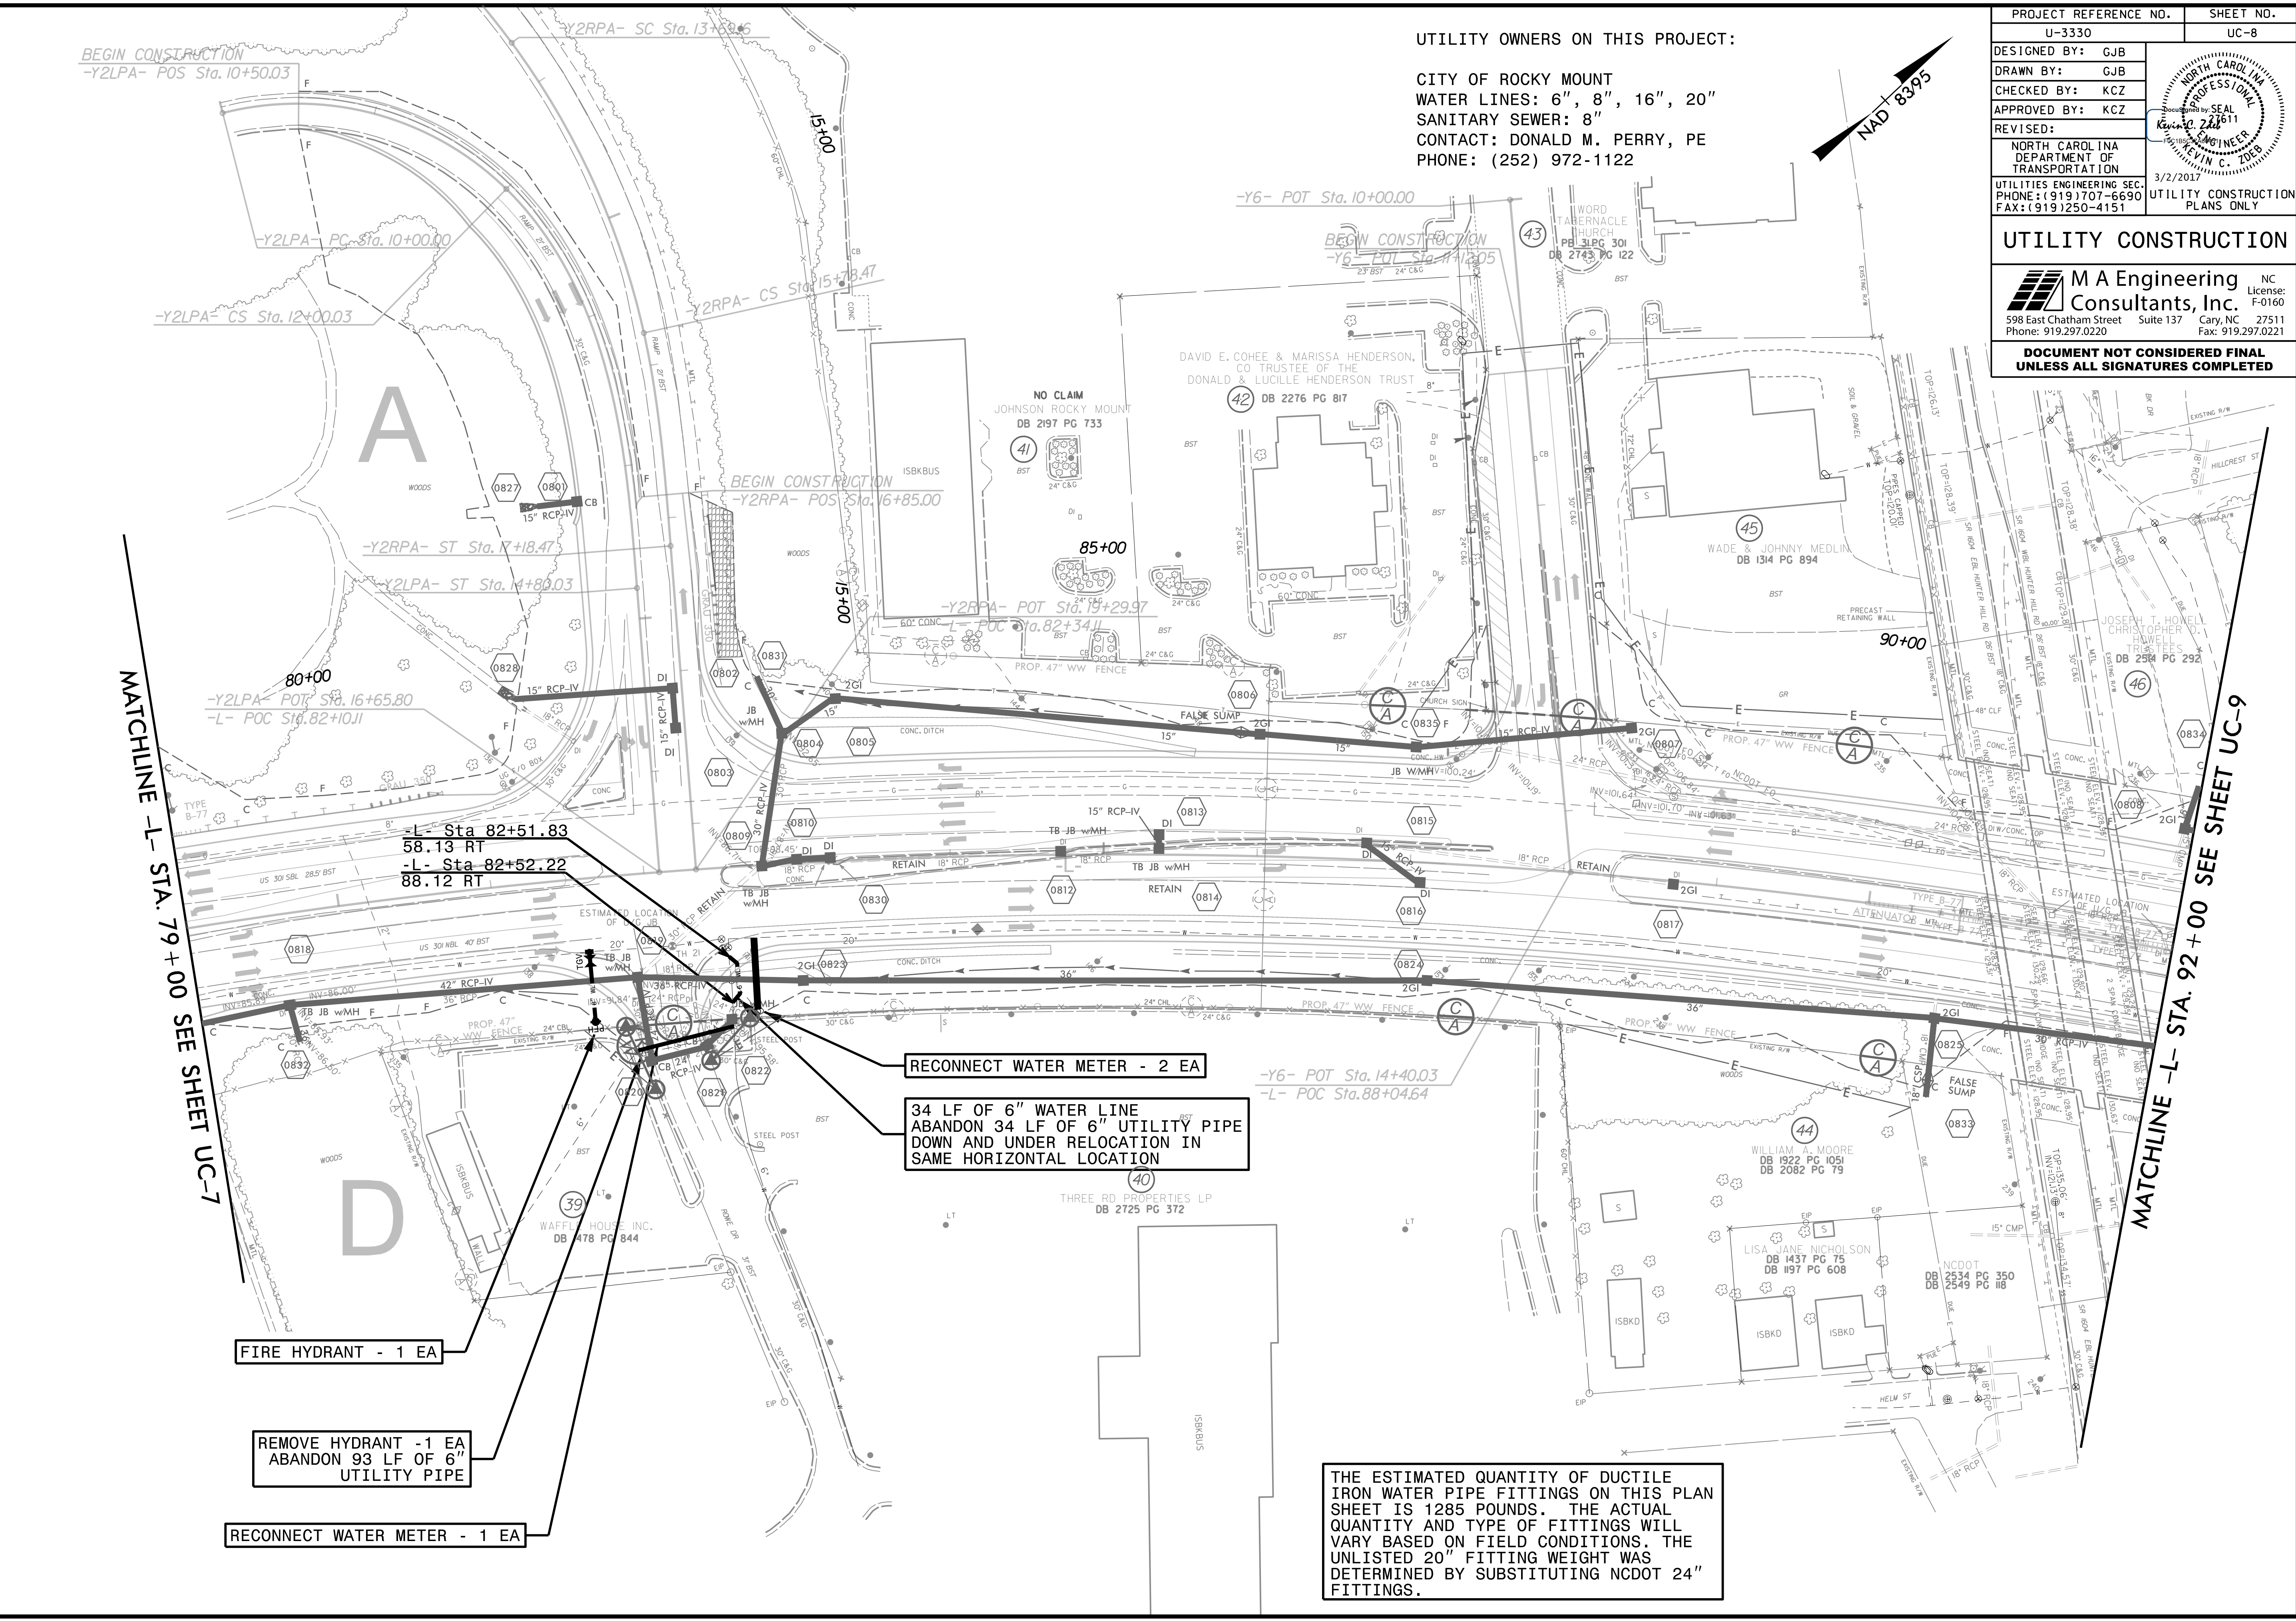

MATCHLINE -L- STA. 79+00 SEE SHEET UC-7

MATCHLINE -L- STA. 92+00 SEE SHEET UC-9

-L- Sta 82+51.83
 58.13 RT
 -L- Sta 82+52.22
 88.12 RT

RECONNECT WATER METER - 2 EA

34 LF OF 6" WATER LINE
 ABANDON 34 LF OF 6" UTILITY PIPE
 DOWN AND UNDER RELOCATION IN
 SAME HORIZONTAL LOCATION

FIRE HYDRANT - 1 EA

REMOVE HYDRANT - 1 EA
 ABANDON 93 LF OF 6"
 UTILITY PIPE

RECONNECT WATER METER - 1 EA

THE ESTIMATED QUANTITY OF DUCTILE IRON WATER PIPE FITTINGS ON THIS PLAN SHEET IS 1285 POUNDS. THE ACTUAL QUANTITY AND TYPE OF FITTINGS WILL VARY BASED ON FIELD CONDITIONS. THE UNLISTED 20" FITTING WEIGHT WAS DETERMINED BY SUBSTITUTING NCDOT 24" FITTINGS.

5/14/1999