

Prepared in the Office of:




AECOM TECHNICAL SERVICES OF NORTH CAROLINA, INC.
701 CORPORATE CENTER DRIVE, SUITE 475, RALEIGH, NC 27607
919-854-6200 919-854-6259 (fax)
F-0342


PROJECT REFERENCE NO. U-3633	SHEET NO. UC-5
DESIGNED BY:	
DRAWN BY:	
CHECKED BY:	
APPROVED BY:	
REVISED:	
UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151	UTILITY CONSTRUCTION PLANS ONLY

DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED

UTILITY CONSTRUCTION

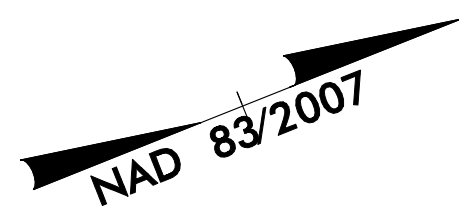

NOTE:
CONTRACTOR TO ADJUST EXIST. MH
AS NECESSARY TO ACCOMMODATE
PROPOSED CURB RAMP AND REPLACE
EXIST. MH COVER WITH WATERTIGHT
COVER.

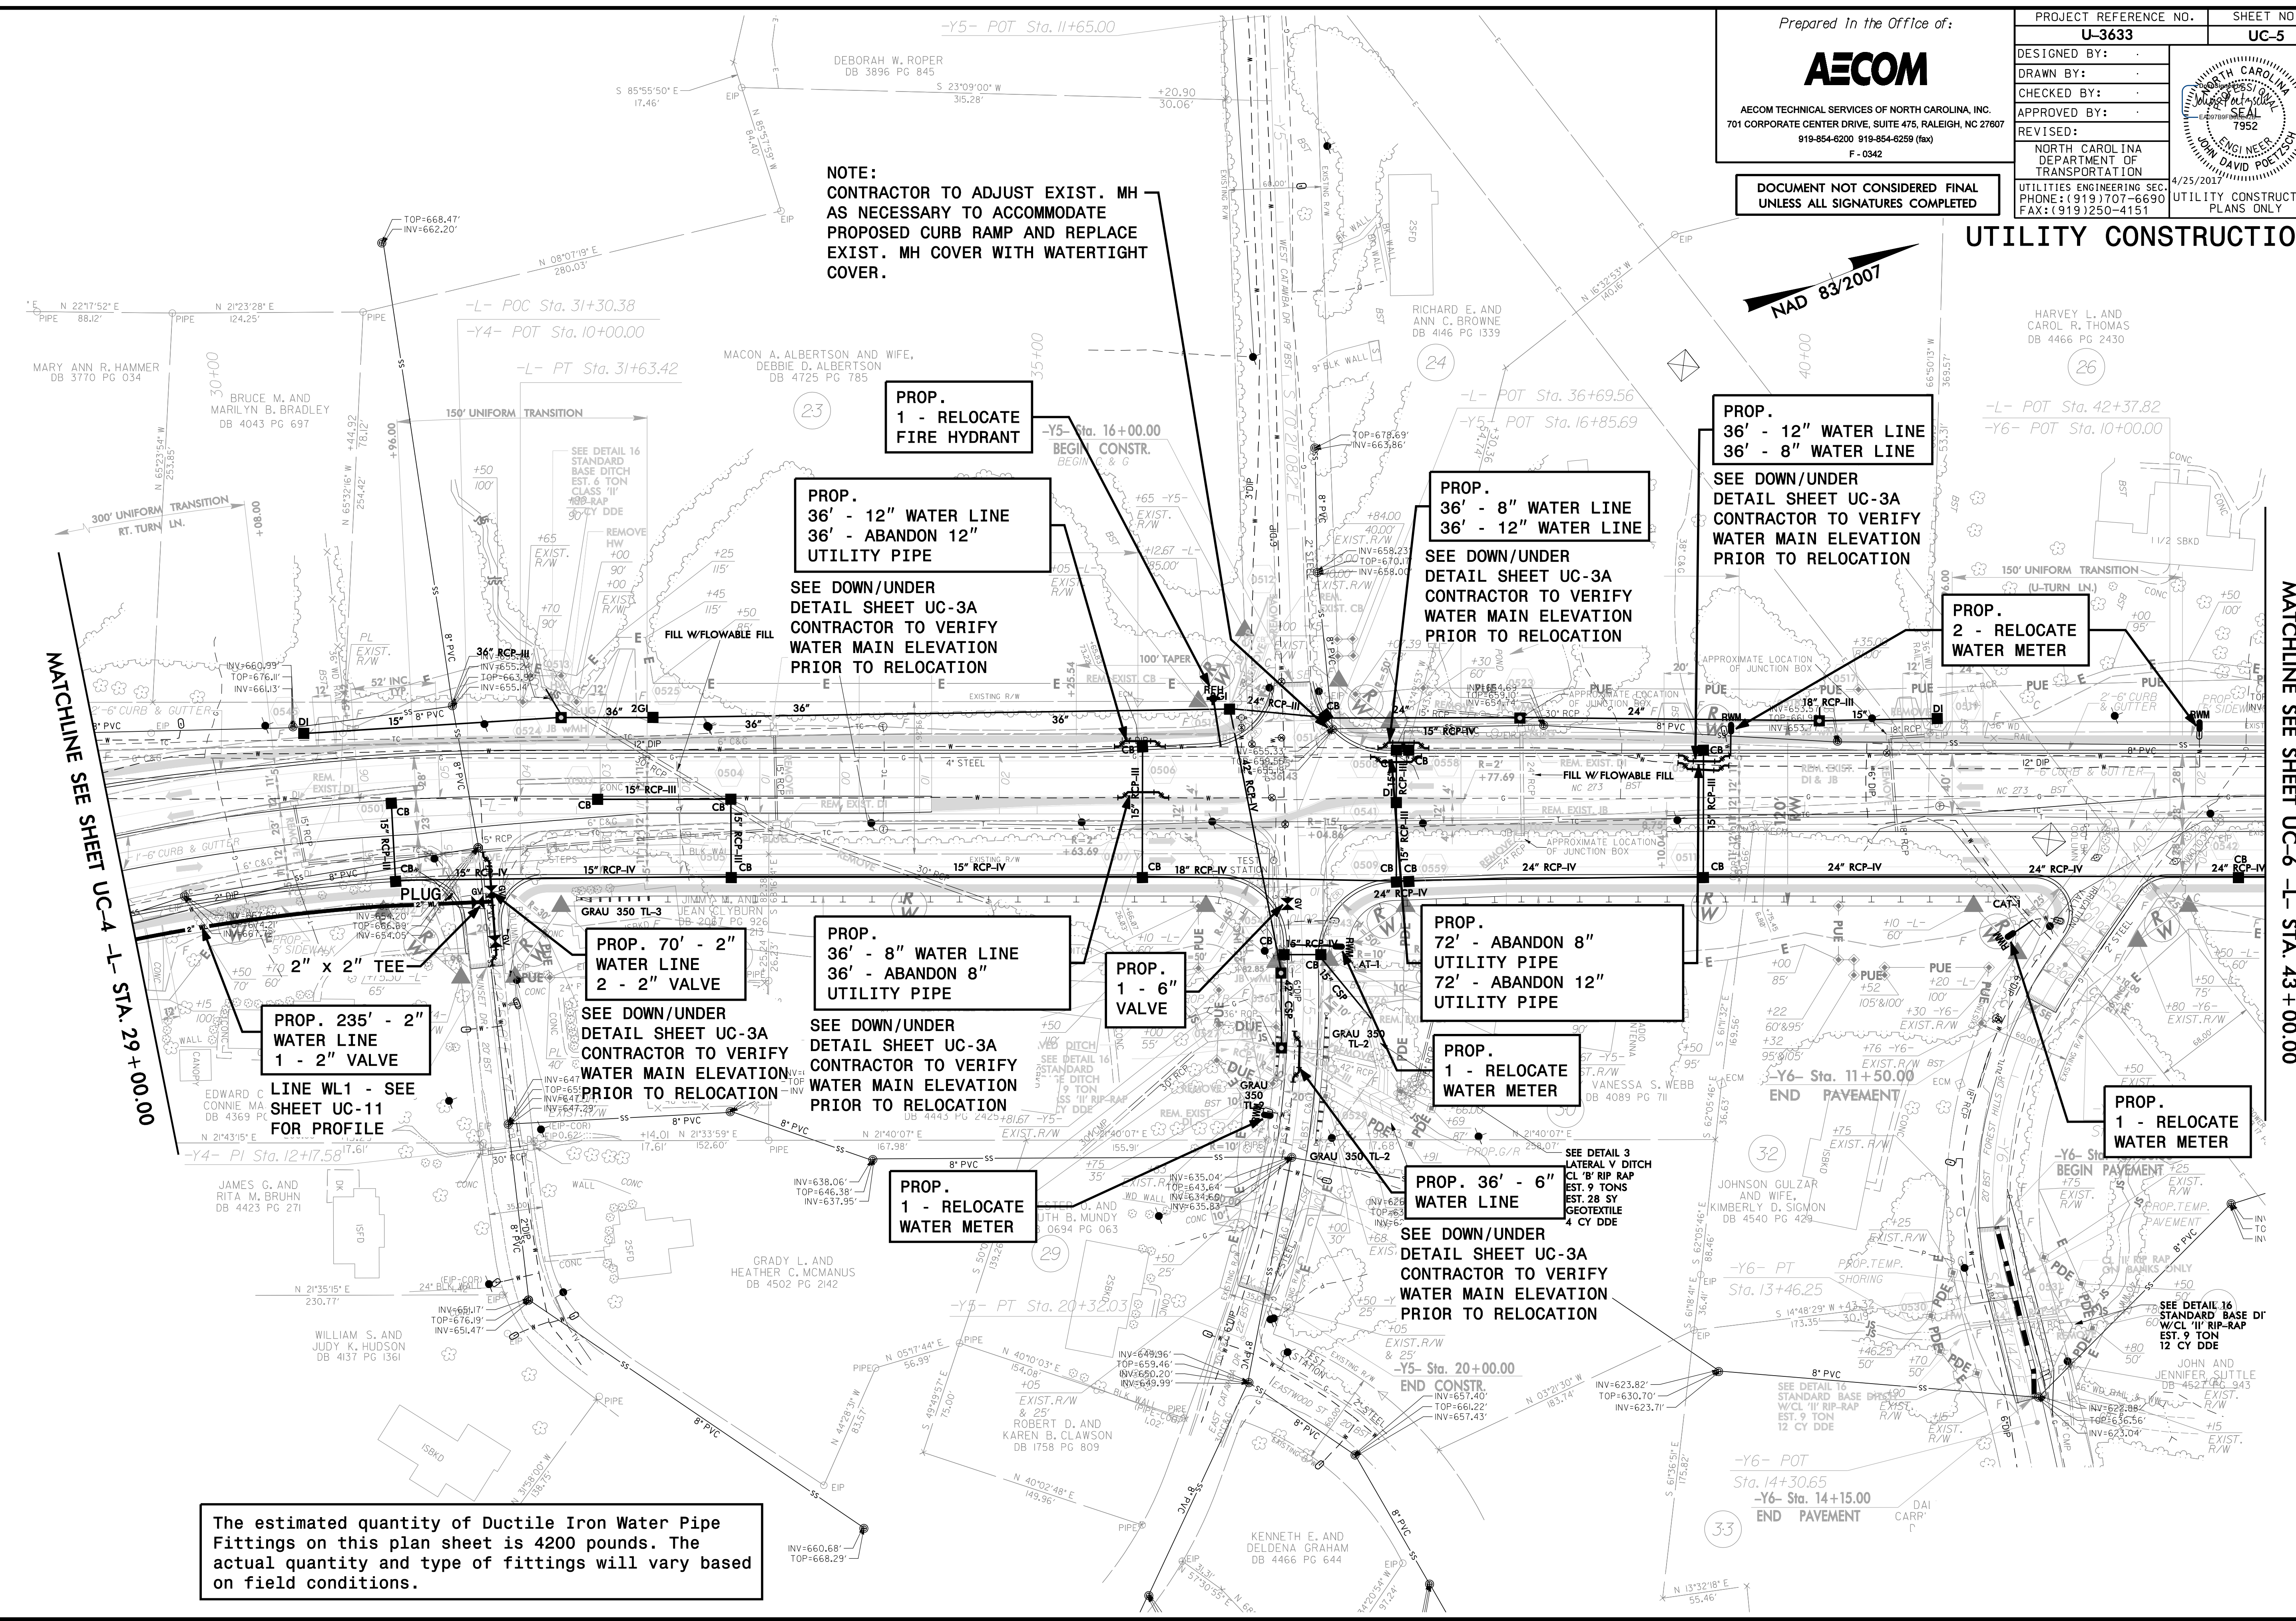

The estimated quantity of Ductile Iron Water Pipe Fittings on this plan sheet is 4200 pounds. The actual quantity and type of fittings will vary based on field conditions.

DATE: 4/24/2017
TIME: 2:20:01 PM
DGN: U5633.uc.dwg

MATCHLINE SEE SHEET UC-6 -L- STA. 43+00.00