



END ELEVATION

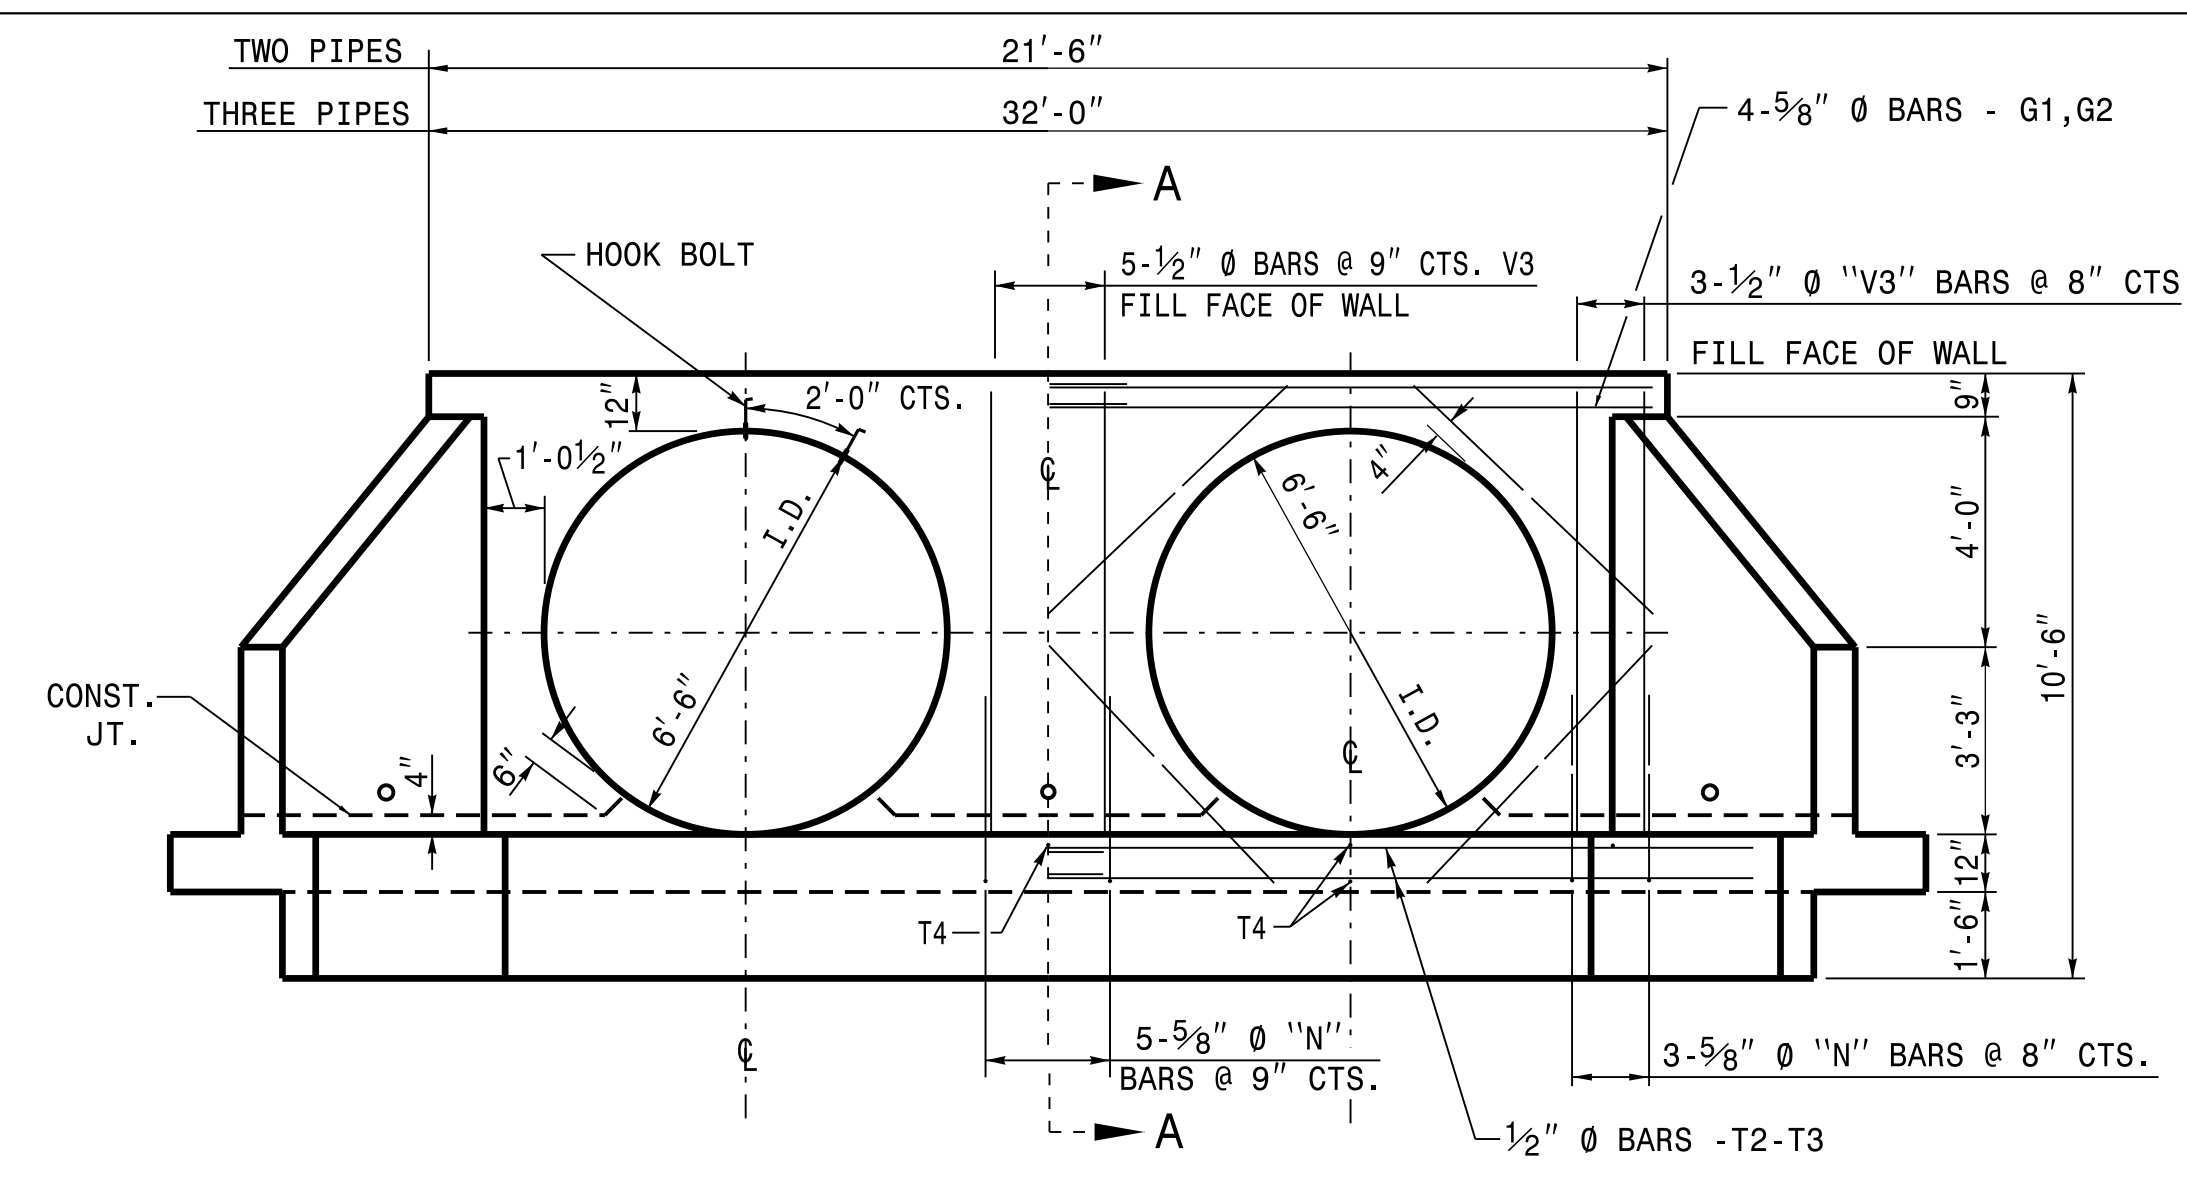


END ELEVATION

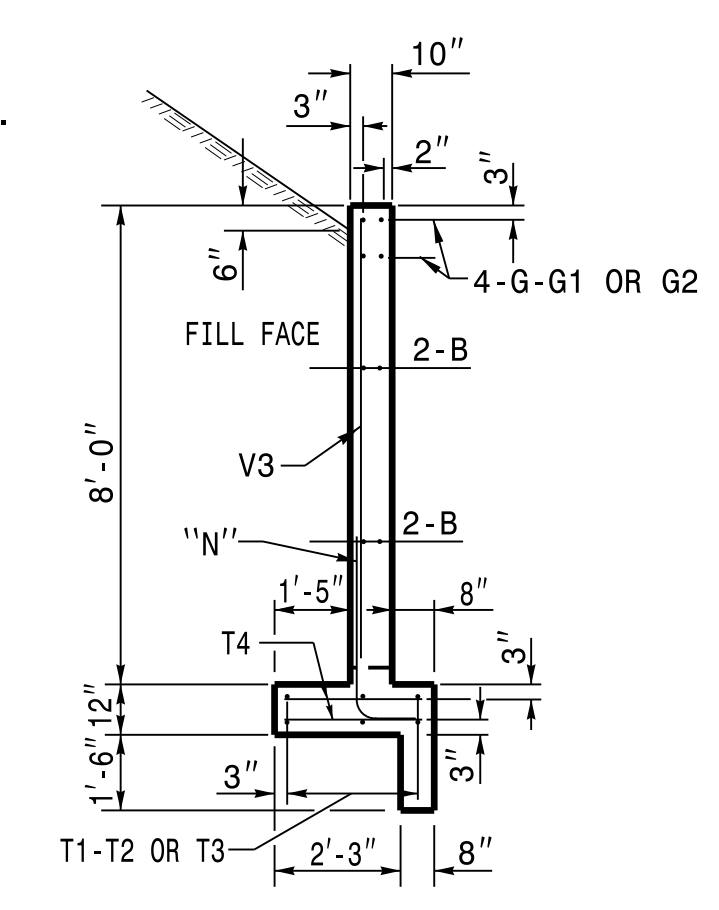


SECTION A-A FOR ALL ENDWALLS


**NOTES:**  
 USE CLASS 'A' CONCRETE.  
 USE ASTM A615-GRADE 60 REINFORCING STEEL.  
 USE DEFORMED BARS FOR ALL REINFORCING STEEL. WHERE SPLICING OF REINFORCEMENT IS NECESSARY, BARS ARE TO BE LAPPED 45 DIAMETERS. ALL DIMENSIONS RELATIVE TO REINFORCEMENT ARE TO CENTERS OF BARS.  
 THE FOOTING, CURTAIN WALL AND 4" OF WALL ARE TO BE POURED IN ONE OPERATION ALLOWING NO TIME FOR INITIAL SET TO TAKE PLACE BETWEEN THEM. POUR THE REMAINING WALL IN ONE OPERATION.  
 CHAMFER ALL EXPOSED CORNERS 1".  
 PLACE 3" DIAMETER DRAINS IN WALL AS SHOWN 6" ABOVE NORMAL FLOW LINE.

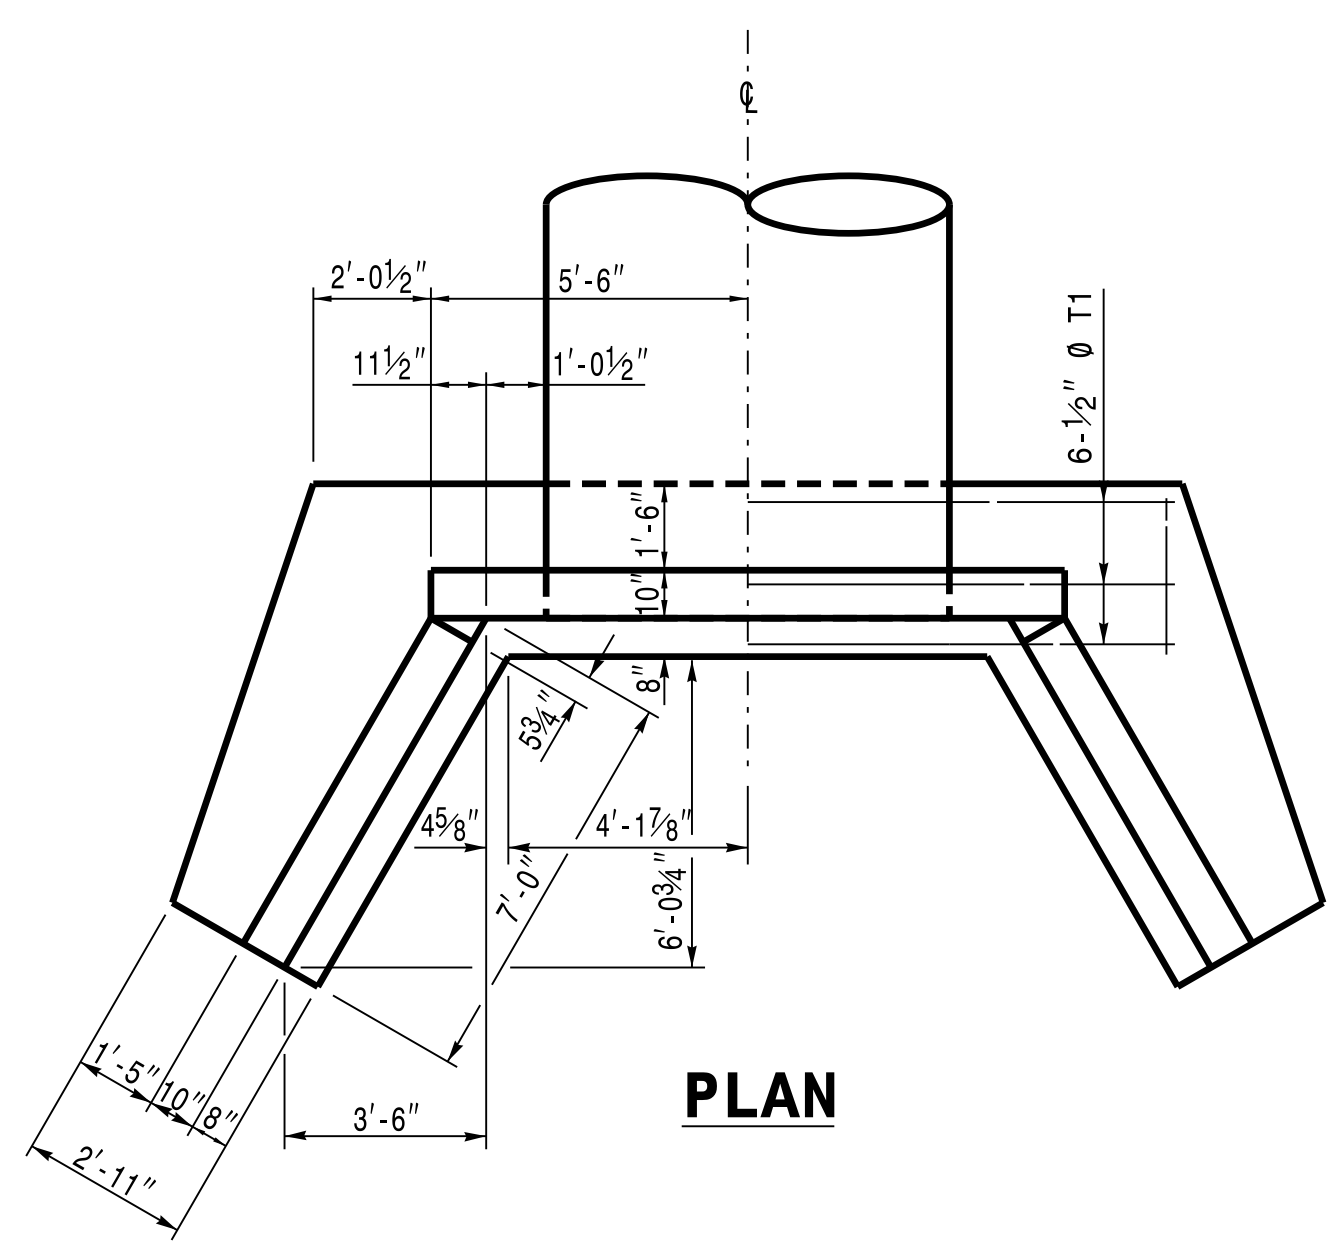


PLAN

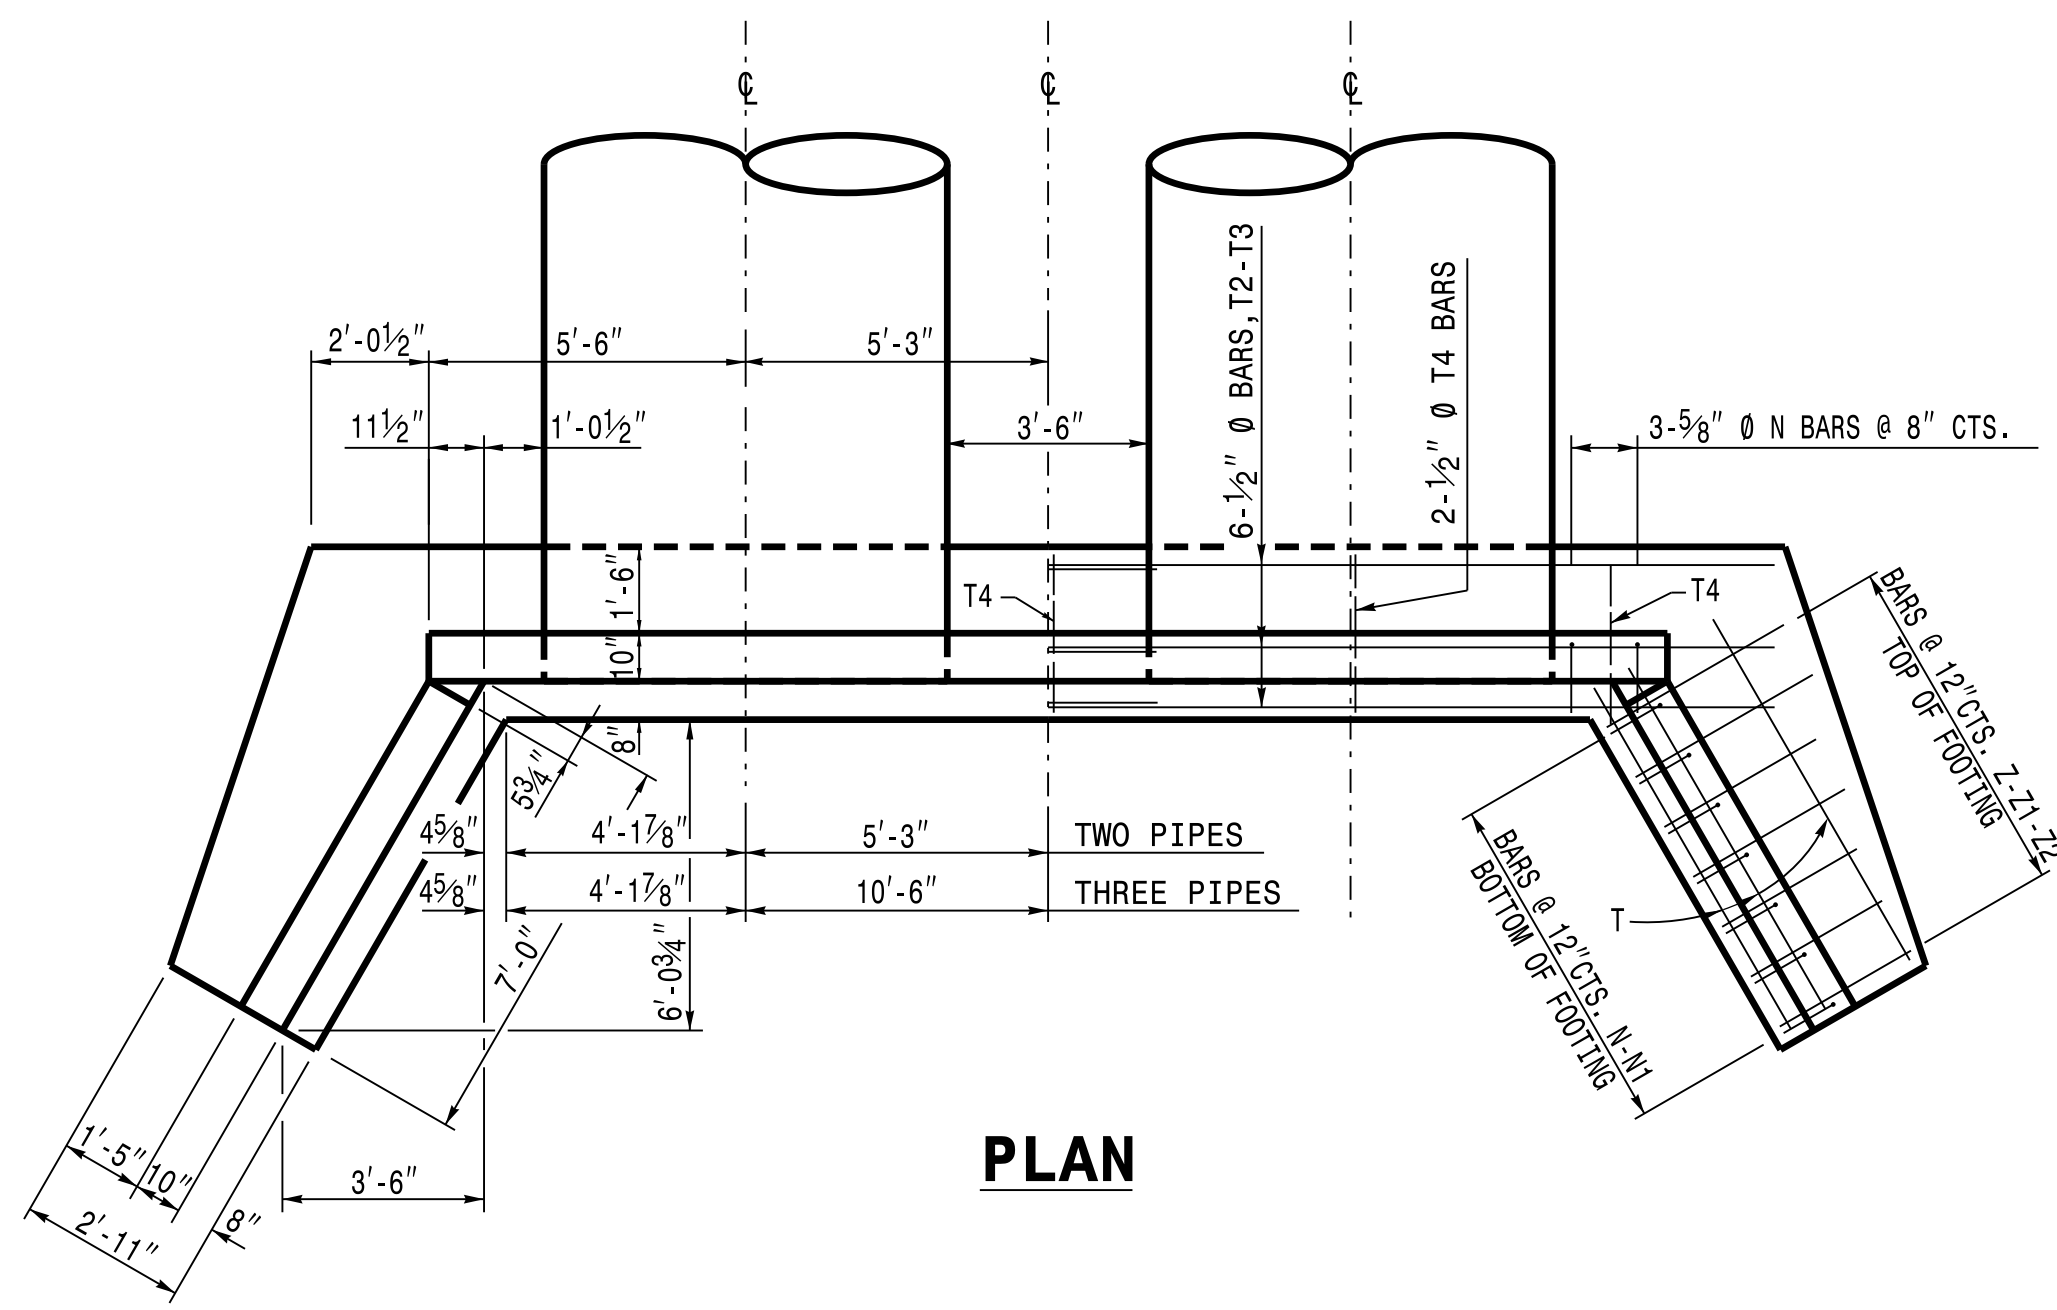


PLAN

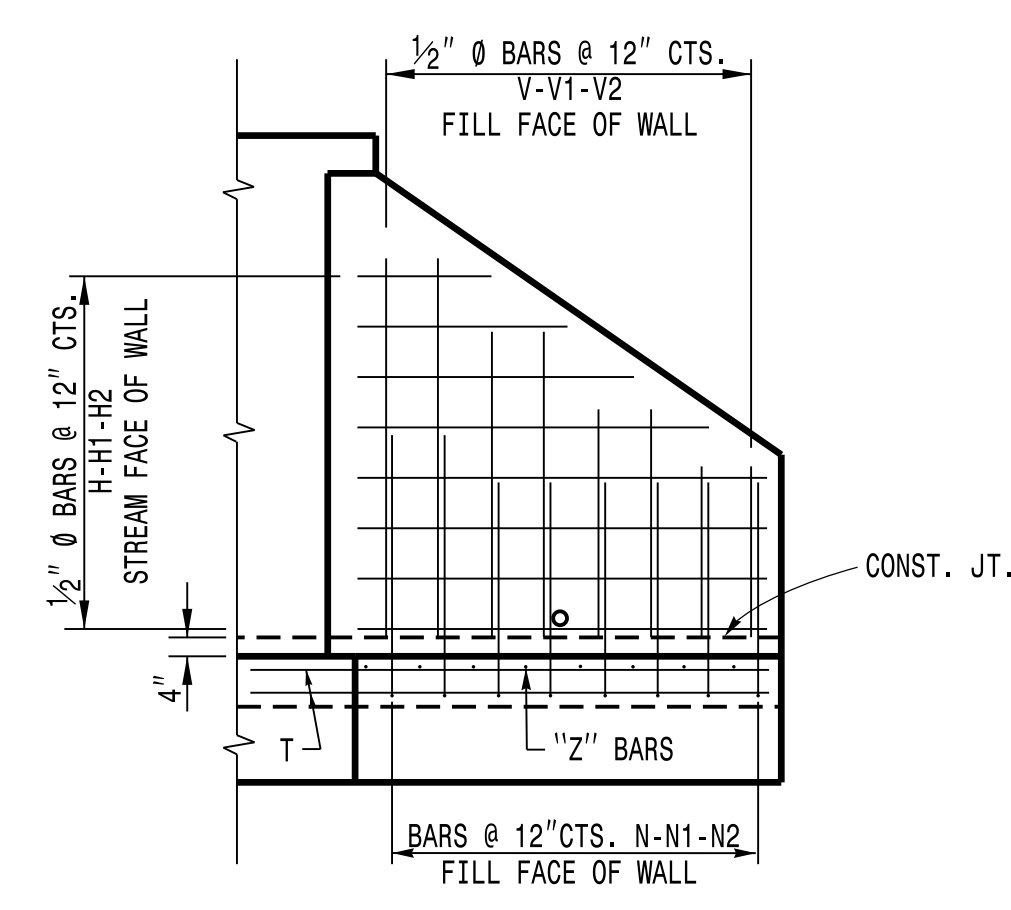

ELEVATION OF WING SHOWING REINFORCEMENT

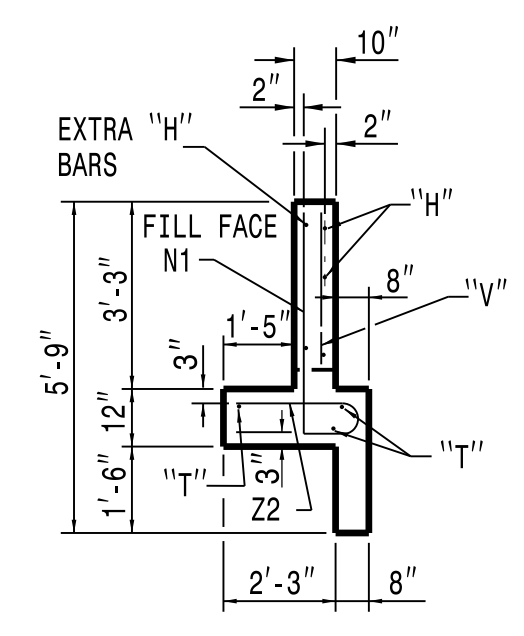


END OF WING

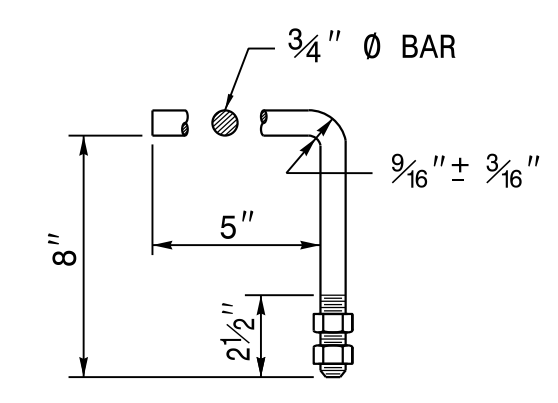


HOOK BOLT


HOOK BOLTS (CONSTRUCT ANCHORS AT 2'-0" CTS. ALONG THE CIRCUMFERENCE OF THE 6'-6" CSP. EMBED THE HOOK BOLTS IN THE CONCRETE ENDWALL 8" IN DEPTH. THE GALVANIZED 3/4" DIA. HOOK BOLTS MUST MEET ASTM A-307 OR ASTM A-836. BOTH BOLTS AND NUTS MUST BE IN ACCORDANCE WITH ASTM A-153 FOR GALVANIZING.

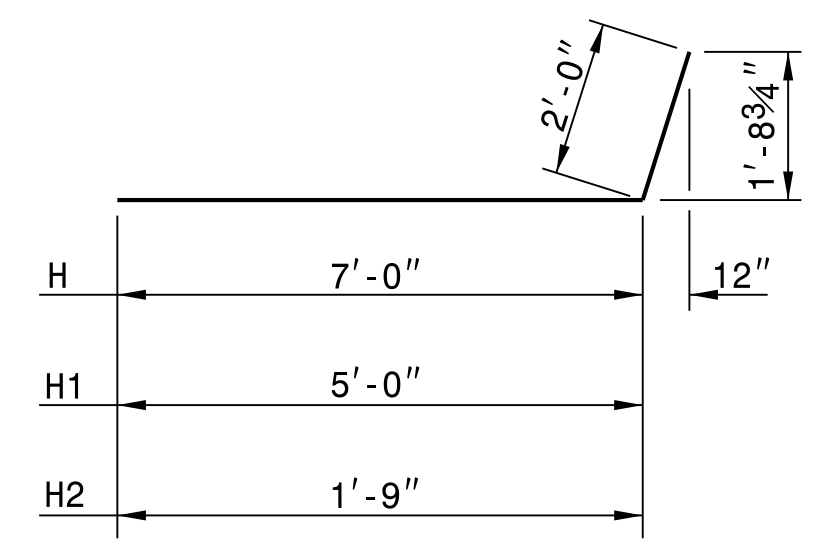

BARS H-H1-H2

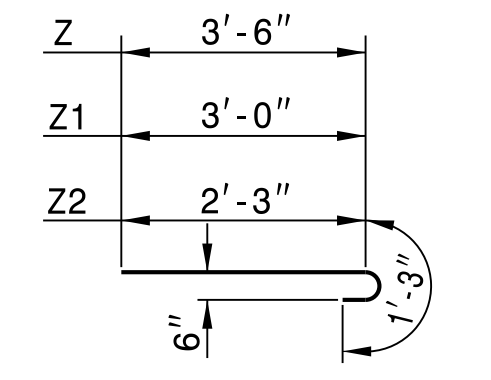

BARS Z-Z1-Z2

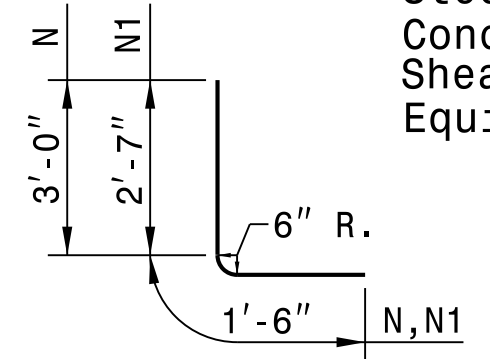

BARS N-N1

**DESIGN DATA**  
 Specifications A.A.S.H.T.O.  
 Steel in tension 20,000 LBS. PER SQ. IN.  
 Concrete in compression 1,200 LBS. PER SQ. IN.  
 Shear Class "A" Concrete SEE A.A.S.H.T.O.  
 Equiv. fluid pressure of earth 30 LBS. PER CU. FT.

**BILL OF MATERIAL FOR ONE ENDWALL**

REINFORCING STEEL	1 PIPE	2 PIPES	3 PIPES
BAR #4	NO. 8	NO. 16	NO. 24
WEIGHT	32	64	96
G #5	NO. 4	NO. 8	NO. 8
LENGTH	10'-9"	11'-9"	17'-0"
WEIGHT	45	98	142
H #4	NO. 10	NO. 10	NO. 10
LENGTH	9'-0"	7'-0"	3'-9"
WEIGHT	60	28	10
H1 #4	NO. 6	NO. 6	NO. 6
LENGTH	7'-0"	3'-9"	3'-9"
WEIGHT	28	10	10
N #5	NO. 10	NO. 15	NO. 20
LENGTH	4'-6"	4'-1"	4'-1"
WEIGHT	47	27	27
T #4	NO. 6	NO. 6	NO. 6
LENGTH	6'-6"	6'-6"	6'-6"
WEIGHT	26	26	26
T1 #4	NO. 6	NO. 12	NO. 12
LENGTH	15'-0"	13'-9"	19'-0"
WEIGHT	60	110	152
T2 #4	NO. 4	NO. 4	NO. 4
LENGTH	13'-9"	2'-9"	2'-9"
WEIGHT	12	7	13
T3 #4	NO. 4	NO. 7	NO. 10
LENGTH	19'-0"	2'-9"	2'-9"
WEIGHT	12	7	10
T4 #4	NO. 4	NO. 7	NO. 10
LENGTH	2'-9"	2'-9"	2'-9"
WEIGHT	7	7	10
V #4	NO. 6	NO. 6	NO. 6
LENGTH	5'-9"	4'-6"	4'-6"
WEIGHT	23	18	18
V1 #4	NO. 6	NO. 8	NO. 8
LENGTH	4'-6"	2'-9"	2'-9"
WEIGHT	18	15	15
V2 #4	NO. 6	NO. 11	NO. 16
LENGTH	2'-9"	7'-6"	7'-6"
WEIGHT	15	55	80
Z #5	NO. 4	NO. 4	NO. 4
LENGTH	4'-9"	4'-3"	3'-6"
WEIGHT	20	11	11
Z1 #4	NO. 4	NO. 4	NO. 4
LENGTH	4'-3"	3'-6"	3'-6"
WEIGHT	11	11	11
Z2 #4	NO. 6	NO. 6	NO. 6
LENGTH	3'-6"	3'-6"	3'-6"
WEIGHT	14	14	14
TOTAL REINF. STEEL (lbs.)	473	662	834
CLASS "A" CONC. (cu. yds.)	7.9	10.8	13.8

I:\JUN-2017 14:54 S:\Contracts\Special Details\english\hydro\78\_endwall\_90sk.dgn .jhoverton AT CSD-292595

CONTRACT STANDARDS & DEVELOPMENT UNIT  
 STANDARDS AND SPECIAL DESIGN  
 Office 919-707-6950 FAX 919-250-4119

**DETAIL OF REINFORCED CONCRETE ENDWALL FOR 78" DIAMETER PIPE - 90° SKEW**

ORIGINAL BY: R.S.WICKER DATE: 6-46  
 MODIFIED BY: R.E.D.&T.S.S. DATE: 6-96 & 5-00  
 CHECKED BY: DATE:  
 FILE SPEC.: w:details\stand\endwpi84sk90.dgn

