
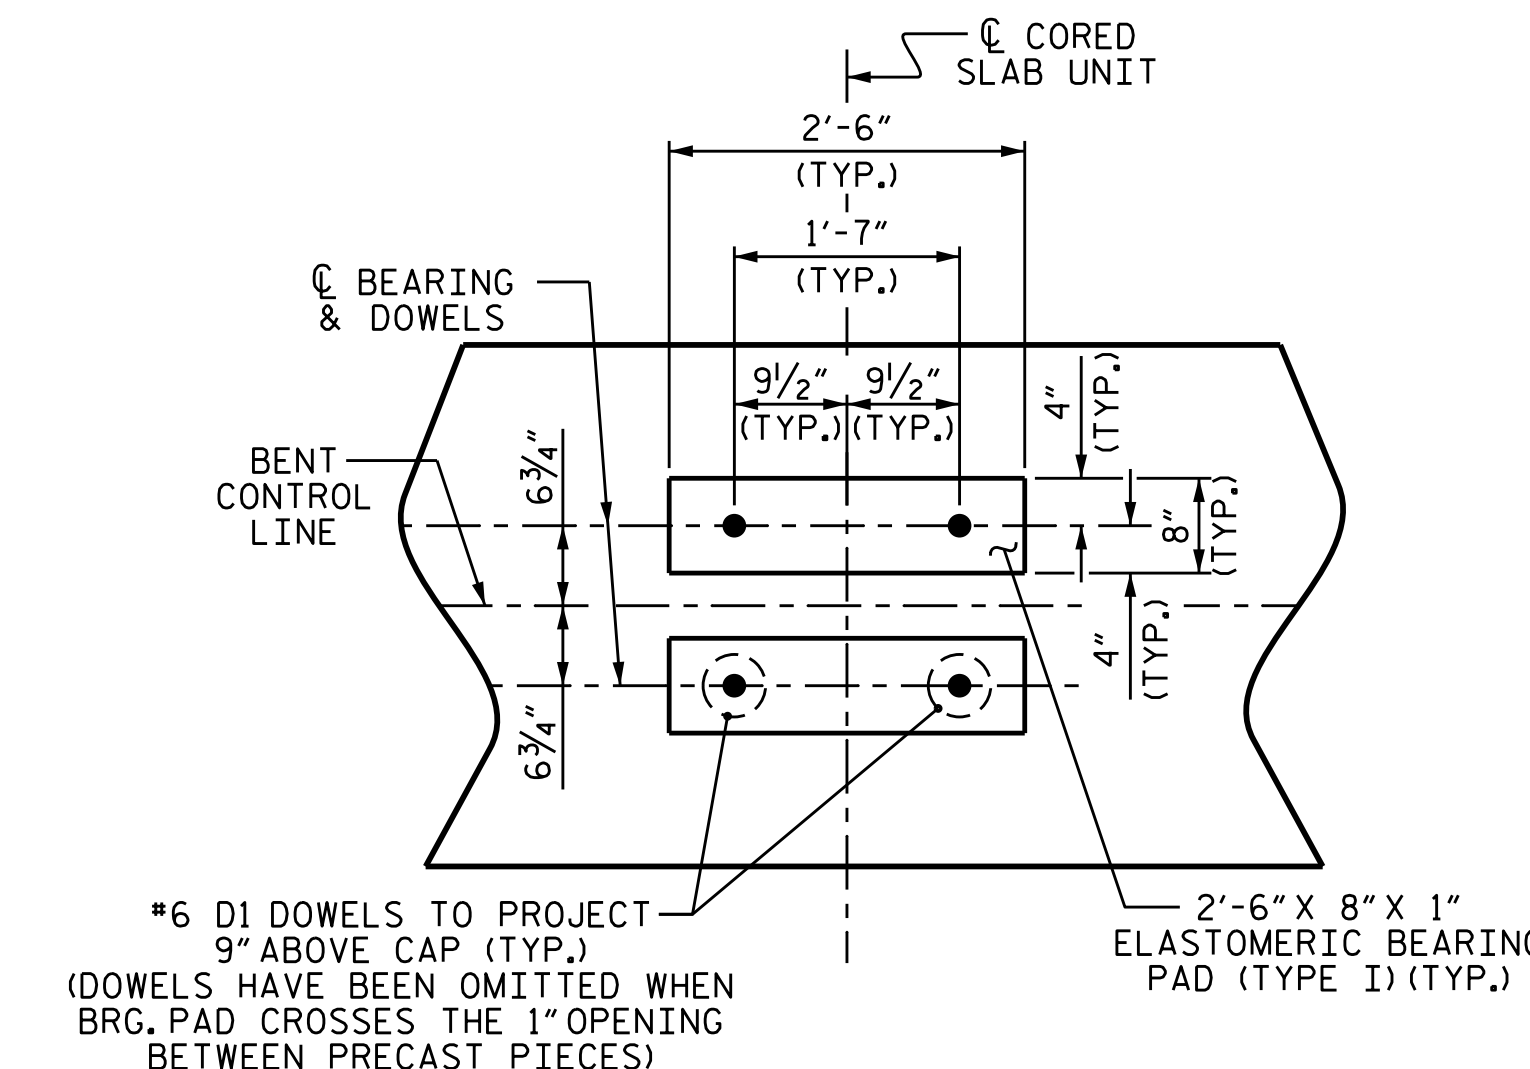


ELEVATION
FOR 2" Ø GROUT PIPE AND PILE BLOCKOUT DETAILS, SEE SHEET 4 OF 4


NOTES

FOR PRECAST CAP DETAILS AND BILL OF MATERIAL, SEE "PIECE B-01" & "PIECE B-02" SHEETS.
 GALVANIZE THE TOP OF EACH INTERIOR BENT PILE A MINIMUM OF 35 FEET. GALVANIZE IN ACCORDANCE WITH SECTION 1076 OF THE STANDARD SPECIFICATIONS.
 FOR GROUT FOR STRUCTURES, SEE SPECIAL PROVISIONS.
 FOR OPTIONAL 3'-0" x 2'-6" PRECAST PRESTRESSED CONCRETE BENT CAPS, SEE SPECIAL PROVISIONS.

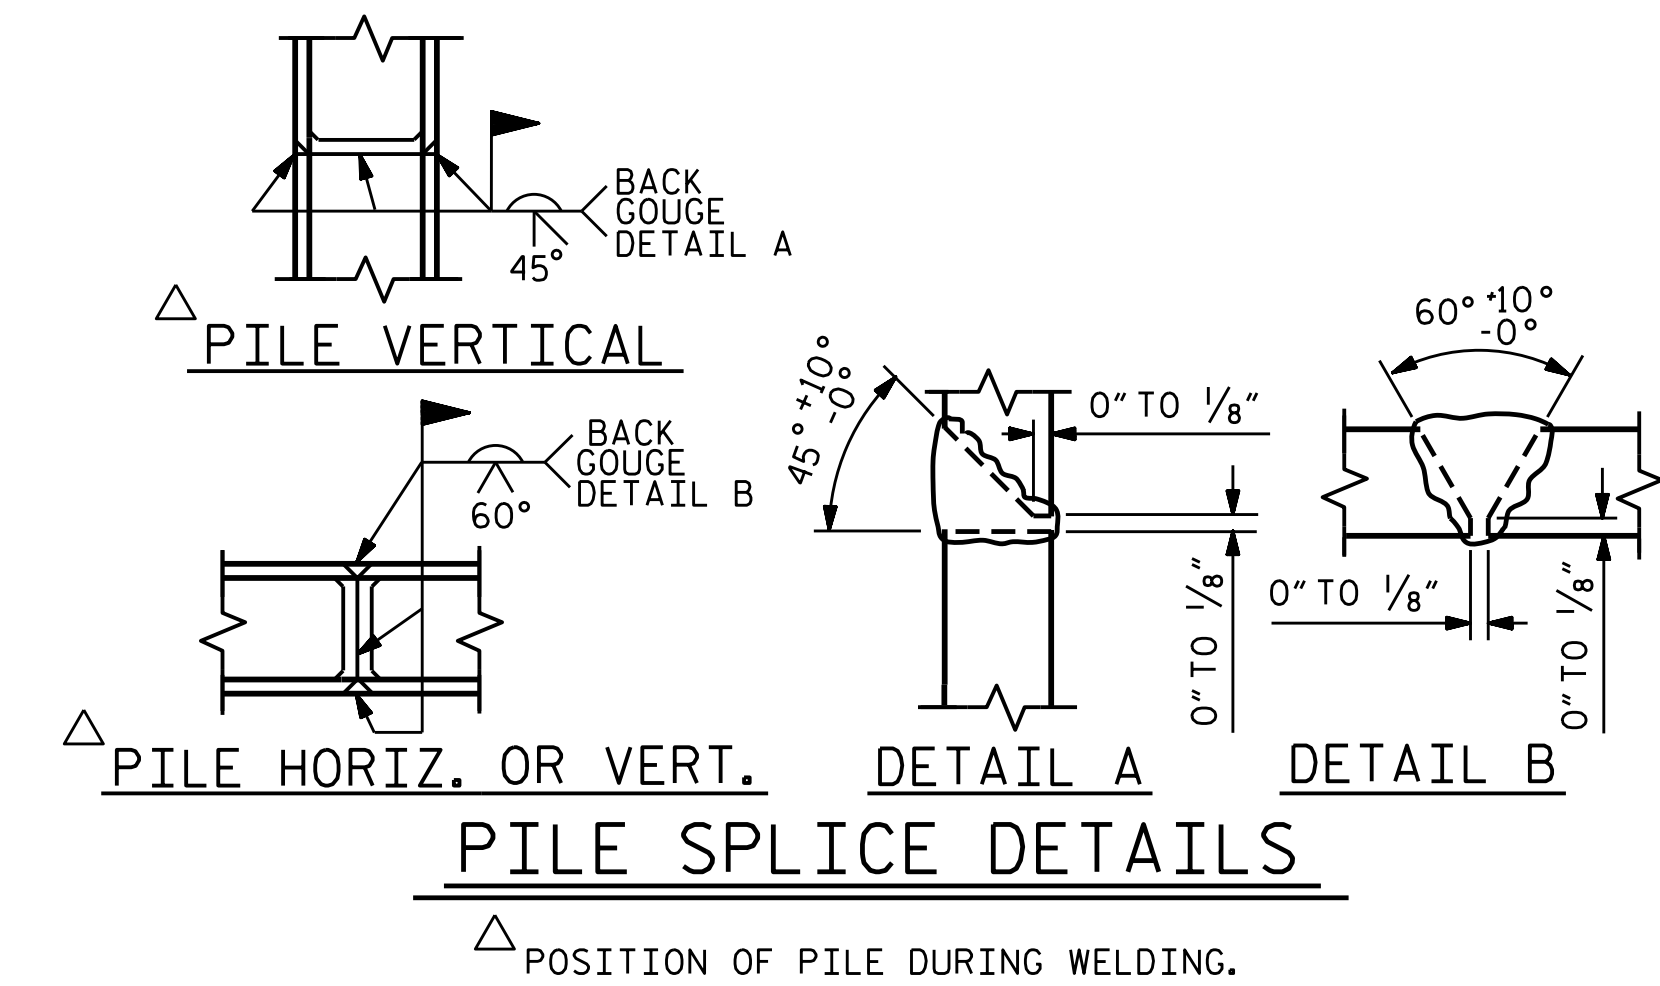

DETAIL "A"
(DIMENSIONS ARE TYPICAL EACH BEARING)

PROJECT NO. B-5304
PENDER COUNTY
 STATION: 12+27.00 -L-
 SHEET 2 OF 5

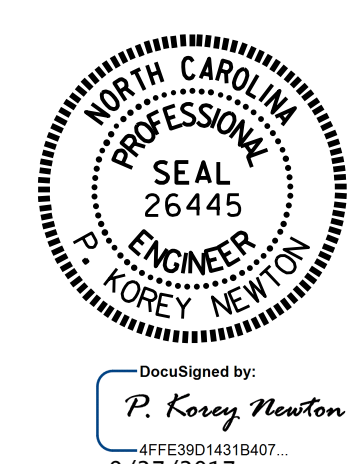

STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH
 SUBSTRUCTURE
 BENT No. 2
 (OPTIONAL PRESTRESSED CONCRETE BENT CAP)

ASSEMBLED BY : P. K. NEWTON	DATE : 9/21/17
CHECKED BY : O. T. NGUYEN	DATE : 9/22/17
DRAWN BY : MAA 3/12	
CHECKED BY : SHS 6/12	

REVISIONS						SHEET NO.	
NO.	BY:	DATE:	NO.	BY:	DATE:	S-23B	
1			3			TOTAL SHEETS	
2			4			25	