



UTILITY CONSTRUCTION PLANS

**DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED**

MAIN SIZE	END PIPE SIZE
4" - 12"	2" BLOW-OFF
16" & GREATER	AS APPROVED BY TOWN ENGINEER

NOTES:

- FOR MAINS THAT ARE TO BE EXTENDED, USE A VALVE EQUAL TO THE MAIN SIZE AS THE BLOW-OFF VALVE AND THEN REDUCE TO THE 2" STANDPIPE.
- RODS SHALL BE "HOOKED" INTO THRUST COLLAR.

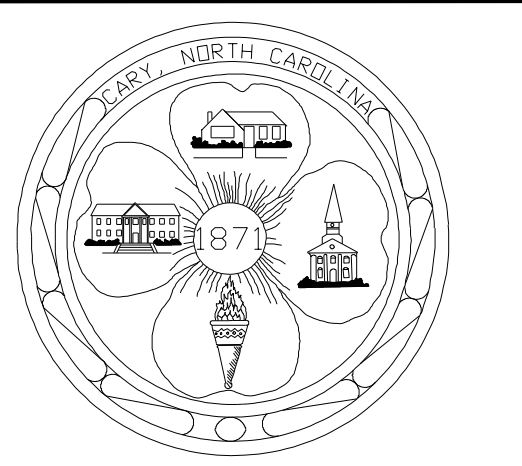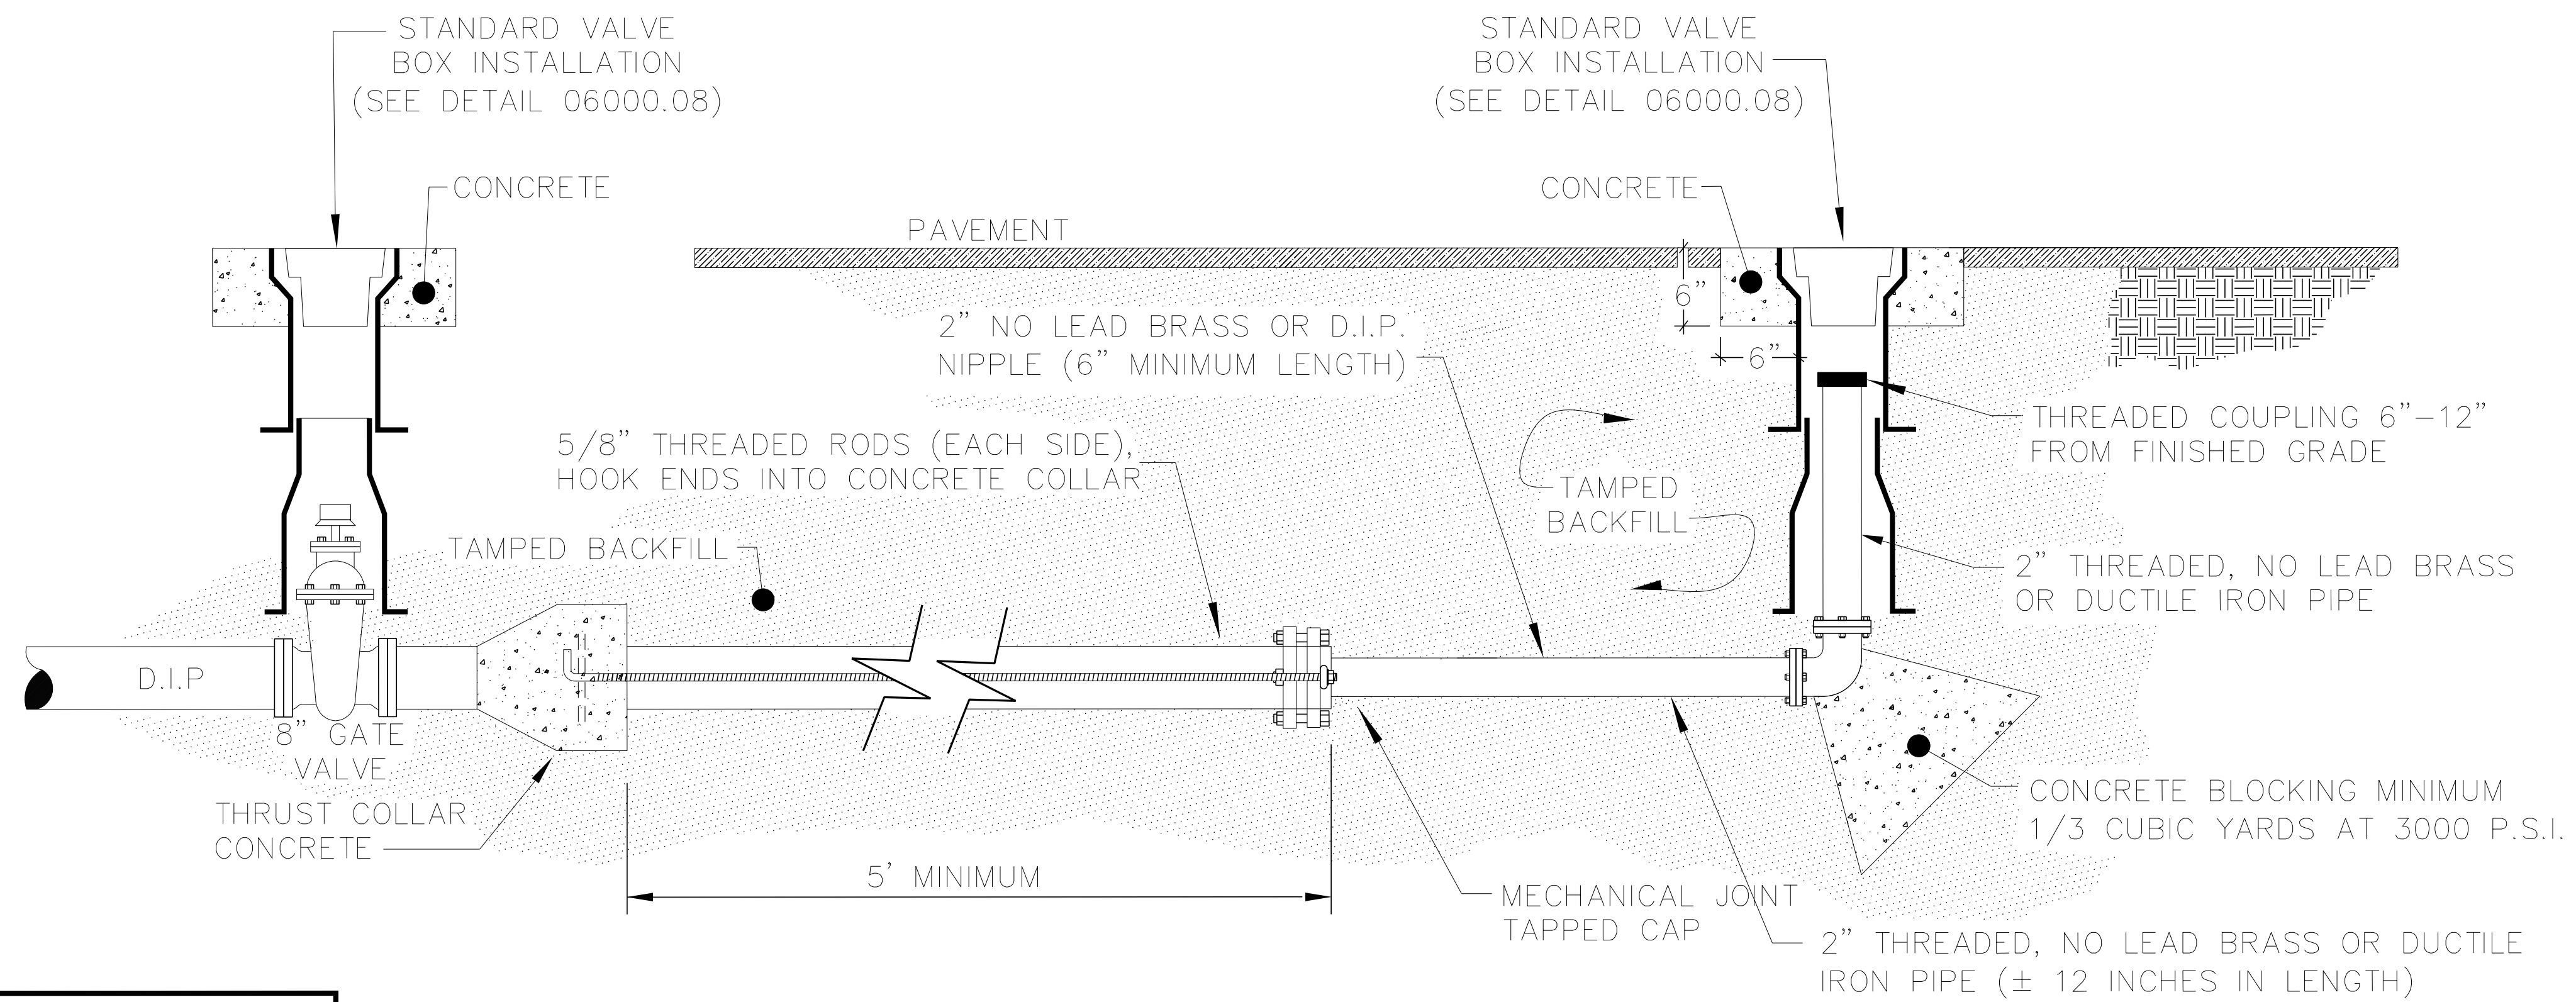

EFFECTIVE: 07/01/13

STANDARD 2" BLOW-OFF ASSEMBLY

DETAIL No.
06000.11
SHEET 1 OF 2