



PLAN

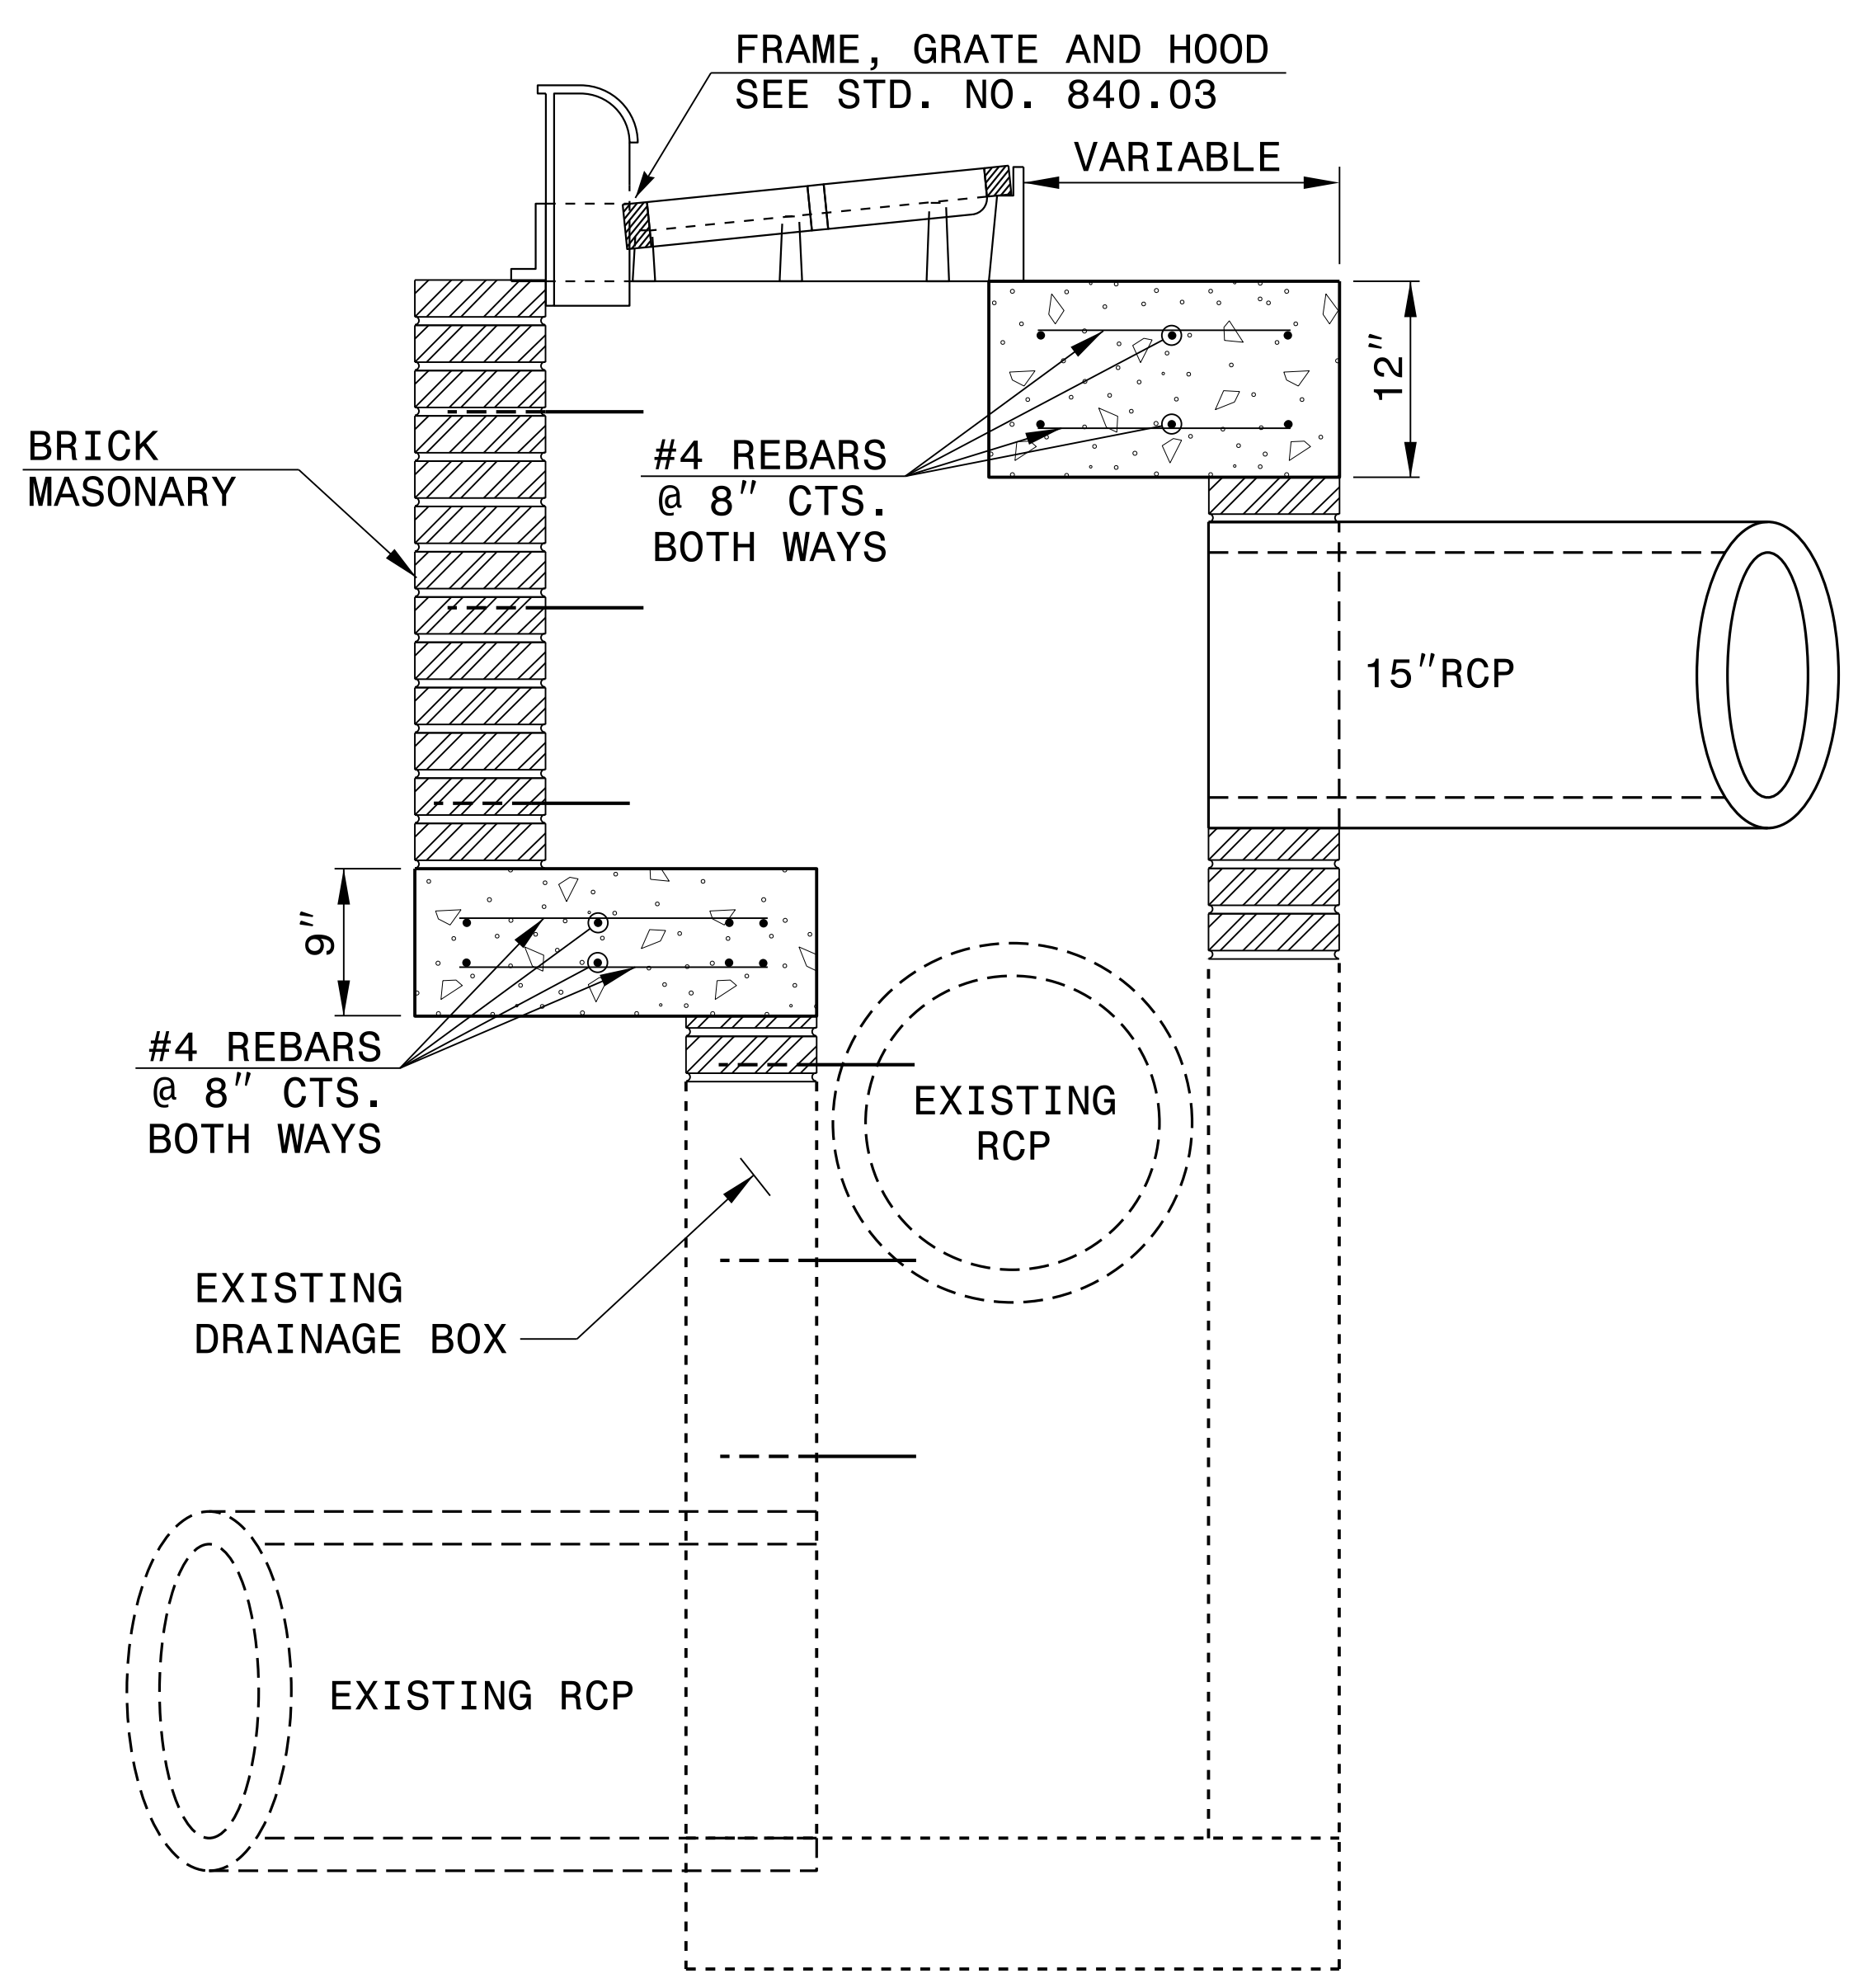

SECTION X-X

NOTES:
 MORTAR JOINTS 1/2" TO 1/4" THICK.
 USE CLASS "B" CONCRETE THROUGHOUT.
 USE TYPE "E", "F" AND "G" GRATES UNLESS OTHERWISE INDICATED.
 USE BRICK OR CONCRETE BLOCK WHICH COMPLIES WITH THE REQUIREMENTS OF SECTION 840 OF THE STANDARD SPECIFICATIONS.
 CHAMFER ALL EXPOSED CORNERS 1".
 ALL CONVERSIONS SHALL BE ACCORDANCE WITH SECTION 859 OF THE STANDARD SPECIFICATIONS.
 PROVIDE ALL CATCH BASINS OVER 3'-6" IN DEPTH WITH STEPS 12" ON CENTER. USE STEPS WHICH COMPLY WITH STD. DRAWING NO. 840.66.
 DRAWING NOT TO SCALE.

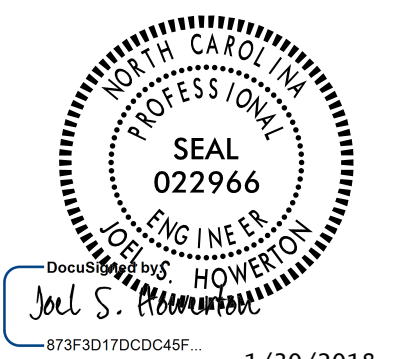

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

CONTRACT STANDARDS & DEVELOPMENT UNIT
STANDARDS AND SPECIAL DESIGN
 Office 919-707-6950 FAX 919-250-4119

OFFSET CATCH BASIN

ORIGINAL BY: E.E. WARD DATE: 1-24-02
 MODIFIED BY: KKEMPF DATE: 11-08-17
 CHECKED BY: DATE:
 FILE SPEC.: kkempf/english/U6804.edb to offsetcb.dgn

30-JAN-2018 13:58 S:\Contracts\Special Details\kkempf\english\U6804.edb to offsetcb.dgn Jhowerton AT USD-232595