
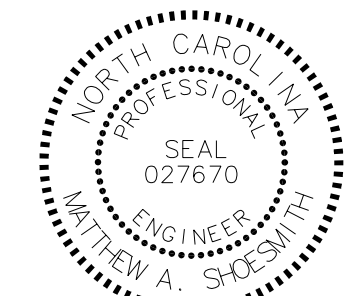


**Kimley»Horn**  
 P.O. BOX 33068  
 RALEIGH, N.C. 27636-3068  
 RIGHT-OF-WAY REV.  
 CONST. REV.

PROJECT REFERENCE NO. U-5828	SHEET NO. UC-7
R/W SHEET NO. UTILITY CONSTRUCTION ENGINEER	
	
DocuSigned by: Matthew A. Shoemith 8/28/2017	

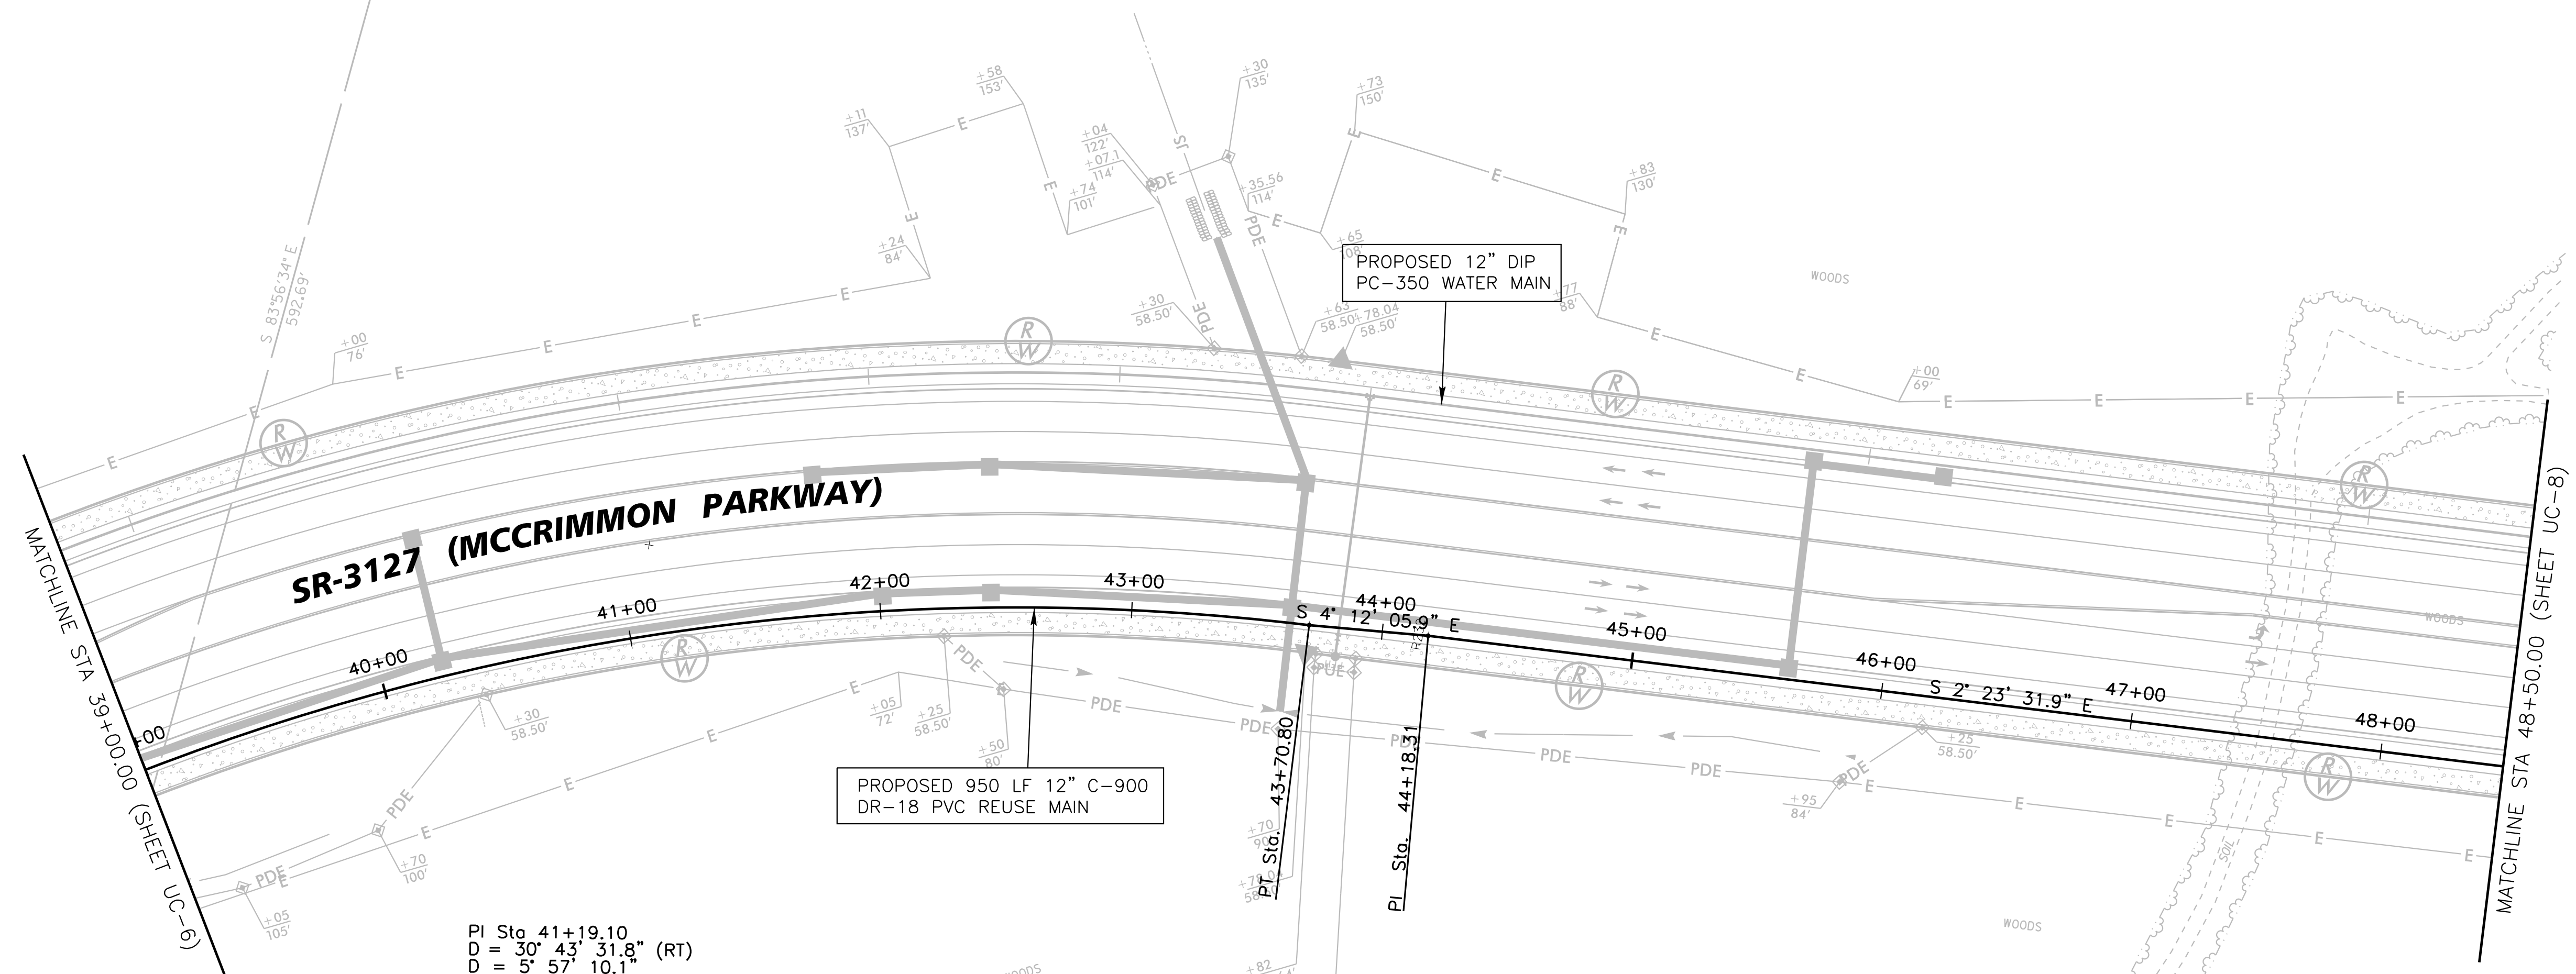

PI Sta 41+19.10  
 D = 30° 43' 31.8" (RT)  
 D = 5' 57' 10.1"  
 L = 516.15'  
 T = 264.44'  
 R = 962.50'

ALL RECLAIMED WATER DISTRIBUTION MAINS IN THE TOWN OF CARY WATER SYSTEM SHALL BE RESTRAINED. THE RECLAIMED WATER DISTRIBUTION SPECIFICATION IS BASED ON MECHANICAL RESTRAINING METHODS PROVIDED AT ALL JOINTS, REGARDLESS OF PIPE MATERIAL. TYPICAL CONCRETE BLOCKING AND RODDING SHALL NOT BE UTILIZED FOR THE RECLAIMED WATER SYSTEM UNLESS OTHERWISE APPROVED BY THE DIRECTOR OF ENGINEERING.

K:\RAL\_Roadway\012108004 - McCrimmon Parkway\Phase 1\Plan\Utility Construction\Phase2\_012108004\_of\_rdy9\_uc07\_psh.dgn 8/28/2017

