


FIRE HYDRANTS TO SERVE FUTURE DEVELOPMENT SHALL BE PROVIDED BY DEVELOPERS TO MAINTAIN TOWN OF MORRISVILLE FIRE DEPARTMENT HYDRANT SPACING STANDARDS.

STATION EQUALITY  
STA. 79+55.87 McCRIMMON PARKWAY=  
STA. 100+00.00 SOUTHPORT DRIVE  
1 - 12"X12" TEE  
1 - 12" ISOLATION VALVE  
SEE SHT. UC-28 FOR  
SOUTHPORT WATER MAIN

NOTES:  
1. ALL CASING PIPE 16-INCH (MIN. 0.250 INCHES THICK).  
2. CASING EXTENDS 1' BEYOND PROPOSED 12" WATER MAIN AND 12" REUSE MAIN.

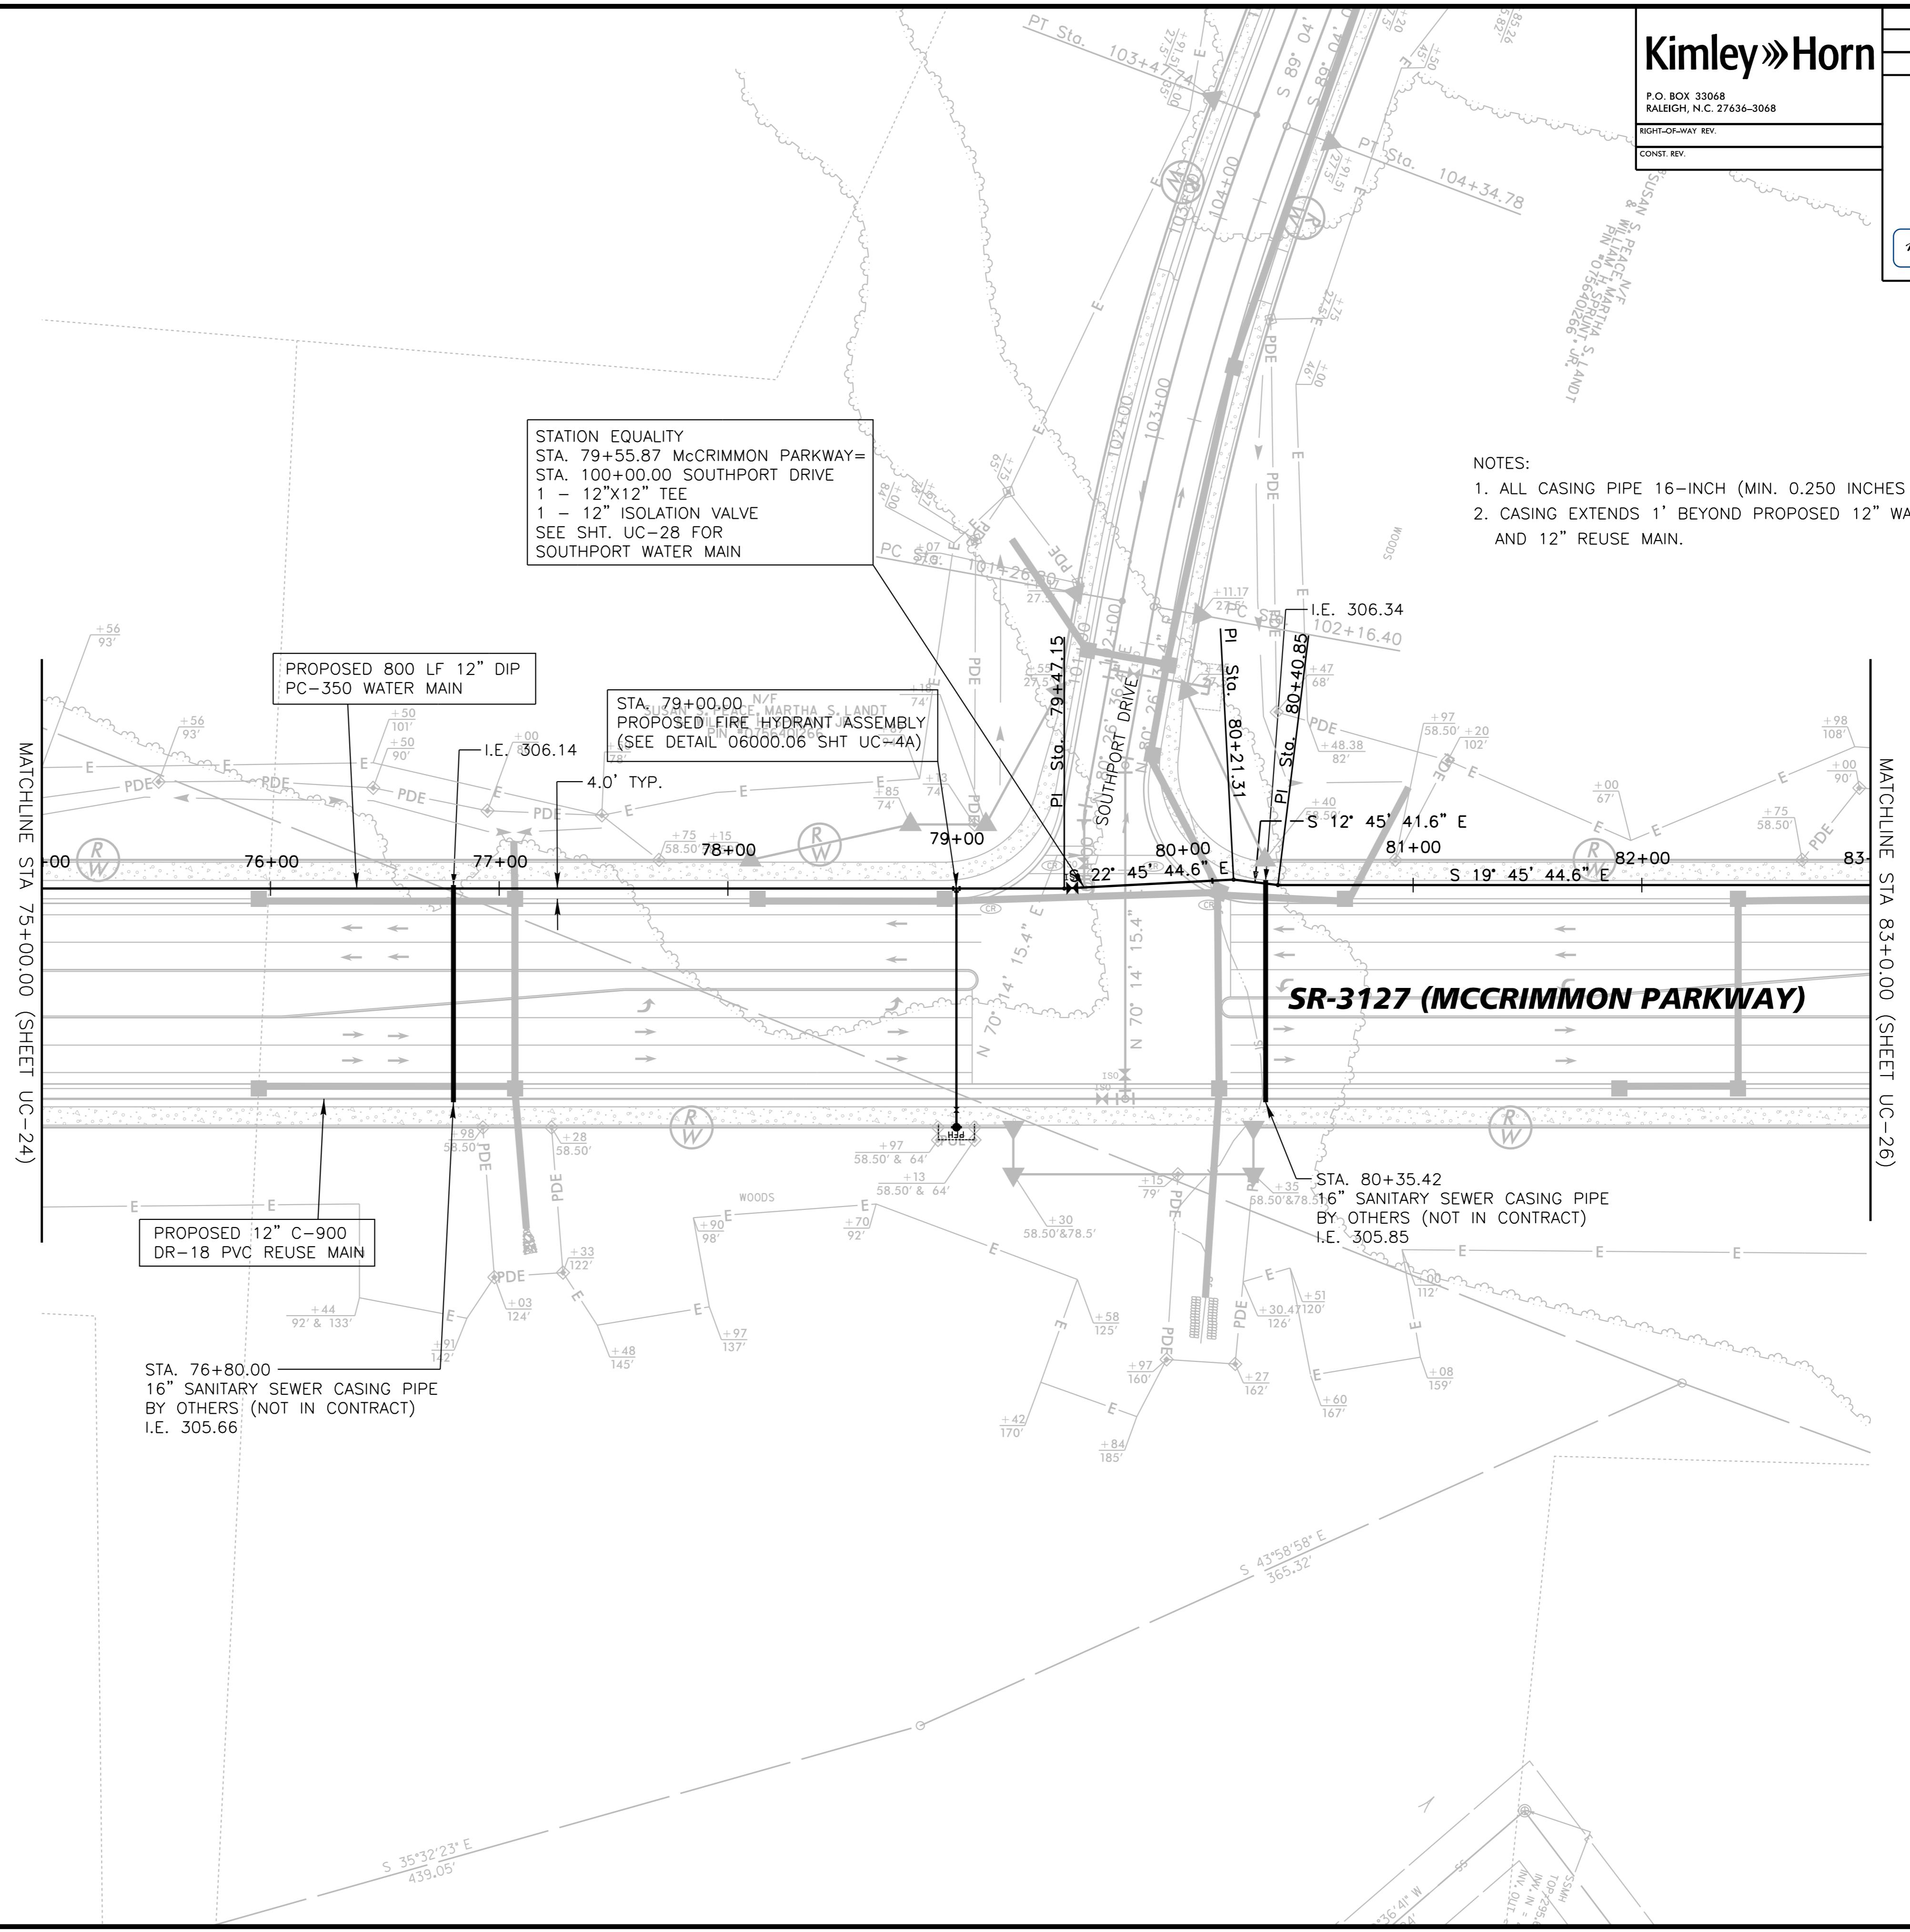

K:\RAL\_Roadway\012108004 - McCrimmon Parkway\Phase I\Plan\Utility Construction\Phase2\_012108004\_ut\_rdy27\_uc25\_pshdgn

8/28/2017

