

EXISTING FIRE HYDRANT TO BE RELOCATED AS SHOWN
 (DETAIL 06000.06 SHT. UC-4A)

RELOCATE EXISTING FH, CONNECT TO EXIST 16" WL

ASPHALT PAVEMENT REPAIR:
 79 SY (SEE DETAIL SHT. UC-4C)
 2'-6" CURB AND GUTTER
 REPLACEMENT : 23 LF

STA. 94+96.20
 CONNECT TO EXISTING 16" DI WATER LINE
 VERIFY LOCATION AND DEPTH OF EXISTING
 WATER LINE. COORDINATE SHUT DOWN WITH
 OWNER. CONNECT TO EXISTING LINE.

STA. 94+96.20
 PROPOSED 12" TAPPING SLEEVE
 AND VALVE ASSEMBLY

REMOVE EXISTING WATER METER VAULT, WATERLINE,
 PANEL, RACK, VALVES, POLES, AND APPURTENANCES

CUT AND CAP EXISTING
 16" DI WATERLINE
 (SEE DETAIL SHT. UC-4C)


PROPOSED 397' LF 12" DIP
 PC-350 WATER MAIN

PROPOSED 12" C-900
 DR-18 PVC REUSE MAIN

STA. 93+25.00
 PROPOSED FIRE HYDRANT ASSEMBLY
 (SEE DETAIL 06000.06 SHT UC-4A)

- NOTES:
1. CONTRACTOR SHALL REMOVE ALL PIPE, VALVES, STRUCTURES, PANELS, ETC. ASSOCIATED WITH THE METER AND LINE TO BE ABANDONED.
 2. THE TOWN OF CARY SHALL HAVE THE FIRST RIGHT OF REFUSAL OF ALL REMOVED COMPONENTS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR CAREFULLY REMOVING ANY ITEMS THE TOWN WISHES TO RETAIN AND STORE ON SITE. CONTRACTOR SHALL COORDINATE THE ITEMS AND THEIR PICK UP BY THE TOWN.
 3. ALL SHUT DOWNS SHALL BE MINIMIZED AND COORDINATED WITH THE TOWN.
 4. ALL FITTINGS SHALL BE RESTRAINED.

FIRE HYDRANTS TO SERVE FUTURE DEVELOPMENT
 SHALL BE PROVIDED BY DEVELOPERS TO MAINTAIN
 TOWN OF MORRISVILLE FIRE DEPARTMENT
 HYDRANT SPACING STANDARDS.

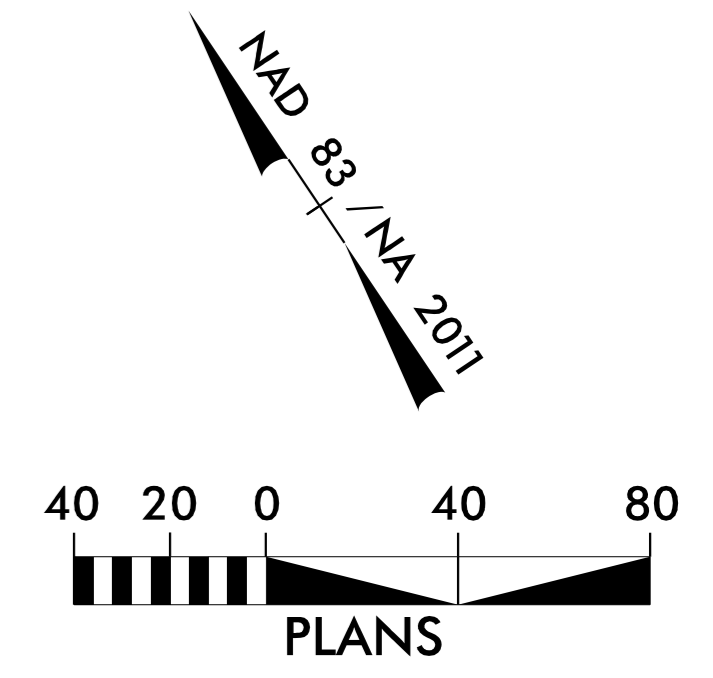

K:\RAL_Roadway\012108004 - McCrimmon Parkway\Phase I\Plan\Utility Construction\Phase2_012108004_ut_rdy29_uc27_pshdgn 1/24/2018