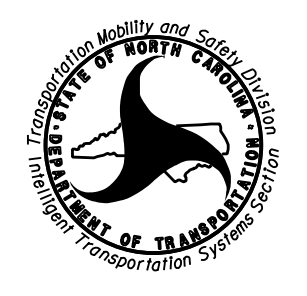



NOTES:

1. INSTALL A MINIMUM OF 3 GROUND RODS SPACED A MINIMUM OF 10 FEET APART. ENSURE THAT EXISTING UNDERGROUND FACILITIES ARE NOT DAMAGED DURING INSTALLATION.
2. TEST GROUNDING SYSTEM USING AN APPROVED METHOD. SYSTEM SHALL MEASURE TWENTY (20) OHMS OR LESS. ADDITIONAL GROUND RODS SHALL BE INSTALLED AS DIRECTED BY THE ENGINEER TO MEET THIS REQUIREMENT.
3. ALL CONNECTIONS TO GROUND RODS SHOULD BE MADE WITH AN IRREVERSIBLE MECHANICAL CRIMP METHOD.
4. INSTALL MARKER TAPE DIRECTLY ABOVE ALL GROUNDING ELECTRODES AND CONDUCTORS AT A DEPTH OF 12 INCHES.
5. REMOVE BONDING JUMPER IN EQUIPMENT CABINET IF INSTALLED BETWEEN AC NEUTRAL AND EQUIPMENT GROUND.
6. BOND ALL RIGID GALVANIZED STEEL CONDUITS ENTERING THE CABINET TO EQUIPMENT GROUND.
7. INSTALL CONDUIT BETWEEN DISCONNECT AND CABINET.
8. ENSURE EQUIPMENT GROUND IS ELECTRICALLY BONDED TO EQUIPMENT CABINET.

DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED

HNTB
 HNTB NORTH CAROLINA, P.C.
 343 E. Six Forks Road, Suite 200
 Raleigh, North Carolina 27609
 NC License No: C-1554
 (919) 546-8997

Plans Prepared for:  250 N. Greenfield Place, Garner, NC 27529	DYNAMIC MESSAGE SIGN NEW ELECTRICAL SERVICE AND GROUNDING DETAIL		SEAL  ENGINEER RAKESH NUNE
	Division 14 Henderson Asheville	PLAN DATE: November 2018 REVIEWED BY: T.R. Terrell	
SCALE NONE	REVISIONS _____ _____ _____	INIT. DATE _____ _____ _____	DocuSigned by: Rakesh Nune 4/26/2019 _____ SIGNATURE DATE CADD File name: I4400BB ITS-36.dgn