

8/17/99

MATCHLINE -L- STA. 163+00
SEE SHEET UC-16B

CONSTRUCTION
SR5- STA. 15+75.00


SEE INSET "A" ON THIS SHEET

UTILITY CONSTRUCTION
DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED

FINAL DESIGN
RELEASE
FOR CONSTRUCTION

PROJECT REFERENCE NO. W-5600	SHEET NO. UC-15F
DESIGNED BY: SS	6/5/2020 10:51:38 EDT
DRAWN BY: SS	
CHECKED BY: MVZ	
APPROVED BY: MVZ	UTILITY ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151
REVISED:	UTILITIES ENGINEERING SEC. PLANS ONLY

NOTE: CONTRACTOR TO UTILIZE
HORIZONTAL & VERTICAL BENDS AS NECESSARY

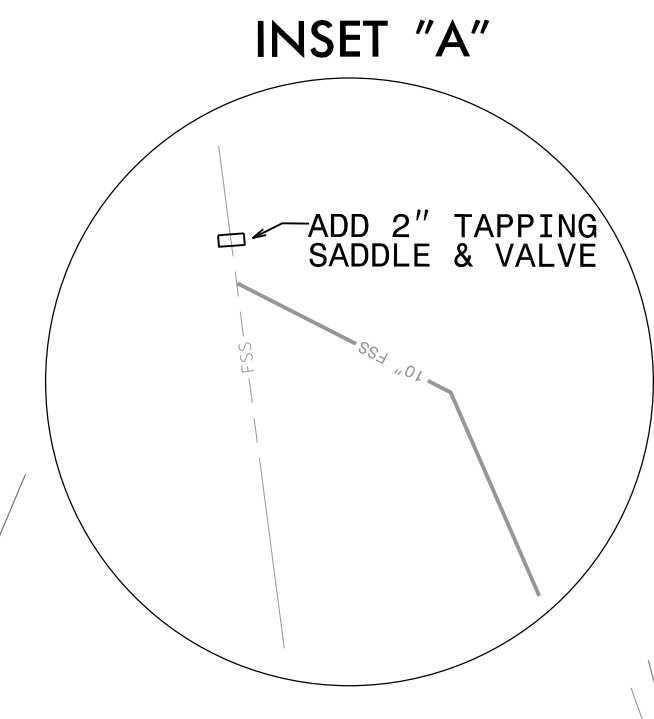


TIE TO EXISTING 10" PVC FORCE MAIN SEWER WITH 45 DEG BENDS. RESTRAIN NEW 45-DEG BEND TO EX. FORCE MAIN SEWER. USE CONCRETE TRUST COLLAR AND USE STAINLESS STEEL "ALL THREAD" RODDING AS REQUIRED. COORDINATE WITH COUNTY.

-WL8- 6" CLASS 51 RJ DIP WATER LINE

-FSS1- 10" SANITARY SEWER FORCE MAIN

EXISTING 10" SANITARY FORCE MAIN TO BE ABANDONED IN PLACE

TIE TO EXISTING 10" PVC FORCE MAIN SEWER. RESTRAIN NEW RESTRAINED JOINT D.I.P. TO EX. FORCE MAIN SEWER. USE CONCRETE TRUST COLLAR AND USE STAINLESS STEEL "ALL THREAD" RODDING AS REQUIRED. COORDINATE WITH COUNTY.

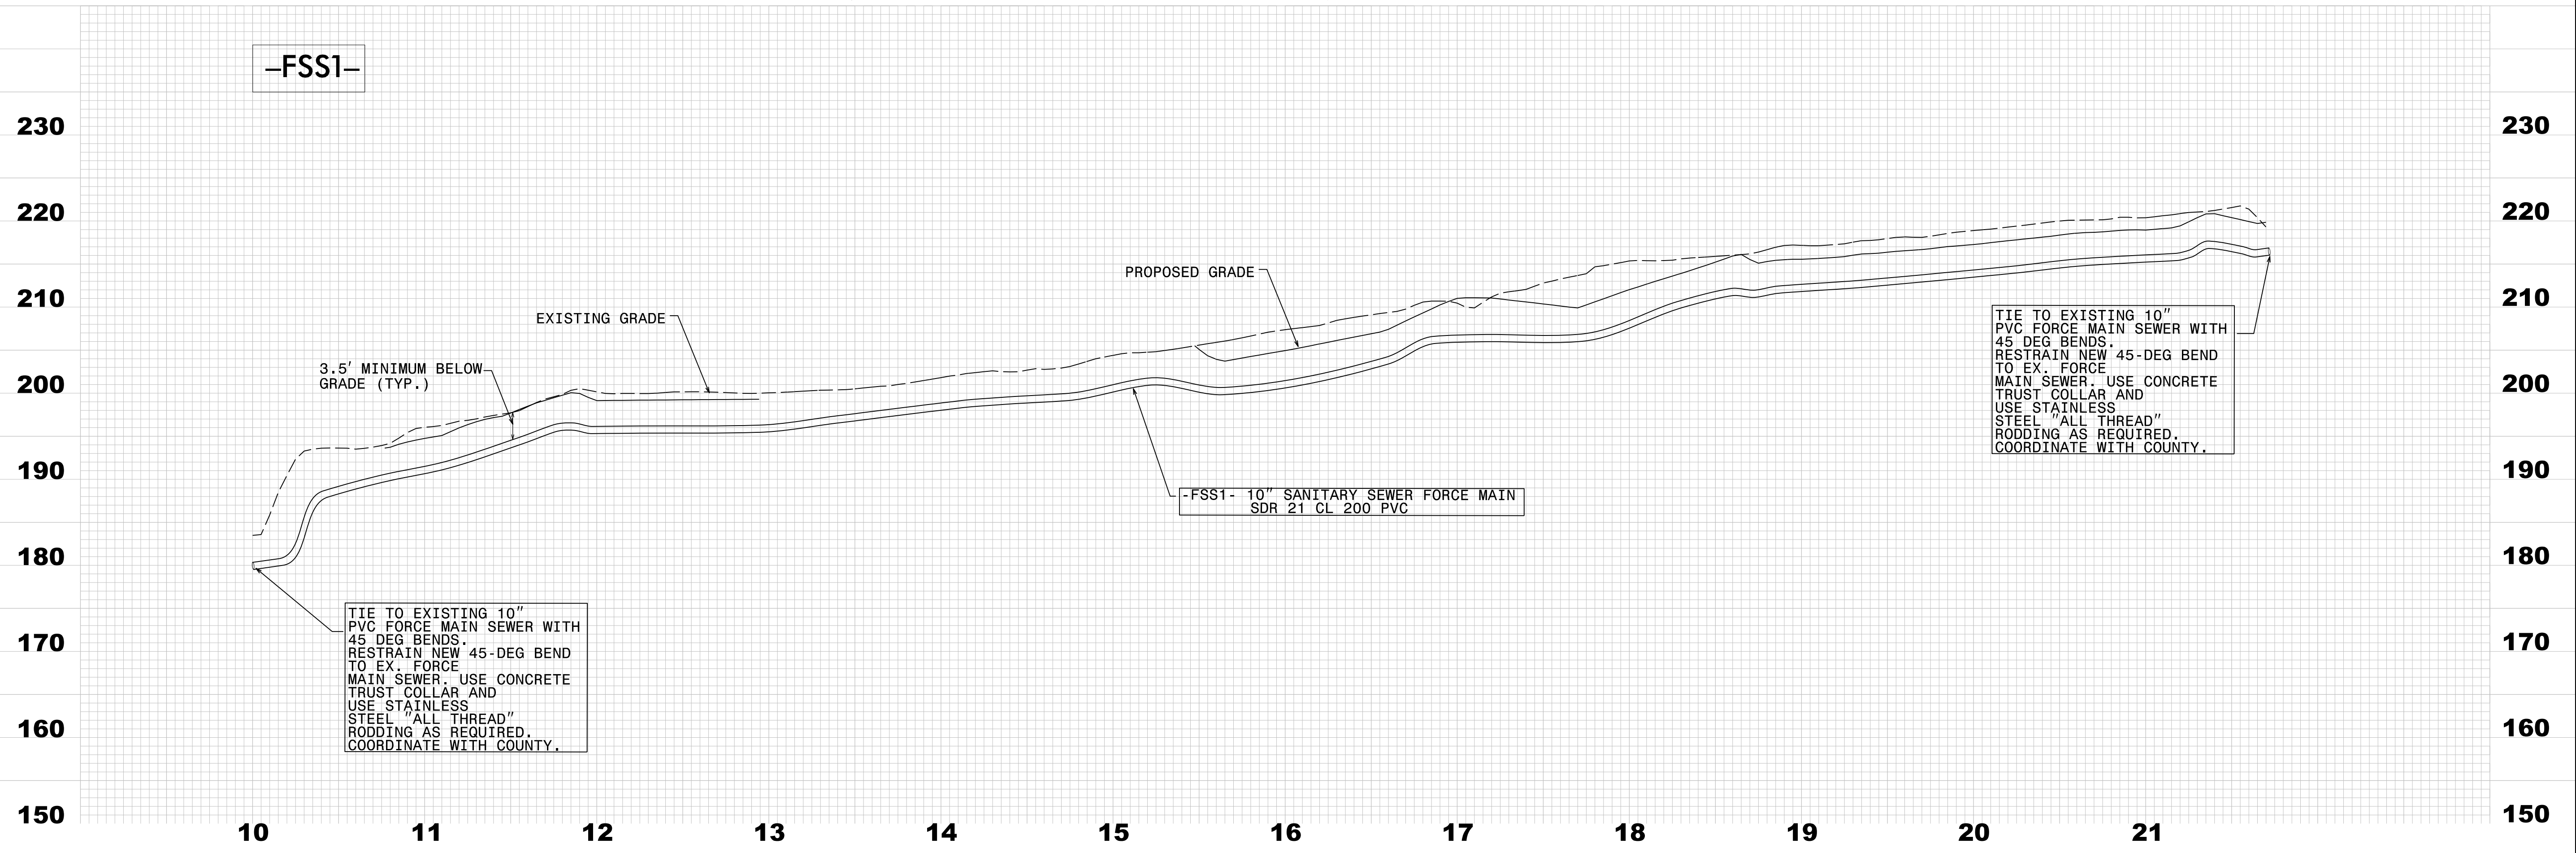

TIE TO EXISTING 10" PVC FORCE MAIN SEWER WITH 45 DEG BENDS. RESTRAIN NEW 45-DEG BEND TO EX. FORCE MAIN SEWER. USE CONCRETE TRUST COLLAR AND USE STAINLESS STEEL "ALL THREAD" RODDING AS REQUIRED. COORDINATE WITH COUNTY.

TIE TO EXISTING 10" PVC FORCE MAIN SEWER WITH 45 DEG BENDS. RESTRAIN NEW 45-DEG BEND TO EX. FORCE MAIN SEWER. USE CONCRETE TRUST COLLAR AND USE STAINLESS STEEL "ALL THREAD" RODDING AS REQUIRED. COORDINATE WITH COUNTY.

REVISIONS

8/17/99
 E:\Projects\W-5600\Drawings\Engineering\UC\15\15F01.dwg
 PLOT DATE: 6/5/2020 10:51:38 EDT
 PLOT BY: C:\WINNT\SYSTEM32\cmd.exe