


8/17/99

PROJECT REFERENCE NO.	SHEET NO.
R-5020B	UC-7
DESIGNED BY: DK	
DRAWN BY: AP	
CHECKED BY: MM	
APPROVED BY:	
REVISED:	
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151	
UTILITY CONSTRUCTION PLANS ONLY Engineers • Planners • Scientists • Construction Managers 4595 Falls of Noe Road, Suite 400 Raleigh, NC 27609 Phone (919) 783-9214 • Fax (919) 783-9266 License No. C-794	

NOTES:

- SEE SHEET UC-3A FOR CONNECTION TO EXISTING AC WATER LINE DETAIL.
- FOLLOWING CONSTRUCTION OF THE PROPOSED WATER LINE, ABANDON VALVE IN PLACE.
- EXISTING PIPE TO BE ABANDONED SHALL BE REMOVED AS NECESSARY BY CONTRACTOR FOR THE PROPOSED PIPE INSTALLATION.
- PROPOSED WATER METER BOX FOR FUTURE METER BY OTHERS.

WATER LINE

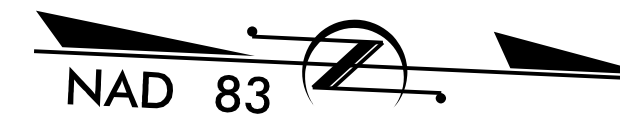


UTILITY CONSTRUCTION

DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED


MATCHLINE -L- STA. 207 + 79.65 SEE SHEET UC-6

MATCHLINE -L- STA. 221 + 83.11 SEE SHEET UC-8

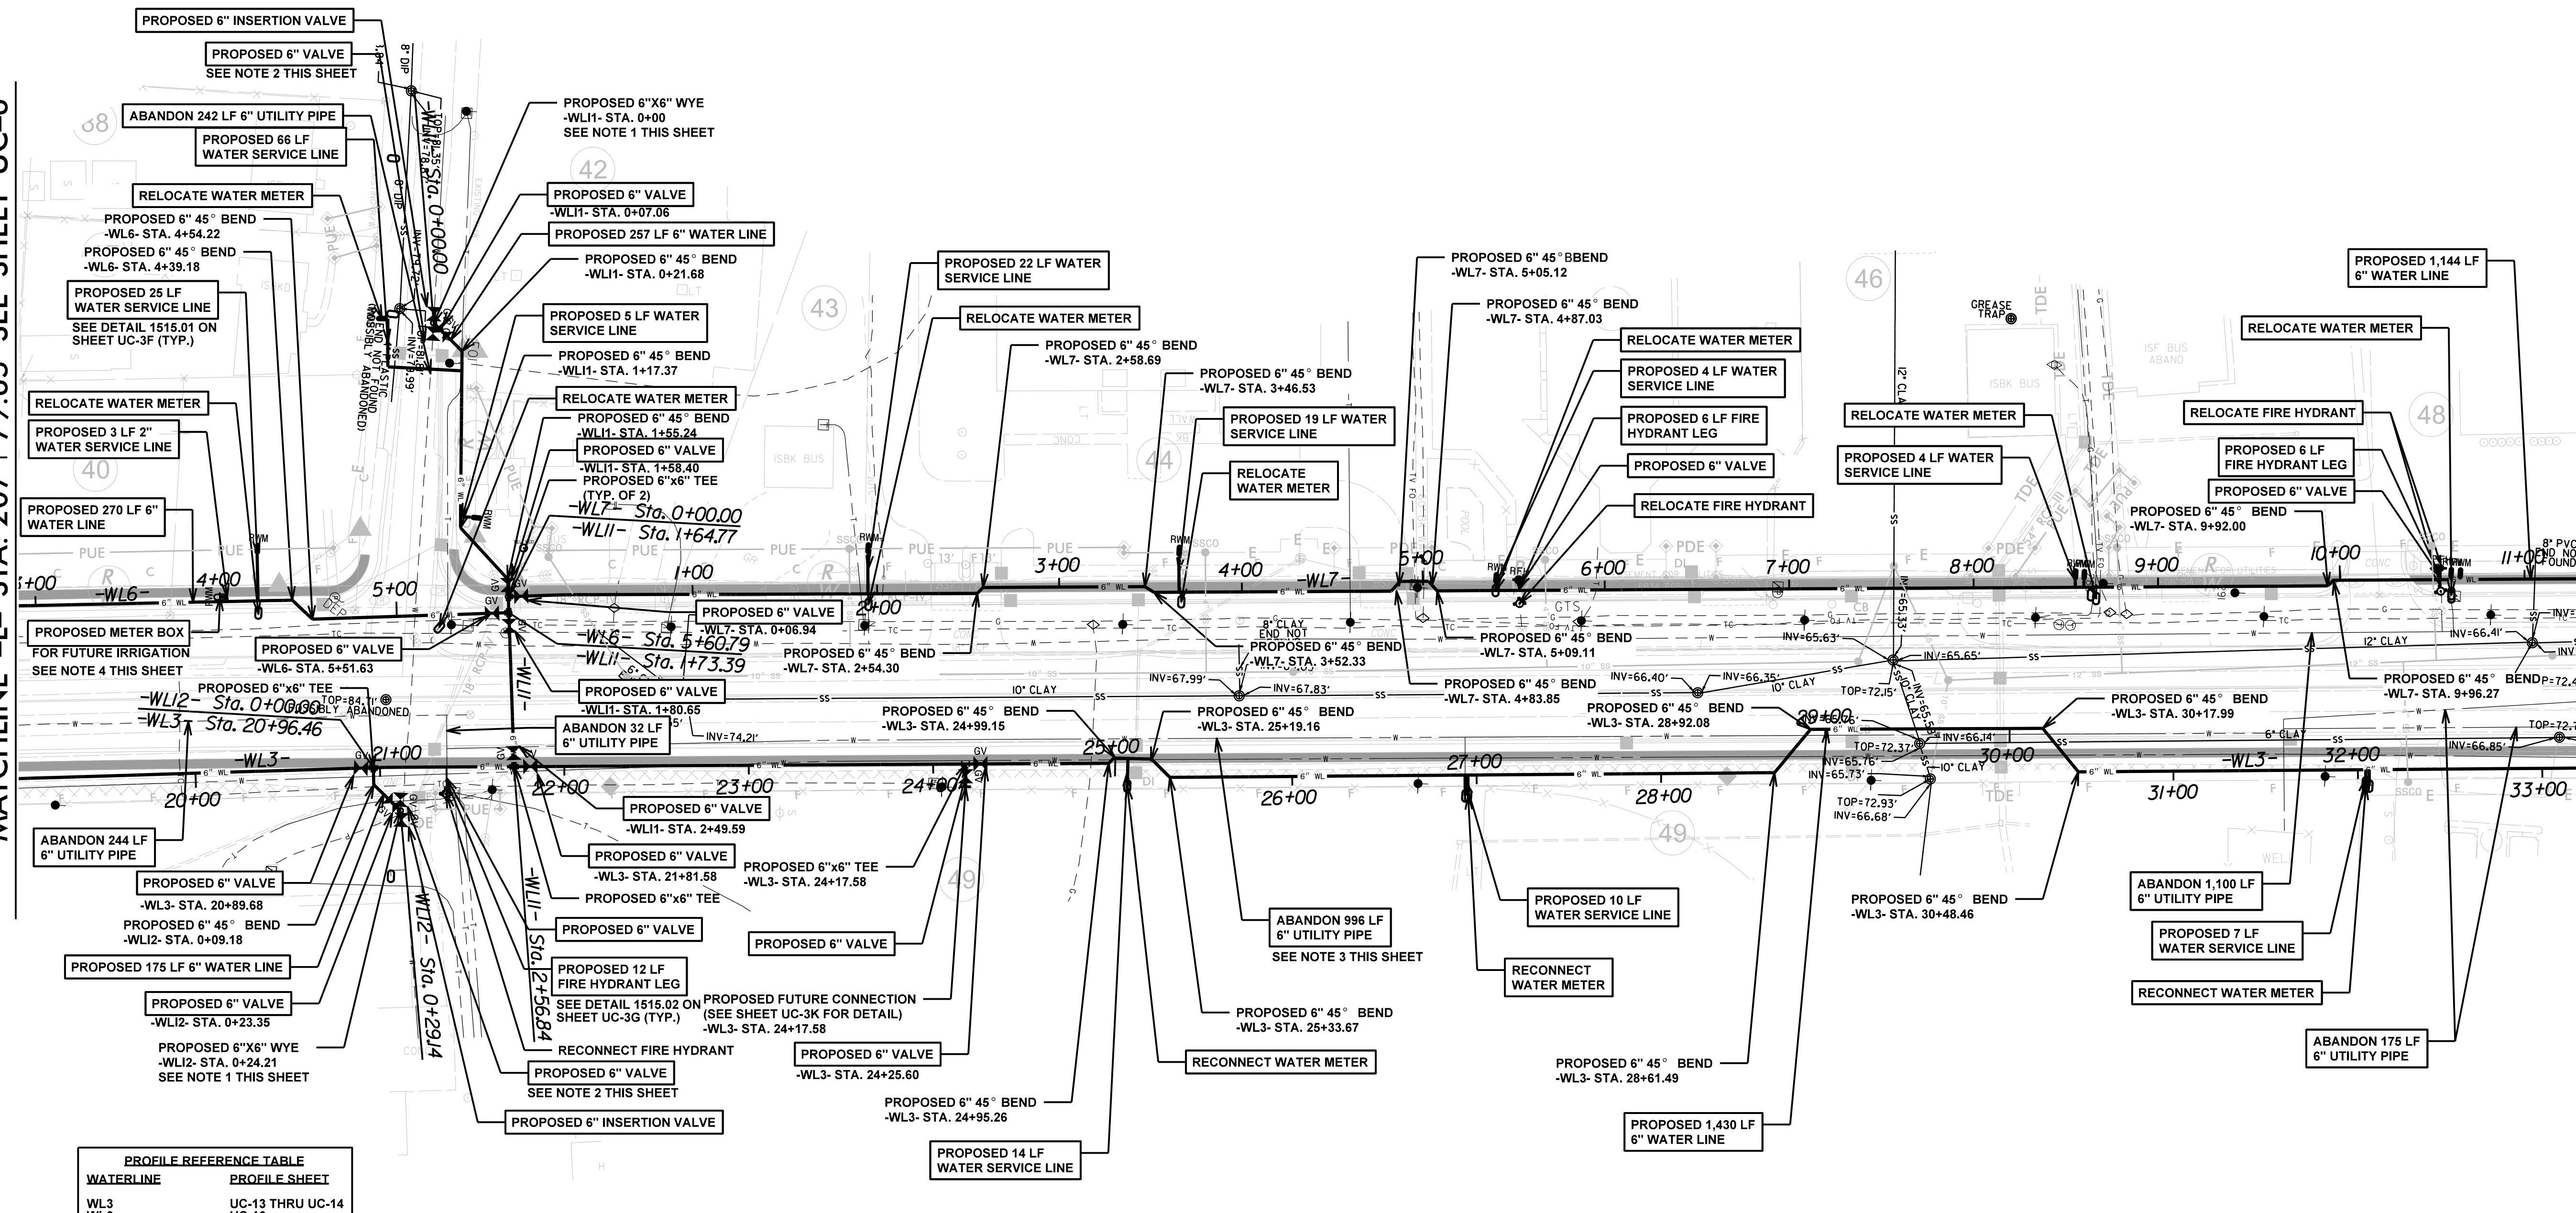

PROFILE REFERENCE TABLE	
WATERLINE	PROFILE SHEET
WL3	UC-13 THRU UC-14
WL6	UC-16
WL7	UC-16
WL11, WL12	UC-22

5,597 LB DUCTILE IRON WATER PIPE FITTING

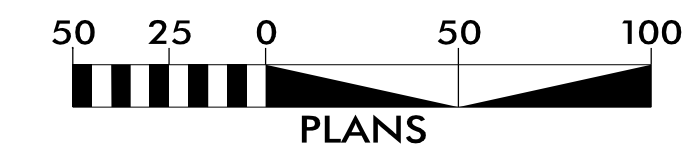

03-SEP-2020 09:27
 M:\2016\2161001854\NCDOT_R-5020B\US 701 Widening\Water_Sanitary\R-5020B.ut_r.dwg UC07_psh.dgn
 USER: JAMES