
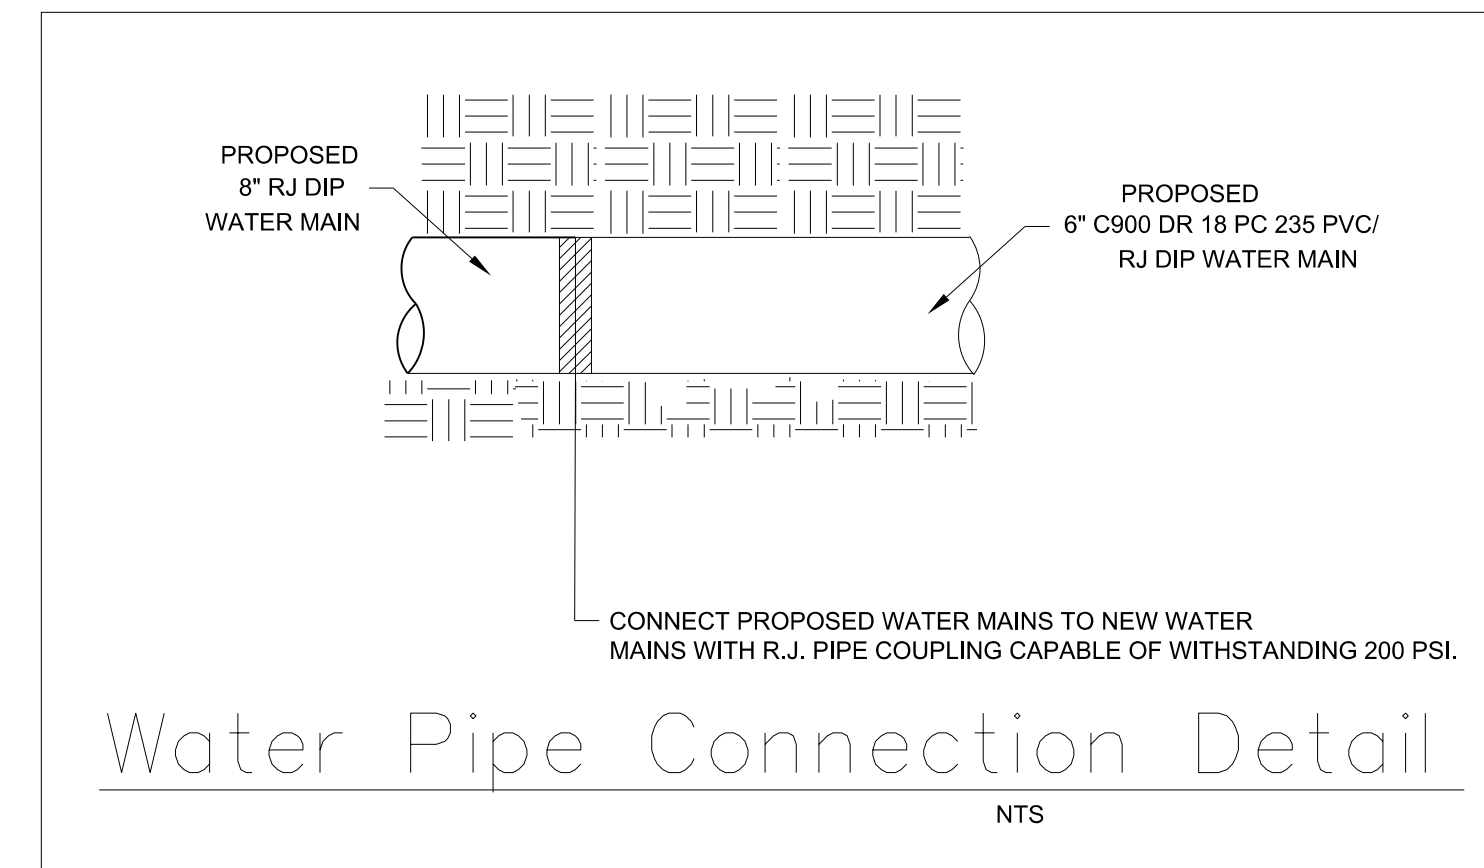
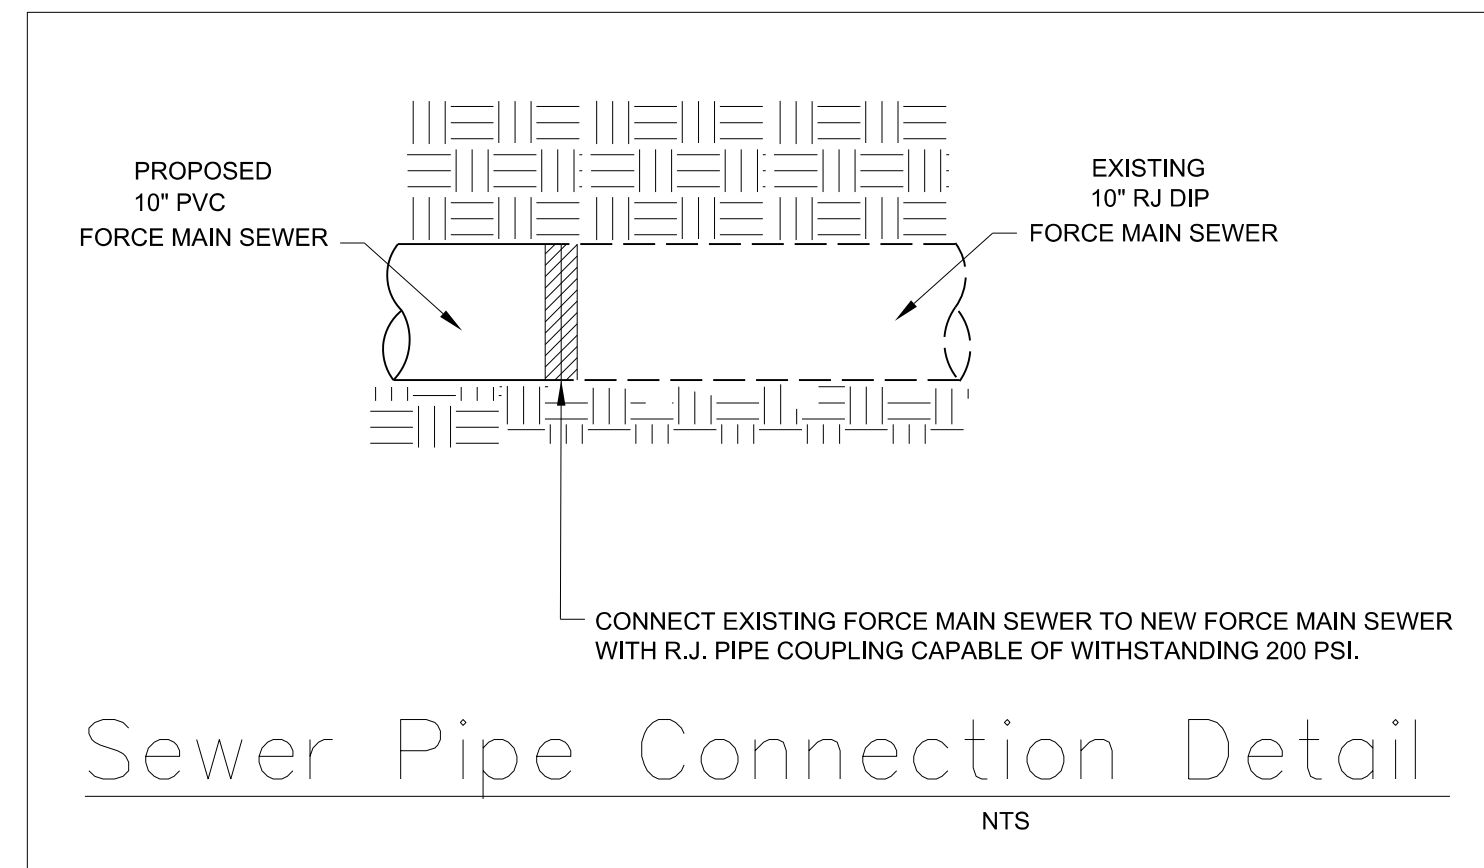



PROJECT REFERENCE NO.	SHEET NO.
R-5797	UC-3B
DESIGNED BY: SLK	
DRAWN BY: SLK	
CHECKED BY: DBC	
APPROVED BY: DBC	
REVISED:	
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151	

# PROJECT TYPICAL DETAILS

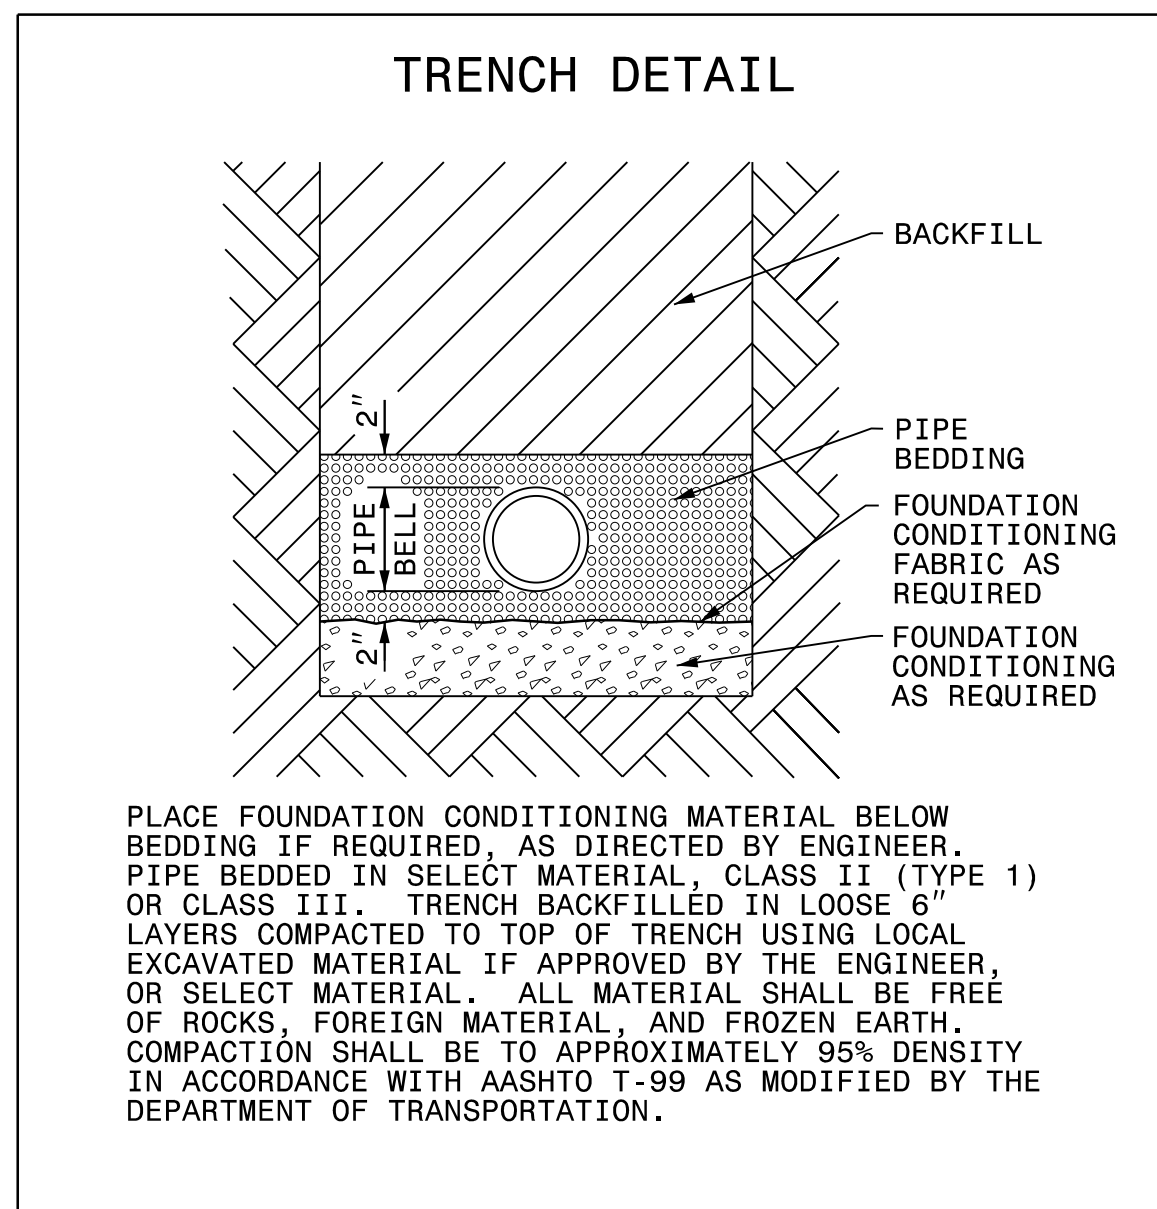

UTILITY CONSTRUCTION  
DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

**FINAL DESIGN**  
RELEASE FOR CONSTRUCTION

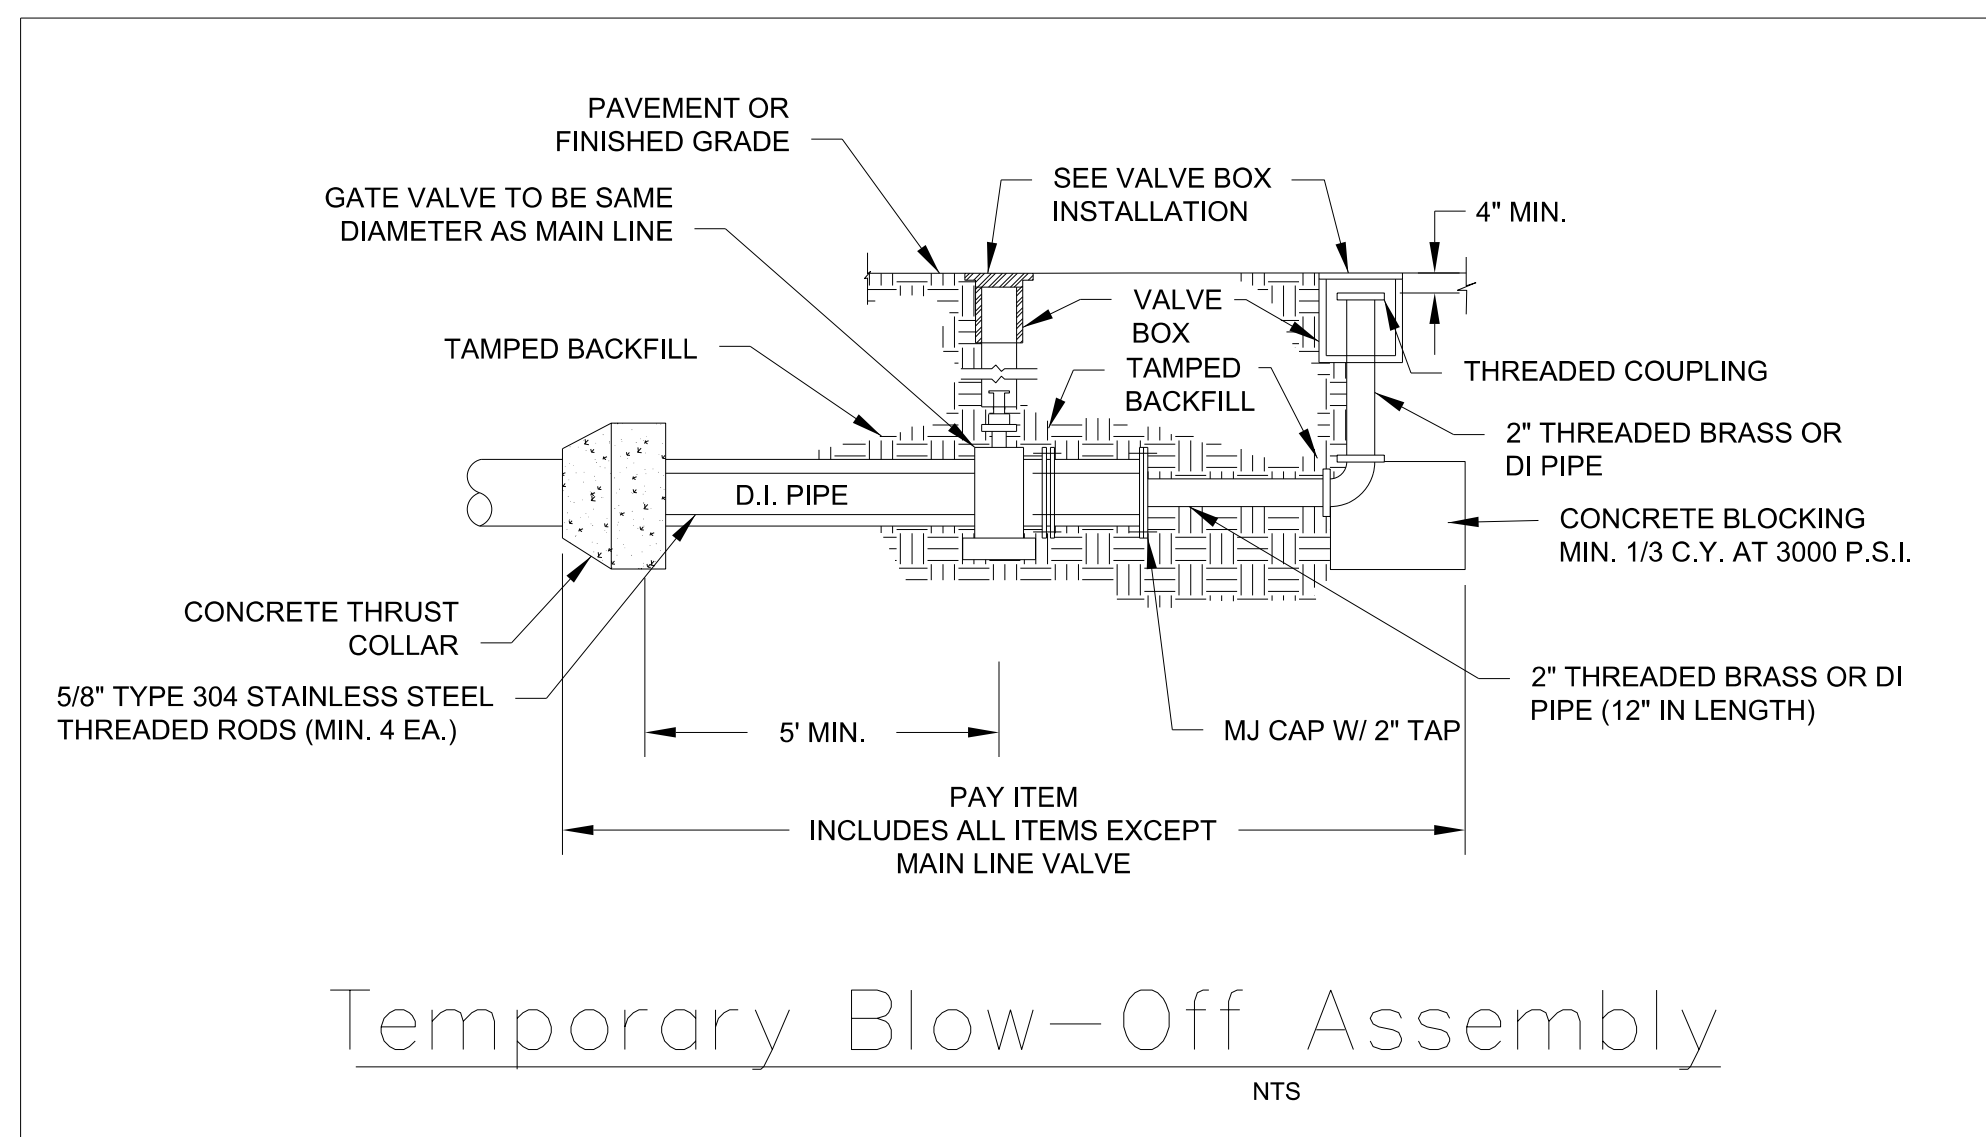

**NOTES:**

- THRUST BLOCKS SHALL BE INSTALLED ON PVC WATER DISTRIBUTION LINES 6" THRU 12" DIA. IN THE MANNER SHOWN.
- PIPE GREATER THAN 12 INCH DIAMETER SHALL REQUIRE RESTRAINT JOINT PIPE FOR THE PROPER LENGTH.
- SAC-CRETE SHALL NOT BE ALLOWED.
- NO CONCRETE SHALL BE PLACED ON BOLTS. WRAP JOINT FITTINGS WITH PLASTIC.
- CONCRETE SHALL BE A MINIMUM 3,000 psi.
- ALL BEARING SURFACES SHALL BE AGAINST UNDISTURBED SOIL.

**CONCRETE THRUST BLOCK DETAIL**

NTS

SEE BLOW-OFF DETAIL FOR CLARIFICATION OF CONSTRUCTION REQUIRED AT DEAD ENDS

ALL BEARING SURFACES SHALL BE AGAINST UNDISTURBED GROUND (TYP.)

CONCRETE SHALL BE KEPT CLEAR OF PIPE JOINTS (TYP.)

FITTING SIZE (IN.)	THRUST BLOCKING SCHEDULE					
	MINIMUM BLOCKING AREA AND VOLUME IN S.F. AND (C.Y.)					
	11 1/4"	22 1/2"	45"	90"	TEE	PLUG
2			0.23 (0.11)	0.38 (0.11)	0.30 (0.11)	0.30 (0.11)
4			0.83 (0.18)	1.35 (0.18)	0.98 (0.18)	0.98 (0.18)
6	0.40 (0.01)	0.80 (0.02)	1.73 (0.20)	3.00 (0.33)	2.17 (0.25)	2.17 (0.25)
8	0.80 (0.02)	1.50 (0.04)	3.08 (0.34)	5.40 (0.60)	3.83 (0.42)	3.83 (0.42)
10	1.20 (0.03)	2.30 (0.07)	4.72 (0.52)	8.40 (0.94)	5.92 (0.66)	5.92 (0.66)
12	1.70 (0.05)	3.30 (0.12)	6.82 (0.75)	12.00 (1.33)	8.48 (0.94)	8.48 (0.94)
16	3.00 (0.33)	5.90 (0.65)	11.60 (0.86)	21.30 (1.57)	15.00 (0.97)	15.00 (0.97)
20	4.60 (0.52)	9.20 (0.76)	18.00 (1.32)	33.30 (3.60)	23.30 (1.87)	23.30 (1.87)
24	6.70 (0.75)	13.20 (0.97)	26.00 (2.28)	48.00 (5.29)	33.60 (3.24)	33.60 (3.24)
30	10.40 (0.77)	20.70 (1.80)	40.60 (4.45)	75.00 (10.30)	52.50 (6.32)	52.50 (6.32)
36	15.00 (1.28)	29.80 (3.11)	58.40 (7.67)	108.0 (17.90)	75.60 (10.90)	75.60 (10.90)

NOTE: Values given are based on 200 psi water pressure and 2000 lb/sf soil bearing capacity. Soils with less bearing capacity such as muck, peat or soft clay will require greater blocking areas and volumes.

The thrust blocking shown above is based on the use of mechanical joint as shown on plans.

