



5/14/99
 \$\$\$\$\$\$SYTIME\$\$\$\$\$CON\$\$\$\$\$USRNAME\$\$\$\$\$
 \$\$\$\$\$\$V\$\$\$\$\$J\$\$\$\$\$S\$\$\$\$\$R\$\$\$\$\$E\$\$\$\$\$M\$\$\$\$\$E\$\$\$\$\$S\$\$\$\$\$

PAY LIMITS FOR 1 CURB RAMP

ETC.

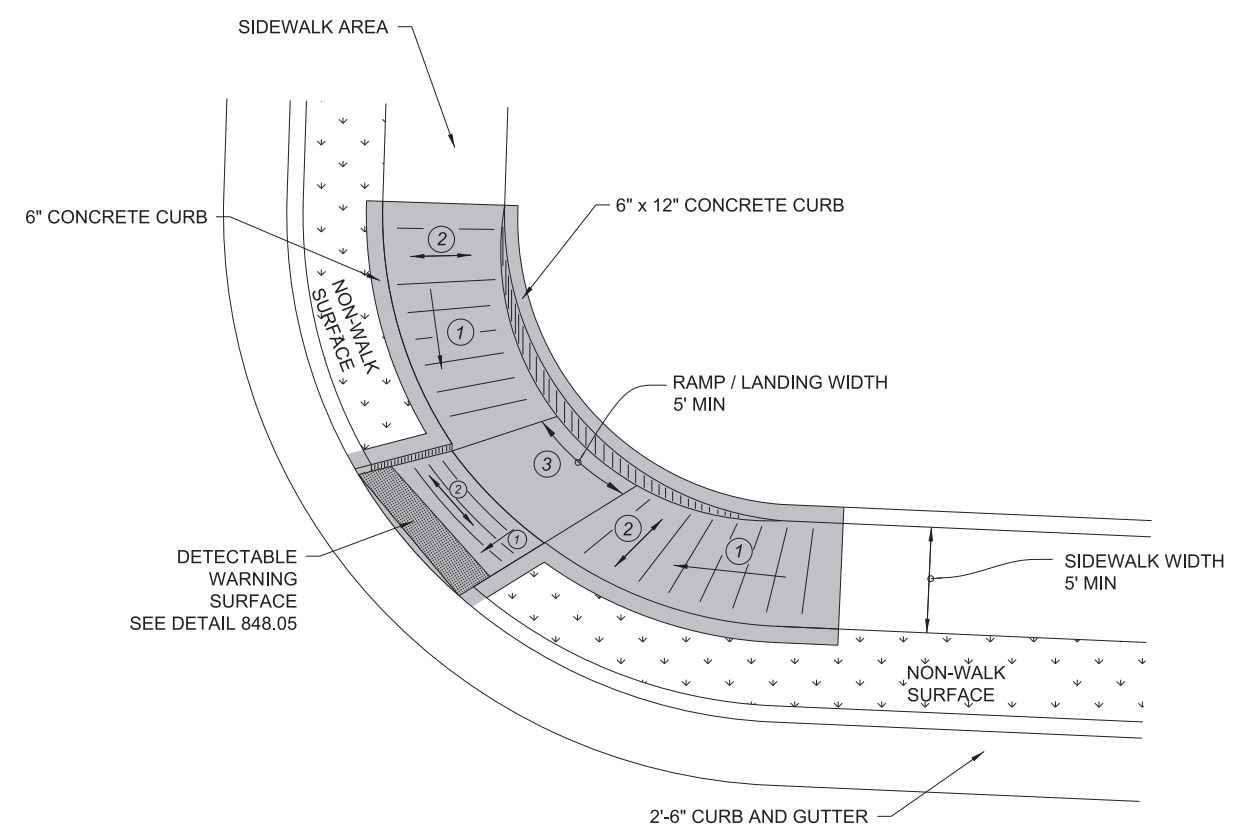


**TYPE 3 MODIFIED
 INSTALLATION IN A RADIUS**

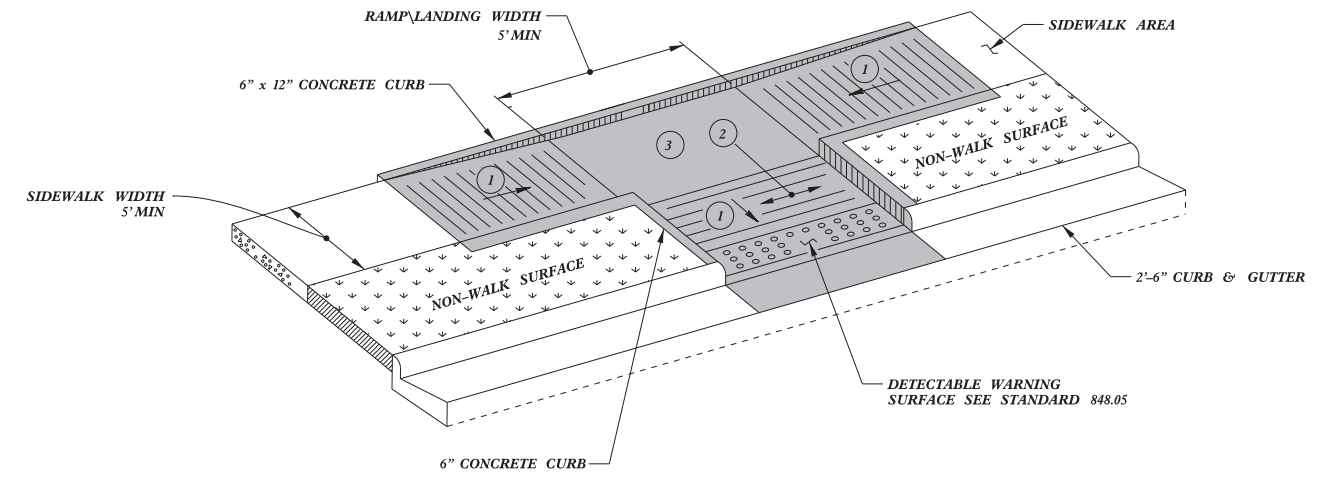

TYPE 3

- 1 8.33% (12:1) MAX RAMP SLOPE
- 2 CROSS SLOPE: 2.00%
- 3 CURB RAMPS REQUIRE A (4'-0") MINIMUM LANDING WITH A MAXIMUM CROSS SLOPE AND LONGITUDINAL SLOPE OF 2.00% WHERE PEDESTRIANS PERFORM TURNING MANEUVERS. SLOPE TO DRAIN TO CURB.

1/8/2020



Designed by:
J.S. Howerton
 873F3D17DCDC45F..

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

CONTRACT STANDARDS AND DEVELOPMENT UNIT	
Office 919-707-6950	FAX 919-250-4119
CURB RAMPS	
ORIGINAL BY: J.S. HOWERTON	DATE: 7/7/11
MODIFIED BY:	DATE:
CHECKED BY:	DATE:
FILE SPEC. sids/2012CurbRamp/CurbRampDetails.dgn	