



USE FOR LIGHTING CONSTRUCTION ONLY


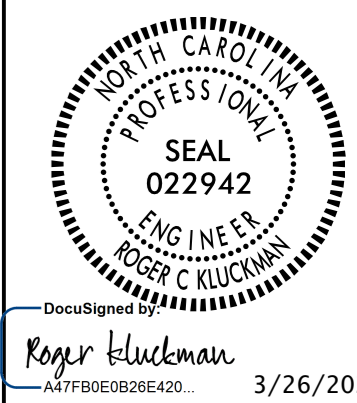


SEE SHEET "E1" FOR LEGEND & △ NOTES

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

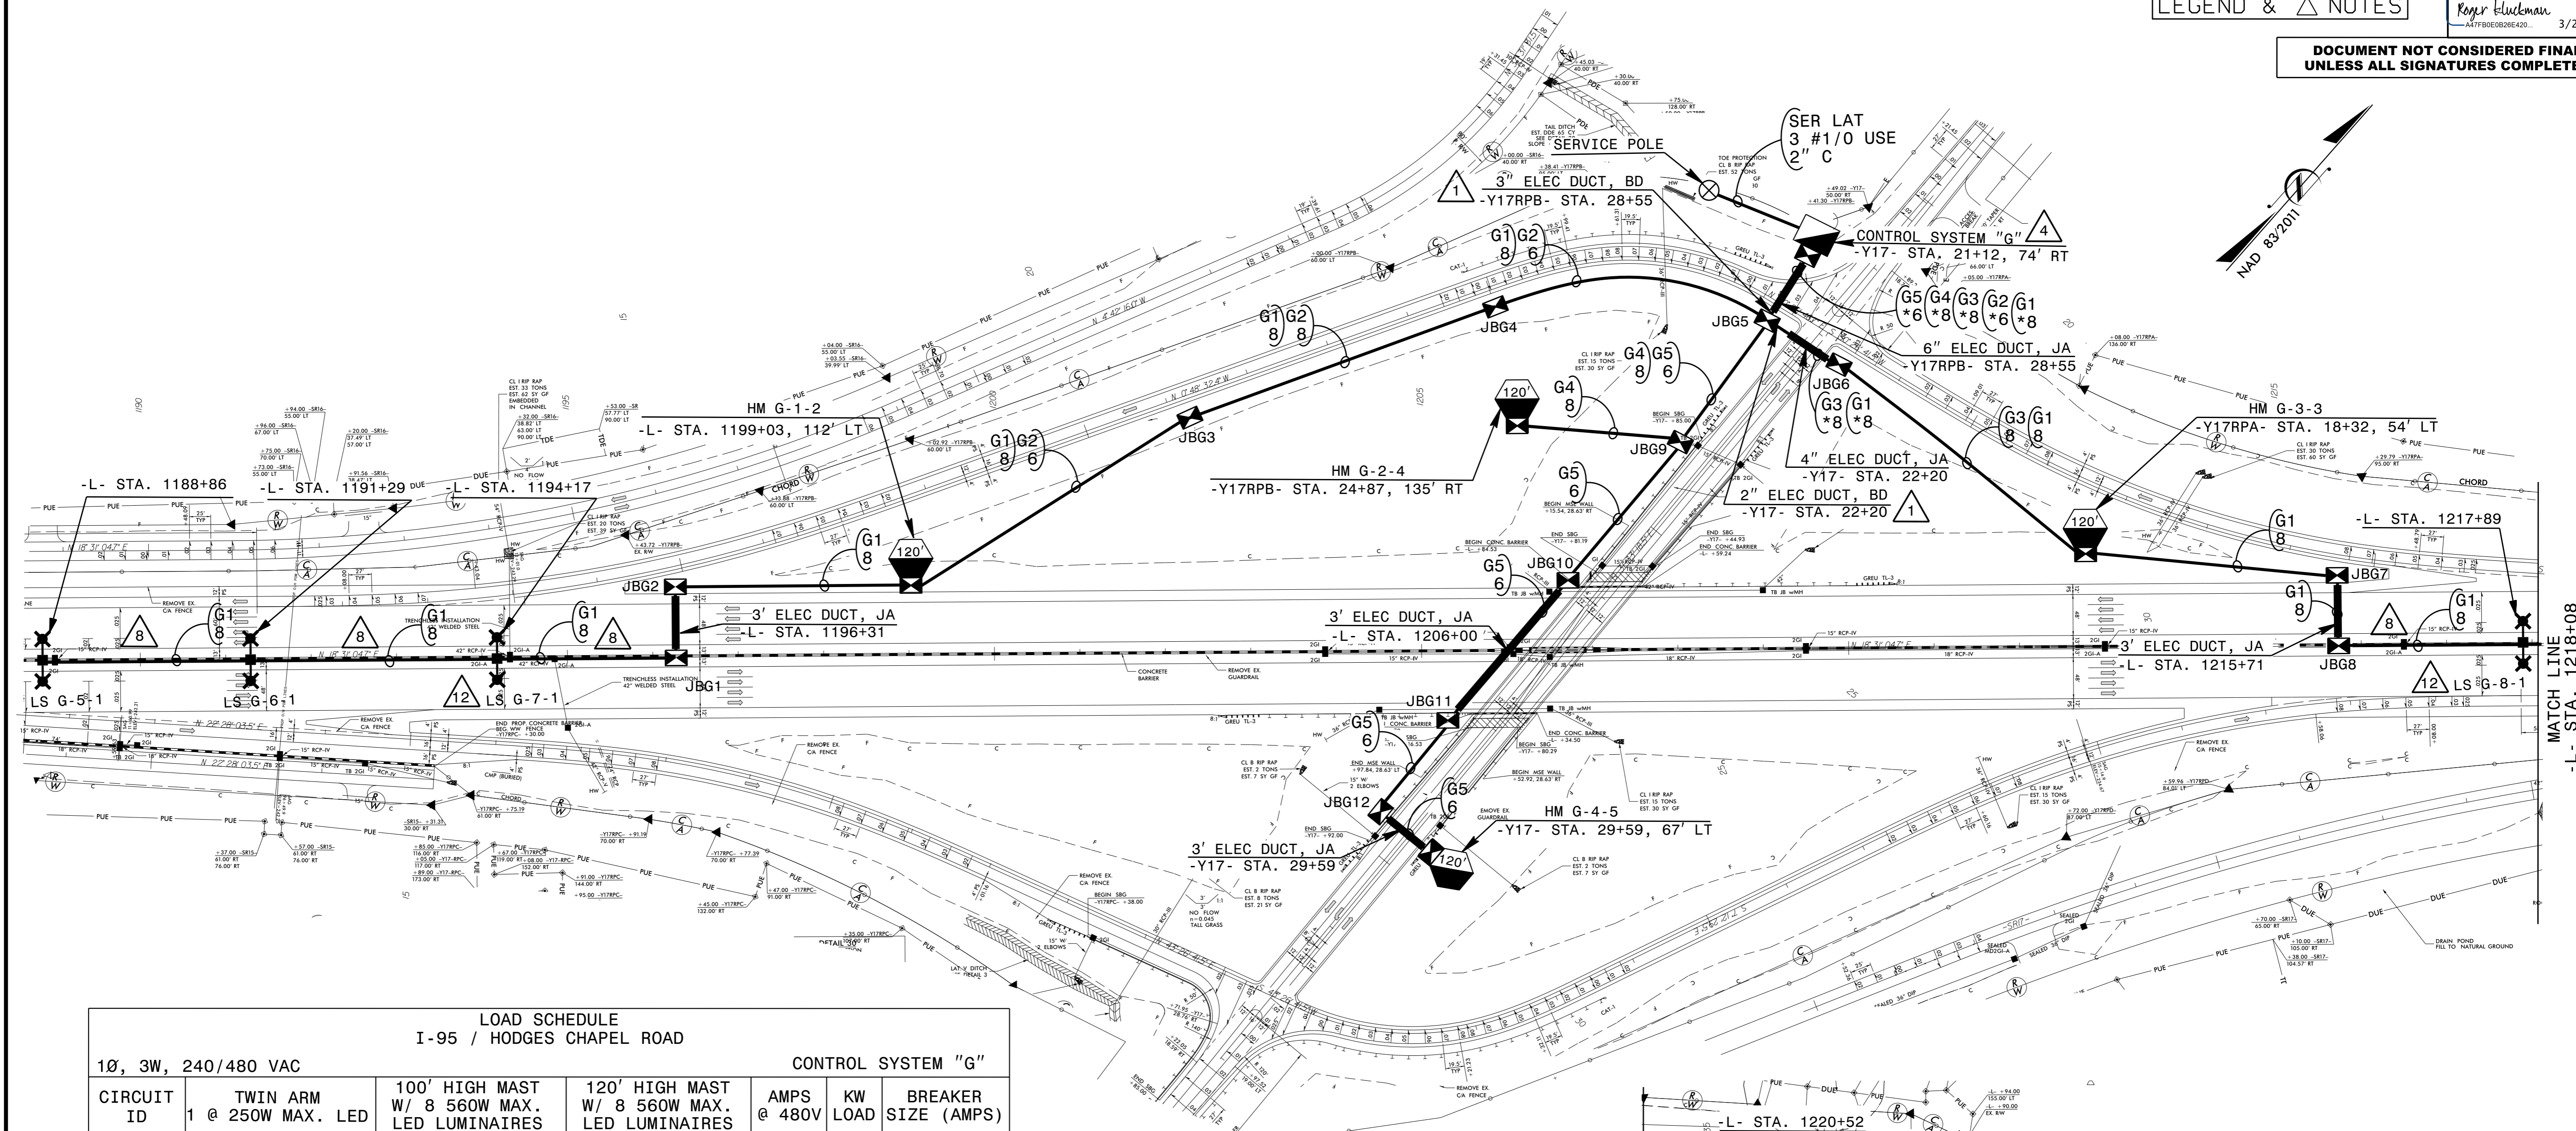

LOAD SCHEDULE I-95 / HODGES CHAPEL ROAD						
1Ø, 3W, 240/480 VAC			CONTROL SYSTEM "G"			
CIRCUIT ID	TWIN ARM @ 250W MAX. LED	100' HIGH MAST W/ 8 560W MAX. LED LUMINAIRES	120' HIGH MAST W/ 8 560W MAX. LED LUMINAIRES	AMPS @ 480V	KW LOAD	BREAKER SIZE (AMPS)
G1	G-5, G-6, G-7, G-8, G-9, G-10			7.2	3.4	15
G2			G-1	9.3	4.5	15
G3			G-2	9.3	4.5	15
G4			G-3	9.3	4.5	15
G5			G-4	9.3	4.5	15
SPARE						15
TOTAL	6		4	44.4	21.4	

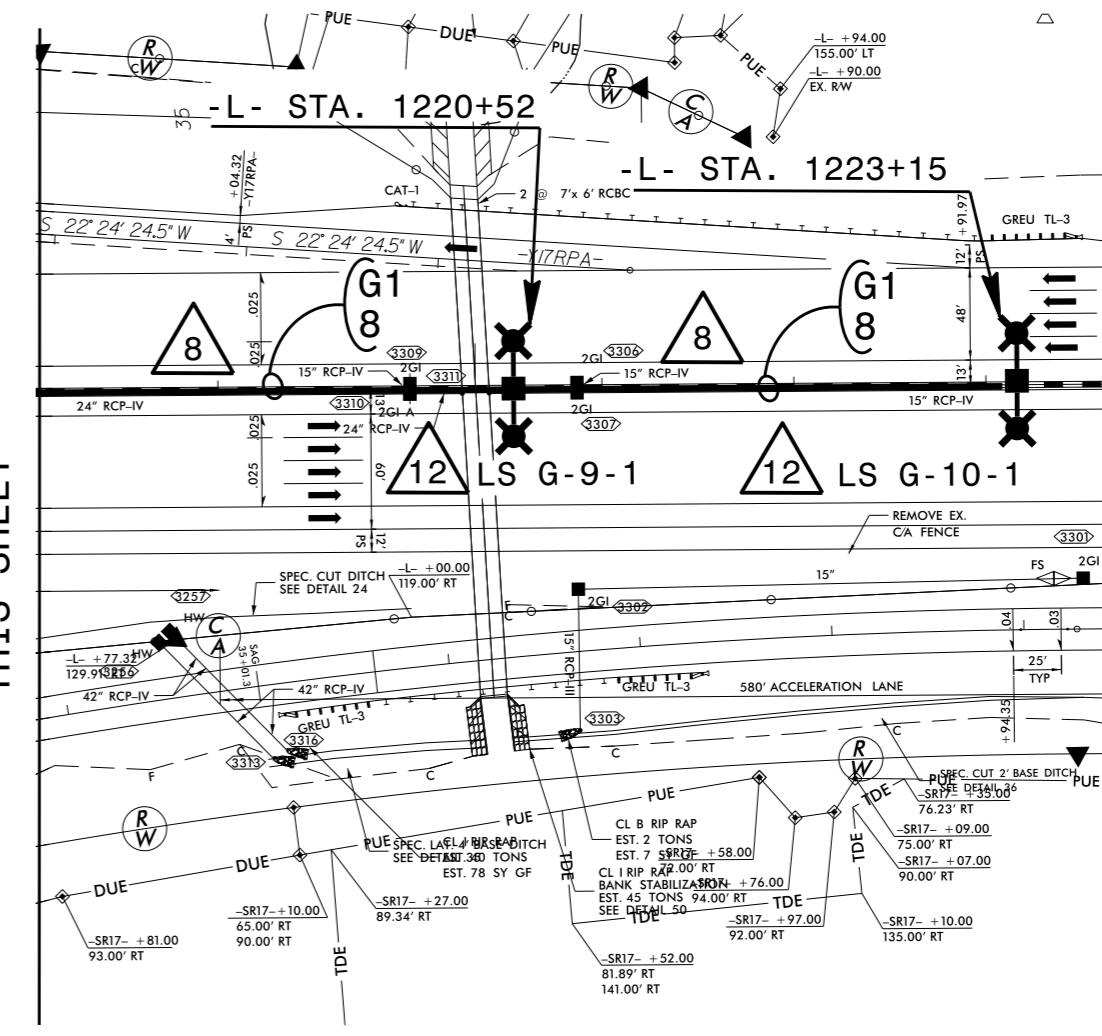

2			
1			
Rev.	Date	Description	Approved
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION ROADWAY DESIGN LIGHTING/ELECTRICAL SECTION LIGHTING LAYOUT I-95 / HODGES CHAPEL ROAD INTERCHANGE (EXIT-77) HARNETT COUNTY			
Drawn By:	SKS	Approved By:	RGH
Dwg No.:			

26-MAR-2021 16:07 P:\Lighting\Lighting Design\Design\I-95866B.LE.E5.dgn rghal AT RD-303048L