


8/17/99

NOTES:

1. SEE SHEET UC-3A FOR CONNECTION TO EXISTING AC WATER LINE DETAIL.
2. FOLLOWING CONSTRUCTION OF PROPOSED WATER LINE, ABANDON VALVE IN PLACE.
3. EXISTING PIPE TO BE ABANDONED SHALL BE REMOVED AS NECESSARY BY CONTRACTOR FOR THE PROPOSED PIPE INSTALLATION




WATER LINE

PROJECT REFERENCE NO. <b>R-5020B</b>	SHEET NO. <b>UC-4</b>
DESIGNED BY: <b>DK</b>	
DRAWN BY: <b>AP</b>	
CHECKED BY: <b>MM</b>	
APPROVED BY:	
REVISED:	9/3/2020
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151	
UTILITY CONSTRUCTION PLANS ONLY 	


UTILITY CONSTRUCTION

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

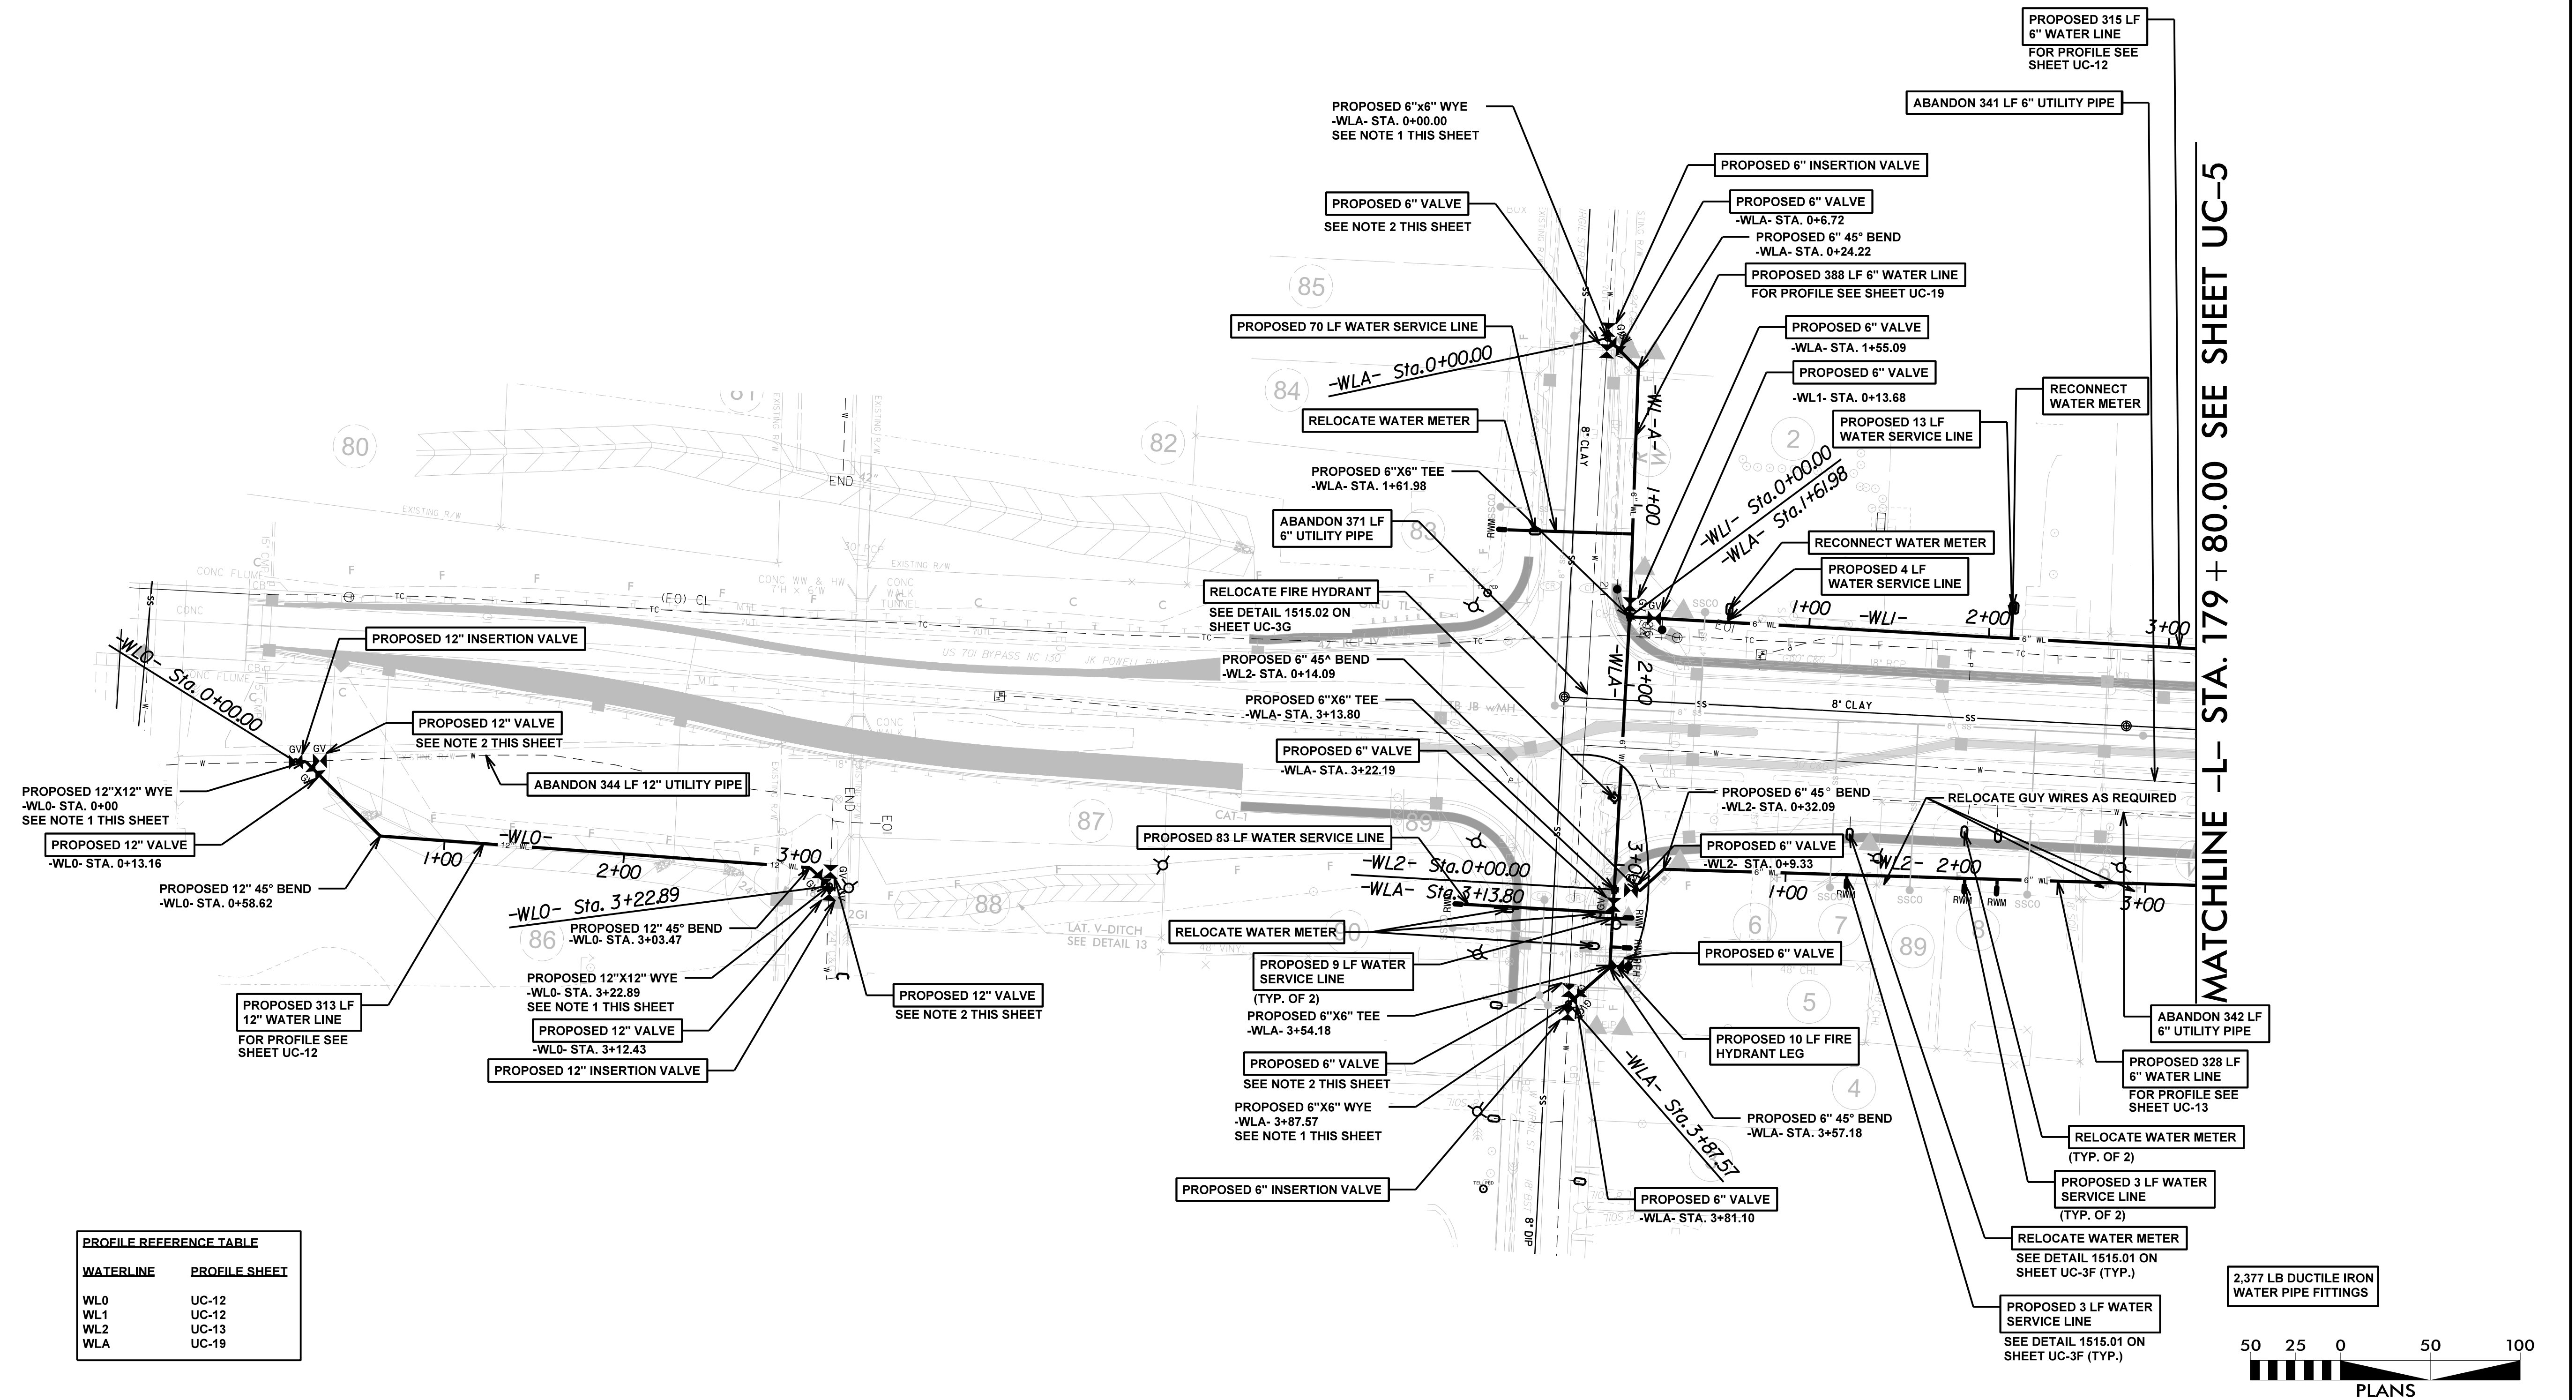

PROFILE REFERENCE TABLE	
WATERLINE	PROFILE SHEET
WL0	UC-12
WL1	UC-12
WL2	UC-13
WLA	UC-19

MATCHLINE -L- STA. 179 + 80.00 SEE SHEET UC-5

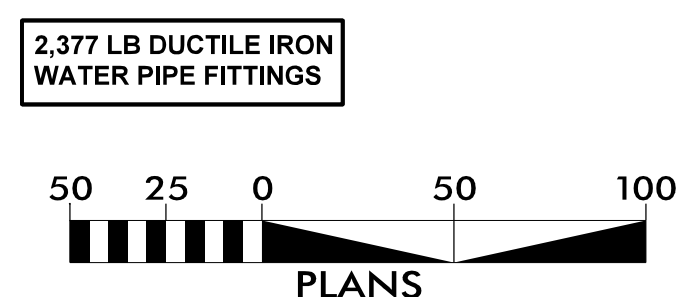

25-AUG-2020 15:16:59 NCDOT R-5020B US 701 Widening\Water\_Sanitary\R-5020B\_ut\_rdy4\_UC04\_psh.dgn  
 8/17/99  
 2016 09 03 10:58 AM  
 2016 09 03 10:58 AM  
 2016 09 03 10:58 AM  
 2016 09 03 10:58 AM