DocuSign Envelope ID: 86AC0722-E9A0-4114-B6B8-B969C0794813

PROJECT REFERENCE NO.	SHEET NO.
U-4906	UC-5
DESIGNED BY: SHF	
DRAWN BY: SHF	
CHECKED BY: KCZ	
APPROVED BY: KCZ	
REVISED:	
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION	
UTILITIES ENGINEERING SEC. PHONE:(919)707-6690 FAX:(919)250-4151	UTILITY CONSTRUCTION PLANS ONLY

NORTH CAROLINA PROFESSIONAL SEAL 27611 ENGINEER KEVIN C. ZIEB 7/1/2021

DocuSigned by: Kevin C. Zieb

UTILITY CONSTRUCTION

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

Weston & Sampson
WSE of North Carolina, PC
598 East Chatham Street Suite 137 Cary, NC 27511
Phone: 919.297.0220 Fax: 919.297.0221
NC License: C-4647

THE ESTIMATED QUANTITY OF DUCTILE IRON WATER PIPE FITTINGS ON THIS PLAN SHEET IS 300 LBS. THE ACTUAL QUANTITY AND TYPE OF FITTINGS WILL VARY BASED ON FIELD CONDITIONS.

THE ESTIMATED QUANTITY OF DUCTILE IRON SEWER PIPE FITTINGS ON THIS PLAN SHEET IS 0 LBS. THE ACTUAL QUANTITY AND TYPE OF FITTINGS WILL VARY BASED ON FIELD CONDITIONS.

UTILITY OWNERS ON THIS SHEET:

ONWASA
UTILITY: 6" WATER
12" SANITARY FORCE MAIN
CONTACT: DAVID M. MOHR, PE
PHONE: 910-937-7521

CITY OF JACKSONVILLE
UTILITY: 10" WATER
CONTACT: MICHAEL MOORE
PHONE: 910-938-5332

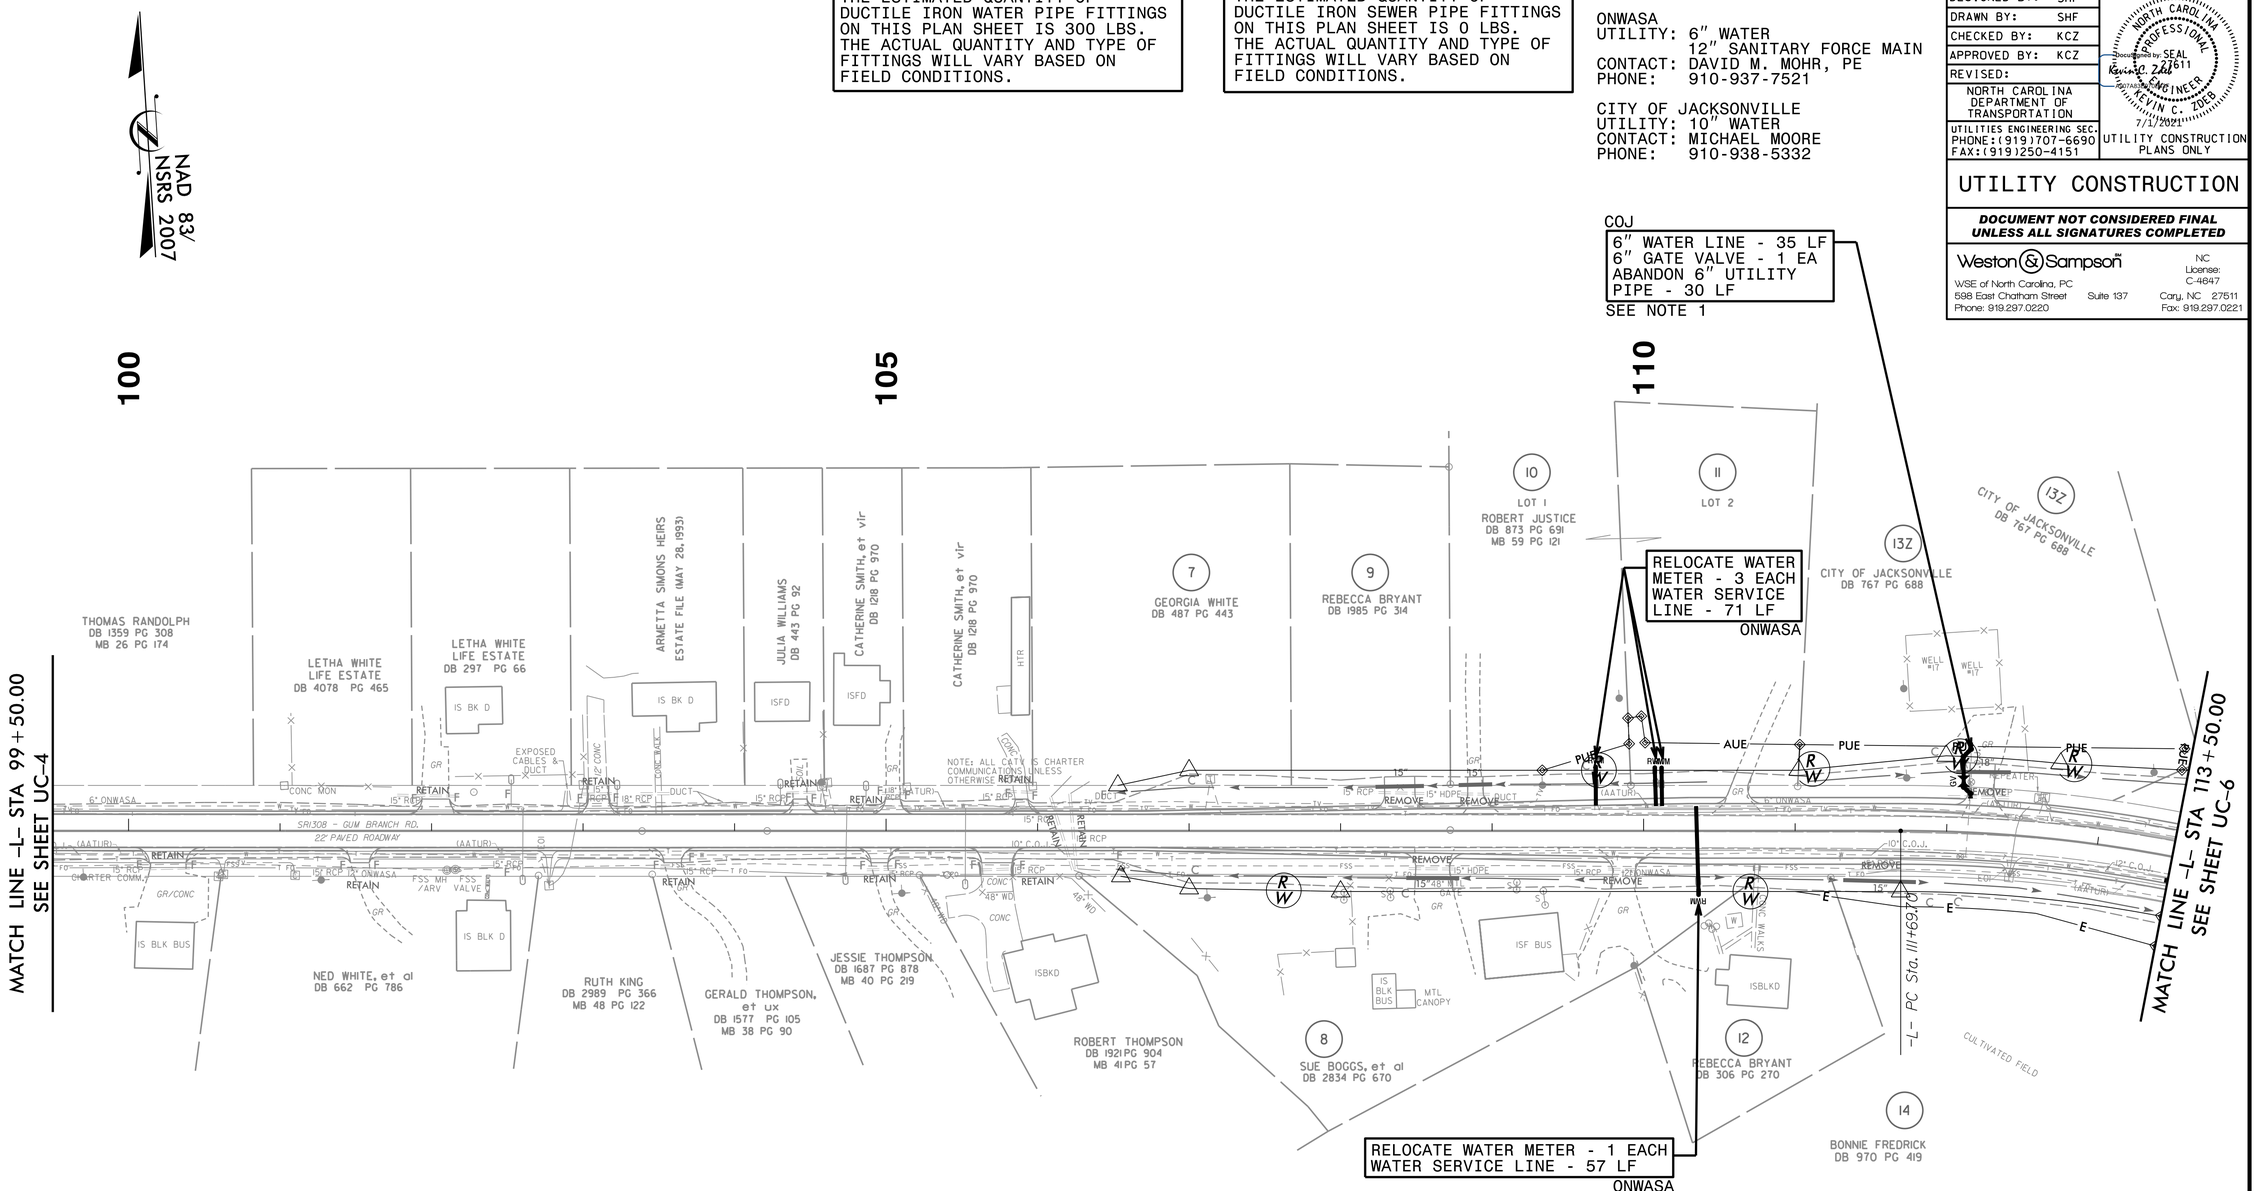

NOTES:
1. PROPOSED DOWN AND UNDER RELOCATION OF UTILITY. REFER TO DETAIL ON SHEET UC-3B.
2. OPEN TRENCH CONSTRUCTION SHALL PROVIDE 3 FEET MINIMUM COVER TO TOP OF PIPE.
3. REFER TO WATER METER DETAILS ON SHEET UC-3E.

3/22/18
5/26/2021 3:45:06 PM
\\wseo2\Local\WSE\Projects\NC_CaryOldServer\Engineer\JOBS\0696\026\2100 U-4906\Utilities\Engineering\UC\Proj\u4906_ut_rdy9_UC05_psh.dgn