

### AS-BUILT REPAIR QUANTITY TABLE

| BENT 9                   | QUANTITIES   |                |              |                |
|--------------------------|--------------|----------------|--------------|----------------|
|                          | ESTIMATE     |                | ACTUAL       |                |
| SHOTCRETE REPAIRS        | AREA SQ. FT. | VOLUME CU. FT. | AREA SQ. FT. | VOLUME CU. FT. |
| CAP                      | 21.7         | 10.9           |              |                |
| COLUMNS & STRUTS         | 3.8          | 1.9            |              |                |
| CONCRETE REPAIRS         | AREA SQ. FT. | VOLUME CU. FT. | AREA SQ. FT. | VOLUME CU. FT. |
| CAP                      | 3.3          | 1.7            |              |                |
| EPOXY RESIN INJECTION    |              | LIN. FT.       |              | LIN. FT.       |
| CAP                      |              | 0.0            |              |                |
| COLUMNS & STRUTS         |              | 0.0            |              |                |
| EPOXY COATING            |              | SO. FT.        |              | SO. FT.        |
| TOP OF BENT CAP & STRUTS |              | 0              |              |                |

VALUES IN CHART REPRESENT ESTIMATED REPAIR TOTALS AFTER REMOVAL OF UNSOUND CONCRETE, MIN. OF 1" BEHIND REBAR AND 2" MIN. CLEAR TO SAWCUT. FOR REPAIR DETAILS, SEE "TYPICAL CAP AND COLUMN REPAIR DETAILS" SHEET.

### NOTES

REPAIR LOCATIONS AND ESTIMATE OF QUANTITIES ARE BASED ON THE BEST INFORMATION AVAILABLE. IF ADDITIONAL REPAIRS NOT SHOWN ON THE DRAWINGS ARE DEEMED NECESSARY BY THE ENGINEER, THE ENGINEER WILL NOTE ON THE DRAWINGS THE APPROXIMATE LOCATIONS AND DESCRIPTION OF THE REPAIRS AND ENTER THE ACTUAL QUANTITIES INTO THE AS-BUILT REPAIR QUANTITY TABLE.

CONCRETE REPAIRS MAY BE SUBSTITUTED IN LIEU OF SHOTCRETE REPAIRS WITH THE APPROVAL OF THE ENGINEER.

FOR SHOTCRETE REPAIR, SEE SPECIAL PROVISIONS.

FOR CONCRETE REPAIR, SEE SPECIAL PROVISIONS.


FOR EPOXY RESIN INJECTION, SEE SPECIAL PROVISIONS.

CLEAN AND REMOVE DEBRIS FROM THE TOP OF THE CAP AND STRUTS AND APPLY EPOXY PROTECTIVE COATING. EPOXY COATING SHALL BE APPLIED TO THE TOP SURFACE OF THE CAP AND STRUTS. THE CONTRACTOR SHALL NOT COAT THE AREA OF THE CAP BENEATH THE MASONRY PLATES. FOR EPOXY COATING, SEE SPECIAL PROVISIONS.

- SHOTCRETE REPAIR AREA
- CONCRETE REPAIR AREA
- EPOXY RESIN INJECTION (ERI)

PROJECT NO. I-5746C  
MECKLENBURG COUNTY  
 BRIDGE NO: 590332

SHEET 4 OF 6

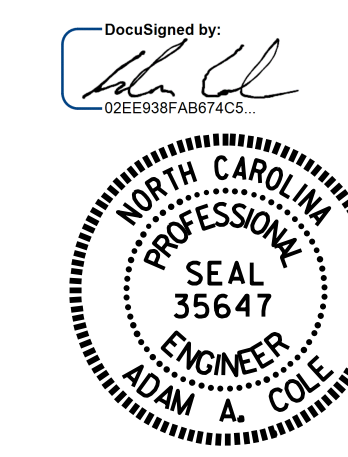

8/23/2021

STATE OF NORTH CAROLINA  
 DEPARTMENT OF TRANSPORTATION  
 RALEIGH

BENT 9  
 SPAN K FACE

### REVISIONS

| NO. | BY: | DATE: | NO. | BY: | DATE: | SHEET NO.        |
|-----|-----|-------|-----|-----|-------|------------------|
| 1   |     |       | 3   |     |       | S10-66           |
| 2   |     |       | 4   |     |       | TOTAL SHEETS 274 |

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

DRAWN BY : R.L.PUTEK DATE : 06/2021  
 CHECKED BY : H.A.LOCKLEAR DATE : 06/2021

ELEVATION  
 BENT 9