
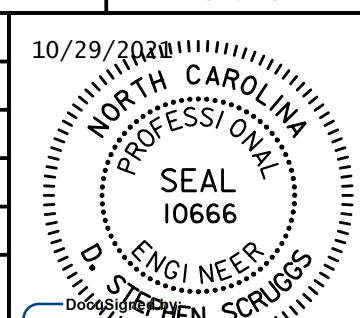
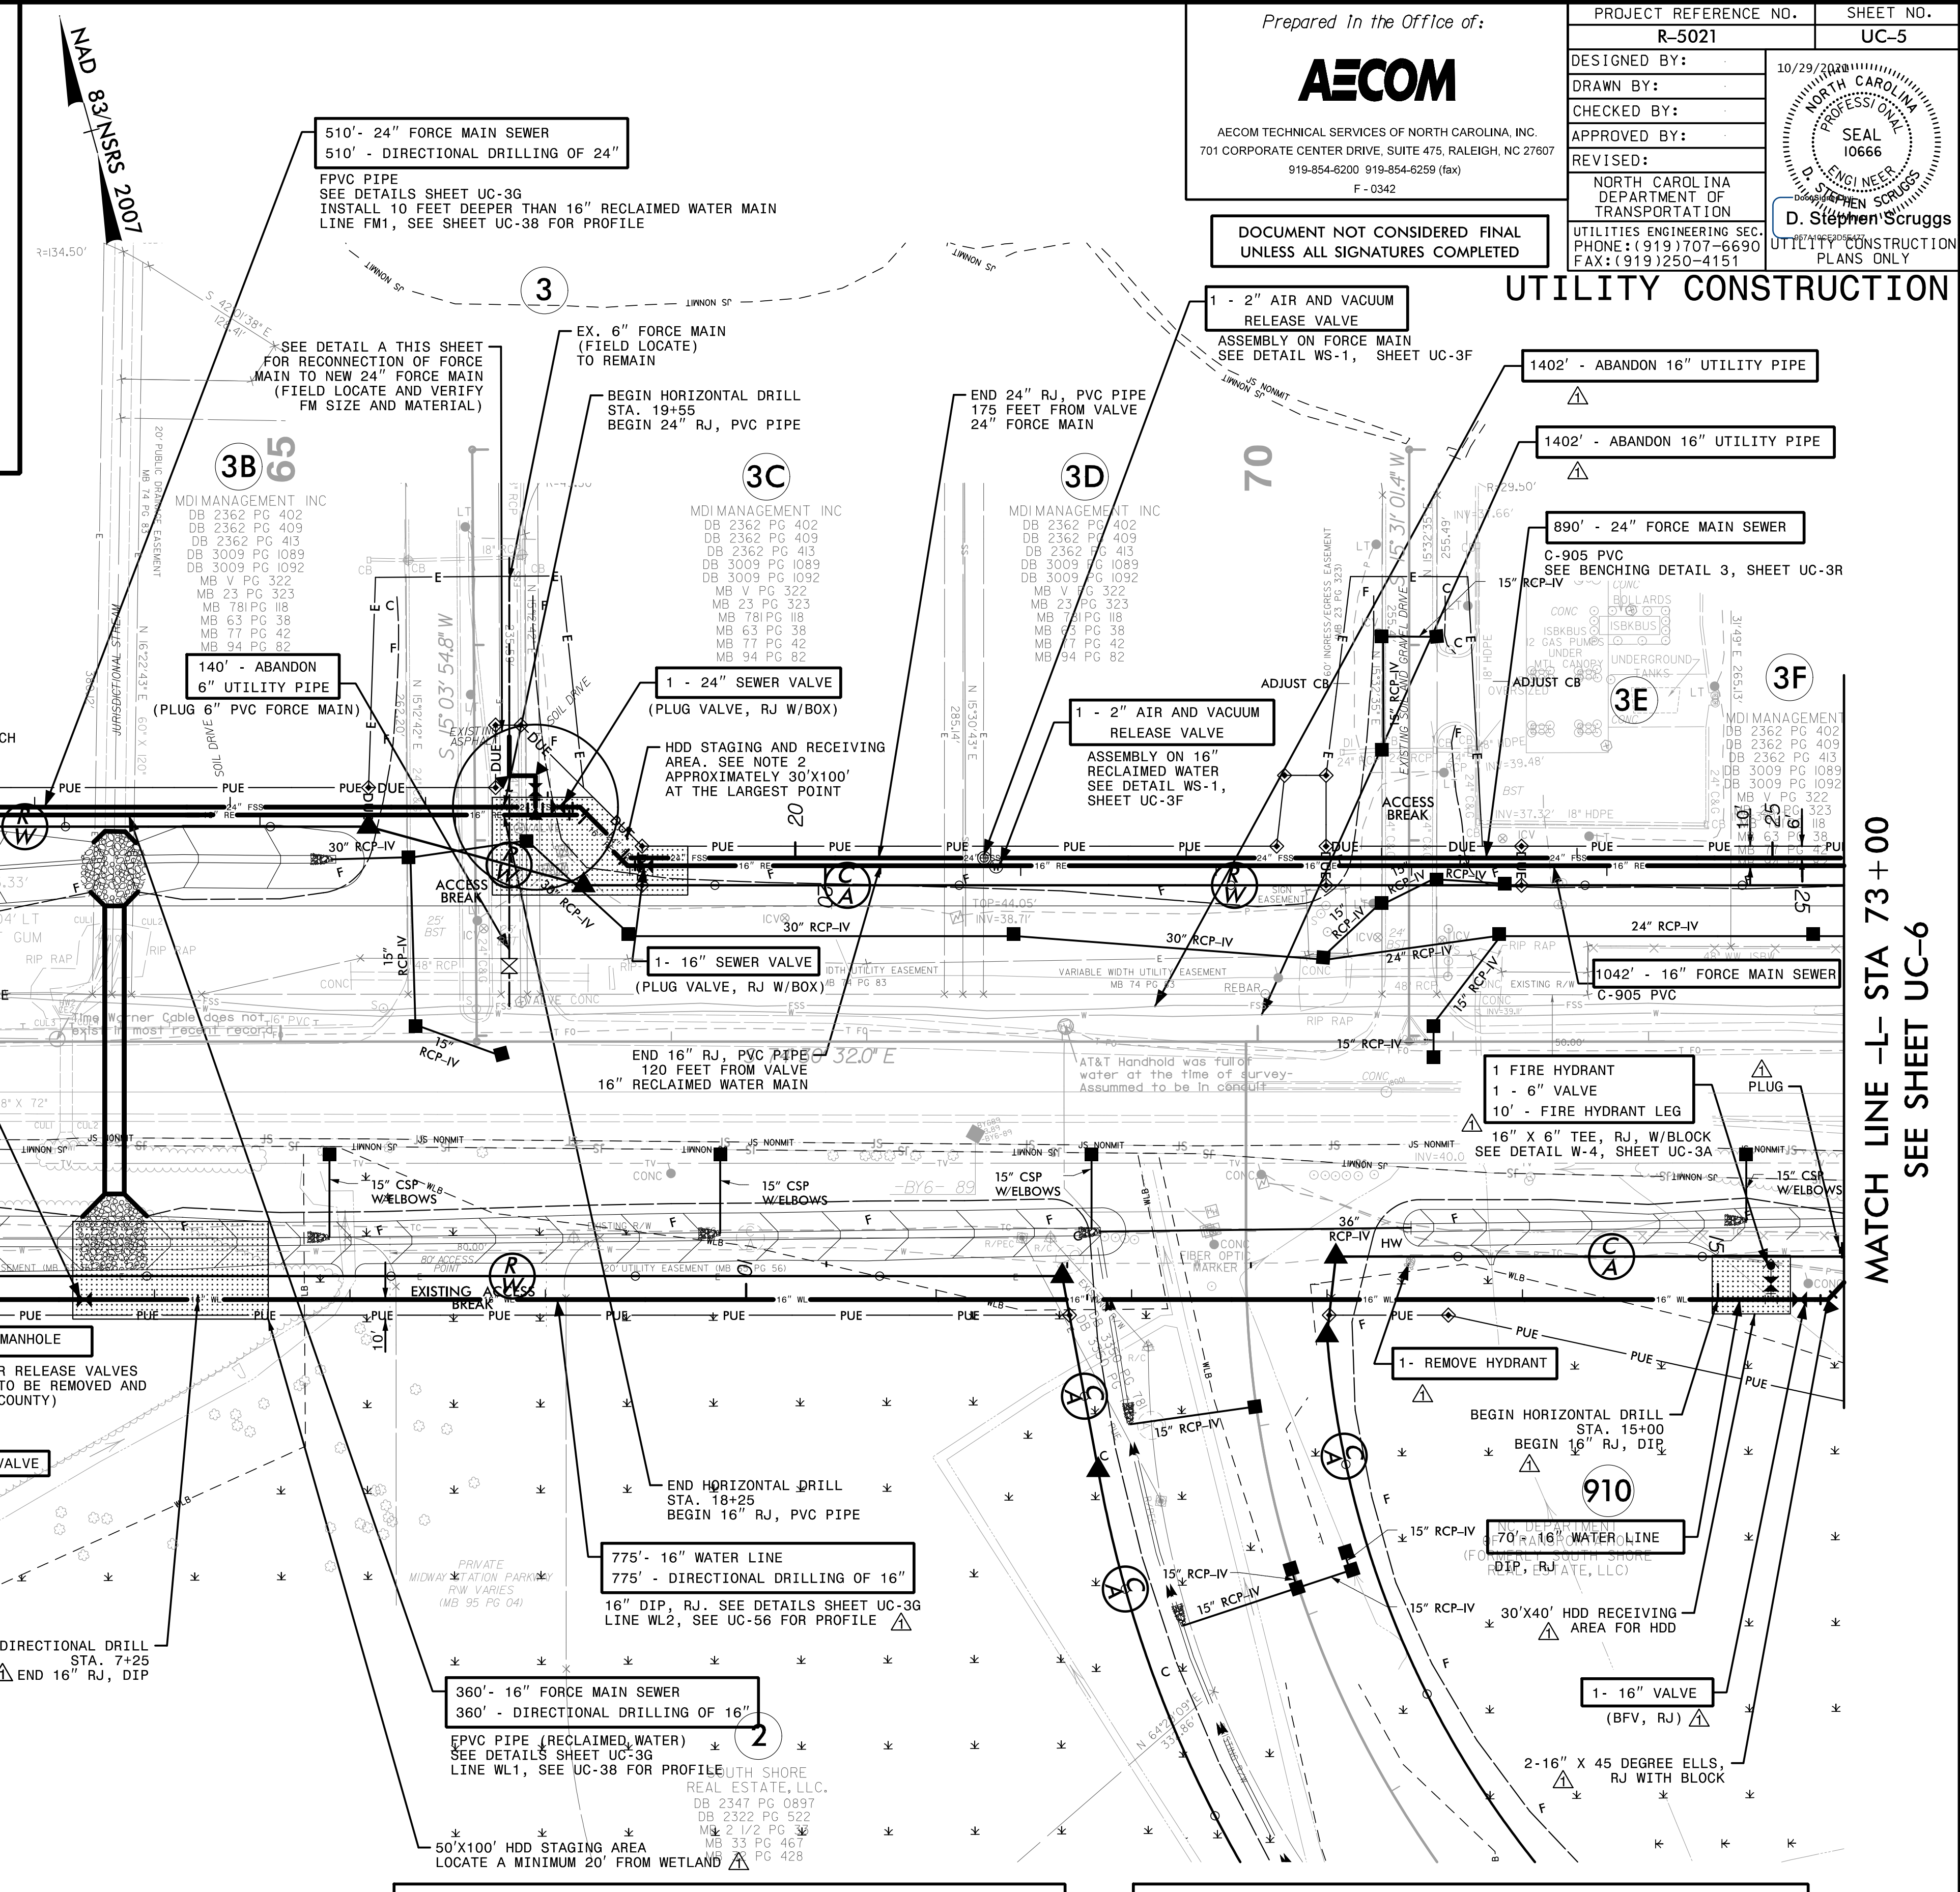


Prepared in the Office of:  
**AECOM**  
AECOM TECHNICAL SERVICES OF NORTH CAROLINA, INC.  
701 CORPORATE CENTER DRIVE, SUITE 475, RALEIGH, NC 27607  
919-854-6200 919-854-6259 (fax)  
F-0342

PROJECT REFERENCE NO.	R-5021	SHEET NO.	UC-5
DESIGNED BY:	10/29/2021		
DRAWN BY:			
CHECKED BY:			
APPROVED BY:			
REVISED:			
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151		UTILITY CONSTRUCTION PLANS ONLY	

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

### UTILITY CONSTRUCTION

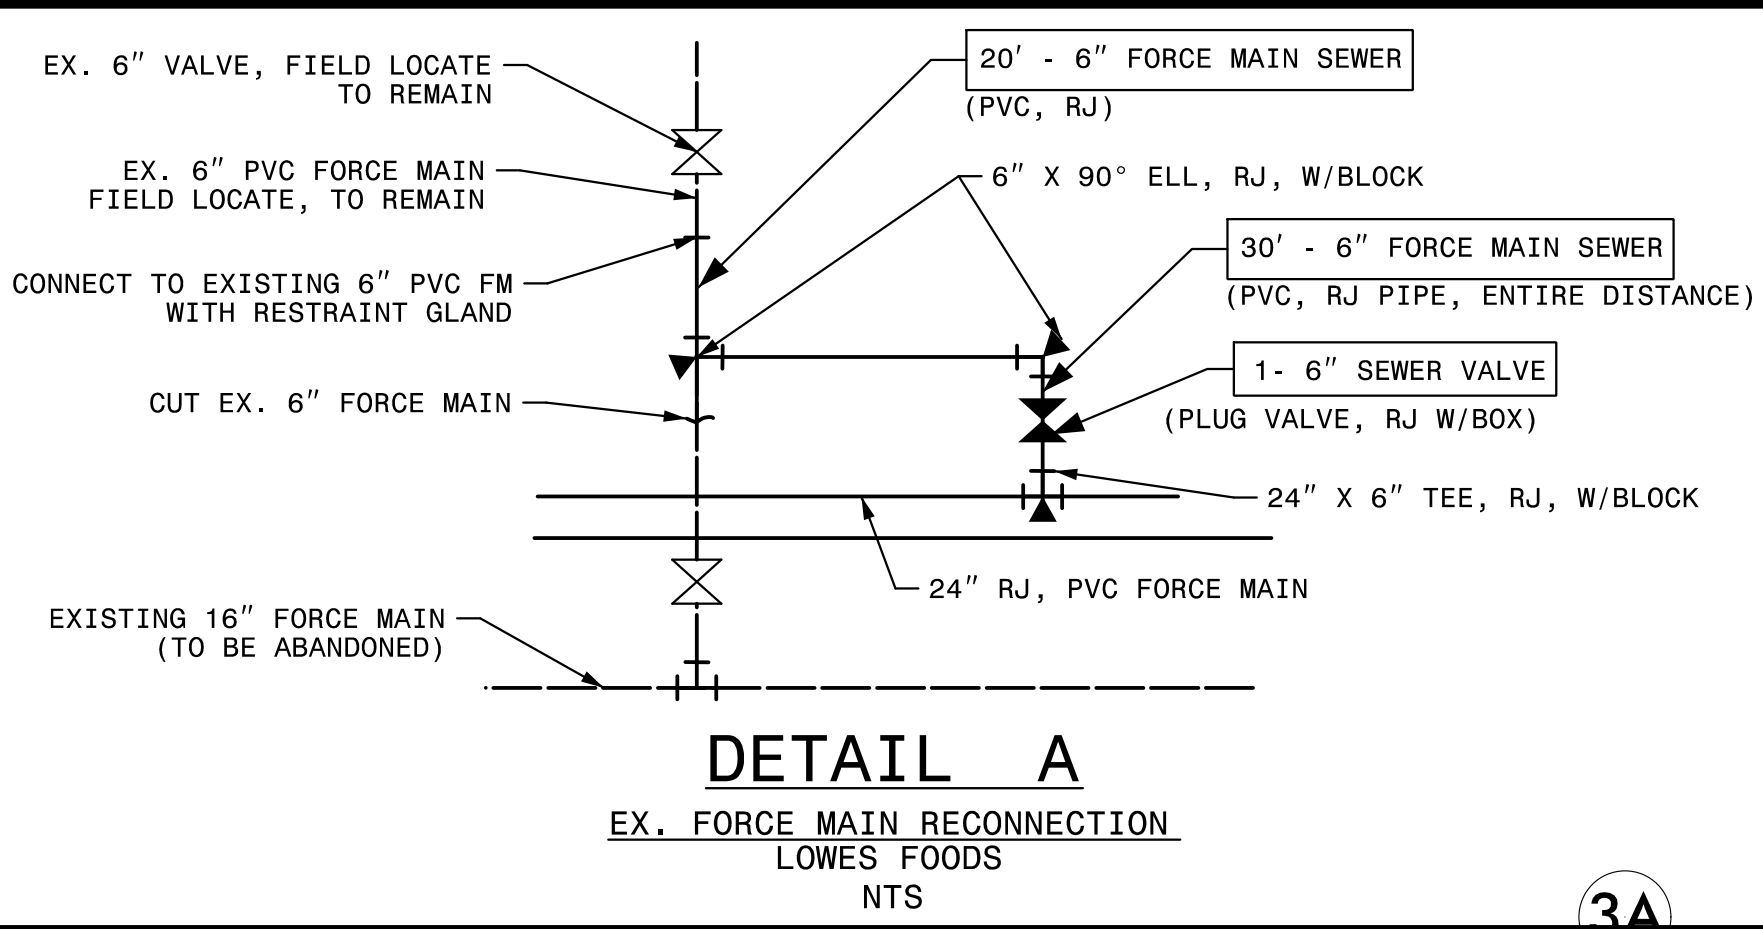

MATCH LINE -L- STA 59+00  
SEE SHEET UC-4

MATCH LINE -L- STA 73+00  
SEE SHEET UC-6

#### NOTES

- SEE SHEETS UC-38 AND UC-56 FOR PROFILES OF NEW MAINS.
- COORDINATE WITH MDI MANAGEMENT, INC FOR THE CLOSURE OF ONE OF THE LANES INTO THE SHOPPING CENTER. MAINTAIN ONE LANE OF TRAFFIC AT ALL TIMES. REPAIR THE ASPHALT ROAD ONCE COMPLETED.

The estimated quantity of Ductile Iron Water Pipe Fittings on this plan sheet is 1,313 pounds. The actual quantity and type of fittings will vary based on field conditions. ⚠

The estimated quantity of Ductile Iron Sewer Pipe Fittings on this plan sheet is 5,535 pounds. The actual quantity and type of fittings will vary based on field conditions.

⚠ 16" WATER MAIN RELOCATED AND EXTENDED PER ADDENDUM NO. 1.  
REMOVED NOTE BELOW PAY ITEM FOR ABANDON UTILITY PIPE PER ADDENDUM NO. 1

DATE: 10/19/2021  
TIME: 3:09:59 PM  
DGN: Z:\NorthCarolina\Projects\2021\Utility Construction\2021\_REV\VISIONS\R-5021\_UC\_FS165\_Rev.dgn