


Prepared In the Office of:



AECOM TECHNICAL SERVICES OF NORTH CAROLINA, INC.  
701 CORPORATE CENTER DRIVE, SUITE 475, RALEIGH, NC 27607  
919-854-6200 919-854-6259 (fax)  
F - 0342

DOCUMENT NOT CONSIDERED FINAL  
UNLESS ALL SIGNATURES COMPLETED

|   |            |
|---|------------|
| PROJECT REFERENCE NO.                       | SHEET NO.  |
| R-5021                                      | UC-13      |
| DESIGNED BY:                                | 10/29/2021 |
| DRAWN BY:                                   |            |
| CHECKED BY:                                 |            |
| APPROVED BY:                                |            |
| REVISED:                                    |            |
| NORTH CAROLINA DEPARTMENT OF TRANSPORTATION |            |
| UTILITIES ENGINEERING SECTION               |            |
| PHONE: (919) 707-6690                       |            |
| FAX: (919) 250-4151                         |            |


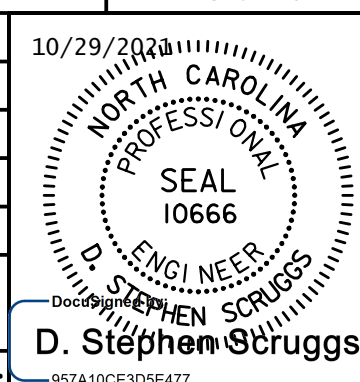


D. Stephen Scruggs  
SEAL 10666  
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION  
UTILITIES ENGINEERING SECTION  
PLANS ONLY

### UTILITY CONSTRUCTION

#### NOTES

- SEE SHEETS UC-42 AND UC-43 FOR PROFILES OF NEW 24" FORCE MAIN AND 16" RECLAIMED WATER MAIN.
- SEE SHEET UC-45 FOR PROFILE OF NEW 18" WATER MAIN.

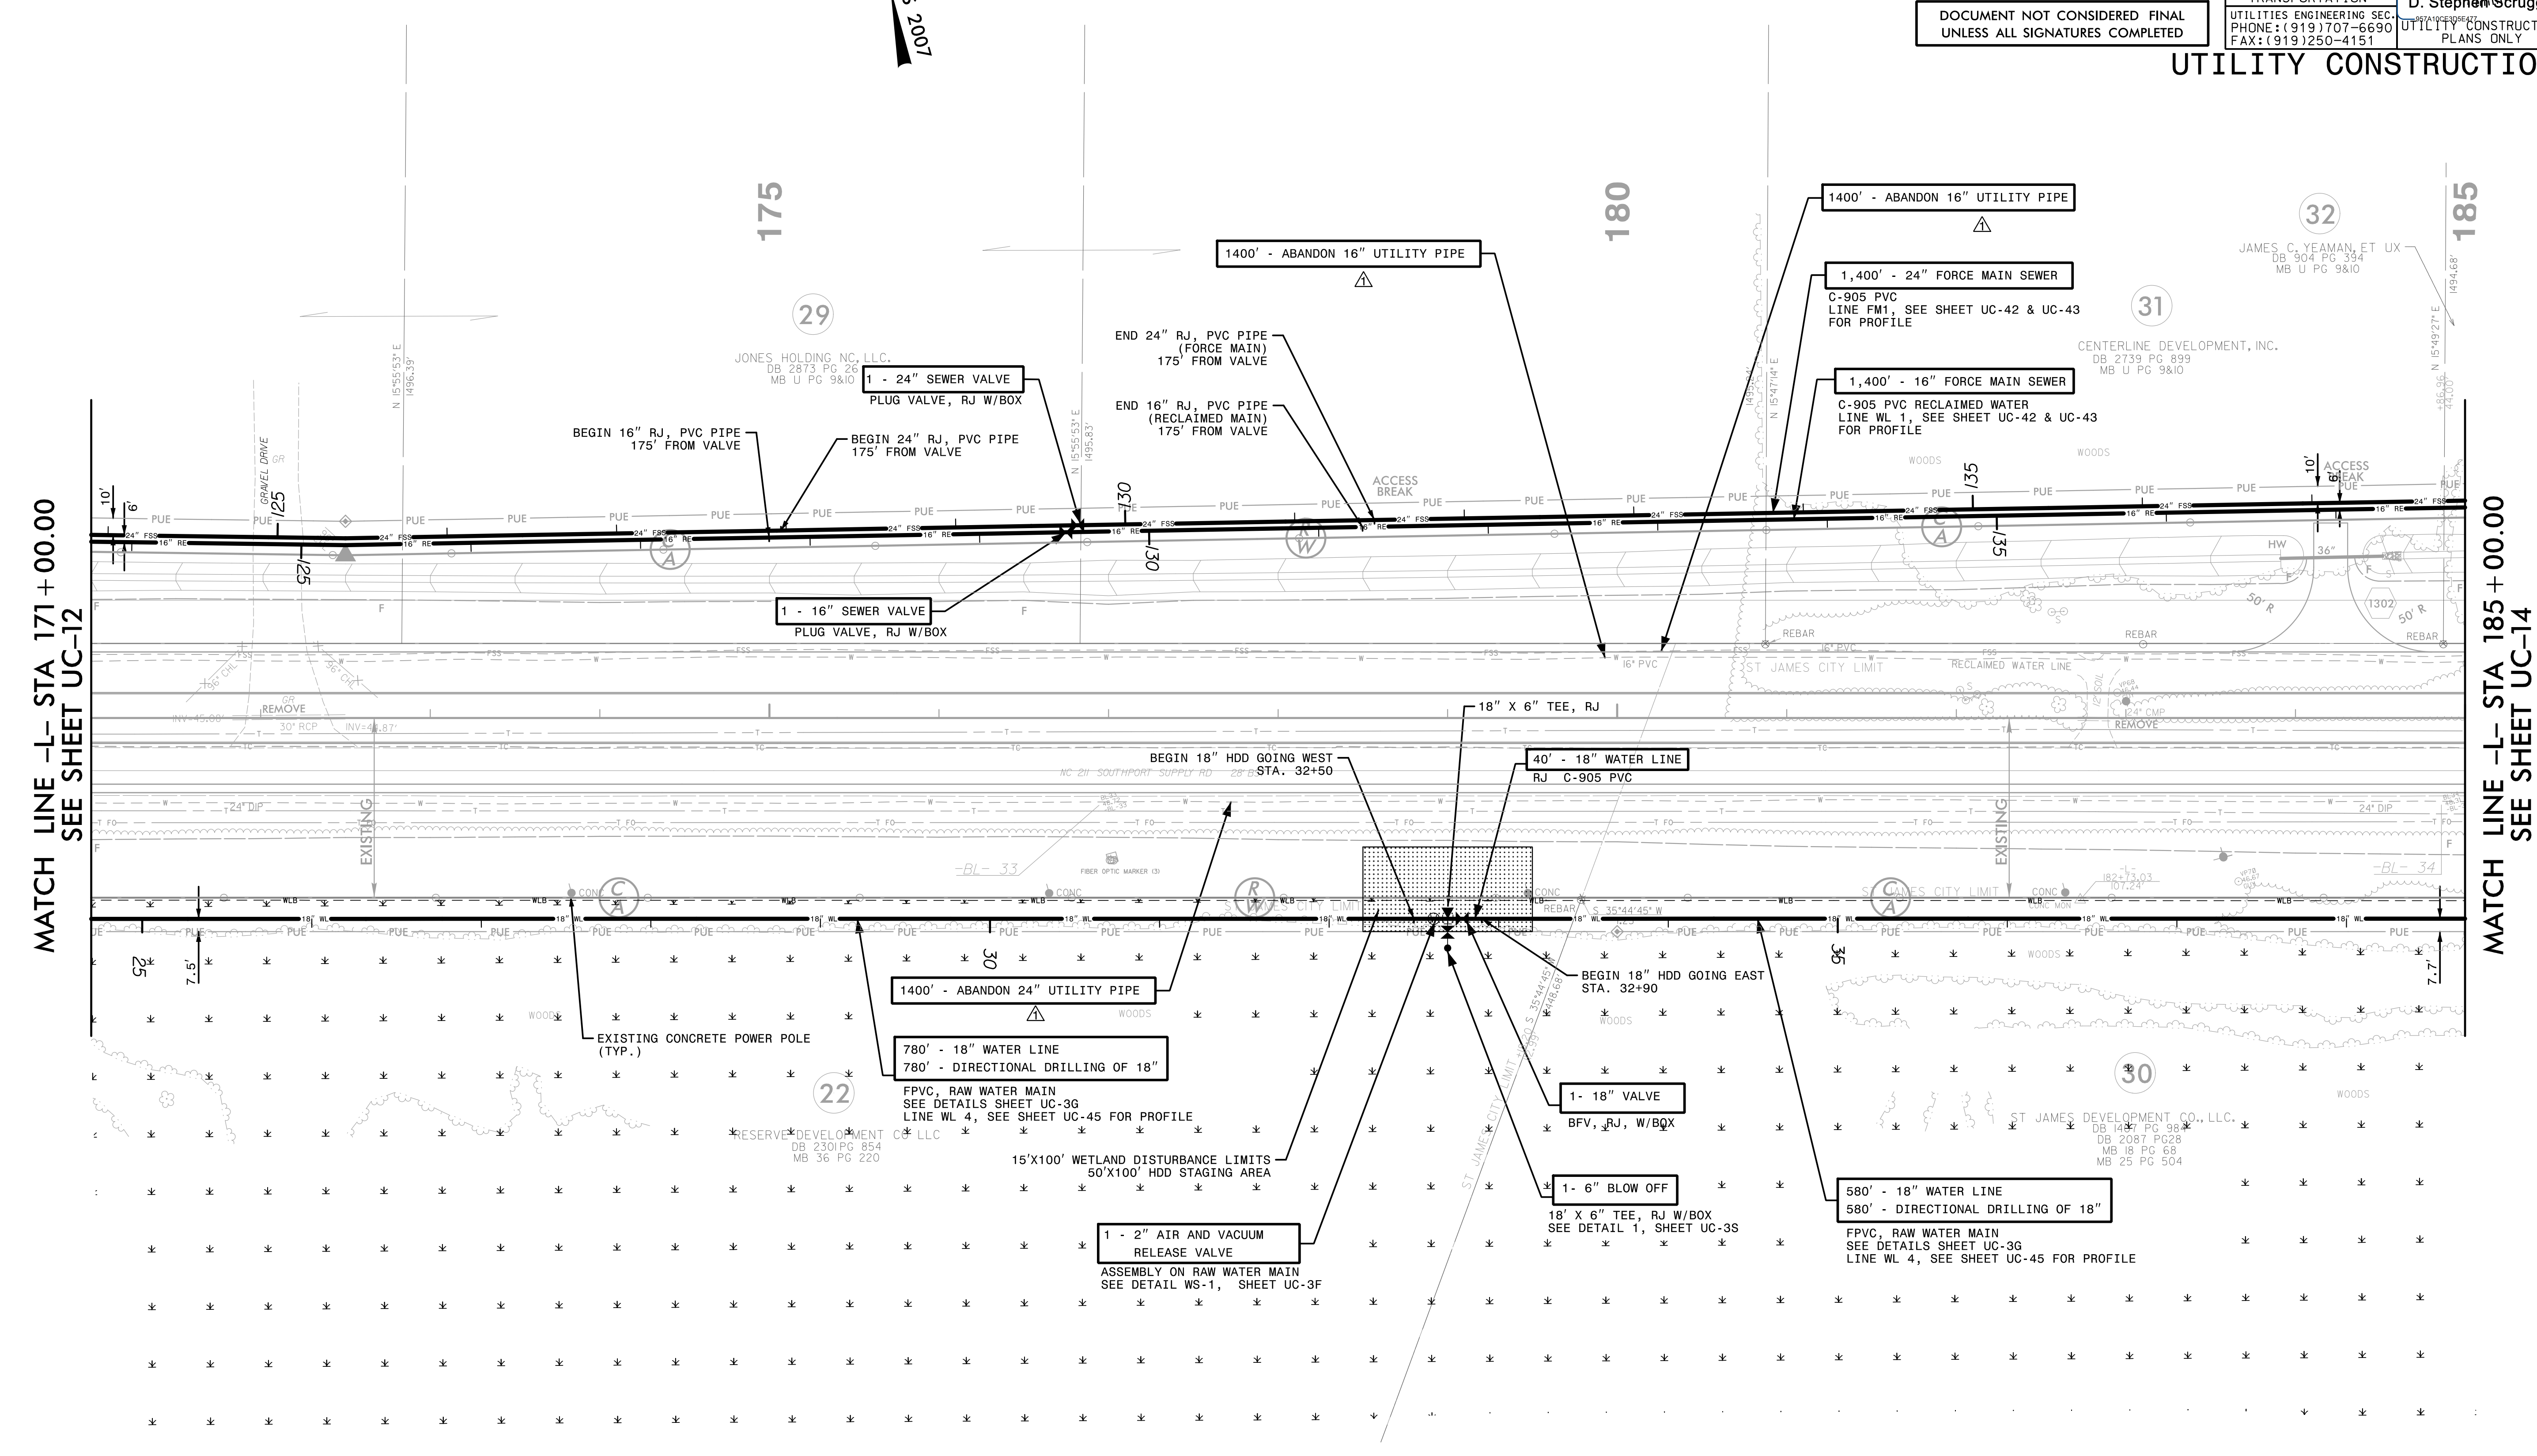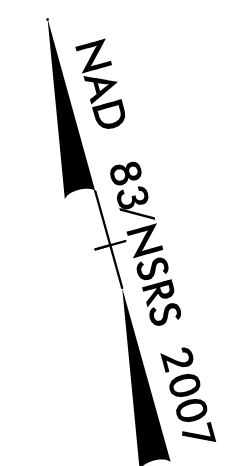

DATE: 10/18/2021  
TIME: 2:06:51 PM  
DGN: Z:\Projects\UTILITY\Projects\60428203\900\_MerA\915\_UTILITY Construction\2021\_REV\VISIONS\R-5021\_UC-13.dgn

REMOVED NOTE BELOW PAY ITEM FOR ABANDON UTILITY PIPE PER ADDENDUM NO. 1

The estimated quantity of Ductile Iron Water Pipe Fittings on this plan sheet is 1,430 pounds. The actual quantity and type of fittings will vary based on field conditions.